

ASME NUM-1–2016
(Revision of ASME NUM-1–2009)

Rules for Construction of Cranes, Monorails, and Hoists (With Bridge or Trolley or Hoist of the Underhung Type)

ASMENORMDOC.COM : Click to view the full PDF of ASME NUM-1-2016

AN AMERICAN NATIONAL STANDARD



**The American Society of
Mechanical Engineers**

ASME NUM-1–2016
(Revision of ASME NUM-1–2009)

Rules for Construction of Cranes, Monorails, and Hoists (With Bridge or Trolley or Hoist of the Underhung Type)

ASMENORMDOC.COM : Click to view the full PDF of ASME NUM-1-2016

AN AMERICAN NATIONAL STANDARD



**The American Society of
Mechanical Engineers**

Two Park Avenue • New York, NY • 10016 USA

Date of Issuance: June 30, 2016

This Standard will be revised when the Society approves the issuance of a new edition.

ASME issues written replies to inquiries concerning interpretations of technical aspects of this Standard. Periodically certain actions of the ASME CNF Committee may be published as Cases. Cases and interpretations are published on the ASME Web site under the Committee Pages at <http://cstools.asme.org/> as they are issued.

Errata to codes and standards may be posted on the ASME Web site under the Committee Pages to provide corrections to incorrectly published items, or to correct typographical or grammatical errors in codes and standards. Such errata shall be used on the date posted.

The Committee Pages can be found at <http://cstools.asme.org/>. There is an option available to automatically receive an e-mail notification when errata are posted to a particular code or standard. This option can be found on the appropriate Committee Page after selecting "Errata" in the "Publication Information" section.

ASME is the registered trademark of The American Society of Mechanical Engineers.

This code or standard was developed under procedures accredited as meeting the criteria for American National Standards. The Standards Committee that approved the code or standard was balanced to assure that individuals from competent and concerned interests have had an opportunity to participate. The proposed code or standard was made available for public review and comment that provides an opportunity for additional public input from industry, academia, regulatory agencies, and the public-at-large.

ASME does not "approve," "rate," or "endorse" any item, construction, proprietary device, or activity.

ASME does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a standard against liability for infringement of any applicable letters patent, nor assumes any such liability. Users of a code or standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Participation by federal agency representative(s) or person(s) affiliated with industry is not to be interpreted as government or industry endorsement of this code or standard.

ASME accepts responsibility for only those interpretations of this document issued in accordance with the established ASME procedures and policies, which precludes the issuance of interpretations by individuals.

No part of this document may be reproduced in any form,
in an electronic retrieval system or otherwise,
without the prior written permission of the publisher.

The American Society of Mechanical Engineers
Two Park Avenue, New York, NY 10016-5990

Copyright © 2016 by
THE AMERICAN SOCIETY OF MECHANICAL ENGINEERS
All rights reserved
Printed in U.S.A.

CONTENTS

Foreword	viii
Committee Roster	ix
Preparation of Technical Inquiries to the Committee on Cranes for Nuclear Facilities	x
Summary of Changes	xi
Section NUM-G-1000 Introduction	1
NUM-G-1100 General	1
NUM-G-1200 Scope	1
NUM-G-1300 Applications	1
NUM-G-1400 Responsibility	1
Section NUM-G-2000 Environmental Conditions of Service	2
NUM-G-2100 General	2
NUM-G-2200 Radiation	2
NUM-G-2300 Temperature	2
NUM-G-2400 Pressure	2
NUM-G-2500 Humidity	2
NUM-G-2600 Chemical	3
NUM-G-2700 Wind	3
NUM-G-2800 Seismic	3
NUM-G-2900 Drainage	3
Section NUM-G-3000 Performance Requirements	4
NUM-G-3100 General	4
NUM-G-3200 Service Class	4
NUM-G-3300 Capacity	4
NUM-G-3400 Speeds	4
NUM-G-3500 Other Considerations	4
Section NUM-G-4000 Coatings and Finishes	8
NUM-G-4100 Coating Service Levels	8
NUM-G-4200 Specific Requirements for Coating Service Levels	8
Section NUM-G-5000 Quality Assurance	10
NUM-G-5100 Requirements	10
NUM-G-5200 Documentation	10
Section NUM-G-6000 Definitions	11
NUM-G-6100 Definitions	11
Section NUM-G-7000 Referenced Codes and Standards	15
NUM-G-7100 General	15
Section NUM-G-8000 Nomenclature	17
NUM-G-8100 General	17
Section NUM-I-1000 Introduction	18
NUM-I-1100 General	18
NUM-I-1300 Applications	18
Section NUM-I-5000 Jib Cranes	19
NUM-I-5300 Mechanical	19
NUM-I-5400 Electrical	19

Section NUM-I-6000	Monorail Systems	20
NUM-I-6300	Mechanical	20
Section NUM-I-7000	Overhead Hoists and Under-Running Trolleys	21
NUM-I-7700	Under-Running Trolleys	21
NUM-I-7900	Hoist Common Requirements	21
Section NUM-I-8000	Common Requirements and Criteria	28
NUM-I-8200	Structural	28
NUM-I-8300	Mechanical	28
NUM-I-8400	Electrical	30
NUM-I-8500	Inspection and Testing	30
NUM-I-8600	Hoist Marking	37
Section NUM-II-1000	Introduction	38
NUM-II-1100	General	38
NUM-II-1300	Applications	38
Section NUM-II-7000	Overhead Hoists and Under-Running Trolleys	39
NUM-II-7100	Description	39
Section NUM-II-8000	Common Requirements and Criteria	40
NUM-II-8200	Structural	40
NUM-II-8300	Mechanical	45
NUM-II-8400	Electrical	45
NUM-II-8500	Inspection and Testing	45
Section NUM-III-1000	Introduction	46
NUM-III-1100	General	46
NUM-III-1300	Applications	46
Section NUM-III-2000	Underhung Cranes	47
NUM-III-2100	Description	47
NUM-III-2200	Structural	47
NUM-III-2300	Mechanical	49
NUM-III-2400	Electrical	50
NUM-III-2500	Inspection and Testing	52
Section NUM-III-3000	Top-Running Bridge and Gantry Cranes	53
NUM-III-3100	Description	53
NUM-III-3200	Structural	53
NUM-III-3300	Mechanical	55
NUM-III-3400	Electrical	57
NUM-III-3500	Inspection and Testing	57
Section NUM-III-4000	Traveling Wall Cranes	58
NUM-III-4100	Description	58
NUM-III-4200	Structural	58
NUM-III-4300	Mechanical	58
NUM-III-4400	Electrical	60
NUM-III-4500	Inspection and Testing	60
Section NUM-III-5000	Jib Cranes	62
NUM-III-5100	Description	62
NUM-III-5200	Structural	62
NUM-III-5300	Mechanical	62
NUM-III-5400	Electrical	63
NUM-III-5500	Inspection and Testing	67
Section NUM-III-6000	Monorail Systems	68
NUM-III-6100	Description	68
NUM-III-6200	Structural	68

NUM-III-6300	Mechanical	69
NUM-III-6400	Electrical	71
NUM-III-6500	Inspection and Testing	72
Section NUM-III-7000	Overhead Hoists and Under-Running Trolleys	73
NUM-III-7100	Description	73
NUM-III-7200	Electric Wire-Rope Hoists	73
NUM-III-7300	Hand-Chain Hoists	74
NUM-III-7400	Electric-Chain Hoists	78
NUM-III-7500	Air-Operated Wire-Rope Hoists	79
NUM-III-7600	Air-Operated Chain Hoists	79
NUM-III-7700	Under-Running Trolleys	79
NUM-III-7800	Inspection and Testing	82
NUM-III-7900	Hoist Common Requirements	82
Section NUM-III-8000	Common Requirements and Criteria	90
NUM-III-8100	Description	90
NUM-III-8200	Structural	90
NUM-III-8300	Mechanical	106
NUM-III-8400	Electrical	114
NUM-III-8500	Inspection and Testing	127
NUM-III-8600	Crane and Monorail Marking	130
Figures		
NUM-I-7931-1	Type IA Dual Hoist Drive Unit With Single Drum	21
NUM-I-7931-2	Type IA Single Hoist Drive Unit With Drum Brake	22
NUM-I-7931-3	Type IA Dual Hoist Drive Unit With Dual Drum	23
NUM-I-7942-1	Drum Fleet Angle	23
NUM-I-7942-2	Sheave Fleet Angle	23
NUM-I-7942.3-1	Type IA Redundant Reeving With Single Drum (With Upper Equalizer Sheaves)	24
NUM-I-7942.3-2	Type IA Redundant Reeving With Single Drum (With Equalizer Bar)	25
NUM-I-7942.3-3	Type IA Redundant Reeving With Dual Drum	25
NUM-II-8215.3.6-1	Boundary Conditions for Wheel-to-Rail Interface	42
NUM-III-2100-1	Single-Girder Underhung Crane	47
NUM-III-2100-2	Double-Girder Underhung Crane With Underhung Trolley	48
NUM-III-2100-3	Double-Girder Underhung Crane With Top-Running Trolley	48
NUM-III-2100-4	Single-Girder Underhung Semi-Gantry Crane	49
NUM-III-2321-1	Arrangement of Crane Bridge Drives (A-2 Drive)	50
NUM-III-2321-2	Arrangement of Crane Bridge Drives (A-4 Drive)	51
NUM-III-3100-1	Single-Girder Top-Running Crane	53
NUM-III-3100-2	Double-Girder Top-Running Crane With Underhung Trolley	54
NUM-III-3100-3	Single-Girder Top-Running Semi-Gantry Crane	54
NUM-III-3100-4	Single-Girder Top-Running Gantry Crane	55
NUM-III-3320-1	Arrangement of Crane Bridge Drives (A-1 Drive)	56
NUM-III-3320-2	Arrangement of Crane Bridge Drives (A-2 Drive)	56
NUM-III-3320-3	Arrangement of Crane Bridge Drives (A-4 Drive)	56
NUM-III-4100-1	Traveling Wall Crane	59
NUM-III-5100-1	Wall-Mounted Jib Cranes	63
NUM-III-5100-2	Freestanding Pillar Jib Cranes	64
NUM-III-5100-3	Mast-Type Jib Cranes	65
NUM-III-5422-1	Slew Drive Motor-Size Selection	66
NUM-III-6100-1	Monorail System	68
NUM-III-6100-2	Two-Way Switches	69
NUM-III-6100-3	Three-Way Switches	69
NUM-III-6100-4	Cross-Track Switches	69
NUM-III-6100-5	Interlocking Mechanisms	70

NUM-III-6100-6	Lift/Drop Sections	70
NUM-III-7100-1	Electric Wire-Rope Hoist	73
NUM-III-7100-2	Hand-Chain Hoist	74
NUM-III-7100-3	Electric-Chain Hoist	74
NUM-III-7100-4	Air-Operated Wire-Rope Hoist	75
NUM-III-7100-5	Air-Operated Chain Hoist	75
NUM-III-7100-6	Under-Running Trolley	75
NUM-III-7210-1	Electric Wire-Rope Hoist, Suspension Types	76
NUM-III-7310-1	Hand-Chain Hoist, Suspension Types	77
NUM-III-7410-1	Electric-Chain Hoist, Suspension Types	78
NUM-III-7510-1	Air-Operated Wire-Rope Hoist, Suspension Types	80
NUM-III-7610-1	Air-Operated Chain Hoist, Suspension Types	81
NUM-III-7942.3-1	Single and Double Reeving	84
NUM-III-8212.2-1	Wheel-Skewing Forces (From CMAA 74)	91
NUM-III-8214-1	Building Runway Alignment Tolerance for Patent Track	93
NUM-III-8214-2	Building Runway Alignment Tolerance (From CMAA 74)	94
NUM-III-8232.3-1	Local Bending of Flanges due to Wheel Loads (From CMAA 74)	97
NUM-III-8234.1-1	Joint Configuration (From CMAA 74)	105
NUM-III-8344.1-1	Bridge Span (From CMAA 74)	112
NUM-III-8425.1-1	Arrangement of Pendant Push-Button Controllers	122
NUM-III-8425.2-1	Arrangement of Cab Master-Switch Controllers	123
NUM-III-8425.3-1	Arrangement of Radio-Transmitter Lever Switch Controllers	124
NUM-III-8427.2-1	Various Styles of Conductor System Types	125

Tables

NUM-G-3210-1	Service Classes for Cranes and Monorails	5
NUM-G-3220-1	Service Classes for Electrically Operated Hoists	6
NUM-G-3230-1	Service Classes for Air Wire-Rope and Air Chain Hoists	7
NUM-I-1100-1	Major Design Differences Between Types IA and IB	18
NUM-I-8210-1	Acceptable Materials and Reference Properties for Structural Components	29
NUM-I-8210-2	Required Inspections or Tests (Type IA)	31
NUM-I-8210-3	Required Inspections or Tests (Type IB)	33
NUM-II-8215.3.6-1	Boundary Conditions for Wheel-to-Rail Interface	43
NUM-III-7942.1-1	Minimum Pitch Diameter of Running Sheaves	84
NUM-III-7942.2-1	Minimum Pitch Diameter of Drums	84
NUM-III-7944.1-1	Bearing Life Expectancy	85
NUM-III-7945-1	Hoist Service Factor, C_d	85
NUM-III-7945-2	Hoist Service Factor, S_f	86
NUM-III-7952-1	Standard Rated Motor Voltages	88
NUM-III-8213-1	Load Designations	92
NUM-III-8231.1-1	Allowable Stresses (Members Not Controlled by Buckling)	95
NUM-III-8231.2-1	Modifying Coefficient, N	95
NUM-III-8231.5-1	Bolt Allowable Stresses	95
NUM-III-8232.4-1	Bolt Shear and Tension Factor, R	99
NUM-III-8234.1-1	Allowable Stress Ranges	100
NUM-III-8234.1-2	Fatigue Stress Provisions — Tension (T) or Reversal (Rev) Stresses	101
NUM-III-8341.2-1	Crane Service Factor, S_f	107
NUM-III-8341.2-2	Machinery Service Factor, C_d	108
NUM-III-8342-1	AFBMA L10 Bearing Life	108
NUM-III-8343.5-1	Crane Class Factor, K_c	110
NUM-III-8343.5-2	Surface Condition Factor, K_{sc}	110
NUM-III-8344.1-1	Bridge Wheel Loadings, $lb; P; KDW$	111
NUM-III-8344.1-2	Bridge Load Factor, K_{bw}	112
NUM-III-8344.1-3	Speed Factor, C_s	113

NUM-III-8344.1-4	Wheel Service Factor, S_m , and Minimum Load Service Factor, K_{wl}	113
NUM-III-8344.2-1	Maximum Wheel Loads/I Beams and Wide Flange Beams	114
NUM-III-8421.4-1	AC Contactor Ratings for AC Wound Rotor Motors	116
NUM-III-8421.4-2	AC Contactor Ratings for AC Squirrel-Cage Motors (Maximum Intermittent Horsepower Rating)	116
NUM-III-8421.4-3	DC Contactor Ratings for DC Motors (230 V to 250 V DC)	116
NUM-III-8421.4-4	AC Contactor Ratings for Mainline Service	117
NUM-III-8421.4-5	DC Contactor Ratings for Mainline Service (230 V to 250 V DC)	117
NUM-III-8421.5-1	NEMA Resistor Classification	117
NUM-III-8422.2-1	Standard Rated Motor Voltages	118
NUM-III-8422.4-1	Standard Maximum Acceleration Rate to Prevent Wheel Skidding	120
NUM-III-8422.4-2	Standard Bridge Motion Acceleration Rates	120
NUM-III-8422.4-3	Mechanical Efficiency, E , of Drive Machinery	120
NUM-III-8422.4-4	Standard Values for Friction Factor, f (for Bridges With Metallic Wheels and Antifriction Bearings)	120
NUM-III-8422.4-5	Standard Values of Accelerating Torque Factor, K_t	121
Mandatory Appendix		
IV	SI Conversion Factors	131
Nonmandatory Appendices		
A	Service Guidance	133
B	Examples	141

FOREWORD

The Committee on Cranes for Nuclear Power Plants was first established in 1976. In 1980, the scope of the Committee was revised, and its name was changed to the Committee on Cranes for Nuclear Facilities. In 1983, the Nuclear Underhung and Monorail (NUM) Subcommittee was established to develop a standard to cover the design, fabrication, installation, and testing of underhung and monorail equipment used in nuclear facilities. The NUM-1 Standard is the result of the Subcommittee's work.

The first edition of ASME NUM-1 was approved by the American National Standards Institute (ANSI) on October 28, 1996. The second edition of ASME NUM-1 was approved by ANSI on May 3, 2000. The third edition of ASME NUM-1 was approved by ANSI on August 17, 2004. The fourth edition of ASME NUM-1 was approved by ANSI on December 22, 2009.

This Standard, or portions thereof, can be applied to cranes, monorails, and hoists at facilities other than nuclear where enhanced equipment safety may be required, and can be provided by means of single failure-proof features, enhanced safety features, or a seismic design.

This Standard is split into four major sections: NUM-G, General Specifications (applicable to all equipment); NUM-I, Type I equipment (i.e., equipment that is used to handle critical loads and is required to withstand a seismic event); NUM-II, Type II equipment (i.e., equipment that is not used to handle critical loads and is required to withstand a seismic event); and NUM-III, Type III equipment (i.e., equipment that is not used to handle critical loads and is not required to withstand a seismic event).

Suggestions for the improvement of this Standard are welcome. They should be addressed to the Secretary, ASME Committee on Cranes for Nuclear Facilities, The American Society of Mechanical Engineers, Two Park Avenue, New York, NY 10016-5990.

The 2016 edition of ASME NUM-1 was approved by ANSI on June 16, 2016.

ASME COMMITTEE ON CRANES FOR NUCLEAR FACILITIES

(The following is the roster of the Committee at the time of approval of this Standard.)

STANDARDS COMMITTEE OFFICERS

A. S. Kureck, *Chair*
S. N. Parkhurst, *Vice Chair*
G. M. Ray, *Vice Chair*
L. T. Powers, *Secretary*

STANDARDS COMMITTEE PERSONNEL

B. K. Barber , Norfolk Naval Shipyard	S. M. Lawrence , Konecrane Nuclear Equipment & Services, LLC
S. T. Nguyen , <i>Alternate</i> , Norfolk Naval Shipyard	J. D. Edmundson , <i>Alternate</i> , Konecrane Nuclear Equipment & Services, LLC
S. W. Butler , USAF	R. C. Lindberg , Sargent & Lundy
T. Finnegan , Lockheed Martin Space Systems Co.	B. P. Lytle , NASA Kennedy Space Center
A. D. Reisner , <i>Alternate</i> , Lockheed Martin Space Systems Co.	S. N. Parkhurst , Material Handling Equipment, Inc.
M. B. Fitzsimmons , Constellation Energy Group	D. L. Borska , <i>Alternate</i> , Material Handling Equipment, Inc.
J. N. Fowler , DP Engineering Ltd. Co.	R. J. Parler , AREVA
L. C. Fraser , Newport News Shipbuilding	G. M. Ray , Tennessee Valley Authority
L. S. Gibbs , Southern Nuclear	B. B. Bacon , <i>Alternate</i> , Tennessee Valley Authority
W. A. Horwath , Whiting Corp.	L. T. Powers , The American Society of Mechanical Engineers
D. Weber , <i>Alternate</i> , Whiting Corp.	J. Schulz , PaR Nuclear/Westinghouse
S. Huffard , URS Corp.	A. W. Rawson , <i>Alternate</i> , Westinghouse Electric Co.
S. R. Jones , U.S. Nuclear Regulatory Commission	N. E. Skogland , Eureka Engineering, LLC
J. F. Knight , Bechtel Marine Propulsion Corp.	G. A. Townes , BE, Inc.
J. Konop , PaR Systems, Inc.	T. V. Vine , GDF Suez Energy Generation NA
J. Kriner , Beckman & Associates	J. L. Weamer , Bechtel National, Inc.
A. S. Kureck , Magnetek Material Handling	T. A. Wetzel , American Crane & Equipment Corp.
C. Larouche , COH, Inc.	

SUBCOMMITTEE ON OPERATION AND MAINTENANCE FOR CRANES

G. M. Ray , <i>Chair</i> , Tennessee Valley Authority	D. E. Klasel , Engineered Solutions
B. B. Bacon , Tennessee Valley Authority	J. F. Knight , Bechtel Marine Propulsion Corp.
B. K. Barber , Norfolk Naval Shipyard	S. McArdle , NSO
M. B. Fitzsimmons , Constellation Energy Group	A. D. Reisner , Lockheed Martin Space Systems Co.
L. C. Fraser , Newport News Shipbuilding	T. V. Vine , GDF Suez Energy Generation NA
L. S. Gibbs , Southern Nuclear	J. L. Weamer , Bechtel National, Inc.
J. G. Griesemer , American Crane & Equipment Corp.	D. Weber , Whiting Corp.

CNF ENGINEERING SUPPORT SUBCOMMITTEE

S. Raymond , COH, Inc.	D. T. Tang , U.S. Nuclear Regulatory Commission
-------------------------------	--

PREPARATION OF TECHNICAL INQUIRIES TO THE COMMITTEE ON CRANES FOR NUCLEAR FACILITIES

INTRODUCTION

The ASME Committee on Cranes for Nuclear Facilities (CNF) will consider written requests for interpretations and revisions to CNF standards and develop new requirements if dictated by technological development. The Committee's activities in this regard are limited strictly to interpretations of the requirements or to consideration of revisions to the present Standard on the basis of new data or technology. As a matter of published policy, ASME does not "approve," "certify," "rate," or "endorse" any item, construction, proprietary device, or activity and, accordingly, inquiries requiring such consideration will be returned. Moreover, ASME does not act as a consultant on specific engineering problems or on the general application or understanding of the

Standard requirements. If, based on the inquiry information submitted, it is the opinion of the Committee that the inquirer should seek assistance, the inquiry will be returned with the recommendation that such assistance be obtained.

All inquiries that do not provide the information needed for the Committee's full understanding will be returned.

INQUIRY FORMAT

Inquiries shall be limited strictly to interpretations of the requirements or to the consideration of revisions to the present Standard on the basis of new data or technology.

Requests for interpretation shall be submitted through the Interpretation Submittal Form found at <http://go.asme.org/InterpretationRequest>.

ASME NUM-1-2016

SUMMARY OF CHANGES

Following approval by the ASME Committee on Cranes for Nuclear Facilities and ASME, and after public review, ASME NUM-1-2016 was approved by the American National Standards Institute on June 16, 2016.

The 2016 Edition of ASME NUM-1 includes revisions, additions, deletions, corrections, and editorial changes introduced in ASME NUM-1-2009, as well as the following changes identified by a margin note, (16), placed next to the affected area.

<i>Page</i>	<i>Location</i>	<i>Change</i>
4	NUM-G-3200	Reference to Nonmandatory Appendix A corrected
	NUM-G-3400	Paragraph (b) reference to Nonmandatory Appendix A corrected
8	NUM-G-4230	First paragraph reference to Nonmandatory Appendix A corrected
10	NUM-G-5200	First paragraph reference to Nonmandatory Appendix A corrected
11, 13	NUM-G-6100	Definitions of <i>braking torque</i> , <i>momentary peak load</i> added; definition of <i>reeving</i> updated; alphabetical order of some definitions updated
15	NUM-G-7100	References updated to latest editions; ANSI/AGMA 9002-B04, ANSI/AGMA 9003-B08, ANSI/AGMA 9103-B08, ANSI/AGMA 9112-A04 added
19	NUM-I-5400, NUM-I-5420	Added for proper nesting
21	NUM-I-7730, NUM-I-7740	Added for proper nesting
	NUM-I-7749	Added
	NUM-I-7931	Paragraph (c) references to figures updated
	Figure NUM-I-7931-1	Figure number updated
22	NUM-I-7942.1	Added for proper nesting
	Figure NUM-I-7931-2	Figure number updated
23	Figure NUM-I-7931-3	Figure number updated
24	NUM-I-7945	Paragraph (a) revised to add “keys”
26	NUM-I-7947	NUM-I-7947.1, NUM-I-7947.2, NUM-I-7947.6 added; NUM-I-7947.4 deleted; others redesignated
27	NUM-I-7950, NUM-I-7952	Added for proper nesting
	NUM-I-7970	Redesignated, reference to NUM-III-7970(a) updated
28	NUM-I-8212, NUM-I-8320, NUM-I-8332	Added for proper nesting
	NUM-I-8340, NUM-I-8345	Added

<i>Page</i>	<i>Location</i>	<i>Change</i>
29–30	Table NUM-I-8210-1	Note (3) reference to tables corrected
	NUM-I-8420	Added for proper nesting
36	NUM-I-8532	Added for proper nesting
40	NUM-II-8210	Added for proper nesting
	NUM-II-8213	Editorially revised
41	NUM-II-8215.3.5	Paragraph (c) equations renumbered
43, 44	Table NUM-II-8215.3.6-1	General Note added
	NUM-II-8215.3.10	Equations renumbered
45	NUM-II-8320, NUM-II-8410, NUM-II-8520, NUM-II- 8521.2	Added for proper nesting
55	NUM-III-3222	Revised
60	NUM-III-4422	Motor sizing cross-reference corrected
63, 65	NUM-III-5422	Paragraph (b) editorially revised
72	NUM-III-6510	Paragraph (e) cross-reference corrected
76	Figure NUM-III-7210-1	Illustration (d) corrected
77, 78	NUM-III-7341	Paragraph (d) reference to table corrected
	Figure NUM-III-7410-1	Callouts added
80	Figure NUM-III-7510-1	Illustration (d) corrected
81	Figure NUM-III-7610-1	Callouts added
	NUM-III-7720	Reference to Nonmandatory Appendix A corrected
85	NUM-III-7945	Subparagraph (b)(2) revised, including equations
88	NUM-III-7953.2	Added new para. (b), others redesignated
91	NUM-III-8212.3	Paragraph (a) reference updated
	NUM-III-8213	Editorially revised
93	Figure NUM-III-8214-1	Caption updated
94	NUM-III-8231.2	Equations (9), (10) editorially revised; eq (11) corrected; equation numbers updated
	Figure NUM-III-8214-2	Caption updated
95	NUM-III-8231.4	Reference updated
	NUM-III-8232.1	Description of σ_b updated
96, 98	NUM-III-8232.3	(1) Subparagraph (a) nomenclature updated (2) Subparagraph (b) σ_t corrected in third paragraph (3) Subparagraph (f) description of τ corrected

<i>Page</i>	<i>Location</i>	<i>Change</i>
99	NUM-III-8233.2	Equation editorially revised
	NUM-III-8233.3	(1) Equation (43) corrected (2) Second column head of text table updated
	NUM-III-8233.4	Reference updated
100	Table NUM-III-8234.1-1	Revised
101–104	Table NUM-III-8234.1-2	Note (1) added
105	Figure NUM-III-8234.1-1	Parts 7, 13, and 31 corrected
107	NUM-III-8341.2	Revised, including equations
108	NUM-III-8343.5	Revised
114	Table NUM-III-8344.2-1	In Contour Tread straddle head, units corrected
118–119	NUM-III-8422.4	(1) Subparagraph (a)(1) definition of K_s updated (2) Subparagraph (b)(3) revised
120	Table NUM-III-8422.4-1	Units updated
135	NUM-A-1320	Table number corrected
144, 146	NUM-B-4100	(1) Subparagraph (a) last equation in section corrected (2) Subparagraph (b) penultimate equation in section corrected (3) Subparagraph (d) units for penultimate equation in section corrected
	NUM-B-4200	Deleted

INTENTIONALLY LEFT BLANK

ASMENORMDOC.COM : Click to view the full PDF of ASME NUM-1 2016

RULES FOR CONSTRUCTION OF CRANES, MONORAILS, AND HOISTS (WITH BRIDGE OR TROLLEY OR HOIST OF THE UNDERHUNG TYPE)

Section NUM-G-1000 Introduction

NUM-G-1100 GENERAL

(a) This Standard is split into the following four major sections:

(1) NUM-G: General Specifications, applicable to all equipment

(2) NUM-I: Type I equipment, i.e., equipment that is used to handle critical loads and is required to withstand a seismic event (see Section NUM-G-6000)

(3) NUM-II: Type II equipment, i.e., equipment that is not used to handle critical loads and is required to withstand a seismic event (see Section NUM-G-6000)

(4) NUM-III: Type III equipment, i.e., equipment that is not used to handle critical loads and is not required to withstand a seismic event (see Section NUM-G-6000)

(b) Equipment covered under this Standard shall be designed in accordance with the Standard's requirements, but not necessarily with its recommendations. The word "shall" is used to denote a requirement, the word "should" is used to denote a recommendation, and the word "may" is used to denote permission, which is neither a requirement nor a recommendation.

NUM-G-1200 SCOPE

This Standard covers underhung cranes, top-running bridge and gantry cranes with underhung trolleys, traveling wall cranes, jib cranes, monorail systems, overhead

hoists, and hoists with integral trolleys used in nuclear facilities. All of the above cranes, whether single or multiple girder, are covered by this Standard with the exception of multiple girder cranes with both top-running bridge and trolley, which are covered by ASME NOG-1.

NUM-G-1300 APPLICATIONS

This Section of the Standard applies to the design, manufacture, testing, inspection, shipment, storage, and erection of the cranes, hoists, and monorails covered by this Standard.

NUM-G-1400 RESPONSIBILITY

The equipment covered by this Standard is classified into three types (see Section NUM-G-6000, equipment Types I, II, and III) depending on the equipment location and usage of the equipment at a nuclear facility.

The owner shall be responsible for determining and specifying the equipment type. The owner shall also be responsible for determining and specifying the environmental conditions of service, performance requirements, type and category of coatings and finishes, and degree of quality assurance.

Determining the extent to which this Standard can be used either in part or in its entirety at other than nuclear facilities shall be the responsibility of those referencing the use of the Standard.

Section NUM-G-2000

Environmental Conditions of Service

NUM-G-2100 GENERAL

The owner shall specify environmental conditions for operation and storage. This equipment shall be designed to withstand the effects of the conditions specified herein. Where the ability of the equipment to withstand the effects is unknown or limited, the manufacturer shall specify such limitations and their basis for acceptance by the owner prior to order.

NUM-G-2110 Clearances

The crane or monorail shall be designed to provide clearance between the equipment and the building and surrounding obstructions. For traveling cranes, jib cranes, and monorails, at least 3 in. of clearance shall be provided between the highest point of a moving crane or monorail component and the lowest overhead obstruction after taking into account variables that affect the elevation of the overhead structure relative to the equipment, including, but not limited to, external loads such as snow, wind, etc. The clearance between the sides and ends of traveling cranes, jib booms, or hoist and trolley units and the building columns and other obstructions shall not be less than 2 in. with the crane centered on the runway rails and the hoist and trolley unit centered on the operating flange. In addition, the equipment must clear the obstructions when operational variables including, but not limited to, maximum wheel float, crane skew, rail alignment, civil installation tolerances, and thermal expansion are considered.

NUM-G-2200 RADIATION

(a) The owner shall specify the accumulated radiation dosage expected to be seen by the crane, hoist, or monorail, over the life of the nuclear facility.

(b) Components whose normal life could be reduced by the effects of the specified radiation shall be tabulated and submitted to the owner.

(c) Components of equipment whose failure due to specified radiation could result in loss of load either shall be designed to withstand the specified radiation or shall have a specific replacement period. Where state of the art is such that sufficient data is not available, periodic inspections shall be made by the owner to determine when replacement should be made. The inspection requirements and their bases are to be specified by the manufacturer and provided to the owner.

NUM-G-2300 TEMPERATURE

(a) The owner shall specify the following temperature requirements in the area where the crane, hoist, or monorail operates:

- (1) maximum operating temperature
- (2) minimum operating temperature
- (3) ambient temperature for motors
- (4) maximum construction temperature
- (5) minimum construction temperature

(b) The crane, hoist, or monorail shall be designed to withstand the effects of the specified temperatures, or the limitation of the equipment's design concerning these temperature conditions shall be specified by the manufacturer. The inspection requirements and their bases are to be specified by the manufacturer and provided to the owner.

NUM-G-2400 PRESSURE

(a) The owner shall specify the following pressure requirements in the area where the crane, hoist, or monorail operates:

- (1) normal operating pressure
- (2) any test or abnormal event pressures including the rate of change of pressures

(b) The crane, hoist, or monorail shall be designed to withstand the effects of the specified pressures, or the limitations of the equipment's design concerning these pressure conditions shall be specified by the manufacturer. Specifically where there are changes in pressure, enclosures shall be vented. The inspection requirements and their bases are to be specified by the manufacturer and provided to the owner.

NUM-G-2500 HUMIDITY

(a) The owner shall specify the humidity conditions in the area where the crane, hoist, or monorail operates.

(b) The crane, hoist, or monorail shall be designed to withstand the effects of the specified humidity, or the limitations of the equipment's design concerning the humidity condition shall be specified by the manufacturer. The inspection requirements and their bases are to be specified by the manufacturer and provided to the owner.

NUM-G-2600 CHEMICAL*(a) Spray Systems*

(1) If the crane, hoist, or monorail may be subject to any spray systems, then the chemistry of the spray shall be specified by the owner. Any restrictions on the use of materials due to the effects of the spray shall also be specified. Specifically, where a corrosive spray is present, the possibility of hydrogen generation exists, and therefore the use of exposed aluminum, magnesium, galvanized steel, and zinc is to be minimized. If these materials are used, the amounts and location shall be provided to the owner.

(2) The crane, hoist, or monorail shall be designed to withstand the effects of the specified spray and shall not use the specified restricted materials. Any limitations of the design concerning the spray condition and the use of any restricted materials shall be specified by the manufacturer prior to the manufacture of the equipment. The inspection requirements and their bases shall be specified by the manufacturer and provided to the owner.

(b) Liquid Immersion

(1) If the hoist load block and wire rope are to be immersed in a liquid, then the owner should identify the immersion liquid and the manufacturer should select the lubricants and component materials that are compatible with the immersion liquid. Compatibilities between lubricants used in the manufacture of wire rope and the immersion liquid should also be addressed. Design requirements should address liquid entrapment in components such as sealed bearings, load blocks, and the wire rope to prevent degradation of lubricants and to protect the components from corrosion.

(2) Load blocks and wire ropes that are to be immersed shall be lubricated with a lubricant that meets the specified lubrication requirements. Any limitations

of the equipment design concerning the pool chemistry and lubrication requirements shall be specified by the manufacturer. The inspection requirements and their bases shall be specified by the manufacturer and provided to the owner.

NUM-G-2700 WIND

The crane, hoist, or monorail shall be designed to operate under any specified operating wind conditions, and shall be designed to withstand the effects in a non-operating secured position under any specified stored or tornado wind conditions.

NUM-G-2800 SEISMIC

(a) The owner shall specify the safe shutdown earthquake (SSE) parameters for Type I and Type II equipment.

(b) As specified under the NUM-I and NUM-II sections of this document, Type I and Type II equipment shall be designed to withstand the effects of the specified seismic conditions.

(c) Seismic design for Type III equipment is not required unless specified by the owner.

NUM-G-2900 DRAINAGE

Box sections, when required by environmental conditions, shall be drained to prevent moisture from accumulating. Where internal full-depth diaphragms extend from the top flange to the bottom flange, the compartment formed by a pair of diaphragms shall be drained. Holes shall be provided in the bottom flange of the box girder for draining the whole box girder of each compartment formed by the diaphragms.

Section NUM-G-3000 Performance Requirements

NUM-G-3100 GENERAL

(a) Individual performance requirements for equipment are addressed in each section for the various types of equipment. General and common requirements are covered in this Section. These requirements may be supplemented by the owner to define the special performance requirements of the given nuclear facility as applicable.

(b) The owner shall specify the service class, capacity, speeds, and dimensional requirements.

(16) NUM-G-3200 SERVICE CLASS

The owner shall specify the applicable crane, monorail, and hoist service class as determined necessary to meet the application. The owner shall state any specific requirements deviating from the selected service class description. See NUM-A-1000 regarding service class.

NUM-G-3210 Crane and Monorail Service Class

Service classes for cranes and monorails, excluding the hoist and hoists with integral trolley, are given in Table NUM-G-3210-1.

NUM-G-3220 Electrically Operated Hoist Service Class

Service classes for electric hoists and electric hoists with integral trolleys are given in Table NUM-G-3220-1.

NUM-G-3230 Air-Operated Hoist Service Class

Service classes for air-operated air-powered hoists and air-operated integral trolleys are given in Table NUM-G-3230-1.

NUM-G-3300 CAPACITY

(a) The capacity of the equipment is defined as the maximum rated load that the equipment handles. This capacity shall be specified by the owner.

(b) In the case where more than one trolley hoist will or may operate on a crane bridge or monorail, then the crane bridge or monorail shall be specified to handle the most severe loading conditions.

NUM-G-3400 SPEEDS

(16)

(a) The operational speeds of the crane, trolley, and hoist shall be specified by the owner. These speeds depend on the nature of the load, load clearances, weight of load, position of the operator, load positioning accuracy, and type of drive. Speeds are for rated load conditions and shall be such as to allow for controlled handling of the equipment and the load.

(b) Suggested operating speeds are provided in NUM-A-2000.

NUM-G-3500 OTHER CONSIDERATIONS

The owner shall determine if true vertical lift is required.

Table NUM-G-3210-1 Service Classes for Cranes and Monorails

Crane and Monorail Class	Service Class	Service Conditions
A	Infrequent or standby	This service class covers cranes and monorails that may be used in installations where precise handling of equipment at slow speeds with long idle periods between lifts is required. Capacity loads may be handled for initial installation of equipment and for infrequent maintenance.
B	Light	This service class covers cranes and monorails that may be used where service requirements are light and the speed is slow. Loads may vary from no load to occasional full-rated loads with 2 to 5 lifts per hr, averaging 10 ft per lift.
C	Moderate	This service class covers cranes and monorails that may be used where service requirements are moderate. In this type of service, the crane will handle loads that average 50% of the rated capacity with 5 to 10 lifts per hr, averaging 15 ft, with not more than 50% of the lifts at rated capacity.
D	Heavy	This service class covers cranes and monorails that may be used where heavy-duty production is required. In this type of service, loads approaching 50% of the rated capacity will be handled constantly during the working period. High speeds are desirable for this type of service with 10 to 20 lifts per hr, averaging 15 ft, with not more than 65% of the lifts at rated capacity.
E	Severe	This type of service requires a crane or monorail capable of handling loads approaching rated capacity throughout its life, with 20 or more lifts per hr at or near the rated capacity.
F	Continuous severe	This type of service requires a crane or monorail capable of handling loads approaching rated capacity continuously under severe service conditions throughout its life. Applications may include custom-designed specialty cranes essential to performing the critical work tasks affecting the total production facility. These cranes shall provide the highest reliability, with special attention paid to ease of maintenance features.

Table NUM-G-3220-1 Service Classes for Electrically Operated Hoists

Hoist Duty Class	Service Conditions	Operational Time Ratings at $k = 0.65$			
		Uniformly Distributed Work Periods		Infrequent Work Periods	
		Max. On Time, min/hr (%)	Max. Number of Starts, per hr	Max. On Time From Cold Start, min	Max. Number of Starts, per hr
H1	Hoists used primarily to install and service heavy equipment where loads frequently approach rated load, and where the hoist is idle for periods of 1 month to 6 months between periods of operation	7.5 (12.5)	75	15	100
H2	Loads and utilization randomly distributed. Rated loads infrequently handled. Total running time not more than 12.5% of the work period	7.5 (12.5)	75	15	100
H3	Loads and utilization randomly distributed. Total running time not more than 25% of the work period	15 (25)	150	30	200
H4	High-volume handling of heavy loads, frequently near rated load, with total running time not more than 50% of the work period. Manual or automatic cycling operations of lighter loads, with rated loads infrequently handled, with total running time frequently 50% of the work period	30 (50)	300	30	300
H5	Duty cycles approaching continuous operations are frequently necessary. User shall specify exact details of operation, including weight of attachments	60 (100)	600	N/A [Note (1)]	N/A [Note (1)]

NOTE:

(1) N/A = Not applicable since there are no infrequent work periods in class H5 service.

**Table NUM-G-3230-1 Service Classes for Air
Wire-Rope and Air Chain Hoists**

Hoist Duty Class	Description
A4	Loads normally less than 50% of rated load with running time up to continuous Loads normally above 50% of rated load with running time up to 50% of work period
A5	Loads normally above 50% of rated load with running time above 50% of work period

ASMENORMDOC.COM : Click to view the full PDF of ASME NUM-1 2016

Section NUM-G-4000

Coatings and Finishes

NUM-G-4100 COATING SERVICE LEVELS

The owner shall specify either coating service Level I or Level II as defined below.

(a) *Coating Service Level I.* For use in areas where coating failure could adversely affect the operation of post-accident fluid systems and thereby impair safe shut-down. With few exceptions, coating service Level I applies to coatings inside a nuclear power plant's primary containment.

(b) *Coating Service Level II.* For use in areas where coating failure could impair, but not prevent, normal operating performance. The function of coating service Level II coatings is to provide corrosion protection and decontaminability in those areas outside primary containment subject to radiation exposure and radionuclide contamination. Coating service Level II also applies to coatings in nonradiation areas.

NUM-G-4200 SPECIFIC REQUIREMENTS FOR COATING SERVICE LEVELS

NUM-G-4210 Requirements for Coating Service Level I

(a) Coating requirements for coating service Level I shall be in accordance with ASTM D5144.

(b) In accordance with ASTM D5144, coating service Level I requires a quality assurance program.

(c) Inspection and testing of coatings for coating service Level I shall be in accordance with ASTM D5144. Specific coating inspections shall be specified by the owner, dependent upon the coating system being used. See ASTM D5161 for selecting and specifying the appropriate inspection requirements.

NUM-G-4220 Requirements for Coating Service Level II

(a) Coating requirements for coating service Level II shall be as specified by the owner. The owner may invoke applicable sections of ASTM D5144.

(b) Quality assurance requirements for coating service Level II shall only apply as specified by the owner.

(c) Inspection and testing requirements for coating service Level II shall only apply as specified by the owner.

NUM-G-4230 Additional Requirements Applicable to All Coatings (16)

Additional requirements for coatings and finishes are listed in (a) through (o) below. Further information for coatings and finishes is provided in NUM-A-3000.

(a) If not specified by the owner, the type of coating shall be determined by the manufacturer to meet the specified environmental conditions of service and coating service level. Specifically, the selected coatings shall be suitable for any specified radiation, temperature, and chemical immersion or chemical spray environment.

(b) Welding through coatings shall not be allowed unless the coating system is specifically designed and formulated as a weldable system and documentation can be provided by the coating manufacturer to attest to this capability. The use of these coatings shall be approved by the owner.

(c) Surfaces exposed to the environment, but inaccessible after assembly, such as wheel wells and hubs, shall be coated prior to assembly.

(d) Coating of interior or enclosed surfaces of the equipment, such as inside a welded box section, is not required by this Standard.

(e) Contact surfaces of friction-type joints to be joined by high-strength bolts shall not be coated with a specified coating system except for organic or inorganic zinc coating systems not prohibited by NUM-G-2600.

(f) Machined mating surfaces and other surfaces not normally protected by the specified coating system, such as hooks, hook nuts, wheel treads, rails, gears, shafts, pinions, couplings, drum grooves, sheave grooves, and brake wheels, shall be protected by means of an appropriate preservative for shipment and/or storage. The manufacturer shall specify which preservatives must be removed by the owner for proper operation of the equipment. Other preservatives may be removed by the owner after installation of the equipment.

(g) Forced curing or drying of the coating system shall not be performed unless recommended by the coating manufacturer.

(h) Fillers, sealants, and caulking compounds shall be compatible with the coating system.

(i) Finished components (such as motors, brakes, gear reducers, limit switches, electrical dials and gauges, control enclosures, brake rectifier cabinets, control masters, safety switches, auxiliary heaters, push-button stations,

transformers, manual magnetic disconnects, light fixtures, reactors, resistor banks, protective guards, cross-shaft bearing blocks, unitized hoists, interior of control cabinets, festoon trolley cable spacer systems, cab interiors, and radio control equipment) may be furnished with conventional coatings unless otherwise specified by the owner.

(j) For coating service Level I applications, the equipment manufacturer shall supply the estimated surface area of exposed parts provided with conventional coatings.

(k) Nameplates and warning labels of factory-finished components that are recoated shall be masked to preserve legibility.

(l) Items such as fasteners and conduits shall be supplied with the specified coating system, galvanized or plated. Galvanizing or plating shall be subject to the requirements of NUM-G-2600. When specifically requested by the owner, a list of galvanized or plated parts shall be provided by the equipment manufacturer.

(m) Surface contaminants such as grease and oil detected after blasting shall be removed to produce the

surface conditions required by the appropriate Steel Structures Painting Council (SSPC) surface preparation.

(n) If there is visible deterioration of the surface beyond the specified SSPC preparation, reparation of the surface shall be required.

(o) Preparation of surfaces shall be accomplished by the methods originally used, except that small areas requiring repair or touchup where conventional blasting is not desirable may be reprepared by one of the following methods, listed in descending order of effectiveness:

(1) Vacuum blasting to clean an abrasive finish with a minimum 2.0-mm profile; the minimum blasting air pressure shall be 50 psi at the blasting nozzle.

(2) Power tool cleaning using grinding wheels, sanding disks, or other devices to provide a minimum 2.0-mm profile in accordance with SSPC SP-3; the use of a needle gun to roughen the surface after grinding is recommended.

(3) Hand sanding to obtain as clean a surface as possible in accordance with SSPC SP-2, or wire brushing in accordance with SSPC SP-2.

Section NUM-G-5000

Quality Assurance

NUM-G-5100 REQUIREMENTS

NUM-G-5110 Type I and Type II Equipment

(a) The quality assurance program of the manufacturer of Type I or Type II equipment shall meet ASME NQA-1, or shall meet the quality assurance requirements specified by the owner.

(b) A specific quality assurance program for manufacturers of mechanical and electrical components for Type II equipment is not required unless specified by the owner.

(c) A specific quality assurance program for suppliers of Type II equipment structural components that are not listed in NUM-II-8500 is not required unless specified by the owner.

(d) A specific quality assurance program for suppliers of Type I equipment structural, mechanical, and electrical components that are not listed in NUM-I-8500 is not required unless specified by the owner.

NUM-G-5120 Type III Equipment

A specific quality assurance program for manufacturers of Type III equipment is not required unless specified by the owner.

Guidance for determining documentation requirements to be specified in the owner's purchase documents is provided in Nonmandatory Appendix A.

(a) As a minimum, design and manufacturing documentation to be specified in the owner's purchase documents for all cranes shall include the following:

- (1) assembly and outline drawings
- (2) electrical schematics and wiring diagrams
- (3) acceptance test plans and procedures
- (4) software test plans for controls
- (5) operating instructions
- (6) maintenance instructions
- (7) software programs

(b) Minimum installation documentation for all cranes shall include the following:

- (1) records of high-strength bolt torquing
- (2) data sheets or logs on equipment installation, inspection, and alignment
- (3) lubrication records
- (4) documentation of testing performed after installation and prior to equipment acceptance
- (5) results of end-to-end electrical tests
- (6) final system adjustment data
- (7) acceptance test procedures and results
- (8) load test

Additionally, for Types I and II cranes, system calculations and load summary reports shall be included.

The owner's quality assurance program shall define which of these quality assurance documents are permanent records.

(16) NUM-G-5200 DOCUMENTATION

The owner shall define, in its purchase documents, the requirements for the collection, storage, and maintenance of documentation applicable to procurement, design, manufacture, shipment, receipt, storage, installation, and startup of cranes covered by this Standard.

Section NUM-G-6000

Definitions

(16) NUM-G-6100 DEFINITIONS

abnormal operating conditions: environmental conditions that are unfavorable, harmful, or detrimental to or for the operation of the crane trolley (carrier) or hoist, such as excessively high or low ambient temperatures, exposure to weather, corrosive fumes, dust-laden or moisture-laden atmospheres, and hazardous locations.

acceptance criteria: specified limits placed on characteristics of an item, process, or service defined in codes, standards, or other required documents.

ampacity: the current-carrying capacity expressed in amperes.

auxiliary girder (outrigger): a girder arranged parallel to the main girder for supporting the platform motor base, operator's cab, control panels, etc., to reduce the torsional forces such load would otherwise impose on the main girder.

brake: a device other than a motor used for retarding or stopping motion, or holding in a rest position.

brake, drag: a friction brake that provides a continuous retarding force having no external control.

brake, holding: a brake that automatically prevents motion when power is off.

brake, mechanical load: an automatic type of friction brake used for controlling loads in a lowering direction. This unidirectional device requires torque from the motor to lower a load but does not impose any additional load on the motor when hoisting a load.

brake, mechanical load (manual chain hoist): an automatic type of brake used for holding and controlling the descent of loads. This unidirectional device requires a force applied to the hand chain to lower the load but does not impose additional hand-chain pull when lifting the load.

brake, parking: a brake for bridge and trolley that may be automatically or manually applied in an attempt to prevent horizontal motion by restraining wheel rotation.

braking, dynamic: a method of controlling speed by using the motor as a generator, with the energy being dissipated in resistors.

braking, eddy current: a method of controlling or reducing speed by means of an electrical induction load brake.

braking means, control: a method of controlling speed by removing energy from the moving body or by imparting energy in the opposite direction.

braking torque: torque on a drive system created by the application of a brake and by dynamic motor braking.

camber: the slight upward vertical curve given to bridge and/or runway girders to compensate partially for deflection due to hook load and weight of the crane.

cantilever frame: a structural member that supports the trolley of a wall crane.

capacity: the maximum rated load that an item of lifting equipment is designed to handle.

carrier: see *trolley*.

certification: the act of determining, verifying, and attesting in writing to the qualifications of personnel, processes, procedures, or items in accordance with specified requirements.

clearance: distance from any part of the crane to a point of the nearest fixed obstruction.

controller, spring-return (dead man): a controller that, when released, will return automatically to a neutral position.

countertorque: see *plugging*.

crane: a machine for lifting and lowering a load and moving it horizontally. Cranes, whether fixed or mobile, are driven manually or by power, or by a combination of both.

crane, gantry: a crane similar to an overhead crane, except that the bridge for carrying the trolley or trolleys is supported on two or more legs running on fixed rails or other runway.

crane, under-running: an electric overhead traveling crane having the end trucks supported on track attached to the bottom flanges of beams or supported on the bottom flanges of the beams. These beams make up the crane runway.

cross shaft: the shaft extending across the bridge, used to transmit torque from motor to bridge drive wheels.

deflection: displacement due to bending or twisting in a vertical or lateral plane caused by the imposed live and dead loads.

drift point: a point on a travel motion controller that releases the brake while the motor is not energized. This allows for coasting before the brake is set.

driving head: a motor-driven carrier head that is supported from and propelled by the load-bearing wheels.

drop section: a mechanism that will permit a section of track to be lowered out of alignment with a stationary track.

electric baffles: conductors that are wired to cut off electric current to approaching motor-driven equipment if switchers, etc., are not properly set for passage of equipment.

end stop: a device located at the end of the track to prevent the carrier from running off the end of the track.

end truck: the assembly consisting of the frame and wheels that supports the crane girder or sill and allows movement along the runway.

equalizer: a device that compensates for unequal length or stretch of a rope or chain.

fork: a mechanical device for use on interlocking transfer equipment to mechanically prevent passage of a trolley or carrier when the elements are not securely locked.

gantry leg: the structural member that supports a bridge girder or end tie from the sill.

girder: the principal horizontal beam of the crane bridge that supports the trolley and is supported by the end trucks.

hand chain: an endless loop of chain grasped by the operator to apply force required for lifting, lowering, and traveling motions.

hand-chain drop: the distance to the lowest point of the hand chain measured from a known reference.

hand-chain overhaul: the number of feet the hand chain must travel to raise the load hook 1 ft.

hand-chain pull: the average force measured in pounds exerted by the operator on the hoist hand chain to lift the rated load.

hand-chain wheel: a wheel with formed pockets on its periphery to allow torque to be transmitted when a force is applied to the hand chain.

hanger rod: steel rods that together with other fittings are used to suspend the track from the supporting structure.

hazardous locations: locations where fire or explosion hazards may exist. Locations are classified depending on the properties of the flammable vapors, liquids, or gases, or combustible dusts or fibers, that may be present, and the likelihood that a flammable or combustible concentration or quantity is present.

headroom: the distance measured with the load hook at its upper limit of travel from the saddle of the load hook to the following:

- (a) saddle of the top hook on hook-suspended hoists
- (b) centerline of the suspension holes on lug-suspended hoists

- (c) bottom of the beam on trolley-suspended hoists

- (d) supporting surface on base-mounted and deck-mounted hoists

- (e) uppermost point of hoist on wall-mounted and ceiling-mounted hoists

hoist, auxiliary: supplemental hoisting unit usually of lighter capacity and higher speed than the main hoist.

hoist, hand-chain-operated: a suspended machinery unit that by use of hand-chain manual operation is used for lifting or lowering a freely suspended (unguided) load.

hoist, lug-suspended: a hoist suspended from a trolley or permanent structure by means of bolt(s) or pin(s) through a rigid-type or swivel-type lug.

hook approach: the minimum horizontal distance between the center of the runway rail and the hook.

hook latch: a mechanical device to close (bridge) the throat opening of a hook.

idler sprocket: a device that is free to rotate and changes the direction of the chain. This device is sometimes called idler wheel, idler sheave, pocket wheel, or chain wheel.

impact allowance: additional hook load assumed to result from the dynamic effect of the rated load.

inspection: examination or measurement to verify that an item or activity conforms to specified requirements.

interlocking mechanism: a mechanical device to lock together the adjacent ends of two cranes or a crane to a fixed transfer section or spur track to permit the transfer of carriers from one crane or track to the other.

L10 bearing life: the minimum expected life, in hours, of 90% of a group of bearings that are operated at a given speed and loading.

lift: the maximum safe vertical distance through which the hook, magnet, or bucket can move between its upper and lower limits of travel.

lift section: a mechanism that will lift a section of track out of alignment with a stationary track.

lift, true vertical: lift in which the load hook travels in a vertical path with no horizontal displacement between the lower limit of lift and the upper limit of lift.

load: the total weight superimposed on the load block, hook, or carrier.

load block: the assembly of hook or shackle, swivel, bearing, sheaves, pins, and frame suspended by the hoisting ropes.

load-carrying part(s): any part(s) of the equipment for which the induced stress is influenced by the load on the hook.

load chain: the load suspension chain in the hoist consisting of a series of interwoven links formed and welded.

load, credible critical: combinations of lifted loads and plant seismic events that have probabilities of occurrence equal to or more than 10^{-7} times per calendar year. The critical loads handled by the crane and their durations of lifts shall be used in the calculations to determine the credible critical load to be considered for the crane in the crane design load combinations that include seismic loadings. The credible critical load shall be specified by the owner.

load, critical: any lifted load whose uncontrolled movement or release could adversely affect any safety-related system when such a system is required for unit safety or could result in potential off-site exposure in excess of the limit determined by the owner.

load hangup: the event in which the load block and/or load is stopped during hoisting (or traversing) by snagging or entanglement with heavy or fixed objects, creating a sudden and potentially severe overload.

load hook: the hook used to connect the load to the hoist.

load, live: a load that moves relative to the structure under consideration.

load, rated: the design rated load to be lifted and transported by the equipment that by definition is not considered as the critical load, including an allowance for lifting accessories that are not part of the equipment.

loads, dead: the loads on a structure that remain in a fixed position relative to the structure. On a crane bridge, such loads include the girders, footwalk, cross shafts, drive units, and panels.

load, seismic lifted: the maximum lifted load under the evaluated seismic conditions where the crane or mono-rail structure and hoist and trolley unit must remain in place. This lifted load is not a critical load; therefore, the load itself need not be retained under the seismic event.

load sprocket: a hoist component that transmits motion to the load chain. This component is sometimes called load wheel, load sheave, pocket wheel, chain wheel, or lift wheel.

load test, dynamic: a test to demonstrate the ability of hoisting equipment to safely handle its rated load by exercising the equipment through vertical and horizontal movement along its lines of travel, using a load of specific weight.

load test, proof: a physical load test, with magnitude to be as specified and always in excess of the design load.

load, wheel: the load, without impact, on any wheel with the trolley and lifted load (rated capacity) positioned on the bridge to give maximum loading.

manufacturer: one who constructs or fabricates an item to meet prescribed design requirements.

momentary peak load: load conditions due to emergency braking, motor locked rotor torque, or drivetrain failure.

noncoasting mechanical drive: a drive that results in decelerating a trolley or bridge when power is not available. The braking effort will be established automatically when power to the drive is interrupted.

nondestructive examination: methods for determining the integrity of structural materials without physically damaging the material; methods of inspection include visual, radiographic, ultrasonic, magnetic particle, and liquid penetrant.

normal walking speed: a walking speed assumed to be 150 ft/min.

overload: any load greater than the rated load.

overtravel restraint: any device used to prevent the slack load chain from inadvertently being lowered out of the load sprocket.

owner: the organization legally responsible for the construction and/or operation of a nuclear facility including, but not limited to, one who has applied for or been granted a construction permit or operating license by the regulatory authority having lawful jurisdiction.

parts (lines): number of lines of hoisting rope or chain supporting the load block or hook.

plugging: a control function that provides braking by reversing the motor line voltage polarity or phase so that the motor develops a countertorque that exerts a retarding force.

push-button station: a device consisting of push-button-operated contacts in an enclosure used by the operator for control of the powered motions of the carrier, hoist, and other auxiliary equipment.

qualified person: a person who, by possession of a recognized degree or certificate of professional standing, or who, by extensive knowledge, training, and experience, has successfully demonstrated the ability to solve or resolve problems relating to the subject matter and work.

quality assurance: all those planned and systematic actions necessary to provide adequate confidence that a structure, system, or component will perform satisfactorily in service.

rail sweep: a mechanical device attached to the crane but located in front of the crane leading wheels to deflect any obstructions.

reach: the distance from the saddle of the load hook at its lower limit of lift to the upper point of the headroom measurement. Reach is equal to lift plus headroom.

reeving: the system of hoisting rope or chain, and sheaves or sprockets, supporting the load block or hook.

running sheave: a sheave that rotates as the load block is raised or lowered.

runway: an assembly of rails, beams, girders, brackets, and framework on or from which the crane travels.

runway conductors: the main conductors mounted on or parallel to the runway that supply current to the crane.

safety lug: a mechanical device fixed securely to the end truck or trolley yoke that will limit the fall of the crane or carrier in case of wheel or axle failure.

shall: the word “shall” indicates that the rule is mandatory and must be followed to conform to the Standard.

should: the word “should” indicates that the rule is a recommendation, the advisability of which depends on the facts in each situation.

sills: horizontal structural members that connect the lower ends of two or more legs of a gantry crane on one runway.

single failure-proof features: those features that are included in the crane design such that any credible failure of a single component will not result in the loss of capability to stop and hold the critical load within facility-acceptable excursion limits.

slew drive: the mechanism (including motor and gearing) used to rotate a jib boom about a vertical axis.

span: the horizontal distance center-to-center of runway rails.

static control: a method of switching electrical circuits without the use of contacts.

switch: a device for making, breaking, or changing connections in an electric circuit.

switch, cross-track: a track switch containing one straight section of track, pivoted at the center, that can be rotated to align it with other crossing tracks to allow passage of the carrier through the junction without changing the direction of the carrier motion.

switch, glide (slide): a track switch with a movable inner frame containing straight or curved sections of track. The inner frame may be moved to align these sections of track with other fixed tracks to permit routing of carriers.

switch, track: a device with a moving section of track that can be moved to permit passage of a carrier from an incoming fixed track(s) to one of various outgoing fixed track(s).

traceability: the ability to trace the history, application, or location of an item and like items or activities by means of recorded identification.

track opener: a section of monorail track arranged to lift or swing out of line to make an opening through which a door may pass.

tractor drive: a motor-driven unit supported by wheels and propelled by drive wheel or wheels, bearing on the underside of the track.

trolley: the unit carrying the hoisting mechanism that travels on the bridge rails or bottom flange of a monorail track or bridge girder to transport the load.

truck: the unit consisting of a crane, wheels, bearings, and axles that supports the bridge girders, the end ties of an overhead crane, or the sill of a gantry crane.

two-blocking: the act of hoisting beyond the intended upper limit in which the load block comes into physical contact with the head-block (upper block) or its supporting structure, preventing further upward movement of the load block and creating a sudden and potentially severe overload.

Type I equipment: a crane, monorail, or hoist that is used to handle a critical load. It shall be designed and constructed so that it will remain in place and support the critical load during and after a seismic event, but does not have to be operational after this event. Type I equipment shall be designed with either single failure-proof features (Type IA) or enhanced safety features (Type IB).

Type IA equipment: a Type I crane, monorail, or hoist that includes single failure-proof features so that any credible failure of a single component will not result in the loss of capability to stop and hold the critical load.

Type IB equipment: a Type I crane, monorail, or hoist with enhanced safety features, including increased design factors and redundant components that minimize the potential for failure that would result in the loss of capability to stop and hold the critical load.

Type II equipment: a crane, hoist, or monorail that is not used to handle a critical load. It shall be designed and constructed so that it will remain in place during a seismic event; however, the crane need not support the load nor be operational during and after such an event. Single failure-proof features are not required.

Type III equipment: a crane, hoist, or monorail that is not used to handle a critical load; no seismic considerations are necessary, and no single failure-proof features are required.

upper block: a fixed block located on a trolley that, through a system of sheaves, bearings, pins, and frames, supports the load block and its load.

Section NUM-G-7000

Referenced Codes and Standards

(16) NUM-G-7100 GENERAL

References are made to portions of other specifications within the text of these specifications. Where conflict occurs, this specification shall prevail. The following is a list of publications referenced in this Standard:

ANSI/AGMA 2001-C95, Fundamental Rating Factors and Calculation Methods for Involute Spur and Helical Gear Teeth

ANSI/AGMA 9002-B04, Bores and Keyways for Flexible Couplings (Inch Series)

ANSI/AGMA 9003-B08, Flexible Couplings—Keyless Fits

ANSI/AGMA 9005-E02, Industrial Gear Lubrication

ANSI/AGMA 9103-B08, Flexible Couplings—Keyless Fits (Metric Edition)

ANSI/AGMA 9112-A04, Bores and Keyways for Flexible Couplings (Metric Series)

Publisher: American Gear Manufacturers Association (AGMA), 1001 North Fairfax Street, Alexandria, VA 22314 (www.agma.org)

ASCE/SEI 7-10, Minimum Design Loads in Buildings and Other Structures

Publisher: American Society of Civil Engineers (ASCE), 1801 Alexander Bell Drive, Reston, VA 20191 (www.asce.org)

ASME B30.10-2009, Hooks

ASME B30.11-2010, Monorails and Underhung Cranes

ASME B30.16-2012, Overhead Hoists (Underhung)

ASME B30.17-2006, Overhead and Gantry Cranes (Top Running Bridge, Single Girder, Underhung Hoist)

ASME HST-4-1999, Performance Standard for Overhead Electric Wire Rope Hoists

ASME NOG-1-2010, Rules for Construction of Overhead and Gantry Cranes (Top Running Bridge, Multiple Girder)

ASME NQA-1-2012, Quality Assurance Requirements for Nuclear Facility Applications

Publisher: The American Society of Mechanical Engineers (ASME), Two Park Avenue, New York, NY 10016-5990 (www.asme.org)

ASTM A6/A6M-13, Standard Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling

ASTM A36/A36M-12, Specification for Carbon Structural Steel

ASTM A48/A48M-03 (2012), Specification for Gray Iron Castings

ASTM A275/A275M-98, Standard Test Method for Magnetic Particle Examination of Steel Forgings

ASTM A325-10, Specification for Structural Bolts, Steel, Heat Treated, 120/105 ksi Minimum Tensile Strength

ASTM A370-10, Standard Test Methods for Mechanical Testing of Steel Products

ASTM A388/A388M-10, Standard Practice for Ultrasonic Examination of Steel Forgings

ASTM A435/A435M-90, Standard Specification for Straight-Beam Ultrasonic Examination of Steel Plates

ASTM A490-12, Specification for Heat-Treated Steel Structural Bolts, 150 ksi Minimum Tensile Strength

ASTM B8-99, Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft

ASTM B174-02, Specification for Bunch-Stranded Copper Conductors for Electrical Conductors

ASTM D5144-00, Standard Guide for Use of Protective Coating Standards in Nuclear Power Plants

ASTM D5161-04, Standard Guide for Specifying Inspection Requirements for Coating and Lining Work (Metal Substrates)

ASTM E114-10, Standard Practice for Ultrasonic Pulse-Echo Straight-Beam Contact Testing

ASTM E165-02, Standard Test Method for Liquid Penetrant Examination

ASTM E208-06, Standard Test Method for Conducting Drop-Weight Test to Determine Nil-Ductility Transition Temperature of Ferritic Steels

ASTM E380-93, Standard Practice for Use of the International System of Units (SI) (The Modernized Metric System)

ASTM E709-01, Standard Guide for Magnetic Particle Examination

Publisher: American Society for Testing and Materials (ASTM International), 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959 (www.astm.org)

AWS D1.1M:2010, Structural Welding Code — Steel

AWS D14.1-97, Specifications for Welding of Industrial and Mill Cranes and Other Material Handling Equipment

Publisher: American Welding Society (AWS), 8669 NW 36th Street, No. 130, Miami, FL 33166 (www.aws.org)

CMAA 74-2010, Specifications for Top Running and Under Running Single Girder Electric Overhead Cranes Utilizing Under Running Trolley Hoist

Publisher: Crane Manufacturers Association of America, Inc. (CMAA), 8720 Red Oak Boulevard, Charlotte, NC 28217 (www.mhi.org/cmaa)

EPRI NP-5380-1987, Visual Weld Acceptance Criteria
Publisher: Electric Power Research Institute (EPRI), 3420 Hillview Avenue, Palo Alto, CA 94304 (www.epri.com)

NEMA ICS 1-2000 (R2005, R2008), Industrial Control and Systems, General Requirements

NEMA ICS 6-1993 (R2001, R2006), Industrial Controls and Systems: Enclosures

Publisher: National Electrical Manufacturers Association (NEMA), 1300 North 17th Street, Rosslyn, VA 22209 (www.nema.org)

NFPA 70-2014, National Electrical Code

Publisher: National Fire Protection Association (NFPA), One Batterymarch Park, Quincy, MA 02169 (www.nfpa.org)

RR-C-271D, Chains and Attachments, Welded and Weldless, September 1990; Amendment 1, November 1995

RR-W-410E, Wire Rope and Strand, February 2002

Publisher: Federal Specifications, Superintendent of Documents, U.S. Government Publishing Office (GPO), 732 North Capital Street, NW, Washington, DC 20401 (www.gpo.gov)

SSPC Systems and Specifications Steel Structures Painting Manual, Volume 2, eighth edition, 2000

Publisher: SSPC: The Society for Protective Coatings, 40 24th Street, Pittsburgh, PA 15222 (www.sspc.org)

The AISC Manual of Steel Construction: Allowable Stress Design, ninth edition, 1989

Publisher: American Institute of Steel Construction (AISC), One East Wacker Drive, Suite 700, Chicago, IL 60601 (www.aisc.org)

Wire Rope Users Manual, third edition

Publisher: Wire Rope Technical Board (WRTB), 801 North Fairfax Street, Alexandria, VA 22314-1757 (www.domesticwirerope.org/wrtb/index.html)

ASME NUM-1-2016

Click to view the full PDF of ASME NUM-1-2016

Section NUM-G-8000 Nomenclature

NUM-G-8100 GENERAL

The nomenclature used in this Standard is listed and defined in the area where it is used.

ASMENORMDOC.COM : Click to view the full PDF of ASME NUM-1 2016

Section NUM-I-1000

Introduction

NUM-I-1100 GENERAL

This Section of the Standard covers Type I equipment and shall be used in conjunction with NUM-G, NUM-II, and NUM-III.

All NUM-I paragraphs are either new requirements in addition to NUM-II and NUM-III requirements or supersede existing NUM-II or NUM-III requirements. If the NUM-I requirements supersede the NUM-II or NUM-III requirements, the NUM-I paragraph will state which paragraph it supersedes.

Type I equipment is used to handle critical loads and is required to withstand a seismic event. Type I equipment, including its component parts and accessories, shall be designed and constructed to remain in place in the loaded and unloaded conditions during a seismic event. The equipment shall support the load but need not remain operational during or after such an event. Type I equipment shall be designed with either single failure-proof features (Type IA) or enhanced safety features (Type IB). Both of these types of design features are outlined in this Standard.

Requirements designated for Type IA equipment apply only to Type IA; requirements designated for Type IB equipment apply only to Type IB; all other requirements apply to both Types IA and IB. Table NUM-I-1100-1 provides a summary of the major design differences between Types IA and IB. It is the

responsibility of the owner to determine if Type IA or Type IB equipment is appropriate for a specific application.

The additional requirements for Type I equipment are included under the following NUM-I headings:

NUM-I-5300	Mechanical (for Jib Cranes)
NUM-I-6300	Mechanical (for Monorail Systems)
NUM-I-7700	Under-Running Trolleys
NUM-I-7900	Hoist Common Requirements (Overhead Hoists and Under-Running Trolleys)
NUM-I-8200	Structural (Common Requirements and Criteria)
NUM-I-8300	Mechanical (Common Requirements and Criteria)
NUM-I-8400	Electrical (Common Requirements and Criteria)
NUM-I-8500	Inspection and Testing (Common Requirements and Criteria)
NUM-I-8600	Hoist Marking (Common Requirements and Criteria)

NUM-I-1300 APPLICATIONS

This Section of the Standard applies to the design, manufacture, testing, inspection, shipment, storage, and erection of Type I equipment.

Table NUM-I-1100-1 Major Design Differences Between Types IA and IB

Item	Type IA Single Failure-Proof Features (Design Factors Based on Ultimate Strength)	Type IB Enhanced Safety Features (Design Factors Based on Ultimate Strength)	Reference Section
Reeving	Dual load path design (redundant reeving)	Single load path design (single or double reeving)	NUM-I-7942.3
Drum bearings/shaft	5:1 with drum restraint	5:1 with drum restraint 10:1 without drum restraint	NUM-I-7942.2
Gear box	Redundant or a brake on the rope drum	Twice the torque rating of the gears	NUM-I-7945
Two-blocking	Designed to withstand two-blocking	Designed to prevent two-blocking	NUM-I-7930

Section NUM-I-5000 Jib Cranes

NUM-I-5300 MECHANICAL

NUM-I-5310 General

If a jib rotation allows the boom to move into an area of facility unacceptable excursion, positive means to tie down or restrain the boom for storage shall be provided.

(16) NUM-I-5400 ELECTRICAL

(16) NUM-I-5420 Electrical Components

NUM-I-5423 Brakes. In lieu of NUM-III-5423, motorized jib booms shall have brakes in accordance with NUM-I-8332.1.

ASMENORMDOC.COM : Click to view the full PDF of ASME NUM-1 2016

Section NUM-I-6000 Monorail Systems

NUM-I-6300 MECHANICAL

NUM-I-6360 Vertical Drop or Lift Sections

Type I vertical drop or lift sections shall have structural, mechanical, and electrical components meeting the Type I requirements. The drop or lift section hoist shall be either a Type IA or Type IB hoist.

ASMENORMDOC.COM : Click to view the full PDF of ASME NUM-1 2016

Section NUM-I-7000

Overhead Hoists and Under-Running Trolleys

NUM-I-7700 UNDER-RUNNING TROLLEYS

(16) NUM-I-7730 Structural Design

NUM-I-7732 Trolley Frames. In lieu of NUM-III-7732(a), safety lugs (drop lugs) shall be provided on the trolley frame to limit the drop to no greater than 1 in., should an axle or wheel fail.

(16) NUM-I-7740 Mechanical

NUM-I-7746 Brakes. In lieu of NUM-III-7746, trolley brakes are required for motorized trolleys and shall be in accordance with NUM-I-8332.1.

NUM-I-7747 Bumpers. In lieu of NUM-III-7747, bumpers are required and shall be supplied in accordance with NUM-I-8333.

(16) NUM-I-7749 Key and Keyway Design for Power Transmission and Braking.

Key and keyway design shall be per NUM-I-8345.

NUM-I-7900 HOIST COMMON REQUIREMENTS

NUM-I-7910 General

In lieu of the requirements of NUM-III-7910, this section, combined with NUM-III-7900, provides all requirements that are common to manual and power (electric or air) operated hoists for vertical lifting service involving handling of freely suspended, unguided loads using wire rope or welded-link-type load chains as a lifting medium for Type I equipment. This Standard does not anticipate the use of chain hoists in Type IA applications. If the owner desires a Type IB chain hoist, it shall be provided with safety features equivalent to the requirements of NUM-I-7930, NUM-I-7940, and NUM-I-7952.

NUM-I-7930 Design Consideration


Hoists and trolleys shall remain in place during the seismic event. See NUM-II-8323.4 for allowable stresses for mechanical fasteners on trolleys and hoist-to-trolley connections.

(16) NUM-I-7931 Type 1A

(a) The hoisting machinery from the motor to the drum shall be designed to provide assurance that a failure of a single component would not result in the uncontrolled movement of the lifted load. The wire rope drum shell is exempted from this requirement.

Fig. NUM-I-7931-1 Type IA Dual Hoist Drive Unit With Single Drum

(16)

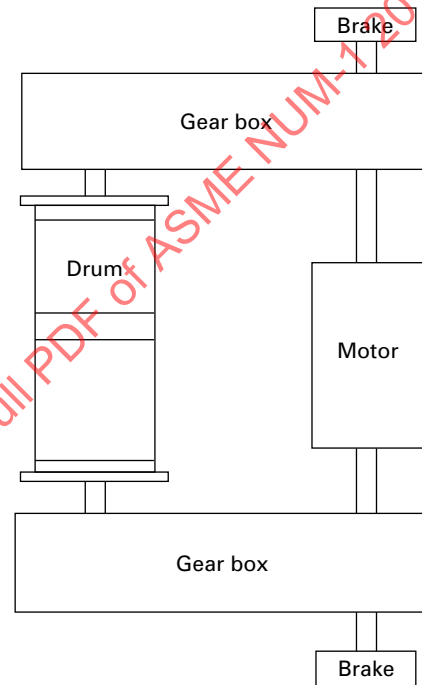


GENERAL NOTE: This figure is a block diagram provided to show conceptual layouts only. The machinery together with the reeving arrangement shall comply with the vertical alignment requirements in NUM-I-7942.3(b).

(b) Load motion due to failure of one load path of a redundant load path hoist shall be evaluated as to facility acceptability.

(c) Figures NUM-I-7931-1, NUM-I-7931-2, and NUM-I-7931-3 provide some block diagrams illustrating examples of Type IA hoist equipment configurations. These block diagrams are not meant to show actual configurations and may be rearranged as needed to meet the specific application. These diagrams are only a few of many acceptable configurations.

(d) The hoisting machinery and wire rope reeving system, in addition to other affected components, shall be designed to withstand the most severe potential overload, including two-blocking and load hangup. Allowable stresses for hoisting machinery components during these events shall be limited to 75% of the yield strength.

(16)

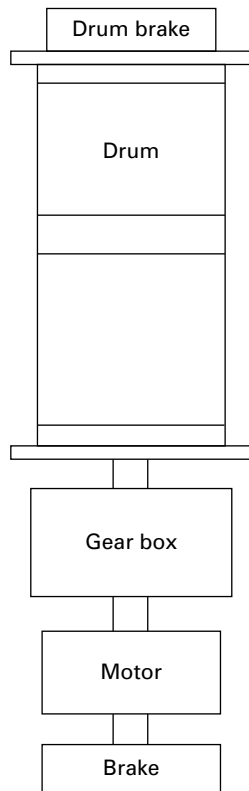Fig. NUM-I-7931-2 Type IA Single Hoist Drive Unit With Drum Brake

GENERAL NOTE: This figure is a block diagram provided to show conceptual layouts only. The machinery together with the reeving arrangement shall comply with the vertical alignment requirements in NUM-I-7942.3(b).

Wire rope stress shall be limited to 40% of the manufacturer's published breaking strength. Design calculations and component sizing shall take into consideration the maximum forces resulting from the kinetic energy of the hoisting machinery operating at maximum normal full-load or unloaded operating speed at the onset of the overload condition. Motor stall torque shall be considered, as well as all other factors contributing to maximum loading of the equipment components. The system or components (which may include torque-limiting or energy-absorbing components or systems) used to mitigate the effects of two-blocking and load hangup shall permit the hoisting machinery and crane to be returned to service without need for repair or replacement of components. Should any device in the hoist drivetrain such as a clutch or torque limiter fail to hold the load, the emergency brake (or other secondary/redundant load path) shall be caused to engage (or remain engaged) and safely retain the load. Design calculations demonstrating the capability of the crane system to withstand

severe overloads including two-blocking and load hangup shall be submitted to the owner.

NUM-I-7940 Mechanical

NUM-I-7941 Hooks and Load Blocks

NUM-I-7941.1 Hooks. Hooks(s) shall be designed for twice the rated load (e.g., for a 5-ton rated load, the design load shall be 10 tons) or shall be of single failure-proof design.

NUM-I-7941.2 Load Blocks. Load blocks shall have double the normal design factors (e.g., for a 5-ton rated load, the design load shall be 10 tons) or shall be of a single failure-proof design.

NUM-I-7941.3 Upper Blocks. The upper block shall have double the normal design factors or shall be of single failure-proof design.

NUM-I-7942 Wire Rope

(a) Rated Load

(1) *Type IA.* In lieu of NUM-III-7942(b), the rated load divided by the total number of parts of the rope shall not exceed 12.5% of the nominal breaking strength of the rope on the total system, or 25% on each of the dual systems.

(2) *Type IB.* In lieu of NUM-III-7942(b), the rated load divided by the total number of parts of the rope shall not exceed 10% of the nominal breaking strength of the rope on the total system.

(b) In lieu of NUM-III-7942(d), end terminations shall be in accordance with the Wire Rope Users Manual and shall be equal to the required rope strength. Wire rope clips shall not be used as the primary end terminations.

(c) In lieu of NUM-III-7942(g), the rope fleet angle to the drum grooves shall be limited to $3\frac{1}{2}$ deg, except the last 3 ft of the maximum lift elevation, which shall be limited to 4 deg. Refer to Fig. NUM-I-7942-1 for fleet angle measurement to the drum grooves.

(d) In lieu of NUM-III-7942(h), the rope fleet angle for sheaves shall be limited to $3\frac{1}{2}$ deg, except the last 3 ft of maximum lift elevation, which shall be limited to $4\frac{1}{2}$ deg. Refer to Fig. NUM-I-7942-2 for fleet angle measurement to the sheaves.

NUM-I-7942.1 Sheaves

(16)

NUM-I-7942.2 Drums


(a) Provisions shall be made to retain the drum and the load in the event of drum shaft or bearing failure.

(b) *Type IB.* As an alternative to (a) above, the drum shaft and bearings shall be designed for twice the rated load.

NUM-I-7942.3 Reeving

(a) *Type IB.* The reeving system may have a single load path design, using either a single or double reeving arrangement. See Fig. NUM-I-7942.3-1 for an example.

(16)

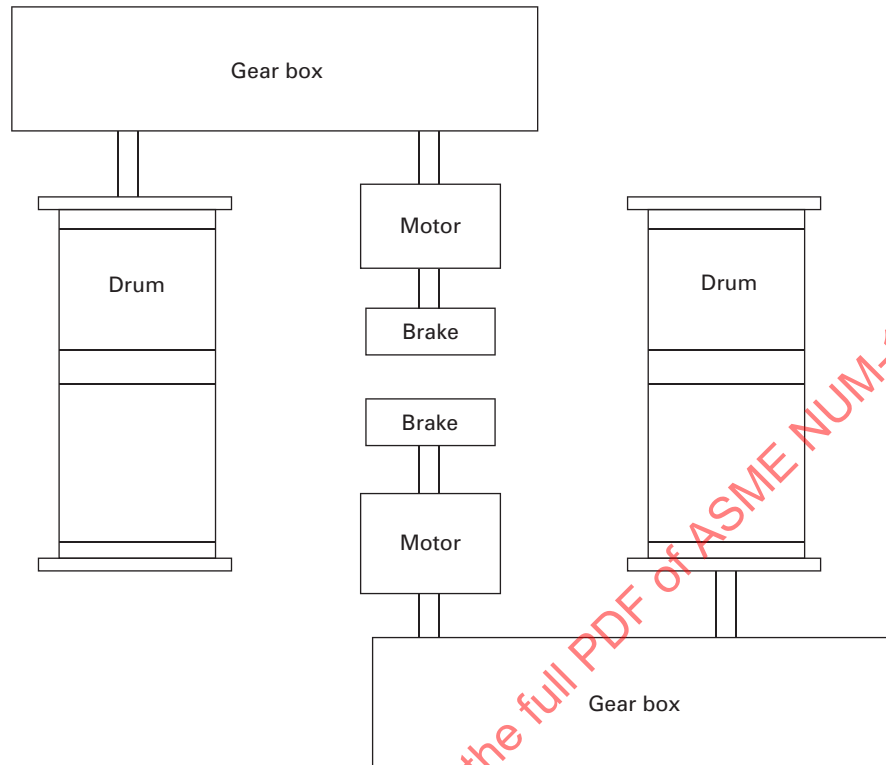Fig. NUM-I-7931-3 Type IA Dual Hoist Drive Unit With Dual Drum

GENERAL NOTE: This figure is a block diagram provided to show conceptual layouts only. The machinery together with the reeving arrangement shall comply with the vertical alignment requirements in NUM-I-7942.3(b).

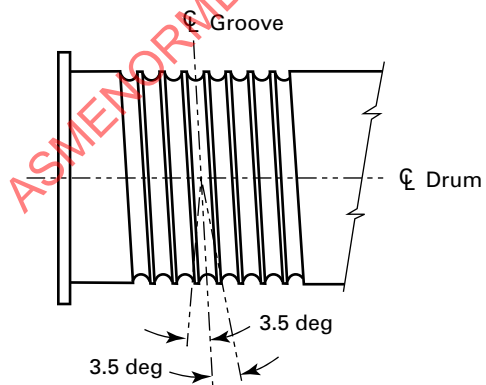
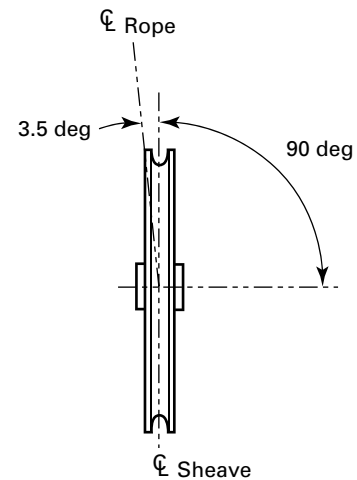
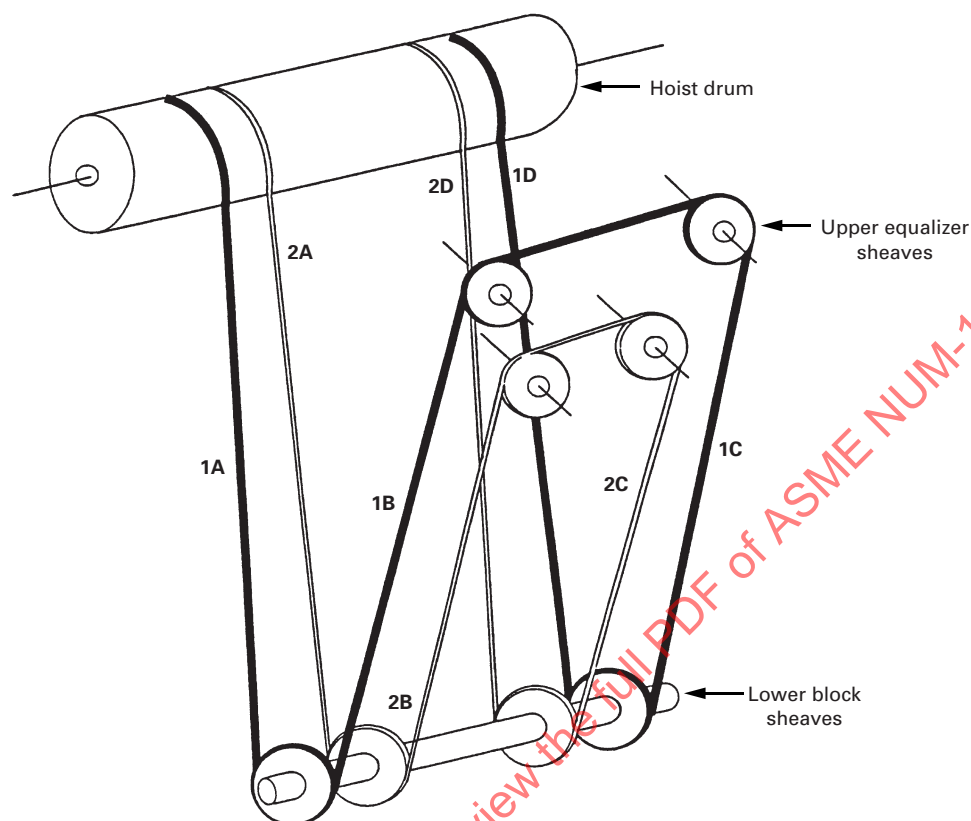
Fig. NUM-I-7942-1 Drum Fleet Angle**Fig. NUM-I-7942-2 Sheave Fleet Angle**

Fig. NUM-I-7942.3-1 Type IA Redundant Reeving With Single Drum (With Upper Equalizer Sheaves)

GENERAL NOTE: Relative position of sheaves is extended and angle of view is distorted to clarify reeving paths. An equalizer system between the two ropes is required but is not shown for clarity. The machinery together with the reeving arrangement shall comply with the vertical alignment requirements in NUM-I-7942.3(b).

(b) *Type IA*. The reeving system shall be divided into two separate (redundant) load paths so that either path will support the load and maintain vertical alignment in the event of rope breakage or failure in the rope system. See Figs. NUM-I-7942.3-1, NUM-I-7942.3-2, and NUM-I-7942.3-3 for examples of Type IA reeving systems. These figures show three of many acceptable configurations.

NUM-I-7942.4 Equalizer Systems (Type IA). Equalizer systems shall be able to withstand the dynamic forces from load transfer upon failure of one wire rope and shall not load the remaining intact reeving system more than 40% of the breaking strength of the wire rope.

NUM-I-7942.5 Equalizer Systems (Type IB). The equalizer for a Type IB reeving system, when provided, may be a sheave or a bar and shall be designed for twice the rated load.

(16) **NUM-I-7945 Hoist Gearing**

(a) *Type IB*. In lieu of the requirements stated in NUM-III-7945(a)(1) for gearing and associated shafts,

keys, and couplings or other connection means, the strength and durability shall be based on twice the torque required to lift the rated load.


(b) *Type IA*. Gearing and associated shafts and couplings or other connection means shall be redundant (i.e., provide two separate load paths from the hoist brakes to the wire rope drum) with each independent gear train rated at full hoisting horsepower. As an alternative, a single hoist gear train may be provided in conjunction with two holding brakes, one of which shall act directly on the wire rope drum and set automatically upon failure or overspeed of the hoist drivetrain.

NUM-I-7946 Hoist Brakes


NUM-I-7946.1 Power-Operated Hoists

(a) In lieu of NUM-III-7946.1(a), the braking system shall consist of at least two holding brakes and a control braking means and shall perform the following functions:

(1) stop hook motion and hold the load when the controls are released

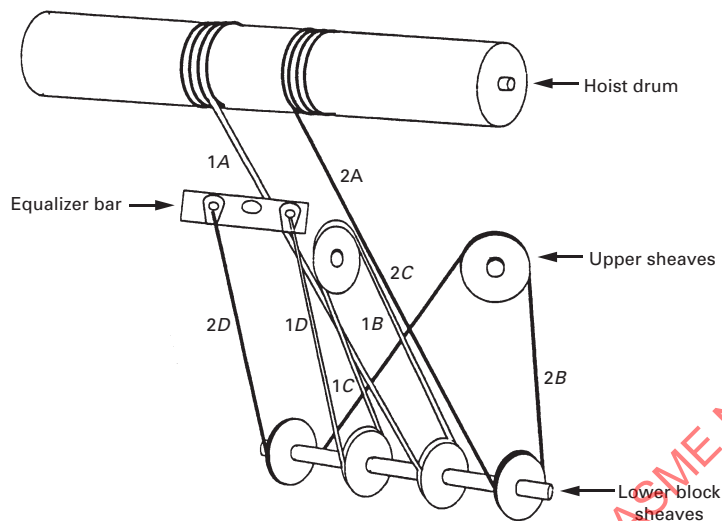Fig. NUM-I-7942.3-2 Type IA Redundant Reeving With Single Drum (With Equalizer Bar)

GENERAL NOTE: Relative position of sheaves is extended and angle of view is distorted to clarify reeving paths. The machinery together with the reeving arrangement shall comply with the vertical alignment requirements in NUM-I-7942.3(b).

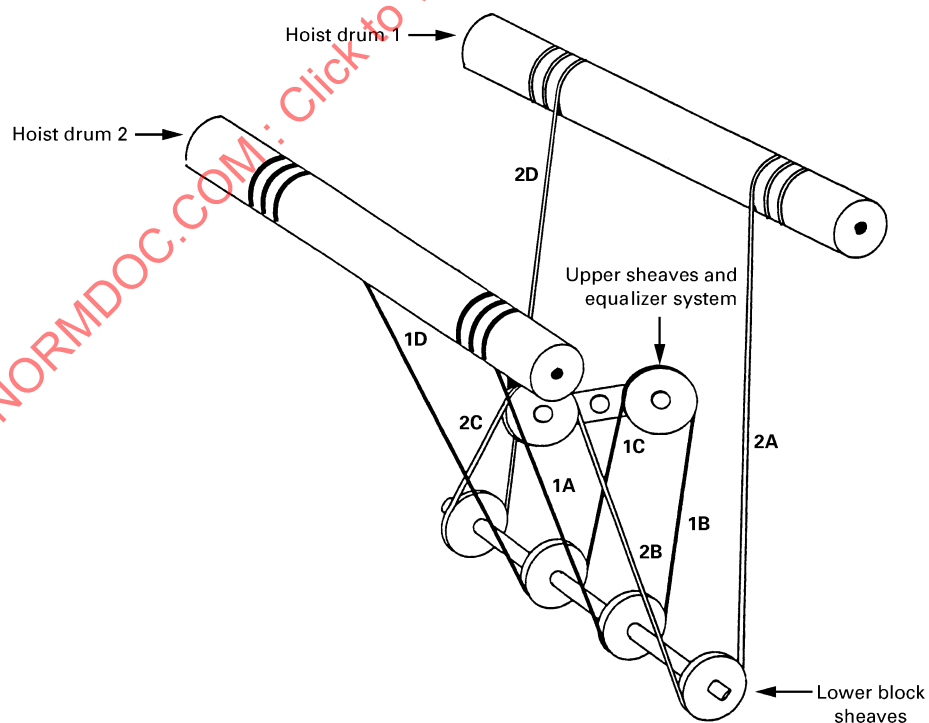Fig. NUM-I-7942.3-3 Type IA Redundant Reeving With Dual Drum

GENERAL NOTE: Relative position of sheaves is extended and angle of view is distorted to clarify reeving paths. The machinery together with the reeving arrangement shall comply with the vertical alignment requirements in NUM-I-7942.3(b).

(2) limit the speed of the load during lowering to a maximum speed of 120% of rated lowering speed for the rated load

(3) stop and hold the load hook in the event of a complete power failure

(b) In lieu of NUM-III-7946.1(b), each hoist holding brake shall have a torque rating not less than 125% of the full (rated) load hoisting torque at the point of brake application, and shall be capable of stopping the lowering movement within amounts of motion wherein damage to load or facility would not occur. A maximum lowering distance of 3 in. is recommended. Under normal operating conditions, the brakes shall apply automatically on power removal. The application of the second (and any other additional) brake(s) shall be delayed to minimize shock to the hoist drivetrain.

(c) *Type IA.* The braking system shall comply with at least one of the following:

(1) Three or more holding brakes shall be provided for stopping and holding the load, such that after failure of any one holding brake or hoist machinery component, at least two holding brakes remain available for emergency load lowering.

(2) Two brakes, each capable of stopping and holding the load, may be provided if one of them acts directly on the wire rope drum shell or a flange or disk attached thereto, is not the primary stopping and holding brake, and does not set prior to the wire rope drum coming to a complete stop during normal operation. The brake acting on the drum shall have sufficient thermal capability to permit emergency lowering of rated load from normal high hook position to normal low hook position at maximum design full-load lowering speed in one continuous operation, and shall have a torque-modulating method of manual release.

(3) Two brakes, each capable of stopping and holding the load, may be provided if the hoist also has a mechanical or electrical control braking means that prevents the rated load from lowering faster than design maximum lowering speed with power off. The control braking system shall be capable thermally and in all respects of lowering the rated load from normal high hook position to normal low hook position in one continuous operation. One of the two stopping and holding brakes and the control braking means shall remain effectively connected to the hoist drivetrain after failure of the other brake or any component of the hoist machinery.

The design of the brakes and the arrangement of the braking system shall enable recovery from an inoperable brake by repair of the brake in place or replacement of the brake, with rated load on the hoist, or by an alternative recovery means acceptable to the purchaser.

provide control functions on the crane. This subsection includes requirements for control limit devices that activate when the normal operating envelope has been reached and safety-critical limit devices that indicate malfunction, failure, or inadvertent operator action. Additional limit device requirements not addressed in this section shall be incorporated in the specifications.

NUM-I-7947.2 Type I Crane Safety-Critical Limit Devices

(a) This paragraph includes additional requirements for the following safety-critical limit devices:

- (1) final hoist overtravel
- (2) overload limit
- (3) hoist drum wire rope mis-spooling
- (4) hoist overspeed
- (5) equalizer travel

(b) *Manual Reset.* When a safety-critical limit device is activated, a manual reset is required. This may be accomplished by means of a key switch on the crane or some other administrative control that will prevent the crane operator from resetting the affected function before a person knowledgeable in the crane control system shall determine and correct the cause of device activation.

(c) *Safety-Critical Limit Devices.* Safety-critical limit devices shall be in addition to and separate from the limiting means or control devices provided for operation unless independently monitored.

NUM-I-7947.3 Overtravel Protection. In lieu of NUM-III-7947.1(a), power-operated hoists shall have the following:

(a) *First High Limit.* The first upper hoisting limit shall be a control circuit device such as a geared-type, weight-operated, or paddle-operated switch. Actuation of this switch shall result in the removal of power from the motor and setting the hoist brakes. The operator may lower or back out of this tripped switch without further assistance.

(b) *Final Overtravel High Limit.* In addition to the first upper limit switch, a final power circuit hoisting limit switch shall directly remove power from the hoist motor and set the hoist brakes.

(c) If the hoist is designed to withstand two-blocking, only the first high limit switch is required. In this case, the ropes shall not be cut or crushed, nor the hoist damaged in the event of load block overtravel.

(d) *Low Limit.* The hoist shall include an overtravel low limit switch. This switch may be of the control circuit type. Actuation of this switch shall stop the lowering motion and set the hoist brakes. The operation of this switch shall not prevent hoisting.

NUM-I-7947.4 Overload Limiting Devices. Overcapacity lifts shall be detected by means of a load-sensing system. The high-load limit shall be set to prevent lifting of more than the rated load, but to permit lowering. The

(16) NUM-I-7947 Limit Devices

NUM-I-7947.1 General (Types I, II, and III Cranes).

A limit device is defined as a switch or sensing system to

sensing system shall be set at a maximum 125% of the rated load unless analysis determines that greater than 125% is acceptable.

NUM-I-7947.5 Hoist Drum Wire Rope Spooling Monitor. Hoists shall include a wire rope spooling device to detect improper threading of the hoist rope in the hoist drum grooves. Actuation of this device shall result in removal of power from the hoist motor and setting of hoist holding brakes. Actuation of this limit device shall prevent further hoisting. A mechanical rope guide that encompasses the circumference of the drum and provides spooling of the wire rope onto the drum may be used in lieu of a spooling device.

NUM-I-7947.6 Hoist Overload Limits (Type I Cranes)

(a) Electrically operated hoists that handle critical loads shall include an overspeed limit device (switch or sensing system). When handling a critical load, hook speeds greater than 115% of the design critical load-lowering speed shall actuate this device, causing all holding brakes to set without intentional time delay. Operation of this device may also initiate any control braking means normally used for stopping of the load. It shall be necessary to position the hoist motion master switch in the neutral or OFF position and to manually reset the overspeed limit device (or the overspeed circuit) before operation can be resumed.

(b) The overspeed device for wire rope hoists shall be located so that it monitors drum rotation irrespective of a single failure in the drivetrain.

(c) On hoists that provide high-speed, light load features, provisions may be made to permit override of this overspeed limit device when handling noncritical loads.

NUM-I-7947.7 Equalizer Travel Error Indication Device (Type IA). A sensing and signaling means shall be provided to automatically shut down the hoist and provide indication to the operator if displacement between the separate reeving systems exceeds design operating limits.

NUM-I-7949 Motor Shafts (Type IB). Motor shafts for Type IB hoists shall be designed for twice the rated load unless the hoist braking system prevents drop of the load after motor shaft failure.

NUM-I-7950 Electrical (16)

NUM-I-7952 Motors. Hoist motors shall have phase loss and phase reversal protection. (16)

NUM-I-7952.1 Variable-Frequency Drive (VFD) Hoist Controls. Hoists shall have controls with the following capabilities:

(a) A warning device shall be provided to warn the operator of a pending motor overheat condition.

(b) A warning device shall be provided to warn the operator that the dynamic braking resistors have overheated.

NUM-I-7970 Hoist Marking (16)

(a) For Type I hoists, the maximum critical load rating (MCL) shall be marked on the hoist or load block in lieu of the rated load as identified in NUM-III-7970(a), using the terminology MCL as part of the marking.

(b) For Type I hoists that lift loads in excess of the MCL, the terminology DRL (design rated load) shall be used and shall also be marked on either the hoist or hoist load block.

Section NUM-I-8000

Common Requirements and Criteria

NUM-I-8200 STRUCTURAL

NUM-I-8210 General

The base materials listed in Table NUM-I-8210-1 are considered acceptable for the structural components. The manufacturer shall list all structural materials actually employed for the owner and shall provide the materials tests and certifications as required in Tables NUM-I-8210-2 and NUM-I-8210-3. Structural materials not listed in Table NUM-I-8210-1 may be acceptable with approval by the owner.

(16) NUM-I-8212 Description of Loads

NUM-I-8212.4 Extreme Environmental Loads. In lieu of NUM-II-8212.4(b), for Type I equipment, the seismic lifted load for a safe-shutdown earthquake (SSE) is the maximum lifted load under the evaluated seismic conditions where the crane or monorail structure and hoist and trolley unit must remain in place and retain the load. This lifted load is critical. The owner shall specify the seismic lifted load.

NUM-I-8300 MECHANICAL

(16) NUM-I-8320 Design and Performance Criteria

NUM-I-8323 Seismic Analysis

NUM-I-8323.1 Criteria. In addition to the criteria in NUM-II-8323.1, analysis shall be performed to ensure retention of the load during the seismic event.

NUM-I-8330 Component Design

NUM-I-8331 Bridge Drives (Type IA). Single failure-proof features are generally not required for bridge travel systems. However, in those cases where failure of a component could result in an owner-specified facility-unacceptable motion, the design shall incorporate single failure-proof features to ensure that the bridge is brought to a safe stop.

(16) NUM-I-8332 Bridge Brakes

NUM-I-8332.1 Emergency and Parking Brakes. Emergency and parking brakes shall be provided for bridge drives and for jib crane slew drives. Any combination of service, emergency, and parking functions may be performed by a single friction brake, provided the emergency and parking functions can be obtained without having power available.

NUM-I-8333 Bumpers. In lieu of NUM-III-8333.1(a), bumpers shall be provided.

NUM-I-8340 General Mechanical Components (16)

NUM-I-8345 Key and Keyway Design for Power Transmission and Braking. This section is applicable to hoist, bridge, and trolley drive components. (16)

(a) Keyed shaft-hub connections shall be used for power transmission in hoist drive systems. Keyless connections per AGMA 9003 or AGMA 9103, as applicable, may be used for power transmission in bridge and trolley drive systems.

(b) Keys used in hoist drives shall be of the parallel, square, or rectangular type only.

(c) The following maximum allowable stresses shall be determined using the rated torque of the driving motor or braking torque during normal operation, whichever is greater. The allowable stress for surface hardened components shall be based on their individual material properties at the core.

(1) *Compressive Bearing Stress* (σ_c , lb/in.²). The key, shaft, and hub compressive bearing stresses shall satisfy the following requirement:

(-a) For torque-reversing drive systems (i.e., trolley and bridge)

$$\sigma_c = \frac{T}{r_{ac}A_c} \leq \frac{S_y}{3} \quad (1)$$

(-b) For nonreversing systems

$$\sigma_c = \frac{T}{r_{ac}A_c} \leq \frac{S_y}{2} \quad (2)$$

where

A_c = compressive area of key in contact with shaft or hub, in.². Compressive area shall not include chamfers or key-end radii.

r_{ac} = average radius at compressive load area, in.

S_y = the minimum tensile yield strength of key, shaft, or hub material at the keyway section. The allowable stress for surface hardened components shall be based on their individual material properties at the core, psi

T = shaft torque, lb in.

Table NUM-I-8210-1 Acceptable Materials and Reference Properties for Structural Components

(16)

ASTM Specification	Grade or Class	Form	Size [Note (1)]	Yield Strength, ksi	Tensile Strength, ksi
A36	...	Plates, shapes, and bars	Plates and bars < 8 in. and shapes [for shapes, see Note (2)]	36 min.	58–80
A53	B	Pipe	Diameters ≤ 26 in.	35 min.	60 min.
A242	...	Plates, shapes, and bars	Plates and bars ≤ 3/4 in.; and shapes with flange or leg thickness ≤ 1 1/2 in.	50 min.	70 min.
A242	...	Plates, shapes, and bars	Plates and bars > 3/4 in. and ≤ 1 1/2 in.; and shapes with flange thickness > 1 1/2 in. and ≤ 2 in.	46 min.	67 min.
A242	...	Plates, shapes, and bars	Plates and bars > 1 1/2 in. and ≤ 4 in.; and shapes with flange thickness > 2 in.	42 min.	63 min.
A333	3 and 7	Pipe	Diameters ≤ 26 in.	35 min.	65 min.
A333	4 and 6	Pipe	Diameters ≤ 26 in.	35 min.	60 min.
A500	B	Rectangular tubing	Wall ≤ 5/8 in. and periphery ≤ 64 in. [Note (3)]	46 min.	58 min.
A501	...	Tubing	Square and rectangular with sides ≤ 10 in. and wall ≤ 1 in.; and round ≤ 24 in. diameter and wall ≤ 1 in.	36 min.	58 min.
A516	65	Plates	Thickness ≤ 8 in.	35 min.	65–85
A516	70	Plates	Thickness ≤ 8 in.	38 min.	70–90
A537	1	Plates	Thickness ≤ 2 1/2 in.	50 min.	70–90
A537	1	Plates	Thickness > 2 1/2 in. and ≤ 4 in.	45 min.	65–85
A537	2	Plates	Thickness ≤ 2 1/2 in.	60 min.	80–100
A537	2	Plates	Thickness > 2 1/2 in. and ≤ 4 in.	55 min.	75–95
A537	2	Plates	Thickness > 4 in. and ≤ 6 in.	46 min.	70–90
A537	3	Plates	Thickness ≤ 2 1/2 in.	55 min.	80–100
A537	3	Plates	Thickness > 2 1/2 in. and ≤ 4 in.	50 min.	75–95
A537	3	Plates	Thickness > 4 in. and ≤ 6 in.	40 min.	70–90
A572	42	Plates, shapes, and bars	Plates and bars ≤ 6 in.; and shapes	42 min.	60 min.
A572	50	Plates, shapes, and bars	Plates and bars ≤ 4 in.; and shapes	50 min.	65 min.
A572	55	Plates, shapes, and bars	Plates and bars ≤ 2 in.; and shapes	55 min.	70 min.
A572	60	Plates, shapes, and bars	Plates and bars ≤ 1 1/4 in.; and shapes with flange or leg thickness ≤ 2 in.	60 min.	75 min.
A572	65	Plates, shapes, and bars	Plates and bars ≤ 1 1/4 in.; and shapes with flange or leg thickness ≤ 2 in.	65 min.	80 min.
A588	...	Plates, shapes, and bars	Plates and bars < 4 in.; and shapes	50 min.	70 min.
A588	...	Plates, shapes, and bars	Plates and bars > 4 in. and ≤ 5 in.	46 min.	67 min.
A588	...	Plates, shapes, and bars	Plates and bars > 5 in. and ≤ 8 in.	42 min.	63 min.
A618	IA, IB, and II	Tubing	Wall ≤ 3/4 in.	50 min.	70 min.
A618	IA, IB, and II	Tubing	Wall > 3/4 in. and ≤ 1 1/2 in.	46 min.	67 min.
A618	III	Tubing	All tubing	50 min.	65 min.
A633	A	Plates	Thickness ≤ 4 in.	42 min.	63–83
A633	C and D	Plates	Thickness ≤ 2 1/2 in.	50 min.	70–90
A633	C and D	Plates	Thickness > 2 1/2 in. and ≤ 4 in.	46 min.	65–85
A633	E	Plates	Thickness ≤ 4 in.	60 min.	80–100
A633	E	Plates	Thickness > 4 in. and ≤ 6 in.	55 min.	75–95
A709	36	Plates, shapes, and bars	Plates and bars ≤ 4 in.; and shapes [for shapes, see Note (2)]	36 min.	58–80
A709	50	Plates, shapes, and bars	Plates and bars ≤ 4 in.; and shapes	50 min.	65 min.
A709	50W	Plates, shapes, and bars	Plates and bars ≤ 4 in.; and shapes	50 min.	70 min.
A737	B	Plates	Thickness ≤ 2 1/2 in.	50 min.	70–90
A737	C	Plates	Thickness ≤ 2 1/2 in.	60 min.	80–100
A913	50	Shapes	All shapes	50 min.	65 min.
A913	60	Shapes	All shapes	60 min.	75 min.
A913	65	Shapes	All shapes	65 min.	80 min.
A913	70	Shapes	All shapes	70 min.	90 min.
A992	...	Shapes	All shapes [Note (5)]	50–65	65 min.
[Note (4)] A992 [Note (4)]	...	Patented shape track	...	...	...

Table NUM-I-8210-1 Acceptable Materials and Reference Properties for Structural Components (Cont'd)

GENERAL NOTE: The above data was obtained from the ASTM 2007 publication.

NOTES:

- (1) For additional material information, see the referenced ASTM specification.
- (2) For wide flange shapes with flange thickness over 3 in., the 80 ksi maximum tensile strength does not apply.
- (3) The exceptions from fracture toughness requirements in NUM-I-8510 [Tables NUM-I-8210-2 and NUM-I-8210-3; Note (4)] do not apply to this material.
- (4) Mechanical properties, standard sizes, and design/selection criteria or patented shape track are under the auspices of the individual manufacturers. Patented shape track is comprised of an upper T-section (compression member) of standard structural steel and a lower load-carrying T-section (tension member) of high-strength alloy steel. The two sections are welded continuously from both sides, web-to-web. Patented shape track is also used for crane bridge girders and jib crane booms with under-running trolleys or hoists with integral trolleys.
- (5) The yield strength to tensile strength ratio shall not exceed 0.85.

(2) *Shear Stress* (τ). The key shear stress shall satisfy the following requirements:

$$\tau = \frac{T}{r_a A_s} \leq \frac{S_y}{3\sqrt{3}} \quad (3)$$

where

A_s = shear area, in.²

r_a = average shaft radius along length of key, in.

(d) The following maximum allowable stress shall be determined using extreme environmental loads per NUM-I-8212.4.

The key shear stress, τ_e , shall satisfy the following requirement:

$$\tau_e = \frac{T}{r_a A_s} \leq \frac{0.75 S_y}{\sqrt{3}} \quad (4)$$

(e) The following maximum allowable stresses shall be determined using momentary peak loads:

The key shear stress, τ_{ce} , shall satisfy the following requirement:

$$\tau_{ce} = \frac{T}{r_a A_s} \leq \frac{0.9 S_y}{\sqrt{3}} \quad (5)$$

(1) For torque-reversing drives, the key, shaft, and hub compressive stresses, σ_{ce} , shall satisfy the following requirement:

$$\sigma_{ce} \leq 0.75 S_y$$

(2) For nonreversing drives, the key, shaft, and hub compressive stresses, σ_{ce} , shall satisfy the following requirement:

$$\sigma_{ce} \leq 0.9 S_y$$

(f) *Interference Fit*. The key and keyway shall be designed to transmit the total design torque with no allowance or credit applied for any interference fit between the components.

(g) *Keyway*. The design shall provide positive retention of the key. The bottom of the keyway in the hub and shaft shall be filleted per AGMA 9002 or AGMA 9112 as applicable.

NUM-I-8400 ELECTRICAL

NUM-I-8420 Electrical Components

(16)

NUM-I-8423 Brakes

NUM-I-8423.1 Parking brakes shall be automatically applied. When two friction brakes are used on a single drive, a time delay means shall be provided to prevent simultaneous application of both brakes.

NUM-I-8424 Disconnects and Protective Devices.

Control shall include a separate disconnecting means for each crane/jib motion.

NUM-I-8427 Conductor System Design

(a) Bridge and runway conductors shall use a separate ground conductor.

(b) Bridge and runway contact conductors shall use tandem collectors.

NUM-I-8500 INSPECTION AND TESTING

NUM-I-8510 General

This section, combined with NUM-II-8500 and NUM-III-8500, provides the inspection and testing requirements for all Type I equipment.

NUM-I-8520 Inspection by Seller Prior to and During Manufacture

NUM-I-8521 Structural

NUM-I-8521.1 Test and Acceptance Criteria. The following identifies the specific criteria for the inspections and tests specified by Tables NUM-I-8210-2 and NUM-I-8210-3:

(a) Welding

(1) All structural welds shall be visually inspected over their entire lengths. Acceptance criteria of welds and repairs shall be in accordance with AWS D1.1. Non-destructive testing of groove welds shall be in accordance with Tables NUM-I-8210-2 and NUM-I-8210-3.

Table NUM-I-8210-2 Required Inspections or Tests (Type IA)

Items	Material Test Reports	Certificate of Conformance From Manufacturer	NDE of Welds [Note (1)]	UT [Note (2)]	Surface MP or PT [Note (3)]	Impact Test [Note (4)]	Proof Load Test [Note (5)]	Breaking Strength Test [Note (6)]	Weld Filler Material C.C. Typical Value	Welder Certs
Hook [Note (7)]	X	...	...	X	X	...	X	...	...	...
Hook nut or attachment device [Note (8)]	X	...	...	X	X	...	X	...	...	...
Hook trunnion cross head and load block load structure (cast or forged)	X	...	...	X	X	...	...	...	...	...
Hook trunnion cross head and load block load structure (rolled)	X	...	...	...	...	X	X	...	...	...
Load block structural welds	...	...	X	...	...	...	...	...	X	X
Load block sheave pin	X	...	...	X	X	...	...	...	...	...
Load chains	...	X	...	...	...	...	...	X	...	...
Wire rope	...	X	...	...	...	...	...	X	...	...
Hoist drum	X	...	...	...	...	...	...	...	...	...
Hoist drum shell and hub welds	...	...	X	...	...	...	...	...	X	X
Hoist drum shafts	X	...	...	X	X	...	...	...	...	...
Upper block sheave pin	X	...	...	X	X	...	...	...	...	...
Upper block load structure (cast or forged)	X	...	...	X	X	...	...	...	...	...
Upper block load structure (rolled)	X	...	...	...	X	X	...	...	...	...
Upper block structural welds	...	...	...	...	...	...	...	...	X	X
Sheaves	...	...	X	...	...	...	...	...	...	...
Gears — hoists [Note (9)]	...	X	...	...	...	...	...	...	...	...
Pinions — hoist [Note (9)]	X	...	...	X	X	...	...	...	...	...
Shafts — hoist [Note (9)]	X	...	...	X	X	...	...	...	...	...
Trolley load girt structure (cast or forged)	X	...	...	X	X	...	...	...	...	...
Trolley load girt structure (rolled)	X	...	X	...	...	X	...	...	X	X
Primary load-bearing structural welds (crane or monorail)	...	...	X	...	...	...	...	...	X	X

Table NUM-I-8210-2 Required Inspections or Tests (Type IA) (Cont'd)

Items	Material Test Reports	Certificate of Conformance From Manufacturer	NDE of Welds [Note (1)]	UT [Note (2)]	Surface MP or PT [Note (3)]	Impact Test [Note (4)]	Proof Load Test [Note (5)]	Breaking Strength Test [Note (6)]	Weld Filler Material C.C. Typical Value	Welder Certs
Fastener material for structural interconnections (including seismic restraints and safety lugs)	X	X	...	...	...	...	...	...	...	...
Crane or monorail structure	X	...	...	...	...	X	...	...	...	...
Bridge and trolley seismic restraints	X	...	X	...	...	X	...	...	X	X
Safety lugs	X	...	...	...	...	X	...	...	X	X
Hinges or pins on jib cranes [Note (10)]	X	...	...	X	X	...	...	...	...	...
Tension rods for jibs or monorails	X	...	...	X	X	...	...	...	...	...
[Note (10)]										
Wire rope eyes and sockets [Note (11)]	...	X	...	...	...	...	X	...	...	...

NOTES:

- (1) See NUM-I-8521.1(a).
- (2) See NUM-I-8521.1(c).
- (3) See NUM-III-8522.1.2(b).
- (4) Impact testing required for materials greater than $\frac{5}{8}$ in. thickness. See NUM-I-8521.1(b).
- (5) See NUM-I-8522.1.1.
- (6) See NUM-I-8522.2.
- (7) See NUM-I-8522.1.
- (8) Load tested with hook. See NUM-I-8522.1.1.
- (9) Surface hardness shall be verified when hardness values are specifically listed on manufacturer's design documents.
- (10) If the item is designed with double a design margin, material test reports are not required.
- (11) Proof tested to 40% of the published breaking strength of the wire rope.

Table NUM-I-8210-3 Required Inspections or Tests (Type IB)

Items	Material Test Reports	Certificate of Conformance From Manufacturer	NDE of Welds [Note (1)]	UT [Note (2)]	Surface MP or PT [Note (3)]	Impact Test [Note (4)]	Proof Load Test [Note (5)]	Breaking Strength Test [Note (6)]	Weld Filler Material C.C. Typical Value	Welder Certs
Hook [Note (7)]	X	...	...	X	X	...	X	...	...	...
Hook nut or attachment device [Note (8)]	X	...	...	X	X	...	X	...	...	...
Hook trunnion cross head and load block load structure (cast or forged) [Note (9)]	...	...	...	...	...	...	X	...	...	...
Hook trunnion cross head and load block load structure (rolled) [Note (9)]	...	...	...	...	...	...	X	...	...	...
Load block structural welds	...	...	X	...	...	...	...	...	...	...
Load block sheave pin [Note (9)]	...	...	...	...	...	...	X	...	...	...
Load chains	...	X	...	...	...	...	...	X	...	...
Wire rope	...	X	...	...	...	...	...	X	...	...
Hoist drum [Note (9)]	...	...	...	...	...	...	...	...	...	...
Hoist drum shell and hub welds	...	...	X	...	...	...	...	...	...	...
Hoist drum shafts [Note (9)]	...	...	...	...	...	...	X	...	...	...
Upper block sheave pin [Note (9)]	...	...	...	...	...	...	X	...	...	...
Upper block load structure	...	...	...	...	...	...	X	...	...	...
(cast or forged) [Note (9)]	...	...	...	...	...	...	X	...	...	...
Upper block load structure (rolled) [Note (9)]	...	...	...	...	...	...	X	...	...	...
Upper block structural welds	...	...	X	...	...	...	...	...	...	...
Sheaves [Note (9)]	...	...	...	...	...	...	X	...	...	...
Gears — hoist [Note (9)]	...	...	...	...	...	...	X	...	...	...
Pinions — hoist [Note (9)]	...	...	...	...	...	...	X	...	...	...
Shafts — hoist [Note (9)]	...	...	...	...	...	...	X	...	...	...
Hoisting machinery load path welds	...	...	X	...	...	...	X	...	...	...
Hoist assembly [Note (10)]	...	...	...	...	...	...	X	...	...	...
Trolley load girt structure	X	...	...	X	X	...	...	...	...	...
(cast or forged) [Note (11)]	...	...	...	...	...	...	...	...	...	...
Trolley load girt structure (rolled) [Note (11)]	X	...	X	...	...	X	...	...	X	X
Primary load-bearing structural welds (crane or monorail)	...	...	X	...	...	...	...	...	X	X

Table NUM-I-8210-3 Required Inspections or Tests (Type IB) (Cont'd)

Items	Material Test Reports	Certificate of Conformance From Manufacturer	NDE of Welds [Note (1)]	UT [Note (2)]	Surface MP or PT [Note (3)]	Impact Test [Note (4)]	Proof Load Test [Note (5)]	Breaking Strength Test [Note (6)]	Weld Filler Material C.C. Typical Value	Welder Certs
Fastener material for structural interconnections (including seismic restraints and safety lugs)	X	X	...	...	...	...	...	...	...	...
Crane or monorail structure	X	...	...	...	...	X	...	...	...	...
Bridge and trolley seismic restraints	X	...	X	...	...	X	...	...	X	X
Safety lugs	X	...	X	...	...	X	...	...	X	X
Hinges or pins on jib cranes [Note (12)]	X	...	...	X	X	...	...	...	...	...
Tension rods for jibs or monorails [Note (12)]	X	...	...	X	X	...	...	...	...	...
Wire rope eyes and sockets [Note (13)]	...	X	...	...	...	...	X	...	...	...

GENERAL NOTE: Surface hardness shall be verified when hardness values are specifically listed on manufacturer's design documents.

NOTES:

- (1) See NUM-I-8521.1(a).
- (2) See NUM-I-8521.1(c).
- (3) See NUM-III-8522.1.2(b).
- (4) Impact testing required for materials greater than $\frac{1}{8}$ in. thickness. See NUM-I-8521.1(b).
- (5) See NUM-I-8522.1.1.
- (6) See NUM-I-8522.2.
- (7) See NUM-I-8522.1.
- (8) Load tested with hook. See NUM-I-8522.1.1.
- (9) To be proof tested with the hoist assembly.
- (10) Proof test assembled hoist at 250% of rated crane or monorail capacity.
- (11) In lieu of stated requirements, a 250% load test may be performed with a visual weld inspection.
- (12) If the item is designed with double a design margin, material test reports are not required.
- (13) Proof tested to 40% of the published breaking strength of the wire rope.

(2) Magnetic particle test (MP) or dye penetrant test (PT) shall be performed on 10% of the length of each weld that exceeds 10 in. in length unless stated otherwise in this Standard. Technique and acceptance criteria shall be in accordance with AWS D1.1.

(3) Welders and welding procedures shall be qualified or prequalified in accordance with AWS D1.1.

(b) Drop weight test shall be per ASTM E208 or Charpy impact test shall be per ASTM A370.

(c) *UT Volumetric Test*

(1) UT volumetric testing and acceptance criteria shall be in accordance with ASTM A435 for plate material.

(2) UT volumetric testing shall be in accordance with ASTM E114 and ASTM A388 for wrought or forged material.

(-a) Acceptance criteria for forged material shall be in accordance with the following:

(-1) *Straight Beam.* A forging or bar shall be unacceptable if the results of straight beam examinations show one or more reflectors that produce indications accompanied by a complete loss of back reflection not associated with or attributable to geometric configurations. Complete loss of back reflection is assumed when the back reflection falls below 5% of full calibration screen height.

(-2) *Angle-Beam Rule.* A forging or bar shall be unacceptable if the results of angle-beam examinations show one or more reflectors that produce indications exceeding the amplitude reference line from the appropriate calibration notches.

(-b) Acceptance criteria for material without parallel surfaces (e.g., sheave pins and shafts) shall be in accordance with NUM-I-8522.1.2(b)(2).

NUM-I-8522 Mechanical

NUM-I-8522.1 Hooks

NUM-I-8522.1.1 Proof Load Test. A proof load test, including dimensional inspection, shall be performed on the hook(s) in accordance with ASME B30.10 prior to assembly on the hoist.

NUM-I-8522.1.2 Nondestructive Examination (NDE)

(a) After the proof load test, surface NDE shall be performed on the hook and its shank, bolt, and nut as outlined in NUM-III-8522.1.2.

(b) After forging or casting, hook(s) shall be UT volumetric tested in accordance with ASTM E114 and ASTM A388 for wrought or forged material.

(1) Acceptance criteria for forged material shall be in accordance with section NUM-I-8521.1(c).

(2) Acceptance criteria for the tensioned area of the hook(s) shall be in accordance with the following:

(-a) Discontinuity indications in excess of the response from a $\frac{1}{8}$ -in.-diameter flat-bottomed hole at the estimated discontinuity depth shall not be acceptable.

(-b) Discontinuity indications in excess of the response from a $\frac{3}{32}$ -in.-diameter flat-bottomed hole at the estimated discontinuity depth shall not have their indicated centers closer than 1 in.

(-c) Elongated (stringer) type defects in excess of 1 in. in length shall not be acceptable if at any point along the length the discontinuity indication is equal to or greater than the response from a $\frac{3}{32}$ -in.-diameter flat-bottomed hole.

NUM-I-8522.2 Wire Rope and Chain

NUM-I-8522.2.1 Wire Rope. A segment of the wire rope shall be pull tested. Breaking strength shall meet or exceed published breaking strength in accordance with the Wire Rope Users Manual.

Where end fittings are used in the design of the load path, at least one identical fitting shall be tested with the rope sample being pulled to failure. During the testing, failure shall occur in the rope, not the crimp or fitting.

NUM-I-8522.2.2 Chain. A segment of the load chain shall be pull tested. Breaking strength shall meet or exceed published breaking strength in accordance with Federal Specification RR-C-271 or the chain manufacturer's published data.

NUM-I-8523 Electrical

NUM-I-8523.1 Visual. Inspections shall be performed at the crane, monorail, or hoist manufacturer's plant (or during field erection if not possible to perform at the plant) to verify the following:

- (a) terminal connections for tightness
- (b) panels and resistors are properly placed
- (c) required fuses are installed
- (d) panels, switches, resistors, and other parts and materials are in accordance with drawings and are properly identified
- (e) raceways are properly supported and installed, and raceways to be removed for shipment are properly marked and fitted for field reinstallation
- (f) no interferences involving electrical items exist when trolley moves through its full range
- (g) electrical items do not protrude beyond the confines of the crane, monorail, or hoist as established by the drawings
- (h) electrical items requiring routine maintenance are accessible
- (i) no wiring is touching resistor heating parts
- (j) portions of conductor systems that are designed to move in order to accommodate crane, monorail, or hoist move freely
- (k) pendant and festoon cable strain relief is properly installed
- (l) overload relay current sensing elements are in accordance with drawings
- (m) motor connections are properly made

(n) contactors and electromechanical relays whose armatures are accessible operate freely by hand

(o) electrical enclosures are correct NEMA type, and panel door operates properly

(p) motor brushes are properly seated

(q) electrical holding brakes are adjusted to correct torque settings

(r) conductors are identified at each termination and correspond to the schematic diagrams

NUM-I-8524 Control Software. Desk audits, peer reviews, and static analysis tools/techniques shall be used throughout the development process to verify implementation of design requirements in the source code, with particular attention paid to the implementation of identified safety-critical functions such as fault detection and safing or correcting logic.

NUM-I-8530 Shop Operational Tests

A shop no-load test shall be performed at the crane/hoist manufacturer's facility. Procedures shall be prepared and used by the manufacturer in conducting the test. If subsequent manufacturing or associated activities affect the validity of this test or portions thereof, the appropriate portions of the test shall be repeated. Non-conformances found during the testing shall be treated as required by the test procedure.

(16) NUM-I-8532 Testing

NUM-I-8532.1 Mechanical Requirements. As a minimum, the following mechanical functions shall be verified:

(a) Traverse the trolley on the bridge, verify interfaces of auxiliary equipment (powered operation is preferred).

(b) Operation of mechanical components shall be verified to meet design criteria.

(c) (Type IA) Type IA hoists shall be two-blocked at maximum hoisting speed to demonstrate that the equipment is capable of withstanding high-speed two-blocking and load hangup without damage and within allowable stress limits in accordance with NUM-I-7930.

NUM-I-8532.2 Electrical Requirements. A test of the crane/hoist electrical system shall be made to verify proper operation of the controls. For remote-controlled cranes/hoists, the transmitter-receiver system shall be used for this test.

NUM-I-8532.3 Software Requirements. For programmable logic controller (PLC) controlled cranes/hoists, the PLC software shall be installed and used during the test. Software testing (either breadboard or as part of the crane/hoist testing) shall include the following, as a minimum:

(a) hardware, software, and operator input failure mode testing

(b) boundary, out-of-bounds, and boundary-crossing test conditions

(c) input values of zero, zero crossing, and approaching zero from either direction

(d) minimum and maximum input data rates in worst-case configurations to determine system capabilities and responses to these environments

NUM-I-8580 Site Load Testing

NUM-I-8582 No-Load Testing

NUM-I-8582.1 Additional Requirements. While the no-load testing is being performed, the following information shall be recorded or observed:

(a) Electrical (full-speed conditions)

(1) motor volts

(2) motor amps

(3) motor rpm

(b) Mechanical

(1) noise levels

(2) oil leaks

(3) excessive vibration

(4) clearances per drawings and specifications

(5) gear alignment and engagement

(6) wire rope or chain condition

(c) Structural

(1) overall building clearances

(2) bridge and trolley end approaches

(d) All software faults

(e) Components, systems, and features having single failure-proof functions related to retaining the load in event of failure in the primary load path are functioning correctly and are properly adjusted and calibrated

NUM-I-8583 Full-Load Test The crane/hoist/monorail shall be statically loaded at bridge midspan (or end of boom) to 100% (+5%, -0%) of hoist manufacturer's rating, and the deflection of the bridge (at its center) or monorail rail (at its center) or boom (at its end) shall be measured and recorded. With this load, the crane/hoist/monorail shall be operated through all drives for hoist, trolley, and bridge/boom, and through all speed ranges to demonstrate speed controls and proper function of limit switches, locking, and safety devices as practical with full load. Manually operated load-lowering devices, if supplied, shall be tested. Each holding brake shall be tested individually to verify it will stop and hold the test load.

NUM-I-8584 Rated-Load Test After the no-load and full-load tests are completed and prior to handling loads, the equipment shall be rated load tested.

(a) The crane, monorail, or hoist shall receive a load test of 125% (+5%, -0%) of the rated capacity.

(b) The test shall consist of the following operations, as a minimum:

(1) Lift the test load approximately 2 ft and hold the load for a minimum of 10 min to verify no drum rotation and test weight drift.

(2) The hoist overload-detection devices shall be tested to verify that they activate when the test weight is greater than 125% of rated load.

(3) Perform loss-of-power test by interrupting the main electrical power or air supply while lowering the test load at slow speed to verify that the holding brakes (and emergency brakes, if applicable) set and hold the load.

(4) Transport the load by means of the trolley (or carrier) from one end of the crane bridge, jib, or monorail to the other. The trolley shall approach the limits of travel as close as practical if use area restrictions are imposed.

(5) For bridge and gantry cranes, transport the test load for the full length of the runway in one direction with the trolley as close to the extreme right-hand end of the crane as practical, and in the other direction with the trolley as close to the left-hand end of the crane

as practical. When cranes operate on more than two runways (multiple-track cranes), the crane shall transport the test load for the full length of the runway with the test load under each of the intermediate tracks.

(6) Verify that the nameplate reflects the load rating per NUM-I-8584(a).

(7) For jib cranes, verify that there is jib boom motion with the trolley located at each end and at the center of the boom.

NUM-I-8600 HOIST MARKING

(a) For Type I bridge cranes, wall cranes, jib cranes, and monorails, the maximum critical load rating (MCL) shall be marked on the bridge beam, jib boom, or monorail in lieu of the rated load as identified in NUM-I-8584(a), using the terminology MCL as part of the marking.

(b) For Type I bridge cranes, wall cranes, jib cranes, and monorails that lift loads in excess of the MCL, the terminology DRL (design rated load) shall be used and shall also be marked on the bridge beam, jib boom, or monorail.

Section NUM-II-1000

Introduction

NUM-II-1100 GENERAL

The NUM-II part of the NUM-1 Standard covers Type II equipment used in nuclear facilities and shall be used in conjunction with NUM-G and NUM-III.

The entire NUM-III Section is applicable for Type II equipment, but it is not repeated here in Section NUM-II. Section NUM-II as it appears builds on Section NUM-III while providing additional requirements needed for Type II equipment.

All NUM-II paragraphs are either new requirements in addition to NUM-III requirements or supersede existing NUM-III requirements. If the NUM-II requirements supersede the NUM-III requirements, the NUM-II paragraph will state which paragraph it supersedes.

Type II equipment is equipment that is not used to handle critical loads, is required to withstand a seismic event, and is not required to be single failure-proof.

Type II equipment and the components thereof shall be designed and constructed to remain in place with or without the load during a seismic event. The equipment need not support the load nor remain operational during or after such an event.

The additional requirements for withstanding a seismic event are included under the following NUM-II headings:

NUM-II-7100	Description
NUM-II-8200	Structural
NUM-II-8300	Mechanical
NUM-II-8400	Electrical
NUM-II-8500	Inspection and Testing

NUM-II-1300 APPLICATIONS

This Section of the Standard applies to the design, manufacture, testing, inspection, shipment, storage, and erection of Type II equipment.

Section NUM-II-7000

Overhead Hoists and Under-Running Trolleys

NUM-II-7100 DESCRIPTION

In addition to the requirements of NUM-III-7100, hoists and trolleys shall remain in place during and after a seismic event.

ASMENORMDOC.COM : Click to view the full PDF of ASME NUM-1 2016

Section NUM-II-8000

Common Requirements and Criteria

NUM-II-8200 STRUCTURAL

(16) NUM-II-8210 General

NUM-II-8212 Descriptions of Loads. Loads due to safe shutdown earthquake (SSE) are categorized as extreme environmental loads.

NUM-II-8212.4 Extreme Environmental Loads

(a) *Earthquake Safe Shutdown (E_S)*. The site SSE parameters shall be used in the seismic analysis of the crane or monorail following the guidance of section NUM-II-8215.

(b) *Seismic Lifted Load SSE (LL_{ES})*. For Type II equipment, the seismic lifted load for an SSE is the maximum lifted load under the evaluated seismic conditions where the crane or monorail structure and hoist and trolley unit must remain in place. This lifted load is not a critical load and, therefore, the load itself need not be retained under the SSE event.

Depending upon the facility-specific application, the requirement that Type II equipment remain in place may not require consideration of a seismic lifted load. The owner shall specify the seismic lifted load, if any, that shall be considered.

(16) NUM-II-8213 Load Combinations

Case 4. A crane or monorail subjected to an SSE is subject to the following loads:

$$DL + TL + LL_{ES} + E_S + WLO$$

$$DL + TL + E_S + WLO$$

where

DL = dead load, the weight of all effective parts of the bridge structure, the machinery parts, and the fixed equipment supported by the structure

E_S = load due to an SSE

LL_{ES} = maximum seismic lifted load during an SSE

TL = trolley load, the weight of the trolley and the equipment attached to the trolley

WLO = operating wind load, lateral load due to wind

NUM-II-8215 Seismic Analysis for Type II Equipment

NUM-II-8215.1 Methods of Analysis. A dynamic analysis method (e.g., response-spectrum or time-history method) or an equivalent static analysis shall be used to establish the response of the equipment to a seismic event.

NUM-II-8215.2 Seismic Input Data. The seismic input data for the equipment seismic analysis shall be provided by the owner. The seismic input shall be specified as broadened floor response spectra or time histories of acceleration, displacements, or velocities defined at an appropriate level in the structure supporting the crane or monorail.

NUM-II-8215.2.1 Load Pendulum Effects. Pendulum effects of the suspended load shall be considered. (In most facilities, the horizontal load due to pendulum effects will be negligible because the load displacement is small. Where displacement is significant, consider obstacle-avoidance measures.)

NUM-II-8215.3 Dynamic Analysis

NUM-II-8215.3.1 Response-Spectrum Method.

The crane or monorail shall be considered to respond as a linear elastic system when using the response-spectrum method. The undamped natural modes and frequencies shall be computed using a model acceptable under the rules of this section. These outputs shall serve as the basis for mode-by-mode computation of the response of the crane or monorail to each of the three components of seismic input.

NUM-II-8215.3.2 Time-History Analysis. Time histories of structural response at the appropriate level may be used for analysis of the crane or monorail. The time histories shall be provided by the owner. Procedures for assembling the mathematical model shall be in accordance with this section. The effects of the three components of ground motion shall be combined in accordance with the following requirements:

(a) The representative maximum values of the structural responses to each of the three components of earthquake motion shall be combined by taking the square root of the sum of the squares of the maximum representative values of the codirectional responses caused by each of the three components of earthquake motion at a particular point of the structure or of the mathematical model.

(b) The maximum value of a particular response of interest for design of a given element may be obtained through a step-by-step method. The time-history responses from each of the three components of the earthquake motions may be obtained separately and then combined algebraically at each time step, or the response at each time step may be calculated directly,

owing to the simultaneous action of the three components. The maximum response is determined by scanning the combined time-history solution. When this method is used, the earthquake motions specified in the three different directions shall be statistically independent.

NUM-II-8215.3.3 Mathematical Model

(a) The crane or monorail shall be represented by a generalized three-dimensional system of nodes. The model's geometry shall reflect the overall size, length, connectivity, and stiffness of the various structural members. An appropriate element representation of each member shall be used to describe all components that contribute significantly to the stiffness of the equipment.

(b) For cranes using pin-connected wheel trucks, pinned connections shall be specified for line elements that represent the attachment of the end trucks to the bridge girders or gantry legs. Where various connected structural members of the crane do not have intersecting centroidal axes, stiff line elements shall be used to represent the offset. These elements shall have stiffnesses that are an order of magnitude higher than the stiffest structural member of the crane.

(c) A simplified finite element representation of the trolley structure using stiff line elements may be used for the crane or monorail dynamic model, provided it can be shown by rational analyses that the actual trolley structure responding as an uncoupled system has natural frequencies above 33 Hz. The model used for seismic analysis should be evaluated and revised if required to account for higher frequencies if plant operations induce such frequencies.

NUM-II-8215.3.4 Location and Number of Dynamic Degrees of Freedom. Dynamic degrees of freedom shall be assigned to a sufficient number of node points and in such locations that the real mass and stiffness distribution of the equipment are simulated. Structural members subject to concentrated loads shall be provided with additional nodes at the points where a concentrated load or its equivalent mass is positioned. Crane or monorail components to be modeled as mass points (concentrated loads) shall include, but not be limited to, upper and lower blocks, gear cases, motors, brakes, heavy electrical control cabinets, cab, wheel assemblies, and trunnion pins. The total number of masses or degrees of freedom selected shall be considered adequate when additional degrees of freedom do not result in more than a 10% increase in responses. Dynamic coupling shall be accounted for.

(16) **NUM-II-8215.3.5 Decoupling Criteria for the Runway.** The crane or monorail and runway shall be evaluated to determine if the equipment should be represented as a separate model or as a model coupled with the runway. For the equipment to be considered

decoupled from the runway, the criteria of (a) or (b) below shall be met.

(a) If $R_m < 0.01$, decoupling can be done for any R_f .

(b) If $0.01 \leq R_m \leq 0.1$, decoupling can be done if $R_f \leq 0.8$ or if $R_f \geq 1.25$.

(c) If $R_m \geq 0.1$, or $0.8 \leq R_f \leq 1.25$, an approximate model of the runway system shall be included with the model.

R_m and R_f are defined as

$$R_m = \frac{\text{total mass of the crane}}{\text{mass of the runway system}} \quad (1)$$

$$R_f = \frac{\text{fundamental frequency of the crane}}{\text{frequency of the dominant runway motion}} \quad (2)$$


The owner shall determine the mass and frequency characteristics of the runway.

NUM-II-8215.3.6 Boundary Conditions

(a) The crane or monorail shall be provided with devices so that they remain on their respective runways during and after a seismic event. Characteristics of these devices that influence the dynamic behavior of the crane or monorail shall be included as boundary conditions in the model of the equipment. The restraint devices shall be considered to be in contact with the resisting structure in establishing boundary conditions used in the analysis for the crane or monorail. The restraint device and resisting structure shall be designed for the maximum load resulting from the boundary condition considered. The crane or monorail shall be modeled with the wheel-to-rail boundary conditions specified in Fig. NUM-II-8215.3.6-1, unless additional restraining, driving, or holding mechanisms exist. The configurations shown in Table NUM-II-8215.3.6-1 were developed to show standard configurations. Other configurations are also acceptable.

(b) The crane or monorail boundary conditions at pivot points (such as hinges at jib crane connections) need to be modeled in computer analysis as rotationally fixed about the rotation of the hinge. If left free to rotate, the crane or monorail will be unstable and the results of the analyses will be unrealistic. By fixing the rotation around the pin, the stresses in the crane or monorail will be conservative. During an actual seismic event, however, the crane or monorail will tend to rotate about these pivot points. It is the responsibility of the owner to determine if uncontrolled movement about the pivot point is acceptable (i.e., the crane or monorail movement will not impact and damage equipment). If uncontrolled movement is not acceptable, the owner shall specify that restraint devices be provided that will limit or dampen the movement.

(c) The crane or monorail boundary conditions at the point of interface with the building structure shall be determined by the person performing the crane or monorail analysis. The boundary conditions shall take

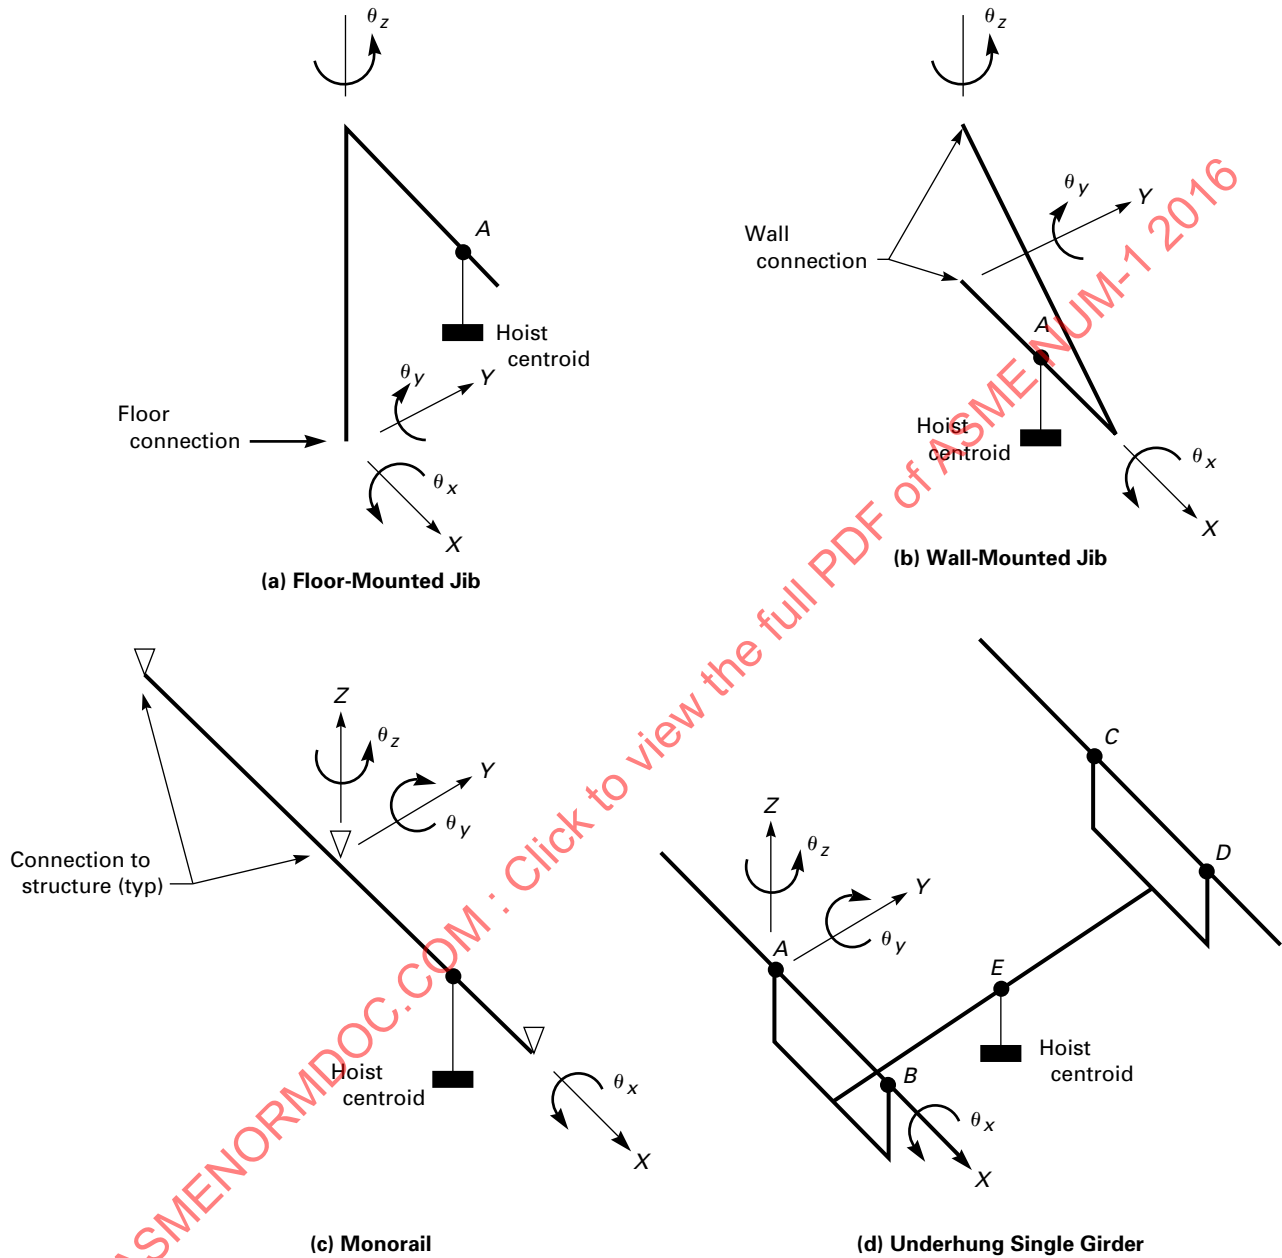Fig. NUM-II-8215.3.6-1 Boundary Conditions for Wheel-to-Rail Interface**GENERAL NOTES:**

- (a) The hoist is modeled as a lumped mass at its centroid.
- (b) The members are modeled at their centroidal axis.
- (c) The nodes shown illustrate wheel-to-rail boundary conditions. Additional nodes are required to complete the mathematical model.

Table NUM-II-8215.3.6-1 Boundary Conditions for Wheel-to-Rail Interface

(16)

Node	Restraint Condition					
	Translation			Rotation		
	X	Y	Z	θ_x	θ_y	θ_z
Floor Jib						
A	Fixed	Fixed	Fixed	Fixed	Fixed	Fixed
Wall Jib						
A	Fixed	Fixed	Fixed	Fixed	Fixed	Fixed
Monorail						
A	Fixed	Fixed	Fixed	Fixed	Fixed	Fixed
Underhung						
A	Fixed	Fixed	Fixed	Free	Free	Free
B	Free	Fixed	Fixed	Free	Free	Free
C	Fixed	Free	Fixed	Free	Free	Free
D	Free	Free	Fixed	Free	Free	Free
E	Fixed	Fixed	Fixed	Fixed	Fixed	Fixed

GENERAL NOTE: The nodes are shown in Fig. NUM-II-8215.3.6-1.

into consideration the method of attachment and flexibility of connections.

NUM-II-8215.3.7 Trolley Locations and Hoist Positions. The crane or monorail (bridge, jib, trolley, and hoist as applicable) shall be analyzed under the following loading conditions:

- (a) seismic lifted load on hook (if specified)
- (b) no load on hook

The analysis procedure shall use the bridge, jib, trolley, and hoist in as many different positions as necessary to envelope the worst-case loading situation. Since this Standard encompasses many different cranes and monorails, which may be fabricated and installed in many different configurations, it is the responsibility of the manufacturer to determine the worst-case configurations.

NUM-II-8215.3.8 Crane or Monorail Damping Values. The response of each mode shall be determined from the amplified response spectra for the appropriate values of structural damping. A damping value of 7% of critical damping shall be used for the crane or monorail when the SSE is used in the analysis.

NUM-II-8215.3.9 Number of Modes Required for Seismic Analysis. It is not generally necessary to include the contributions of all modes to the seismic response of the crane or monorail. A modal participation factor shall be used with the modal frequencies to select significant modes. Since high-frequency modes may respond strongly in some cases, it is not sufficient to limit the modal analysis to the first several modes computed. Additional modes shall be computed until the inclusion of additional modes does not result in more than a 10% increase in response.

(16) **NUM-II-8215.3.10 Combination of Modal Responses.** In combining the dynamic responses, it

shall be assumed that the dynamic responses have the sign that yields the worst case for the combination being considered.

(a) *With No Closely Spaced Modes.* When the results of the modal dynamic analysis show that the crane or monorail modes are not closely spaced, the equipment's response to each of the three components of seismic input shall be combined by taking the square root of the sum of the squares (SRSS).

(b) *With Closely Spaced Modes.* When the results of the modal dynamic analysis show that some or all of the modes are closely spaced (two consecutive modes are defined as closely spaced if their frequencies differ from each other by 10% or less of the lower frequency), modal responses for each of the three components for seismic input shall be combined using one of the following three methods:

(1) *Grouping Method.* Closely spaced modes shall be divided into groups that include all modes having frequencies between the lowest frequency in the group and a frequency 10% higher [see Note (1)]. The representative maximum value of a particular response of interest for the design of a given element of a nuclear power plant structure, system, or the crane or monorail attributed to each such group of modes shall first be obtained by taking the sum of the absolute values of the corresponding peak values of the response of the element attributed to individual modes in that group. The representative maximum value of this particular response attributed to all the significant modes of the structure, system, or the crane or monorail, shall then be obtained by taking the square root of the sum of the squares of corresponding representative maximum values of the response of the element attributed to each closely spaced group of modes and the remaining modal responses for the modes that are not closely spaced.

Mathematically, this is expressed as follows:

$$R = \left(\sum_{k=1}^N R_k^2 + \sum_{q=1}^P \sum_{l=i}^j \sum_{m=i}^j |R_{lq} R_{mq}| \right)^{1/2} \quad (3)$$

where $l \neq m$; R_{lq} and R_{mq} are modal responses; R_l and R_m are within the q th group; i is the number of the mode where a group starts; j is the number of the mode where the group ends; R , R_k , and N are as defined in Note (2); and P is the number of groups of closely spaced modes, excluding individual, separated modes.

(2) 10% Method

$$R = \left(\sum_{k=1}^N R_k^2 + 2 \sum |R_i R_j| \right)^{1/2} \quad (4)$$

where $i \neq j$; and R , R_k , and N are as defined in Note (2). The second summation shall be done on all i and j modes whose frequencies are closely spaced to each other. Let ω_i and ω_j be the frequencies of the i th and j th modes. To verify which modes are closely spaced, the following equation shall be applied:

$$(\omega_j - \omega_i) / \omega_i \leq 0.1 \quad (5)$$

where

$$1 \leq i < j \leq N \quad (6)$$

(3) Double-Sum Method

$$R = \left(\sum_{k=1}^N \sum_{s=1}^N |R_k R_s| \epsilon_{ks} \right)^{1/2} \quad (7)$$

where R , R_k , and N are as defined in Note (2); R_s is the peak value of the response of the element attributed to the s th mode; and ϵ_{ks} is a correlation coefficient between modes k and s .

$$\epsilon_{ks} = \left\{ 1 + \frac{(\omega'_k - \omega'_s)^2}{(\beta'_k \omega_k + \beta'_s \omega_s)^2} \right\}^{-1} \quad (8)$$

where

$$\omega'_k = \omega_k \left(1 - \beta_k^2 \right)^{1/2} \quad (9)$$

$$\beta'_k = \beta_k + \frac{2}{t_d \omega_k} \quad (10)$$

where ω_k and β_k are the modal frequency and the damping ratio in the k th mode, respectively, and t_d is the time duration of the earthquake.

NOTES:

(1) Groups shall be formed starting from the lowest frequency and working toward successively higher frequencies. No one frequency shall be in more than one group.

(2) R is the representative maximum value of a particular response of a given element to a given component of an earthquake; R_k is the peak value of the response of the element due to the k th mode; and N is the number of significant modes considered in the modal response combination.

(c) *Combination of Three Components of Earthquake Motion.* The representative maximum values of the structural responses of each of the three directional components of earthquake motion shall be combined by taking the square root of the sum of the squares of the maximum m representative values of the codirectional responses caused by each of the three components of earthquake motion at each node of the crane or monorail mathematical model.

NUM-II-8215.4 Equivalent Static Analysis. In cases where a dynamic analysis is not necessary because the crane or monorail model is very simple (as in the case of a single-span monorail or simple jib crane), an equivalent static analysis can be performed.

NUM-II-8215.4.1 Mathematical Model. The crane or monorail shall be represented by a generalized three-dimensional system of nodes. The model's geometry shall reflect the overall size, length, connectivity, and stiffness of the various structural members. An appropriate element representation of each member shall be used to describe all components that contribute significantly to the stiffness of the crane or monorail.

NUM-II-8215.4.2 Decoupling Criteria for the Runway. Refer to NUM-II-8215.3.5.

NUM-II-8215.4.3 Trolley Locations and Hoist Positions. Refer to NUM-II-8215.3.7.

NUM-II-8215.4.4 Crane or Monorail Damping Values. Refer to NUM-II-8215.3.8.

NUM-II-8215.4.5 Number of Modes Required for Seismic Analysis. Only the fundamental frequency of the crane or monorail in each direction of earthquake is used. For fundamental frequencies less than or equal to the frequency at which the maximum spectral acceleration occurs, the maximum spectral acceleration shall be used. For fundamental frequencies greater than the frequency at which the maximum spectral acceleration occurs, the actual spectral acceleration depicted on the response spectra curve shall be used. The maximum spectral acceleration may conservatively be used without calculation of the fundamental frequency.

NUM-II-8215.4.6 Combination of Modal Responses. Since only one mode is calculated in each direction, an increase factor of 1.5 shall be used on the acceleration to account for other modes.

NUM-II-8215.4.7 Combination of Three Components of Earthquake Motion. The representative maximum values of the structural responses of each of the three directional components of earthquake motion shall be combined by taking the square root of the sum of the squares of the maximum representative values of the codirectional responses caused by each of the three components of earthquake motion at each node of the crane or monorail mathematical model.

NUM-II-8300 MECHANICAL

(16) NUM-II-8320 Design and Performance Criteria

NUM-II-8323 Seismic Analysis

NUM-II-8323.1 Criteria. Analyses shall be performed to confirm that those mechanical components that, if dislodged, would damage safety-related equipment shall remain in place during the seismic event.

NUM-II-8323.2 Component Analysis (> 33 Hz).

Components whose major resonant frequency is greater than 33 Hz may be modeled as a lumped mass.

(a) Analysis shall consist of the determination of the stress level of the mounts when applying maximum dynamic forces to the center of gravity of the item.

(b) Loads due to vertical and horizontal motions shall act together and shall be combined in accordance with NUM-II-8215.

NUM-II-8323.3 Component Analysis (< 33 Hz).

Components whose major resonant frequency is less than 33 Hz shall be analyzed dynamically. The component shall be represented by a generalized three-dimensional system of nodes. The model's geometry shall reflect the overall size, length, connectivity, and stiffness of the various structural members. An appropriate element representation of each member shall be used to describe all components that contribute significantly to the stiffness.

NUM-II-8323.4 Allowable Stresses for Fasteners.

Seismic loads shall induce stresses that, when combined with appropriate dead and live loads, do not exceed 90% of the yield strength of the fastener.

NUM-II-8400 ELECTRICAL

NUM-II-8410 General

(16)

NUM-II-8411 Seismic. Analyses shall be performed to confirm that those electrical components that, if dislodged, would damage safety-related equipment shall remain in place during the seismic event.

NUM-II-8412 Allowable Stresses for Fasteners. Fasteners for mounting electrical components, such as control enclosures, shall comply with the requirements of NUM-II-8323.4.

NUM-II-8500 INSPECTION AND TESTING

NUM-II-8520 Inspection by Seller Prior to and During Manufacture

(16)

NUM-II-8521 General

NUM-II-8521.1 Structural Welds. Welds whose failure during a seismic event could cause the crane/monorail/hoist to fall shall be nondestructively tested. For butt welds, radiographic testing (RT) or ultrasonic testing (UT) shall be performed in accordance with NUM-II-8521.5(a). For other welds, magnetic particle testing (MT) or dye penetrant testing (PT) shall be performed in accordance with NUM-II-8521.5(b).

NUM-II-8521.2 Component Fit-Up. The requirements under NUM-II-8521.2 apply. (16)

NUM-II-8521.3 Structural Materials. Material test reports shall be required on structural materials, including seismic restraints, whose failure during a seismic event would cause the crane/monorail/hoist to fall.

NUM-II-8521.4 Fasteners. Material test reports shall be required on fasteners, including those of a seismic restraint, whose failure during a seismic event would cause the crane/monorail/hoist to fall.

NUM-II-8521.5 Nondestructive Tests. The following are the nondestructive tests for the welds identified in NUM-II-8521.1:

(a) 100% RT or UT of butt welds in accordance with AWS D1.1. Acceptance criteria shall be in accordance with AWS D1.1.

(b) 100% MT or PT of each weld 10 in. or less in length; 10% MT or PT of each weld that exceeds 10 in. in length. Technique and acceptance criteria shall be in accordance with AWS D1.1.

Section NUM-III-1000

Introduction

NUM-III-1100 GENERAL

The NUM-III part of the NUM-1 Standard covers Type III equipment used in nuclear facilities and shall be used in conjunction with NUM-G. Type III equipment is equipment that is not used to handle critical loads, is not required to withstand a seismic event, and is not required to be single failure-proof.

The NUM-III part of the NUM-1 Standard is divided into the following Sections:

NUM-III-1000	Introduction
NUM-III-2000	Underhung Cranes

NUM-III-3000	Top-Running Bridge and Gantry Cranes
NUM-III-4000	Traveling Wall Cranes
NUM-III-5000	Jib Cranes
NUM-III-6000	Monorail Systems
NUM-III-7000	Overhead Hoists and Under-Running Trolleys
NUM-III-8000	Common Requirements and Criteria

NUM-III-1300 APPLICATIONS

This Section of the Standard applies to the design, manufacture, testing, inspection, shipment, storage, and erection of Type III equipment.

Section NUM-III-2000 Underhung Cranes

NUM-III-2100 DESCRIPTION

In accordance with the introduction for Type III equipment defined in Section NUM-III-1000, Section NUM-III-2000 applies to the following:

(a) underhung, single-girder cranes whose wheels operate on the bottom flange of a runway track (see Fig. NUM-III-2100-1)

(b) underhung, multiple-girder cranes whose wheels operate on the bottom flange of a runway track (see Figs. NUM-III-2100-2 and NUM-III-2100-3)

(c) semi-gantry cranes having one end of the bridge supported by wheels operating on the bottom flange of a runway track and having one end of the bridge rigidly supported on a leg, with the leg supported on a top-running end truck (covered in Section NUM-III-3000) operating on a fixed rail or track (see Fig. NUM-III-2100-4)

NUM-III-2200 STRUCTURAL

NUM-III-2210 General

This section covers structural requirements and design criteria specific to Type III underhung cranes. For other structural requirements and criteria common to all cranes, refer to NUM-III-8200.

NUM-III-2220 Design Criteria

NUM-III-2221 Allowable Deflections and Cambers

NUM-III-2221.1 Miscellaneous Structure Deflection. Deflections of components such as end ties, end trucks, trolley load bars, and auxiliary beams shall not impair the functions for which they were designed or cause any attachments to the crane to become dislodged or leave the crane.

Fig. NUM-III-2100-1 Single-Girder Underhung Crane

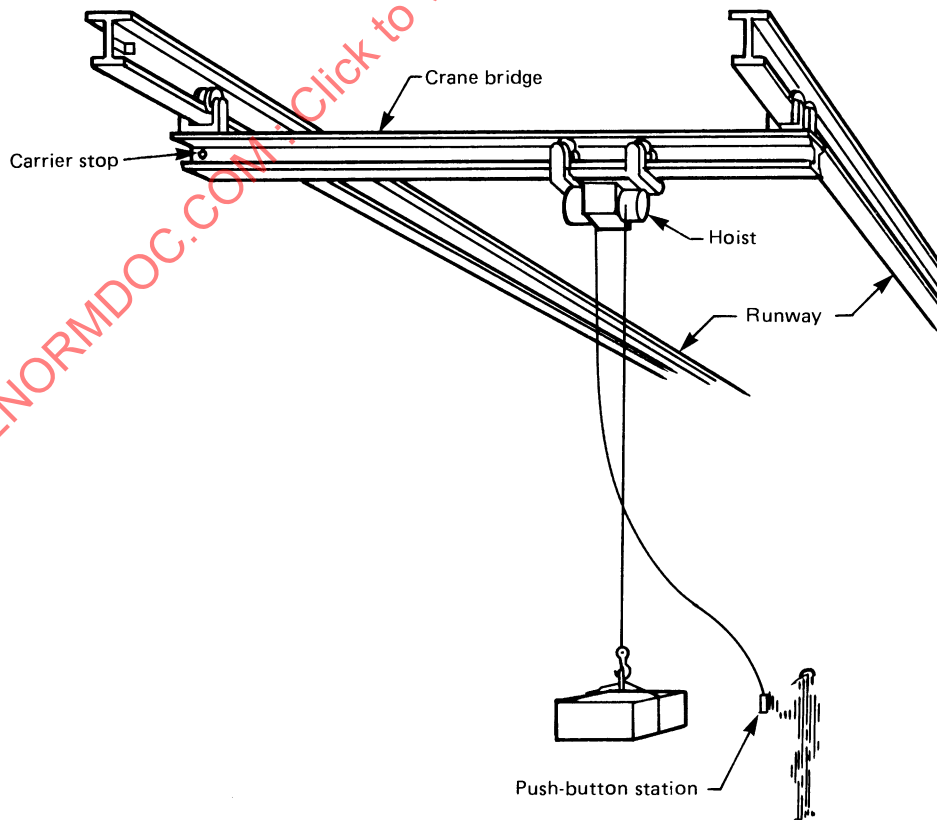
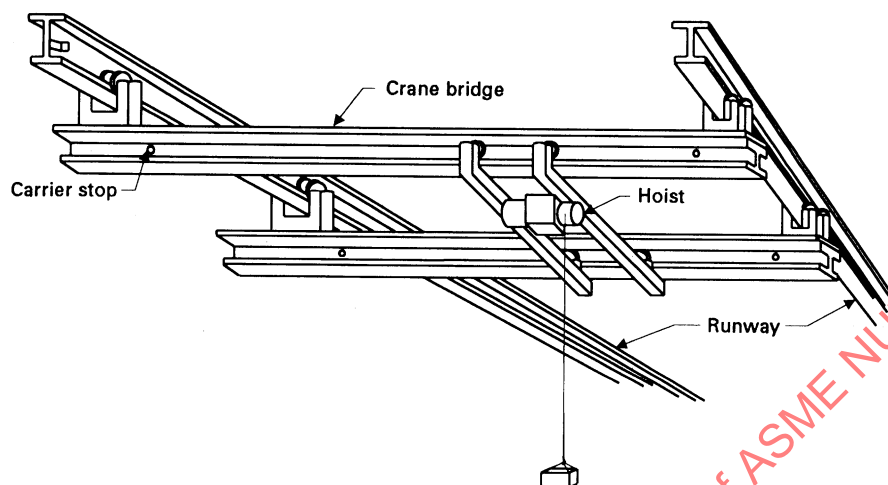
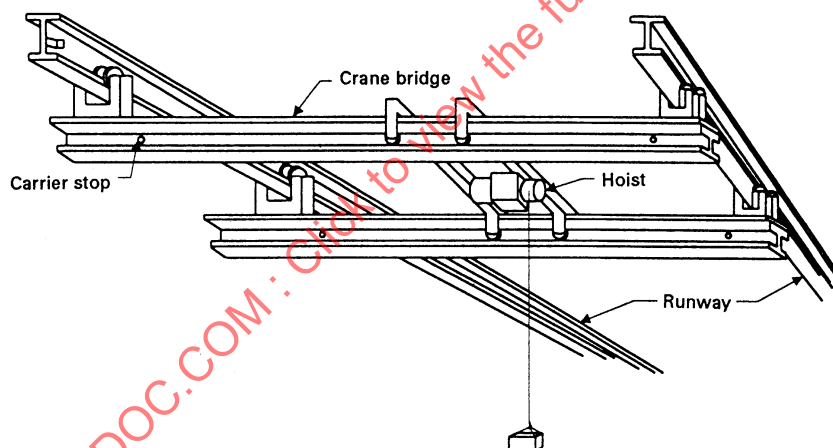


Fig. NUM-III-2100-2 Double-Girder Underhung Crane With Underhung Trolley**Fig. NUM-III-2100-3 Double-Girder Underhung Crane With Top-Running Trolley**


NUM-III-2221.2 Girder Deflection. The maximum vertical deflection of the girder produced by the bridge dead load, trolley dead load (including hoist dead weight), and design rated load shall not exceed $\frac{1}{600}$ of the span. Impact need not be considered in determining deflection. For interlocking cranes, the deflection shall not exceed $\frac{1}{1,000}$ of the span.

NUM-III-2221.3 Girder Camber. Where girders are cambered, the recommended amount of camber is equal to the bridge dead load deflection, plus $\frac{1}{2}$ of the deflection caused by the trolley dead load (including hoist dead weight), plus $\frac{1}{2}$ of the deflection caused by the design rated load. Girder camber and deflection shall be considered when determining vertical clearances.

NUM-III-2230 Components Design

NUM-III-2231 Girders, Beams, or Tracks. Girders may be standard rolled beams, patented shape track, or plate girders. Where necessary, auxiliary girders shall be used to support overhanging loads to minimize torsional moments on and lateral deflections of the girder. The analysis required for girders shall be in accordance with NUM-III-8200. On spans longer than 16 ft, the ratio of span to top flange width shall not exceed 60 to 1.

NUM-III-2232 End Trucks. The crane bridge shall be carried on end trucks designed to carry the rated loads when lifted at one end of the crane bridge (closest approach). Load combinations and basic allowable

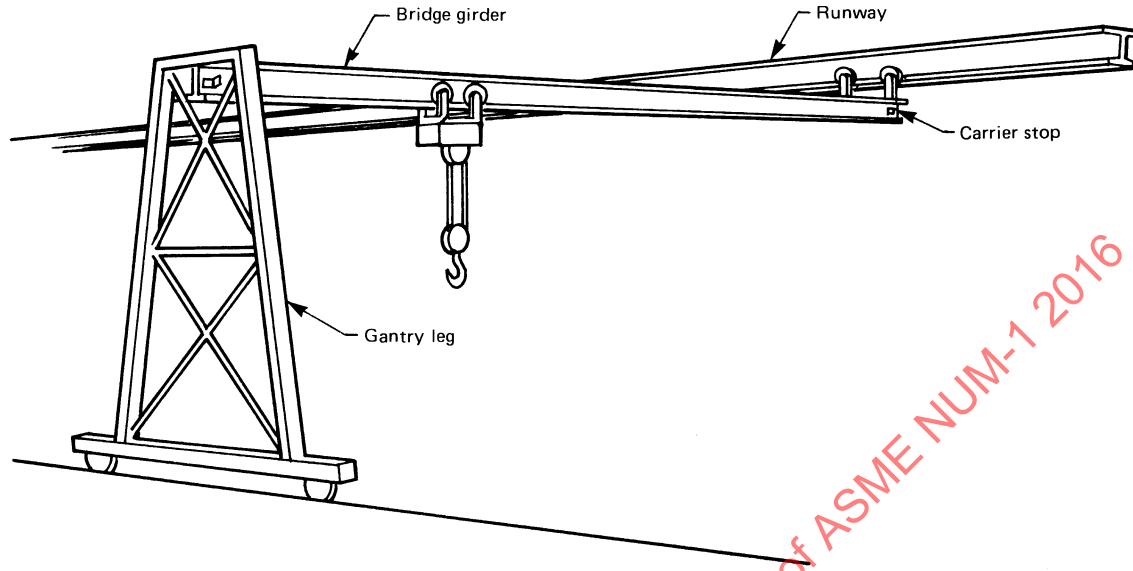Fig. NUM-III-2100-4 Single-Girder Underhung Semi-Gantry Crane

stresses shall be in accordance with NUM-III-8213 and NUM-III-8231. The wheel base of the outermost wheels shall be $\frac{1}{8}$ of the span or greater.

End trucks may be of the rotating-axle or fixed-axle type. Provisions shall be made to prevent a drop of the crane not more than 1 in. in the case of axle failure. When appropriate, equalizer bridge trucks shall be incorporated to promote sharing of the bridge wheel loads. Equalizer pins shall be provided between equalizer truck and equalizer beams and/or rigid bridge structures. A rail sweep shall be provided in front of each outside wheel. End trucks shall be in accordance with applicable sections of NUM-III-8200.

NUM-III-2300 MECHANICAL

NUM-III-2310 General

This section covers the specific mechanical requirements and criteria for underhung bridge cranes. For other mechanical requirements and criteria common to all cranes, refer to NUM-III-8300.

NUM-III-2320 Bridge

NUM-III-2321 Bridge Drive. The bridge drive arrangements normally used with underhung bridge cranes are illustrated in Figs. NUM-III-2321-1 and NUM-III-2321-2. An underhung bridge has a minimum of four pairs of wheels and shall use a drive arrangement where at least one pair of wheels is driven on each end truck. Underhung bridges running on multiple runways may be driven by wheel pairs on two or more end trucks. End trucks may be driven by more than one wheel pair.

NUM-III-2321.1 Bridge Drive Arrangements

(a) A-2 Drive

(1) The motor is connected to a self-contained gear reducer unit located near the center of the bridge. The gear reducer is connected to a set of squaring shafts that in turn are connected to the end truck drive pinions. The pinions drive the geared section of the wheels.

(2) The motor is connected by chain and sprockets or through a self-contained reducer to a squaring shaft that in turn is connected to the axle of the rubber wheels at each bridge end truck. The rubber drive wheels are arranged to provide spring-loaded contact to the underside of the runway rail for traction drive.

(b) A-4 Drive


(1) A mechanically independent drive is provided at each bridge end truck. The drive motor is directly connected to the integral self-contained gear reduction unit that in turn is connected to the drive pinion that drives the geared section of the bridge wheels.

(2) A mechanically independent drive is provided at each bridge end truck. The drive motor is directly connected to the integral self-contained gear reduction unit that in turn is connected to the axle of the rubber wheel. The rubber drive wheel is arranged to provide spring-loaded contact to the underside of the runway rail for traction drive.

NUM-III-2322 Bridge Interlocking Mechanisms

(a) Interlock mechanisms for underhung cranes shall maintain alignment between mating track sections and shall provide smooth trolley transfer across sections.

(b) Stops or forks shall be part of the interlock mechanisms to prevent the trolley from rolling off open track

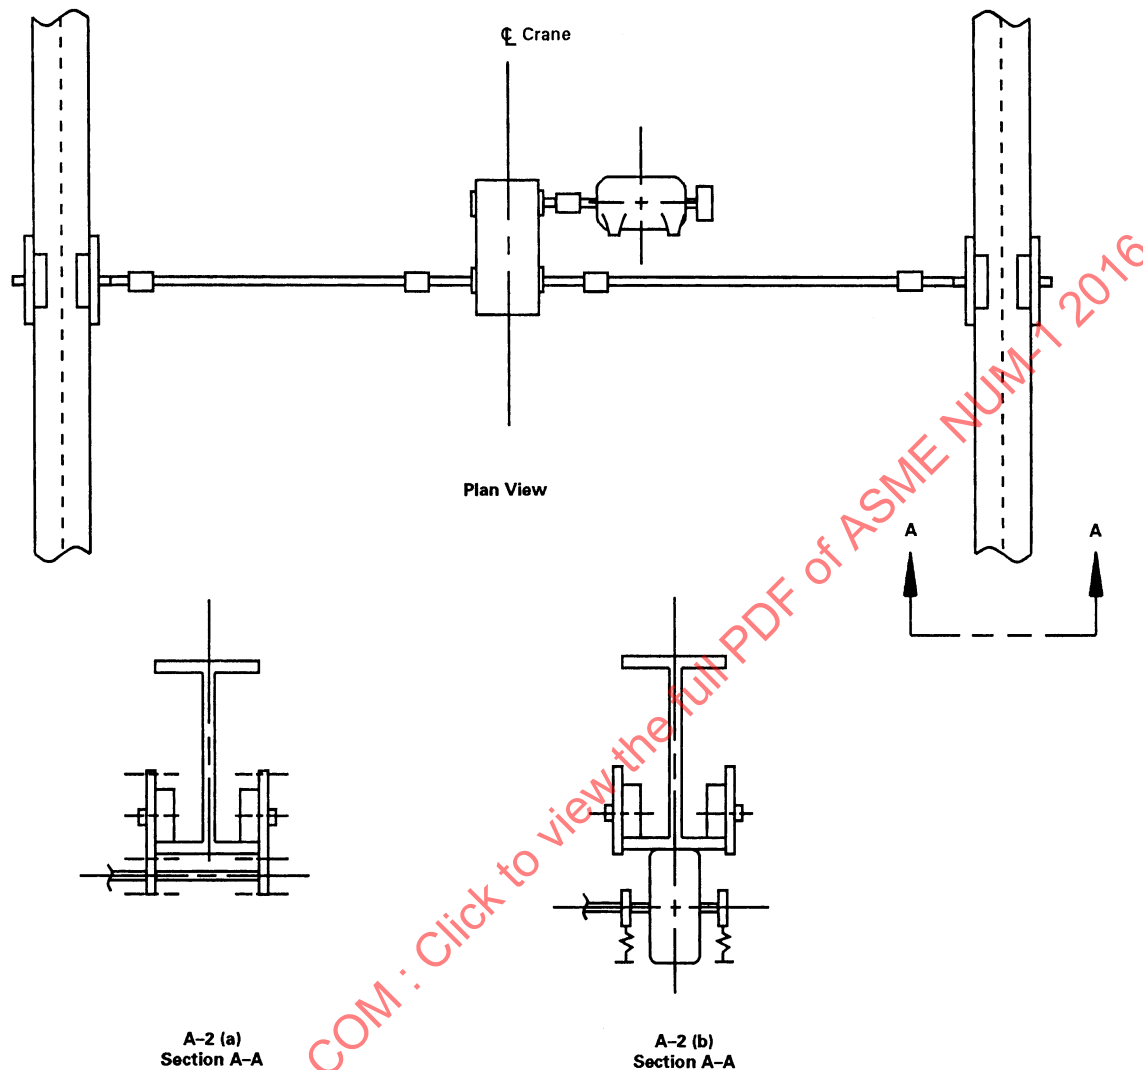Fig. NUM-III-2321-1 Arrangement of Crane Bridge Drives (A-2 Drive)

ends. When girders and spur tracks or transfer sections are aligned and interlock mechanisms are engaged, stops or forks shall be in the open position and permit transfer of the trolley. When girders and spurs or transfer tracks are not aligned and the interlock mechanisms are not engaged, stops or forks shall be in the closed position.

(c) Interlock mechanisms shall be designed to limit vertical misalignment to less than $\frac{1}{8}$ in.

(d) Interlocking cranes and mating tracks shall have a gap of less than $\frac{1}{4}$ in. between adjacent ends of the load-carrying flange.

NUM-III-2330 Underhung Trolley

Underhung trolleys are covered by NUM-III-7700. If the trolley is top running, refer to ASME NOG-1 (for trolley design only).

NUM-III-2331 Underhung Trolley Drive. Trolley drives for single-girder bridge cranes shall be in accordance with NUM-III-7741. Underhung trolley drives for double-girder bridge cranes shall be driven on both sides similar to bridge drives and in accordance with NUM-III-8300.

NUM-III-2340 Hoist


The hoist shall be in accordance with Section NUM-III-7000.

NUM-III-2400 ELECTRICAL

NUM-III-2410 General

(a) Except as noted under (b) below, the following information applies to underhung cranes that have an electric motor-operated bridge.

Fig. NUM-III-2321-2 Arrangement of Crane Bridge Drives (A-4 Drive)

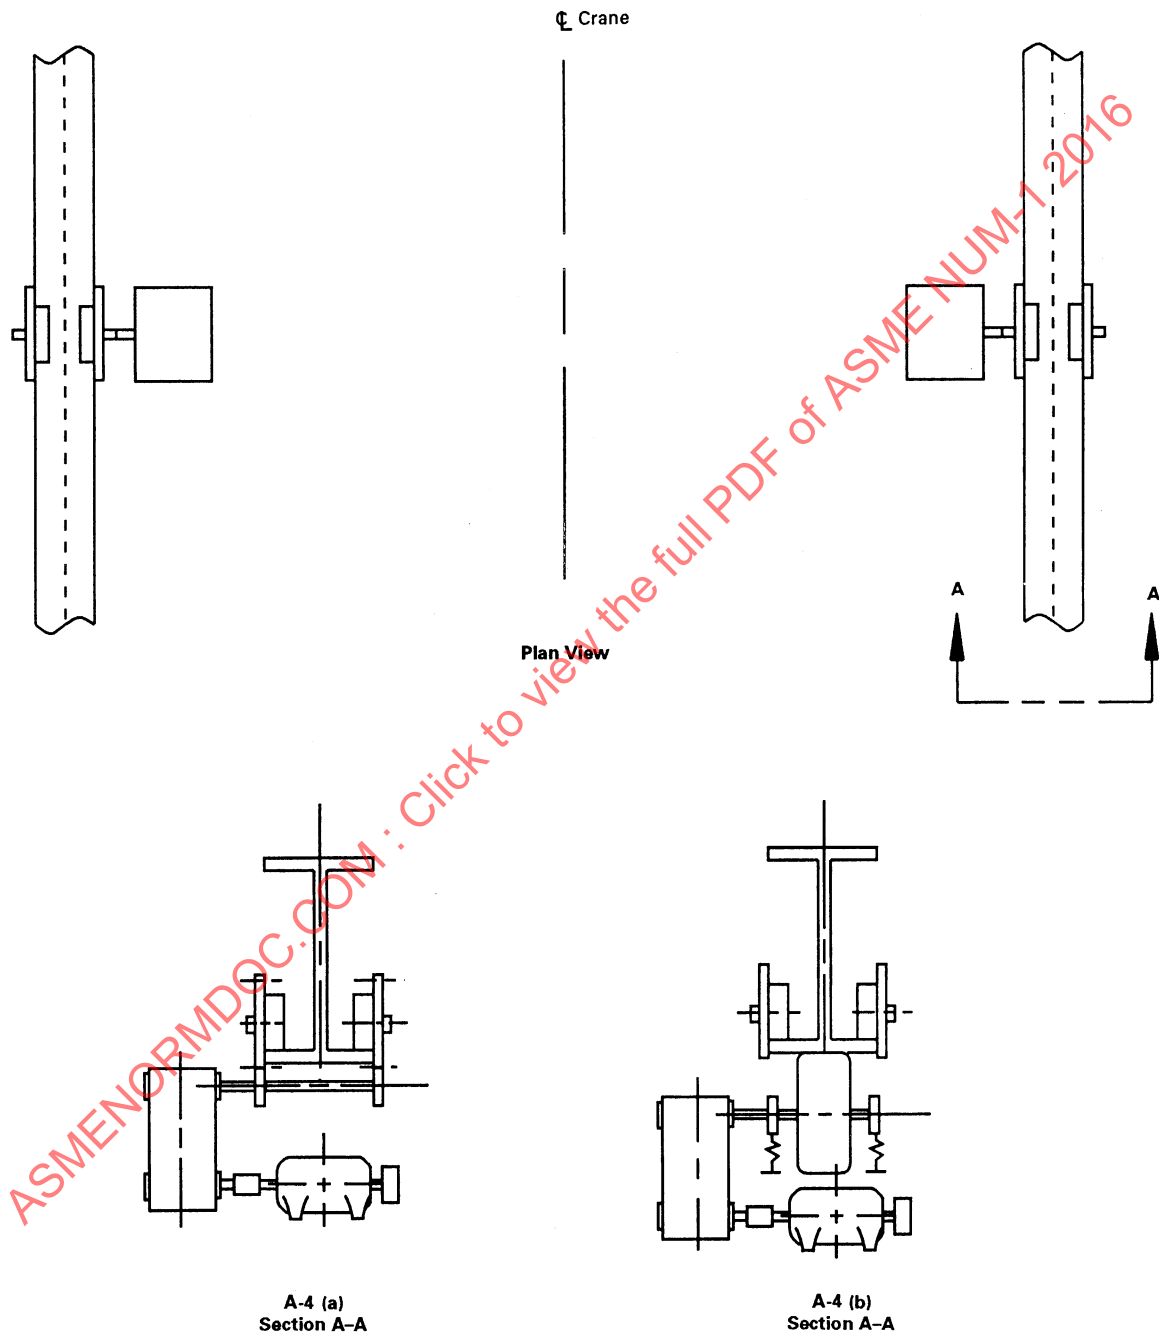

(b) For underhung cranes that do not have an electric motor-operated bridge, but use either an electrically operated hoist or electrically operated trolley, the information listed in the following sections will still apply: NUM-III-2424, NUM-III-2425, NUM-III-2427, and NUM-III-2430.

NUM-III-2420 Electrical Components

NUM-III-2421 Crane Controls. Crane controls shall meet the criteria of NUM-III-8421.

NUM-III-2422 Motors. Traverse drive motors for an electric motor-operated bridge shall meet the criteria of NUM-III-8422, with motor sizing in accordance with NUM-III-8422.4.

NUM-III-2423 Brakes

(a) An electric motor-operated bridge shall be furnished with either a noncoasting mechanical drive or spring-set, friction-type brakes for each traverse drive motor.

(b) A noncoasting mechanical drive shall be capable of stopping the motion of the bridge within a distance in feet equal to 10% of the full-load speed in feet per minute when traveling at full speed with rated load.

(c) Spring-set, friction-type brakes shall be in accordance with NUM-III-8423.

NUM-III-2424 Disconnects and Protective Devices. Disconnects and protective devices shall be provided in accordance with NUM-III-8424.

NUM-III-2425 Operator Stations and Controllers

(a) The type of operator station and its location shall be specified by the owner.

(b) The location of the pendant push-button station controllers shall be one of the following:

(1) suspended from the hoist and trolley

(2) suspended from a festooned messenger track system along the bridge span

(3) suspended from a single point off the bridge

(4) remote-mounted off the crane

(c) A crane operator station of any type shall meet the criteria of NUM-III-8425.

NUM-III-2426 Electrical Enclosures. Electrical enclosures shall be in accordance with the criteria of NUM-III-8426, suitable for the owner-specified environmental conditions of service.

NUM-III-2427 Current Conductor Systems

(a) The type and location of runway system conductors shall be specified by the owner.

(b) All current conductor systems shall meet the criteria of NUM-III-8427.

NUM-III-2428 Warning Devices. Warning device information and criteria shall be in accordance with NUM-III-8428.

NUM-III-2429 Auxiliary Electrical Equipment. Auxiliary electrical equipment information and criteria, such as for travel limit switches, shall be in accordance with NUM-III-8429.

NUM-III-2430 Wiring Materials and Methods

Wiring materials and methods shall meet the criteria of NUM-III-8430.

NUM-III-2500 INSPECTION AND TESTING

Perform inspection and testing of underhung cranes in accordance with NUM-III-8500, as applicable.

Section NUM-III-3000

Top-Running Bridge and Gantry Cranes

NUM-III-3100 DESCRIPTION

In accordance with the introduction for Type III equipment defined in Section NUM-III-1000, Section NUM-III-3000 applies to the following:

(a) top-running, single-girder cranes whose end trucks operate on fixed rails or tracks attached to the top flange or surface of runway girders. Overhead hoists of the underhung type (covered in Section NUM-III-7000) may be rigidly suspended or trolley suspended from the bridge girder. If the trolley is suspended, the trolley will operate on the bottom flange of the bridge girder. The bridge girder may be a patented shape, a structural shape, a reinforced patented or structural shape, or a fabricated section (see Fig. NUM-III-3100-1).

(b) top-running, double-girder cranes whose end trucks operate on fixed rails or tracks attached to the top flange or surface of runway girders, and that use an underhung, trolley-suspended hoist. Overhead hoists of the underhung type (covered in Section NUM-III-7000) may be rigidly suspended or trolley suspended from the bridge girders. The trolley operates on the bottom flange of the bridge girders, which may be a patented shape, a structural shape, a reinforced patented or structural shape, or a fabricated section (see Fig. NUM-III-3100-2). Top-running, double-girder cranes with trolley-hoist units that operate on fixed rails or tracks attached

to the top flange or surface of the bridge girders are covered by ASME NOG-1.

(c) top-running, semi-gantry cranes having one end of the bridge supported by an end truck operating on a fixed rail or track attached to the top flange or surface of a runway girder, and one end of the bridge rigidly supported on a leg with the leg supported on an end truck operating on a fixed rail or track. Hoists, trolleys, and girders are the same as described in (a) above (see Fig. NUM-III-3100-3).

(d) top-running, gantry cranes having both ends of the bridge rigidly supported on legs, with the legs supported on end trucks operating on fixed rails or tracks. Hoists, trolleys, and girders are the same as described in (a) above (see Fig. NUM-III-3100-4).

NUM-III-3200 STRUCTURAL

NUM-III-3210 General

This section covers structural requirements and design criteria specific to Type III top-running bridge and gantry cranes. For other structural requirements and criteria common to all cranes, refer to NUM-III-8200.

NUM-III-3220 Design Criteria

NUM-III-3221 Allowable Deflections and Cambers

NUM-III-3221.1 Structure Deflection. Deflections of components such as end ties, end trucks, trolley load

Fig. NUM-III-3100-1 Single-Girder Top-Running Crane

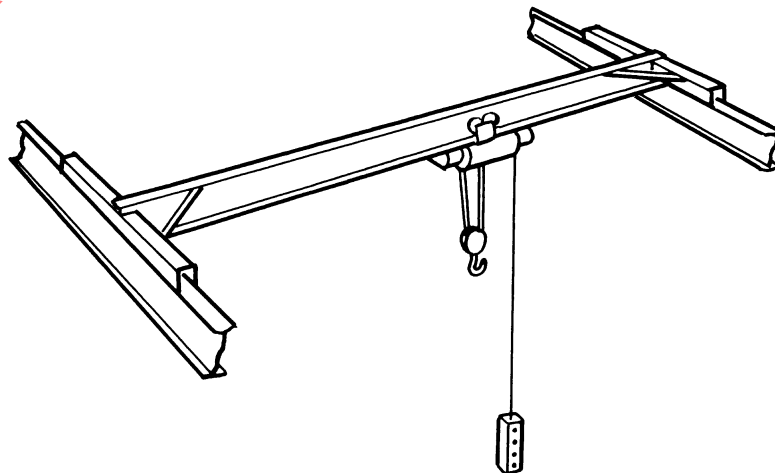


Fig. NUM-III-3100-2 Double-Girder Top-Running Crane With Underhung Trolley

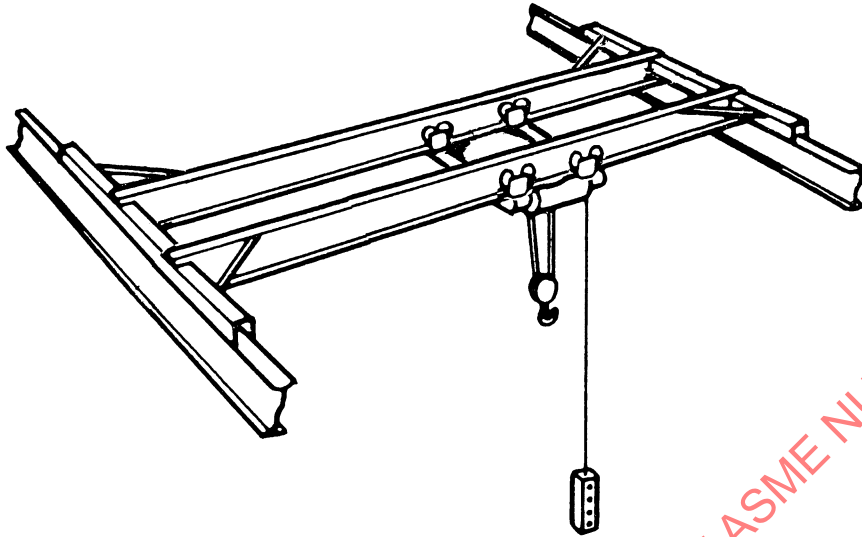


Fig. NUM-III-3100-3 Single-Girder Top-Running Semi-Gantry Crane


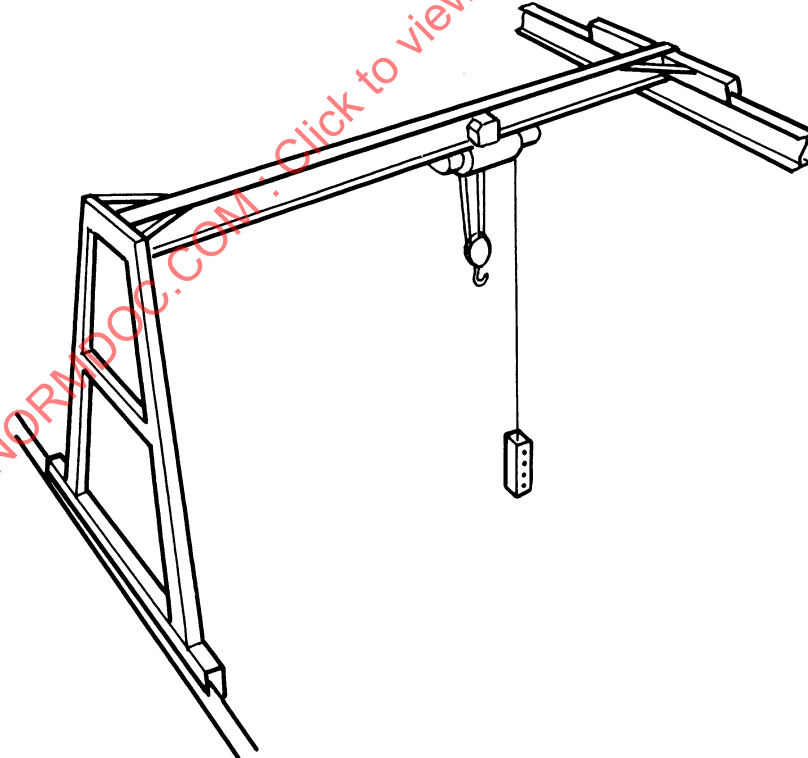


Fig. NUM-III-3100-4 Single-Girder Top-Running Gantry Crane

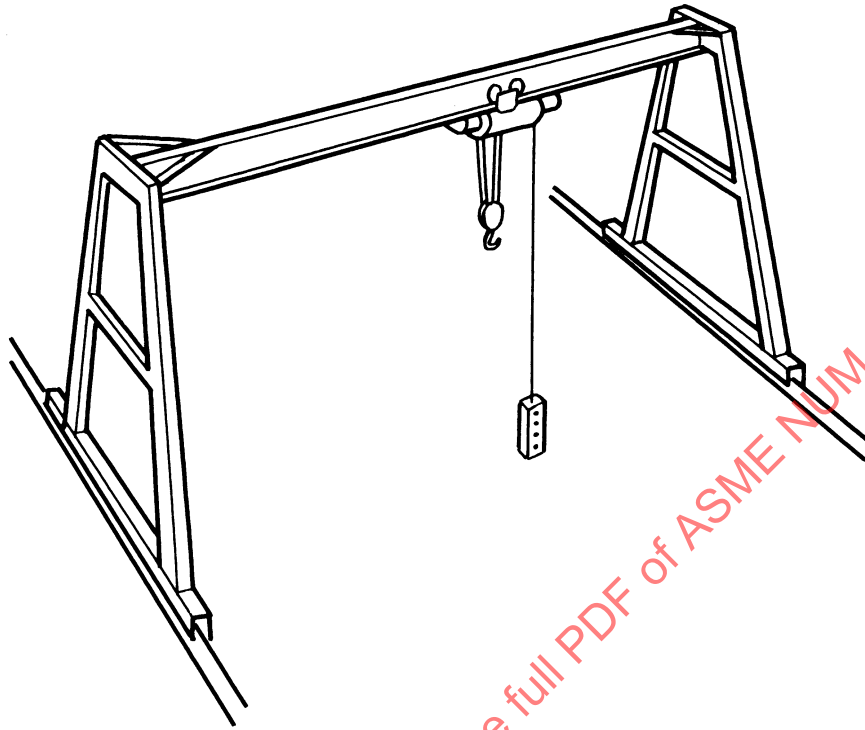

bars, and auxiliary beams shall not impair the functions for which they were designed or cause any attachments of the crane to become dislodged or leave the crane.

NUM-III-3221.2 Girder Deflection. The maximum vertical deflection of the girder produced by the bridge dead load, trolley dead load (including hoist dead weight), and the design rated load shall not exceed $\frac{1}{600}$ of the span. Vertical inertia forces need not be considered in determining deflection. For interlocking cranes, the deflection shall not exceed $\frac{1}{1,000}$ of the span.

NUM-III-3221.3 Girder Camber. Where girders are cambered, the recommended amount is equal to the bridge dead load deflection, plus $\frac{1}{2}$ of the deflection caused by the trolley dead load (including hoist dead weight), plus $\frac{1}{2}$ of the deflection caused by the design rated load. Girder camber and deflection shall be considered when determining vertical clearance.

- (16) **NUM-III-3222 Wind Loads.** Gantry structures shall be designed to withstand wind-loading conditions as specified by the owner. If loads are not specified, a load of 30 lb/ft² on the projected area, under nonoperating conditions, is to be used. For through-leg gantries, a check is to be made using a 5-lb/ft² wind loading with the lifted load at the end of the bridge.

NUM-III-3230 Components Design

NUM-III-3231 Girders, Beams, or Tracks. Girders may be standard rolled beams, patented shape track, or

plate girders. Where necessary, auxiliary girders shall be used to support overhanging loads to minimize torsional moments on and lateral deflections of the girder. The analysis required for girders shall be in accordance with NUM-III-8200. On spans longer than 16 ft, the ratio of span to top flange width shall not exceed 60 to 1.




NUM-III-3232 End Trucks. The crane bridge shall be carried on end trucks designed to carry the rated load when lifted at one end of the crane bridge (closest approach). Load combinations and basic allowable stresses shall be in accordance with NUM-III-8213 and NUM-III-8231. The wheel base of the outermost wheels shall be $\frac{1}{8}$ of the span or greater.

End trucks may be of the rotating-axle or fixed-axle type. Provisions shall be made to prevent a drop of the crane not more than 1 in. in the case of axle failure. When appropriate, equalizer bridge trucks shall be incorporated to promote sharing of the bridge wheel loads. Equalizing pins shall be provided between equalizer truck and equalizer beams and/or rigid bridge structures. A rail sweep shall be provided in front of each outside wheel and shall project below the top of the runway rail. End trucks shall also be in accordance with applicable sections of NUM-III-8200.

NUM-III-3300 MECHANICAL

NUM-III-3310 General

This section covers the specific mechanical requirements and criteria for top-running bridge and gantry

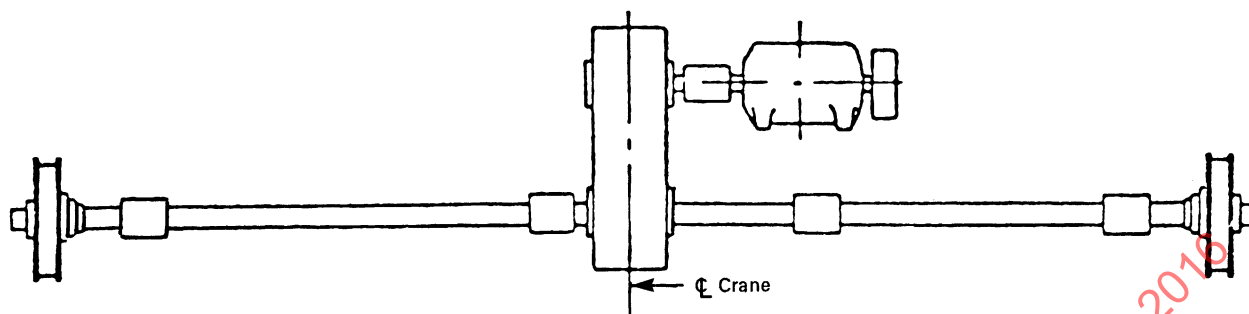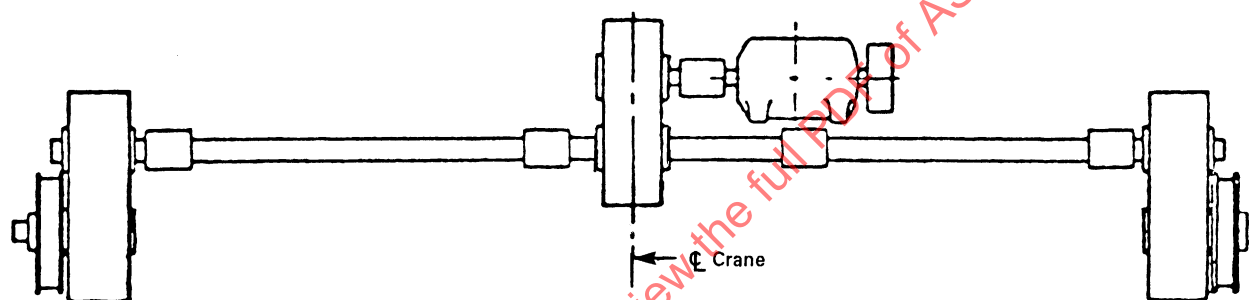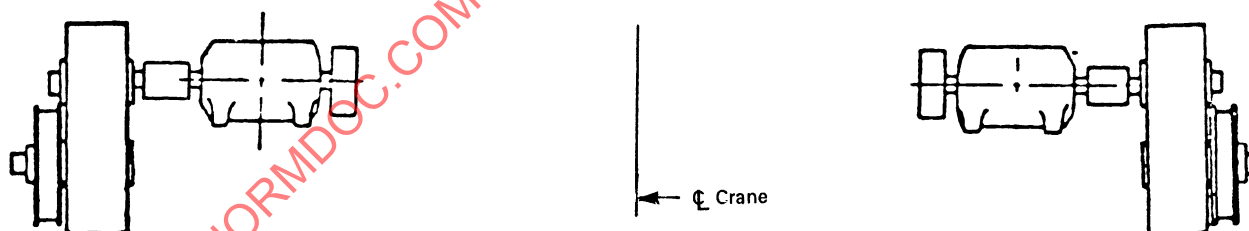Fig. NUM-III-3320-1 Arrangement of Crane Bridge Drives (A-1 Drive)**Fig. NUM-III-3320-2 Arrangement of Crane Bridge Drives (A-2 Drive)****Fig. NUM-III-3320-3 Arrangement of Crane Bridge Drives (A-4 Drive)**

cranes. For other mechanical requirements and criteria common to all cranes, refer to NUM-III-8300.

NUM-III-3320 Bridge Drive

Bridge drive arrangements normally used with top-running bridge cranes are illustrated in Figs. NUM-III-3320-1, NUM-III-3320-2, and NUM-III-3320-3. A top-running bridge has a minimum of four wheels and shall use a drive arrangement where at least one wheel is driven on each end truck.

(a) *A-1 Drive.* The motor is located near the center of the bridge span and is connected to a self-contained

gear reduction unit, also located near the span center, that in turn is connected to a set of line shafts that are connected to the wheel axles.

(b) *A-2 Drive.* The motor is located near the center of the bridge span and connected by a flexible coupling to a self-contained gear reduction unit, also located near the span center, that in turn is connected to a set of line shafts by solid or semiflexible couplings. Each line shaft is connected to a pinion at the end truck that meshes with the drive gear. Connecting couplings between line shaft and pinion are semiflexible. All other couplings, if required, are of the solid type.

(c) *A-4 Drive.* Two mechanically independent drive arrangements are provided, one unit at each end truck of the bridge. Motors are connected to the gear reduction units that in turn are connected to the wheel axles.

NUM-III-3321 Travel Drives for Gantry Cranes. For travel drives on gantry cranes, the number of driven wheels shall be selected based on crane acceleration rates to prevent wheel skidding.

NUM-III-3322 Gantry Crane Drive Brakes. Each motorized drive on gantry cranes shall be provided with a suitable brake and sized as described in NUM-III-8300.

NUM-III-3330 Underhung Trolley

Underhung trolleys are covered by NUM-III-7700. If the trolley is top running, refer to ASME NOG-1 for the entire crane.

NUM-III-3331 Underhung Trolley Drive. Trolley drives for single-girder bridge cranes shall be in accordance with NUM-III-7741. Underhung trolley drives for double-girder bridge cranes shall be driven on both sides similar to bridge drives and in accordance with NUM-III-8300.

NUM-III-3340 Hoist

The hoist shall be in accordance with Section NUM-III-7000.

NUM-III-3400 ELECTRICAL

NUM-III-3410 General

(a) Except as noted under (b) below, the following information applies to top-running bridge and gantry cranes that have an electric motor-operated bridge.

(b) For top-running bridge and gantry cranes that do not have an electric motor-operated bridge but use either an electrically operated hoist or electrically operated trolley, the information listed in the following sections will still apply: NUM-III-3424, NUM-III-3425, NUM-III-3427, and NUM-III-3430.

NUM-III-3420 Electrical Components

NUM-III-3421 Crane Controls. Crane controls shall meet the criteria of NUM-III-8421.

NUM-III-3422 Motors. Traverse drive motors for an electric motor-operated bridge shall meet the criteria of NUM-III-8422, with motor sizing in accordance with NUM-III-8422.4.

NUM-III-3423 Brakes

(a) An electric motor-operated bridge shall be furnished with either a noncoasting mechanical drive, or

spring-set, friction-type brakes for each traverse drive motor.

(b) A noncoasting mechanical drive shall be capable of stopping the motion of the bridge within a distance in feet equal to 10% of the full-load speed in feet per minute when traveling at full speed with rated load.

(c) Spring-set, friction-type brakes shall be in accordance with NUM-III-8423.

NUM-III-3424 Disconnects and Protective Devices.

Disconnects and protective devices shall be provided in accordance with NUM-III-8424.

NUM-III-3425 Operator Stations and Controllers

(a) The type of operator station and its location shall be specified by the owner.

(b) The location of the pendant push-button station controllers shall be one of the following:

- (1) suspended from the hoist and trolley
- (2) suspended from a festooned messenger track system along the bridge span
- (3) suspended from a single point off the bridge
- (4) remote-mounted off the crane

(c) A crane operator station of any type shall meet the criteria of NUM-III-8425.

NUM-III-3426 Electrical Enclosures. Electrical enclosures shall be in accordance with the criteria of NUM-III-8426, suitable for the owner-specified environmental conditions of service.

NUM-III-3427 Current Conductor Systems

(a) The type and location of runway system conductors shall be specified by the owner.

(b) All current conductor systems shall meet the criteria of NUM-III-8427.

NUM-III-3428 Warning Devices. Warning device information and criteria shall be in accordance with NUM-III-8428.

NUM-III-3429 Auxiliary Electrical Equipment. Auxiliary electrical equipment information and criteria, such as for travel limit switches, shall be in accordance with NUM-III-8429.

NUM-III-3430 Wiring Materials and Methods

Wiring materials and methods shall meet the criteria of NUM-III-8430.

NUM-III-3500 INSPECTION AND TESTING

NUM-III-3510 Performance

Perform inspection and testing of top-running bridge and gantry cranes in accordance with NUM-III-8500, as applicable.

Section NUM-III-4000

Traveling Wall Cranes

NUM-III-4100 DESCRIPTION

In accordance with the introduction for Type III equipment defined in Section NUM-III-1000, Section NUM-III-4000 applies to traveling wall cranes whose vertical frame is supported on trucks that operate on tracks or rails by manual operation or power operation. The jib boom can be single girder or multiple girder; top braced, under braced, or full cantilever; and is usually fixed (nonrotating) to the vertical frame.

On single-girder and multiple-girder booms, the jib boom may be a patented shape, a structural shape, a reinforced patented or structural shape, or a fabricated section.

On single-girder booms, overhead hoists of the underhung type (covered in Section NUM-III-7000) may be rigidly suspended or trolley suspended from the jib boom. If the trolley is suspended, the trolley will operate on the bottom flange of the jib boom.

On multiple-girder booms, overhead hoists of the underhung type (covered in Section NUM-III-7000) may be rigidly suspended or trolley suspended from the jib boom girders. If the trolley is suspended, the trolley may operate on the bottom flange of the boom girders or on fixed rails or track attached to the top flange or surface of the boom girders (see Fig. NUM-III-4100-1).

NUM-III-4200 STRUCTURAL

NUM-III-4210 General

This section covers the structural requirements and design criteria specific to Type III traveling wall cranes as described in NUM-III-4100. For other structural requirements and criteria, refer to NUM-III-8200.

NUM-III-4220 Design Criteria

NUM-III-4221 Allowable Deflections

NUM-III-4221.1 Boom Deflections. The maximum vertical deflection of the boom and its end tie structure produced by the boom dead load, the trolley dead load (including the hoist dead weight), and the design rated load shall not exceed $\frac{1}{600}$ of the span. When a motorized trolley is specified, the allowable vertical deflection may be increased up to $\frac{1}{450}$ of the span. Impact shall not be considered in determining deflection.

NUM-III-4230 Component Design

NUM-III-4231 Booms. Crane booms may be fabricated with standard rolled beams and reinforced with angles, channels, or plates as necessary. Auxiliary members may be of standard shapes, structural tube, or fabricated plates. Structural analysis shall be in accordance with NUM-III-8200.

NUM-III-4232 End Tie Structure

(a) End tie structure may be fabricated with standard rolled shapes, structural tube, or plate and reinforced with the same. Structural analysis shall be consistent with the requirements of NUM-III-8200.

(b) Loads induced from drive mechanisms, acceleration and braking, motor stall, bumper stops, and varying loads from a swinging boom, where used, shall be considered.

NUM-III-4233 Braces and Secondary Members.

Braces and secondary members may be fabricated of standard rolled beams, angles, tees, rods, structural tube, or other structural shapes. They shall be analyzed in accordance with NUM-III-8200.

NUM-III-4240 Design Requirements for Wall Crane Supports

(a) The manufacturer shall provide general arrangement drawings to define all reactions and special attaching considerations at all the tie points to the supporting structure. The general arrangement drawings shall specify rail alignment tolerances applicable to the design.

(b) The owner shall analyze the supporting structure for all loading conditions imposed by the wall crane and any auxiliary system.

NUM-III-4300 MECHANICAL


NUM-III-4310 General

This section covers the specific mechanical requirements and criteria for traveling wall cranes. For other mechanical requirements and criteria common to all cranes, refer to NUM-III-8300.

NUM-III-4320 Truck Assembly

NUM-III-4321 Wall Crane Configuration. The wall crane shall have vertical and horizontal end trucks and a cantilevered girder. The driven vertical truck may be

Fig. NUM-III-4100-1 Traveling Wall Crane

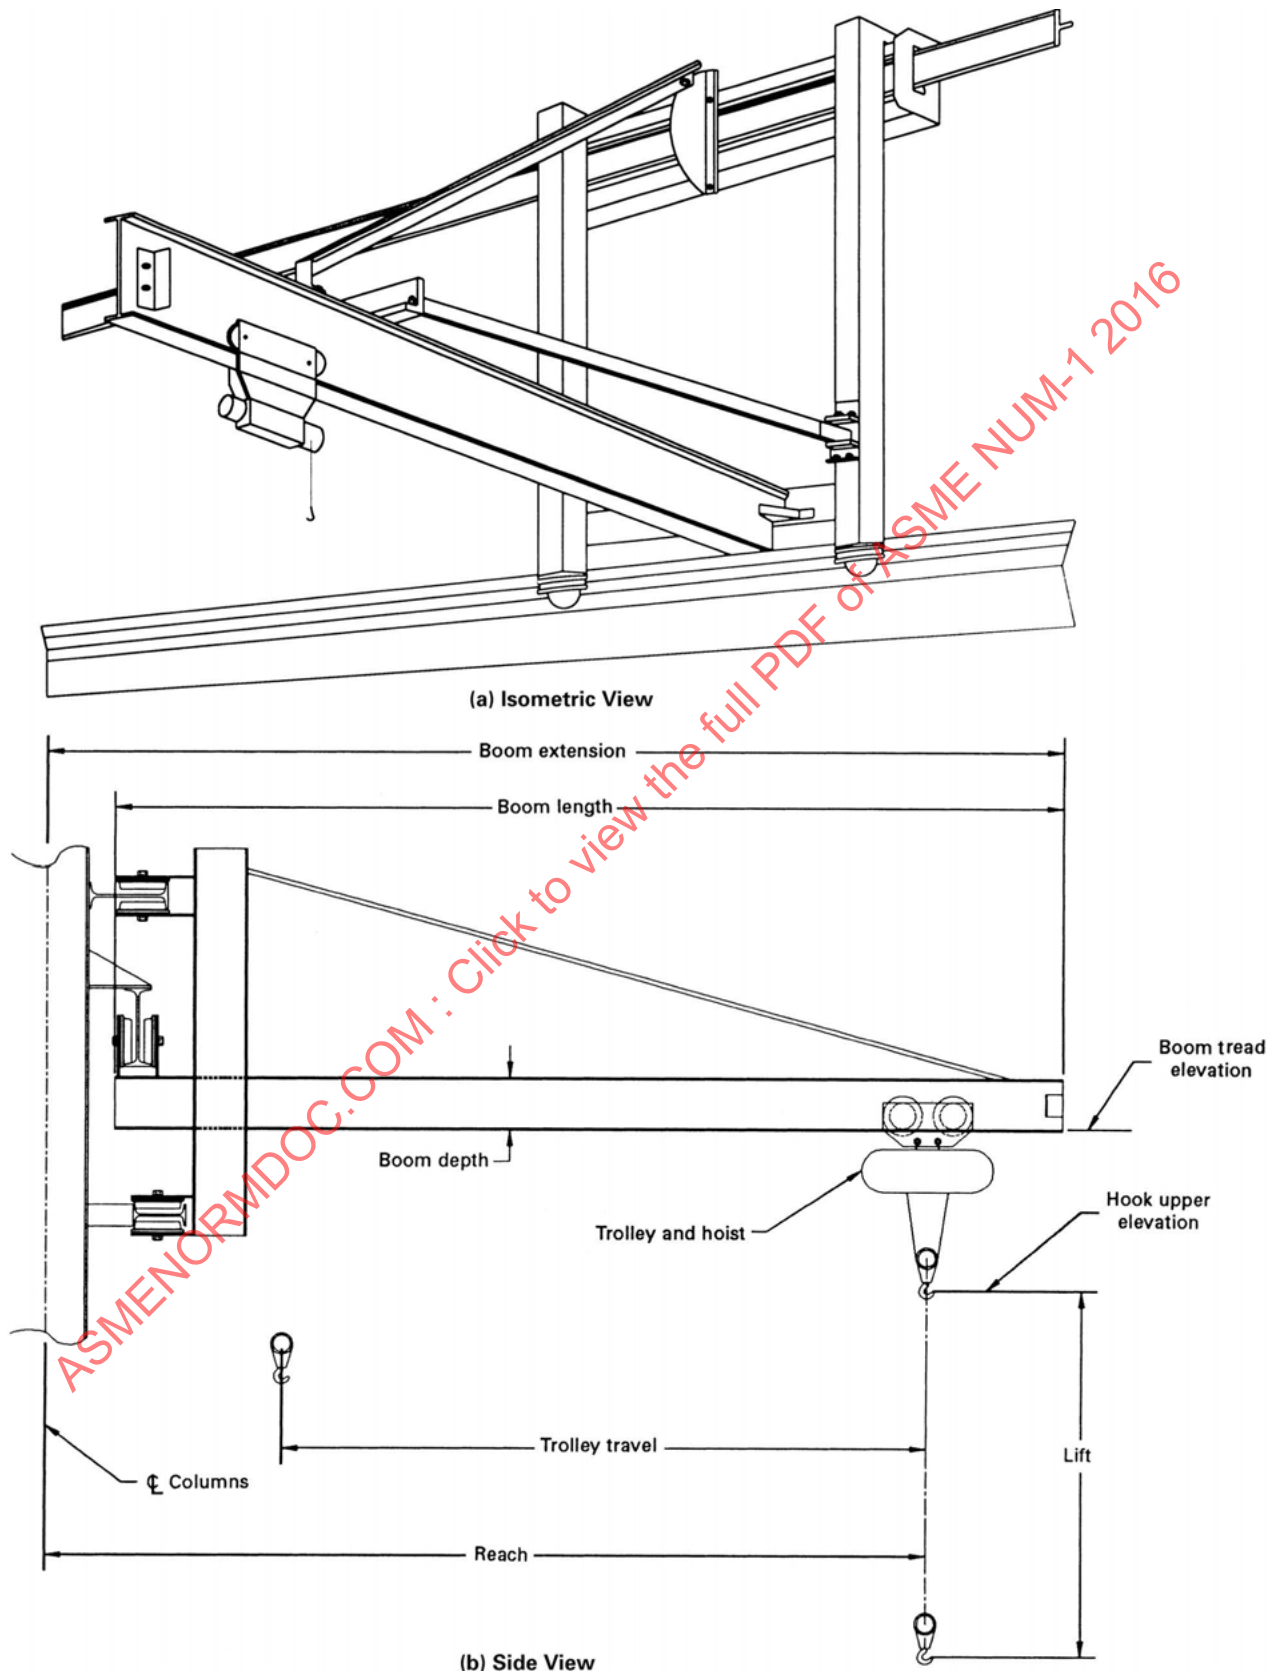

top running with wheels on standard rails or underhung from the lower flange of an I beam or patented track. The horizontal reaction idler trucks may be constructed similar to the vertical truck, top running or under running (see Fig. NUM-III-4100-1).

NUM-III-4322 End Truck Assembly. For the truck assembly drive, if the vertical wheels are top running, a minimum of two wheels shall be driven. If the vertical wheels are under running, a minimum of two pairs of wheels shall be driven.

NUM-III-4322.1 Crane Drive Brakes. Each motorized drive shall be provided with a suitable brake, sized as described in NUM-III-8300.

NUM-III-4330 Underhung Trolley

Underhung trolleys are covered by NUM-III-7700. If the trolley is top running, refer to ASME NOG-1 (for trolley design only).

NUM-III-4331 Underhung Trolley Drive. Trolley drives for single-girder bridge cranes shall be in accordance with NUM-III-7741. Underhung trolley drives for double-girder bridge cranes shall be driven on both sides similar to bridge drives and shall be in accordance with NUM-III-8300.

NUM-III-4340 Hoist

The hoist shall be in accordance with Section NUM-III-7000.

NUM-III-4400 ELECTRICAL

NUM-III-4410 General

(a) Except as noted under (b) below, the following information applies to traveling wall cranes that have an electric motor-operated crane traverse motion.

(b) For traveling wall cranes that do not have an electric motor-operated crane traverse motion, but use either an electrically operated hoist or electrically operated trolley, the information listed in the following sections will still apply: NUM-III-4424, NUM-III-4425, NUM-III-4427, and NUM-III-4430.

NUM-III-4420 Electrical Components

NUM-III-4421 Crane Controls. Crane controls shall meet the criteria of NUM-III-8421.

- (16) **NUM-III-4422 Motors.** Traverse drive motors for an electric motor-operated wall jib shall meet the criteria of NUM-III-8422, with motor sizing in accordance with NUM-III-8422.4.

NUM-III-4423 Brakes

(a) An electric motor-operated wall crane shall be furnished with either a noncoasting mechanical drive, or spring-set, friction-type brakes for each traverse drive motor.

(b) A noncoasting mechanical drive shall be capable of stopping the motion of the wall crane, within a distance in feet equal to 10% of the full-load speed in feet per minute when traveling at full speed with rated load.

(c) Spring-set, friction-type brakes shall be in accordance with NUM-III-8423.

NUM-III-4424 Disconnects and Protective Devices.

Disconnects and protective devices shall be provided in accordance with NUM-III-8424.

NUM-III-4425 Operator Stations and Controllers

(a) The type of operator station and its location shall be specified by the owner.

(b) The location of the pendant push button station controllers shall be one of the following:

- (1) suspended from the hoist and trolley
 - (2) suspended from a festooned messenger track system along the wall crane's boom
 - (3) suspended from a single point off the wall crane's vertical frame or boom
 - (4) remote-mounted off the crane
- (c) A crane operator station of any type shall meet the criteria of NUM-III-8425.

NUM-III-4426 Electrical Enclosures. Electrical enclosures shall be in accordance with the criteria of NUM-III-8426, suitable for the owner-specified environmental conditions of service.

NUM-III-4427 Current Conductor Systems

(a) The type and location of runway system conductors shall be specified by the owner.

(b) All current conductor systems shall meet the criteria of NUM-III-8427.

NUM-III-4428 Warning Devices. Warning device information and criteria shall be in accordance with NUM-III-8428.

NUM-III-4429 Auxiliary Electrical Equipment. Auxiliary electrical equipment information and criteria, such as for travel limit switches, shall be in accordance with NUM-III-8429.

NUM-III-4430 Wiring Materials and Methods

Wiring materials and methods shall meet the criteria of NUM-III-8430.

NUM-III-4500 INSPECTION AND TESTING

NUM-III-4510 Performance

Perform inspection and testing of traveling wall cranes in accordance with NUM-III-8500, as applicable, and the following (to be performed after installation at site):

- (a) Check the levelness and alignment of the wall crane, without load.
- (b) Check deflection of the boom with crane loaded to rated capacity and load positioned at maximum distance

from support rails/flanges. Deflection shall not exceed the maximum specified in NUM-III-4200 or by the owner. Verify that the trolley does not drift along the boom at rated load.

(c) Verify proper alignment and engagement of all wheels with support rails/flanges and proper operation through all modes of travel during rated-load and no-load conditions.

ASMENORMDOC.COM : Click to view the full PDF of ASME NUM-1 2016

Section NUM-III-5000

Jib Cranes

NUM-III-5100 DESCRIPTION

In accordance with the introduction for Type III equipment defined in Section NUM-III-1000, Section NUM-III-5000 applies to the following:

(a) *Wall-Mounted Jib Cranes of the Top-Braced, Under-Braced, or Full-Cantilever Type.* The jib boom may be fixed or have partial rotation and can be manually or power operated. The jib boom may be a patented shape, a structural shape, a reinforced patented or structural shape, or a fabricated section. Overhead hoists of the underhung type (covered in Section NUM-III-7000) may be rigidly suspended or trolley suspended from the jib boom. If trolley suspended, the trolley will operate on the bottom flange of the jib boom (see Fig. NUM-III-5100-1).

(b) *Freestanding Pillar Jib Cranes of the Base-Mounted or Insert-Mounted Type.* The jib boom may be fixed or have partial or full 360-deg rotation (specified degree of overlap or continuous) and can be manually or power operated. Jib boom, hoists, and trolleys are the same as described in (a) above (see Fig. NUM-III-5100-2).

(c) *Mast-Type Jib Cranes of the Top-Braced, Under-Braced, or Full-Cantilever Type.* The jib boom may be fixed or have partial or full 360-deg rotation (specified degree of overlap or continuous) and can be manually or power operated. Jib boom, hoists, and trolleys are the same as described in (a) above (see Fig. NUM-III-5100-3).

NUM-III-5200 STRUCTURAL

NUM-III-5210 General

This section covers the structural requirements and design criteria specific to Type III jib cranes as described in NUM-III-5100. For other structural requirements and criteria, refer to NUM-III-8200.

NUM-III-5220 Design Criteria

NUM-III-5221 Allowable Deflections and Cambers

NUM-III-5221.1 Jib Boom Deflection. The maximum vertical deflection of the boom produced by the boom dead load, the trolley dead load (including the hoist dead weight), and the design rated load shall not exceed $\frac{1}{600}$ of the span. When a motorized trolley is specified, the allowable vertical deflection may be increased up to $\frac{1}{450}$ of the span. Impact shall not be considered in determining deflection.

NUM-III-5221.2 Miscellaneous Structure Deflection. In the case of jib cranes that are self-supporting (such as freestanding or mast type) the entire structure shall not produce a deflection greater than that given in NUM-III-5221.1 under jib boom deflection.

NUM-III-5230 Components Design

NUM-III-5231 Jib Booms, Beams, or Tracks. Jib booms may be standard rolled beams and reinforced with angles, channels, or plates. Where necessary, auxiliary members shall be used to act as bracing when a full cantilever is not used.

The analysis required for jib booms shall be in accordance with NUM-III-8200.

NUM-III-5232 Columns, Posts, or Masts. Columns may be standard rolled beams, plate girders, structural tube, or structural pipe, and reinforced with angles, channels, or plates. The analysis shall be as stated for jib booms in NUM-III-5231.

NUM-III-5233 Braces and Secondary Members.

Braces and secondary members may be fabricated of standard rolled beams, angles, tees, rods, structural tube, or other structural shapes. They shall be analyzed in accordance with NUM-III-8200.

NUM-III-5240 Design Requirements for Jib Crane Supports

(a) All attachment point locations and load reactions to the interfacing structures and foundations shall be provided by the manufacturer.

(b) The owner shall analyze the interfacing structures and foundations for all loading conditions the jib crane may impose through its full rotational movement.




(c) Interfacing structures and foundations shall be designed such that the maximum resisting moment against overturning (based upon dead load plus rated load) will provide a safety factor of 2.

(d) For the purposes of sizing baseplates of jib cranes attached to concrete, the manufacturer shall assume a concrete ultimate compressive strength of 2,000 psi unless otherwise specified by the owner.

NUM-III-5300 MECHANICAL

NUM-III-5310 General

This section covers the specific mechanical requirements and criteria for jib cranes. For other mechanical

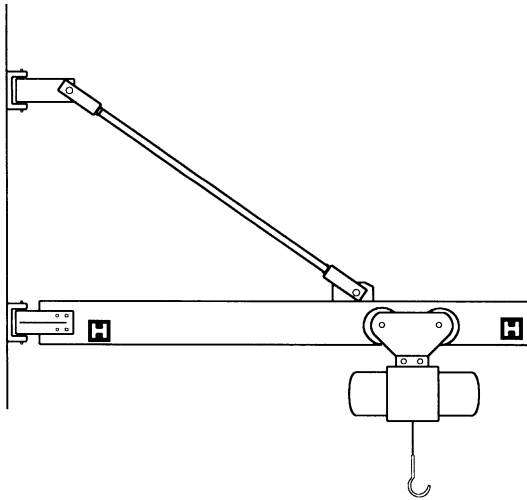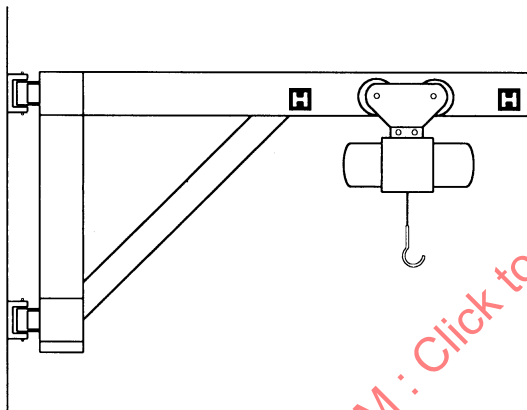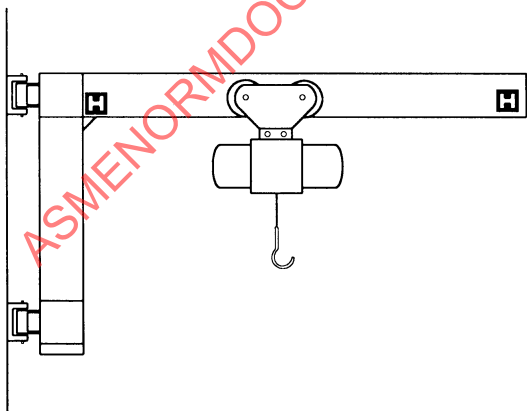Fig. NUM-III-5100-1 Wall-Mounted Jib Cranes**(a) Top-Braced Wall-Mounted Jib Crane****(b) Under-Braced Wall-Mounted Jib Crane****(c) Full-Cantilevered Wall-Mounted Jib Crane**

requirements and criteria common to all cranes, refer to NUM-III-8300.

(a) If the jib crane is subject to damage due to wind loading, a means shall be provided to tie down or restrain the boom during storage.

(b) If the jib crane's boom is located 16 ft or more above the operating floor, or if the jib crane is subject to wind loading, the jib boom's rotation should be hand-gear powered or motorized.

NUM-III-5320 Underhung Trolley

Underhung trolleys are covered by NUM-III-7700.

NUM-III-5321 Underhung Trolley Drive. Trolley drives for jib cranes shall be in accordance with NUM-III-7741.

NUM-III-5330 Hoist

The hoist shall be in accordance with NUM-III-7000.

NUM-III-5340 Wall-Bracket-Type Jib Cranes

Rotational stops for the jib boom shall be specified by the owner, if required.

NUM-III-5350 Freestanding or Mast-Type Jib Cranes

Jib boom rotation shall be limited unless the power service connection provides for continuous rotation.

NUM-III-5400 ELECTRICAL

NUM-III-5410 General

(a) Except as noted under (b) below, the following information applies to jib cranes that have motor-operated boom rotation.

(b) For jib cranes that do not have a motor-operated boom, but use either an electrically operated hoist or electrically operated trolley, the information listed in the following sections will still apply: NUM-III-5424, NUM-III-5425, NUM-III-5427, and NUM-III-5430.

NUM-III-5420 Electrical Components


NUM-III-5421 Crane Controls

(a) Crane controls for a motorized boom shall have a cushioned start device or other controlled acceleration means.


(b) Crane controls of any type shall meet the criteria of NUM-III-8421.

NUM-III-5422 Motors. A jib slew drive motor for a motorized boom shall meet the criteria of NUM-III-8422, except that the motor rating, which is basically the mechanical horsepower with consideration for the effect (16)


Fig. NUM-III-5100-2 Freestanding Pillar Jib Cranes

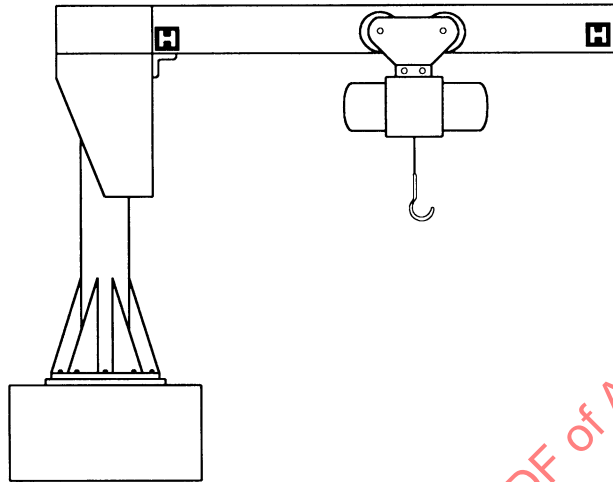

(a) Base-Mounted Pillar Jib Crane

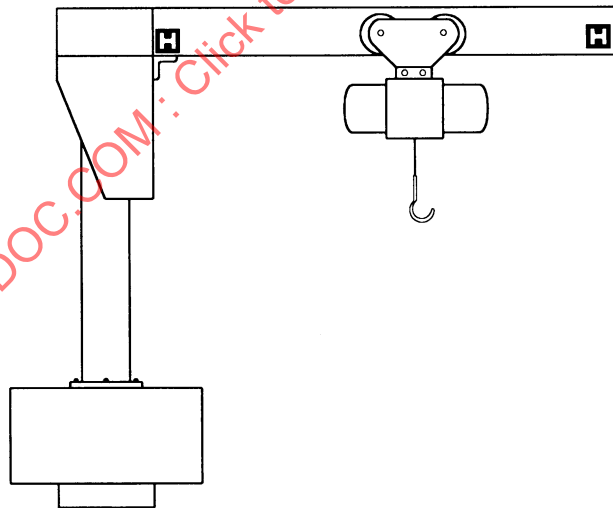

(b) Insert-Mounted Pillar Jib Crane

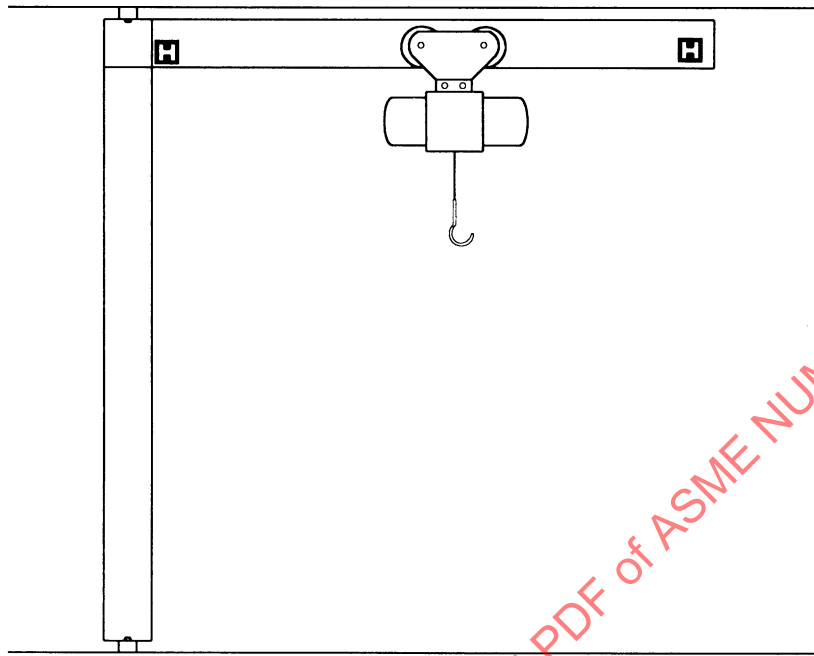Fig. NUM-III-5100-3 Mast-Type Jib Cranes

of control, shall be sized as follows for indoor and outdoor applications:

(a) *Slew Drive Motor-Size Selection, Indoor Cranes.* The jib slew drive motor shall be selected so that the horsepower rating is not less than that given by the following formula:

$$HP = \frac{I_o(N^3)}{(7 \times 10^6)EK_t} \quad (1)$$

where, referring to Fig. NUM-III-5422-1

E = system efficiency

I_o = load moment of inertia
= $WL \times RL^2$

K_t = torque factor, which is the equivalent steady-state torque relative to rated motor torque that results in accelerating up to rated motor rpm in the same time as the actual variable-torque speed characteristic of the motor and control characteristic used (see Table NUM-III-8422.4-5 for standard values of K_t)

N = rotational speed, rpm

RL = maximum load radius, ft

WL = rated load plus the hoist weight, lb

(b) *Slew Drive Motor-Size Selection, Outdoor Cranes.* The jib slew drive motor shall be selected so that the horsepower rating is not less than that given by the following formula:

$$\text{Total required horsepower} = HP + HP_{\text{wind}}$$

where HP is as specified above and

$$HP_{\text{wind}} = \frac{TN}{5,250 EK_t} \quad (2)$$

and where, referring to Fig. NUM-III-5422-1

HP_{wind} = horsepower required to overcome wind load

$$T = PSF [(A_{\text{boom}})(RB) + (A_{\text{load}})(RL)]$$

where

A_{boom} = projected area of boom, ft²

A_{load} = projected area of load, ft²

HB = height of boom, ft

HL = height of load, ft

LB = length of boom, ft

LL = length of load, ft

PSF = operating wind load, psi (use 5 psi if not otherwise specified by the owner)

$$= LB \times HB$$


RB = radius to centroid of projected area of boom, ft

$$= LL \times HL$$

RL , N , E , and K_t are defined in (a) above.

(c) See NUM-B-2000 for a jib slew drive sample calculation and NUM-B-3000 for derivation of the simplified horsepower formula.

Fig. NUM-III-5422-1 Slew Drive Motor-Size Selection

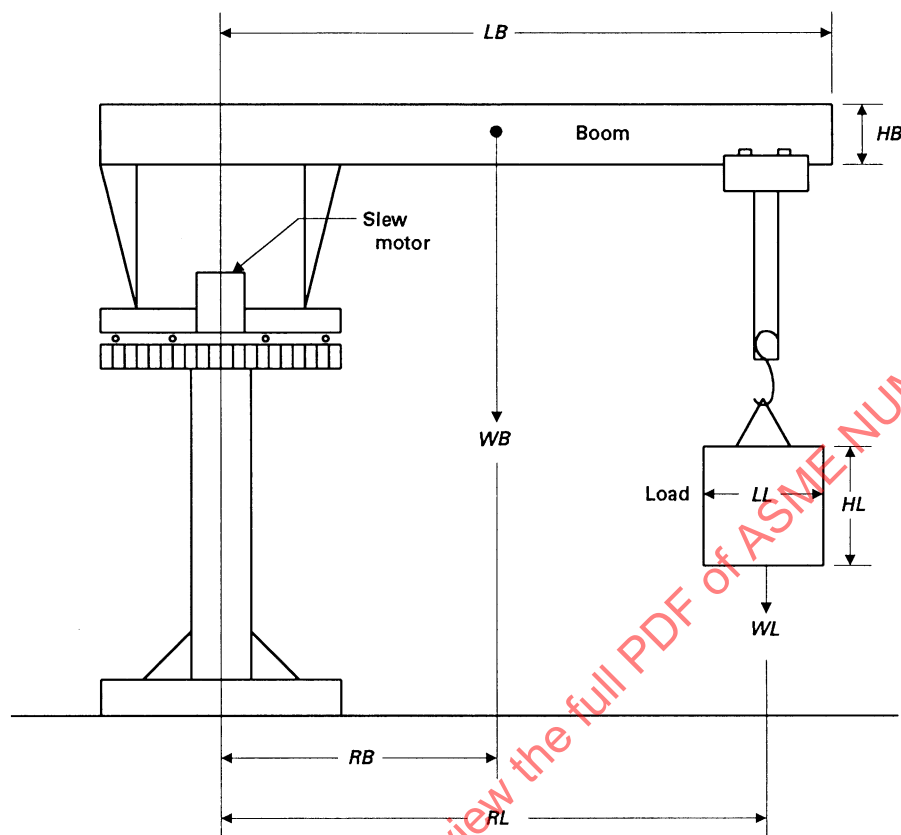**NUM-III-5423 Brakes**

(a) A motorized boom shall be furnished with either a noncoasting mechanical drive or a spring-set, friction-type brake.

(b) A noncoasting mechanical drive shall be capable of stopping the motion of the jib boom within a distance in revolutions equal to 10% of the full-load speed in revolutions per minute when traveling at full speed with rated load.

(c) A spring-set, friction-type brake shall have a torque rating of at least 50% of the rated motor torque and shall meet the additional criteria of NUM-III-8423.

NUM-III-5424 Disconnects and Protective Devices.

Disconnects and protective devices shall be provided in accordance with NUM-III-8424.

NUM-III-5425 Operator Stations and Controllers

(a) The type of operator station and its location shall be specified by the owner.

(b) The location of the push-button station controllers shall be one of the following:

- (1) suspended from the hoist and trolley
- (2) suspended from a festooned messenger track system along the boom
- (3) suspended from a single point off the jib boom, or suspended off the jib hood for a self-supported jib

(4) mounted on the mast of a self-supported jib

(5) remote-mounted off the crane

(c) A crane operator station of any type shall meet the criteria of NUM-III-8425.

NUM-III-5426 Electrical Enclosures. Electrical enclosures shall be in accordance with the criteria of NUM-III-8426, suitable for the owner-specified environmental conditions of service.

NUM-III-5427 Current Conductor Systems

(a) Unless otherwise specified by the owner, the main power to a motorized jib or manual jib with either an electrically operated hoist or electrically operated trolley shall be provided by the owner.

(1) Location of the main power supply interface shall be specified by the owner.

(2) For a self-supporting jib, the main power supply interface is normally identified as either a top-entry or bottom-entry system.

(b) All current conductor systems shall meet the criteria of NUM-III-8427, with jib boom conductors meeting the same criteria as those specified for bridge systems.

NUM-III-5428 Warning Devices. Warning device information and criteria shall be in accordance with NUM-III-8428.

NUM-III-5429 Auxiliary Electrical Equipment. Auxiliary electrical equipment information and criteria, such as for travel limit switches, shall be in accordance with NUM-III-8429.

NUM-III-5430 Wiring Materials and Methods

Wiring materials and methods shall meet the criteria of NUM-III-8430.

NUM-III-5500 INSPECTION AND TESTING

NUM-III-5510 Performance

Perform inspection and testing of jib cranes in accordance with NUM-III-8500, as applicable, and the following (to be performed after installation at site):

(a) Check the levelness and alignment of the boom or jib, without load.

(b) Check deflection of the boom with rated load applied at maximum distance from wall, mast, or column support. Deflection shall not exceed the maximum specified in NUM-III-5200. Verify that the trolley does not drift along the boom at rated load.

(c) Verify proper rotation of the jib throughout its full range of travel with the rated load applied at the maximum distance from the wall, mast, or column support as permitted by the test load configuration. Verify that the amount of boom drift under these conditions is acceptable.

ASMENORMDOC.COM : Click to view the full PDF of ASME NUM-1 2016

Section NUM-III-6000

Monorail Systems

NUM-III-6100 DESCRIPTION

In accordance with the introduction for Type III equipment defined in Section NUM-III-1000, Section NUM-III-6000 applies to single-track monorail systems including curves, switches, transfer devices, lift and drop sections, and associated equipment (see Figs. NUM-III-6100-1 through NUM-III-6100-6). Monorail equipment may be manually operated, power operated, or automatic and may be controlled by floor operation, cab operation, pulpit operation, or remote operation. For monorail systems, the trolley operates on the bottom flange of the track. The monorail track may be a patented shape, a structural shape, a reinforced patented or structural shape, or a fabricated section.

NUM-III-6200 STRUCTURAL

NUM-III-6210 General

This section covers the structural requirements and design criteria specific to Type III monorail systems as described in NUM-III-6100. For other structural requirements and criteria, refer to NUM-III-8200.

NUM-III-6220 Design Criteria


NUM-III-6221 Allowable Deflections and Cambers

NUM-III-6221.1 Miscellaneous Structure Deflection. Deflections of components such as end ties, end trucks, and auxiliary beams shall not impair the functions for which they were designed or cause any attachments to the crane to become dislodged or leave the crane.

NUM-III-6221.2 Monorail Beam Deflection. The maximum vertical deflection of the monorail beam produced by the beam dead load, the trolley dead load (including the hoist dead weight), and the design rated load shall not exceed $\frac{1}{600}$ of the span between supports. Impact need not be considered in determining deflection.

NUM-III-6221.3 Monorail Camber. Where monorail beams are cambered, the recommended amount of camber is equal to the beam dead load deflection, plus $\frac{1}{2}$ of the deflection caused by the trolley dead load (including hoist dead weight), plus $\frac{1}{2}$ of the deflection caused by the design rated load. Monorail beam camber and deflection shall be considered when determining vertical clearance.

Fig. NUM-III-6100-1 Monorail System

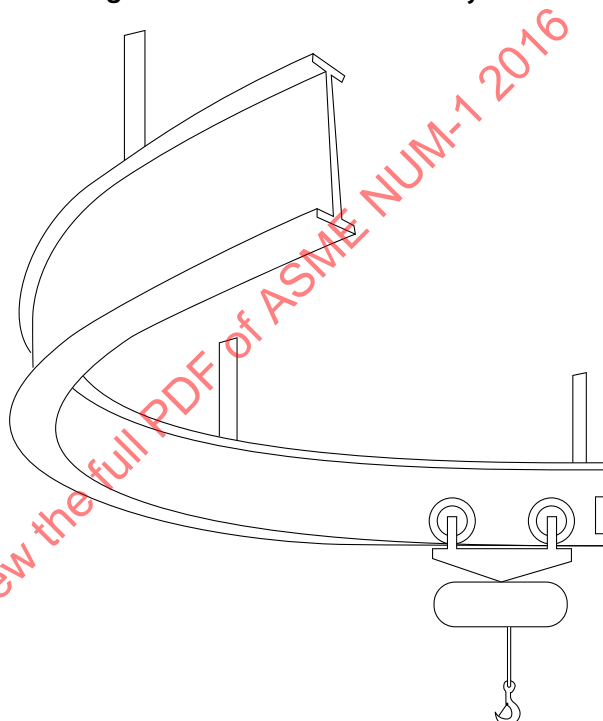




NUM-III-6222 Inertia Forces From Drives. The inertia forces occur during acceleration or deceleration of trolley motion and depend on the driving and braking torques applied by the drive units and brakes during each cycle. These loads are longitudinal to the monorail only. This load shall be taken as 10% of the combined trolley dead load and the rated load.

NUM-III-6223 Allowable Stresses and Wheel Loads

NUM-III-6223.1 Lower Load-Carrying (Tension) Flange. The allowable stress in the lower load-carrying (tension) flange shall be 20% of the minimum ultimate strength of the material used.

NUM-III-6223.2 Compression Flange. The allowable stress in the compression flange shall be determined per NUM-III-8200.

NUM-III-6223.3 Allowable Wheel Loads. Allowable wheel loads shall take into account the stress imposed on the lower load-carrying flange when a carrier transfers from one track to another. Where track sections are diagonally cut at transfers, the wheel loads

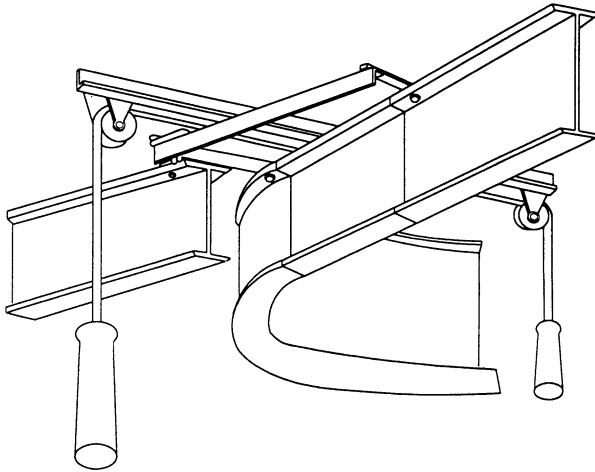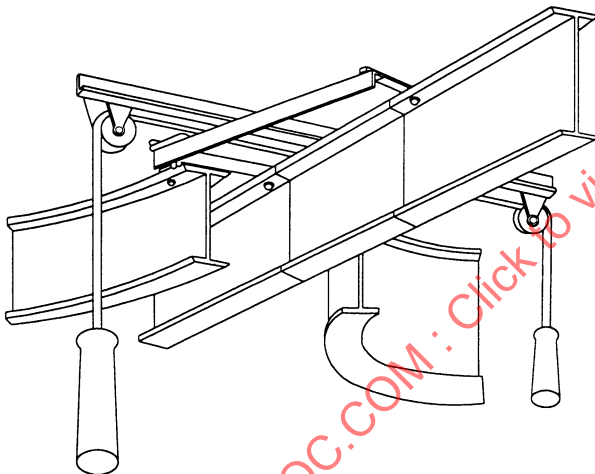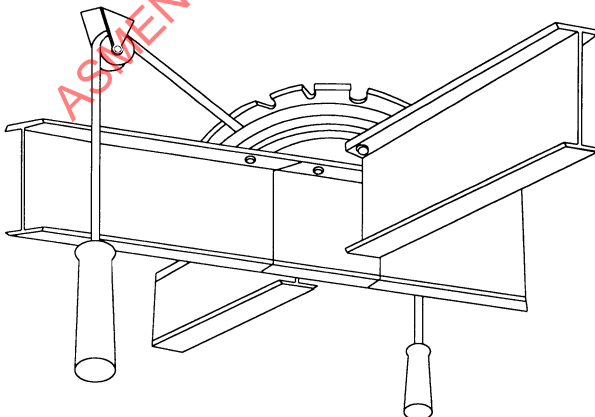Fig. NUM-III-6100-2 Two-Way Switches**Fig. NUM-III-6100-3 Three-Way Switches****Fig. NUM-III-6100-4 Cross-Track Switches**

shall be limited by the stress imposed on the lower load-carrying flange.

NUM-III-6224 Monorail Supports

(a) Monorail beams shall be fastened to a supporting structure.

(b) All clamps, hanger rods, bolts, or other suspension fittings and supporting structures shall be designed to withstand the loads and forces imposed by the cranes or carriers.

(c) Where multiple hanger rods are used at a suspension point, consideration shall be given to the unequal load induced in the rods.

(d) Means shall be provided to restrain the track against damaging lateral and longitudinal movement.

(e) Where the track is suspended from hanger rod assemblies, restraining means shall be provided to prevent the hanger rod nuts from backing off the hanger rods.

(f) All monorail beam supports shall conform to the minimum design parameters as specified in NUM-III-8200 and The AISC Manual of Steel Construction.

NUM-III-6225 Girders, Beams, or Tracks. Girders may be standard rolled beams, patented shape track, or plate girders. Where necessary, auxiliary girders shall be used to support overhanging loads to minimize torsional moments on and lateral deflections of the girder. The analysis required for girders shall be in accordance with NUM-III-8200. On spans longer than 16 ft, the ratio of span to top flange width shall not exceed 60 to 1.

NUM-III-6230 Components Design

NUM-III-6231 Track Joints. Web-type or other suitable couplings shall be provided at all track joints. The maximum gap between ends of the load-carrying flange shall not exceed $\frac{1}{16}$ in.

NUM-III-6232 Monorail Curves. Monorail curves shall be of such radius as to permit operation of the carrier without binding.

NUM-III-6233 Building Expansion Joints. Where a track system crosses building expansion joints, provision shall be made to accommodate for differential expansion of the building and track.

NUM-III-6300 MECHANICAL

NUM-III-6310 General

This section covers the specific mechanical requirements and criteria for monorail systems. For other mechanical requirements and criteria common to all cranes, refer to NUM-III-8300.

Fig. NUM-III-6100-5 Interlocking Mechanisms


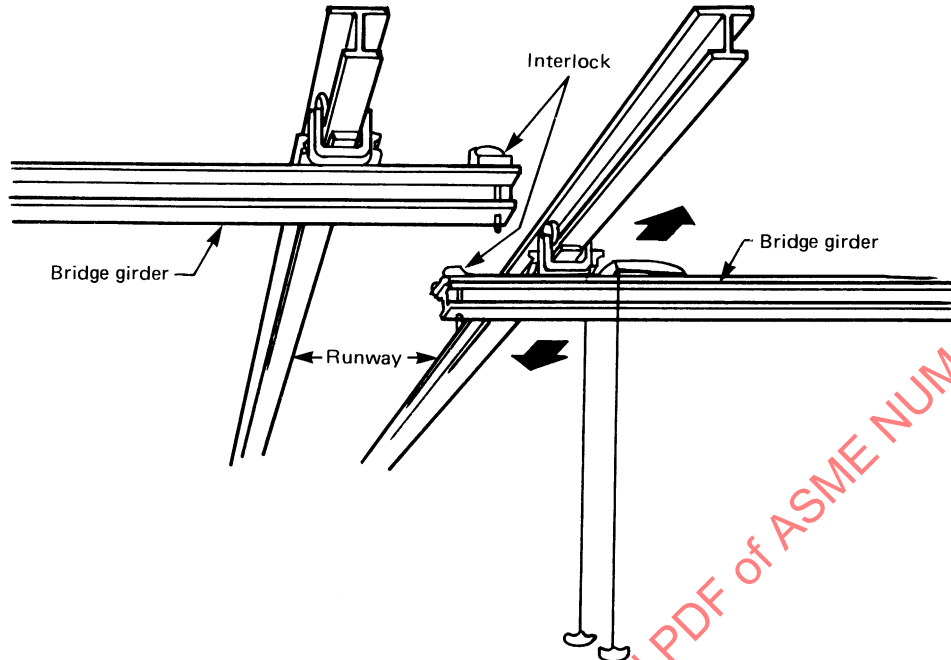


Fig. NUM-III-6100-6 Lift/Drop Sections

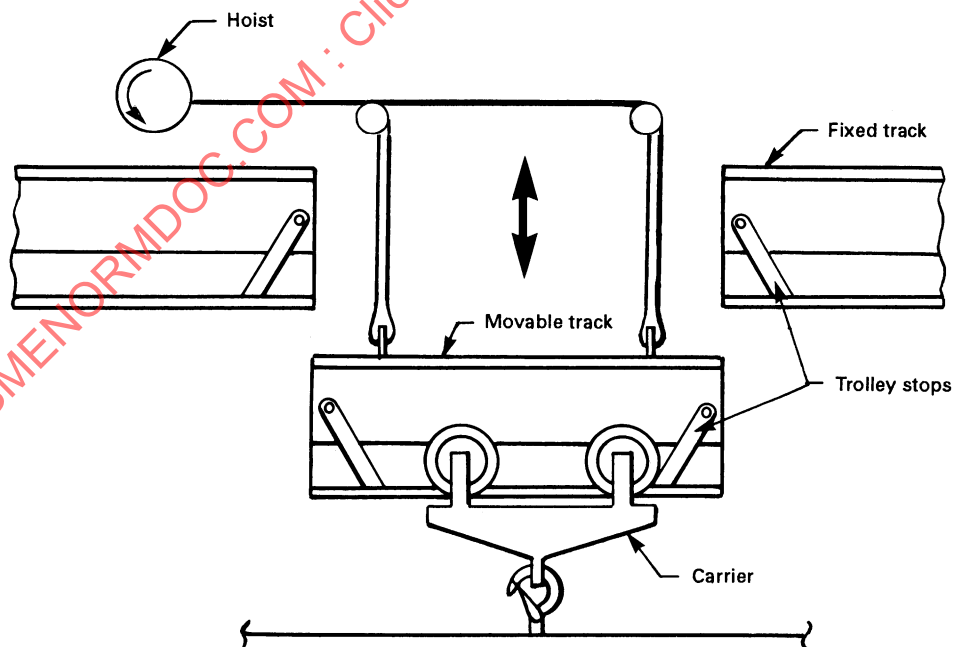

NUM-III-6320 Carrier (Trolley)

NUM-III-6321 Carrier Drives. Carrier drives for monorail cranes shall be in accordance with NUM-III-7741.

NUM-III-6330 Hoist

The hoist shall be in accordance with Section NUM-III-7000.

NUM-III-6340 Track Switches

NUM-III-6341 Track Switch Types. Track switches shall be of the tongue, rotary, cross-track, or sliding type. Track switches shall maintain alignment of the incoming tracks and switch tracks with a maximum gap of $\frac{3}{16}$ in. between adjacent ends of the load-carrying flanges. Switches may be operated by pull chains or ropes, manually, or by electric, pneumatic, or hydraulic operated devices.

NUM-III-6342 Track Switch Stops. Stops shall be provided as an integral part of the switch to protect the end of an incoming track when the switch track is not aligned with the incoming track. Stops shall resist the impact forces of a fully loaded carrier traveling at a speed of 150 ft/min or 50% of the full-load speed if the carrier is motor propelled. Guards shall also be provided to prevent a carrier on the movable track from running off the movable track when it is not engaged with an incoming track.

NUM-III-6343 Track Switch Holding. Means shall be provided to hold the movable frame in alignment during passage of carriers through the track switch.

NUM-III-6350 Track Openers

Track openers, when required, shall be specified by the owner. The gap between the adjacent track and the track opener shall be not more than $\frac{3}{16}$ in. Forks or stops shall be provided to prevent a carrier from running off either of the open ends of the track when the movable section is not in alignment with the track.

NUM-III-6360 Vertical Drop or Lift Sections**NUM-III-6361 Alignment**

(a) Vertical drop or lift sections shall maintain alignment of the stationary tracks and the movable tracks with a maximum gap of $\frac{3}{16}$ in. between adjacent ends of the load-carrying flanges.

(b) When sections are operated by electric, pneumatic, or hydraulic power, means shall be provided to limit the vertical travel for alignment of the movable track with the stationary tracks. Vertical misalignment between the movable track and stationary tracks shall not exceed $\frac{1}{16}$ in.

NUM-III-6362 Track Stops for Vertical Drop or Lift Sections. Stops shall be an integral part of the movable

and stationary track and shall prevent a carrier from running off the open ends of the movable or stationary track when the movable track is not in alignment with the stationary tracks.

NUM-III-6400 ELECTRICAL**NUM-III-6410 General**

The following information applies to monorail systems that use either an electrically operated hoist or electrically operated trolley, or that use electrically operated track devices.

NUM-III-6420 Electrical Components**NUM-III-6421 Electrically Operated Track Devices**

(a) The owner shall specify if track devices are to be electrically operated.

(b) Standard track devices that are electrically operated are as follows:

- (1) track switches and turntables
- (2) track interlocks
- (3) vertical track lift and drop sections
- (4) electric baffles

(c) Electric baffles shall be provided as required by ASME B30.11.

NUM-III-6422 Motors. Motors for electrically operated track devices shall meet the criteria of NUM-III-8422, except that time rating and size selection shall be as required for the specific track device and application.

NUM-III-6423 Brakes

(a) Vertical track lift and drop sections shall be furnished with a spring-set, friction-type brake having a torque rating of at least 125% of the rated motor torque of the track device hoisting motor.

(b) Spring-set, friction-type brakes shall be in accordance with NUM-III-8423.

NUM-III-6424 Disconnects and Protective Devices.

Disconnects and protective devices shall be provided in accordance with NFPA 70, Article 610.

NUM-III-6425 Operator Stations and Controllers

(a) The type of operator station and its location for controlling electrically operated track devices shall be specified by the owner.

(b) The location of the push-button controllers shall be one of the following:

(1) suspended from the track device or from the track itself near the device, offset from the track to allow clearance for the hoist, trolley, and load

(2) mounted on a fixed building column or other structure near the track device

(3) combined with the controllers of a suspended push-button station from the hoist and trolley

(4) combined with the controllers of a suspended push-button station from an interlocking bridge

(5) remote-mounted off the monorail

NUM-III-6426 Electrical Enclosures. Electrical enclosures shall be in accordance with the criteria of NUM-III-8426, suitable for the owner-specified environmental conditions of service.

NUM-III-6427 Current Conductor Systems. All current conductor systems shall meet the criteria of NUM-III-8427, with monorail system conductors meeting the same requirements as those specified for bridge conductors.

NUM-III-6428 Warning Devices. A gong or other warning means shall be provided for all cab-operated and remote-operated monorail systems.

NUM-III-6429 Auxiliary Electrical Equipment. Electrical interlocks and travel limit switches shall be provided as requested by the owner.

NUM-III-6430 Wiring Materials and Methods

Wiring materials and methods shall meet the criteria of NUM-III-8430.

NUM-III-6500 INSPECTION AND TESTING

(16) NUM-III-6510 Performance

Inspection and testing of monorails shall be in accordance with NUM-III-8500. The following site inspections shall be performed as applicable to verify installation:

(a) *Tracks.* Check the following for compliance with drawings and with NUM-III-6200:

- (1) track levelness
- (2) proper location and installation of supports (e.g., hanger rods)
- (3) bracing to prevent excessive sway
- (4) rail couplings (splice plates)
- (5) rail spacing (gaps)
- (6) track radii
- (7) proper clearances
- (8) end stops

(b) *Track Switches.* Check track switches for

- (1) proper alignment and operation
- (2) spacing (gaps)
- (3) stops or guards on open ends of track and on movable track
- (4) means of holding movable track when carrier (trolley) is being moved on it
- (5) electric baffles (if provided to prevent load path from interfering with load path of adjacent track)

NOTE: Track switches shall only operate with an unloaded carrier unless otherwise specified and designed for.

(c) *Track Openers.* Check track openers, if provided, for

- (1) proper alignment and operation
- (2) spacing (gaps)
- (3) proper installation of forks or stops to prevent carrier (trolley) from running off open ends of track when movable section is not aligned with the track
- (d) *Vertical Drop and Lift Sections.* Check vertical drop and lift sections for
 - (1) proper alignment
 - (2) spacing (gaps)
 - (3) end stops
 - (4) clearances
 - (5) electric baffles (if provided for cab-operated carriers or automatic-dispatch carriers)

(e) *Clearances.* Check clearances of lateral or overhead obstructions for compliance with NUM-G-2110.

(f) *Locking and Safety Devices.* During no-load operational testing, check all locking and safety devices for interlocking mechanisms, track switches, drop sections, and lift sections.

(g) *Deflection.* Check deflection of track and track components at rated load for compliance with NUM-III-6200.

(h) *Rated-Load Testing.* During rated-load testing, check the trolley for smooth motion in all directions, around all curves, across all rail splices, and through all switch configurations and travel directions. Check for proper structural bracing to prevent excessive sway and to check for proper alignment of track splices and switches under load.

Section NUM-III-7000

Overhead Hoists and Under-Running Trolleys

NUM-III-7100 DESCRIPTION

(a) In accordance with the introduction for Type III equipment defined in Section NUM-III-1000, Section NUM-III-7000 applies to overhead hoists and under-running trolleys. The various types of hoists covered by this Section are as follows:

(1) *Electric Wire-Rope Hoist*. An electric-powered hoist using wire rope as the lifting medium (see Fig. NUM-III-7100-1 and subsection NUM-III-7200).

(2) *Hand-Chain Hoist*. A manually operated hoist actuated by a hand chain and using chain as the lifting medium (see Fig. NUM-III-7100-2 and subsection NUM-III-7300).

(3) *Electric-Chain Hoist*. An electric-powered hoist using chain as the lifting medium (see Fig. NUM-III-7100-3 and subsection NUM-III-7400).

(4) *Air-Operated Wire-Rope Hoist*. An air-powered hoist using wire rope as the lifting medium (see Fig. NUM-III-7100-4 and subsection NUM-III-7500).

(5) *Air-Operated Chain Hoist*. An air-powered hoist using chain as the lifting medium (see Fig. NUM-III-7100-5 and subsection NUM-III-7600).

(b) All hoists listed above are considered overhead hoists and are to be used for vertical lifting or lowering a freely suspended, unguided load.

(c) The type of hoist suspension shall be by either an under-running trolley (see Fig. NUM-III-7100-6 and subsection NUM-III-7700) or by another means as described in the paragraph pertaining to the particular hoist type.


NUM-III-7200 ELECTRIC WIRE-ROPE HOISTS

NUM-III-7210 General

This section applies to electric wire-rope hoists for vertical lifting service involving material handling of freely suspended, unguided loads using wire rope as a lifting medium with one of the following types of suspension (see Fig. NUM-III-7210-1):

- (a) lug
- (b) hook
- (c) trolley
- (d) base or deck mounted

Fig. NUM-III-7100-1 Electric Wire-Rope Hoist

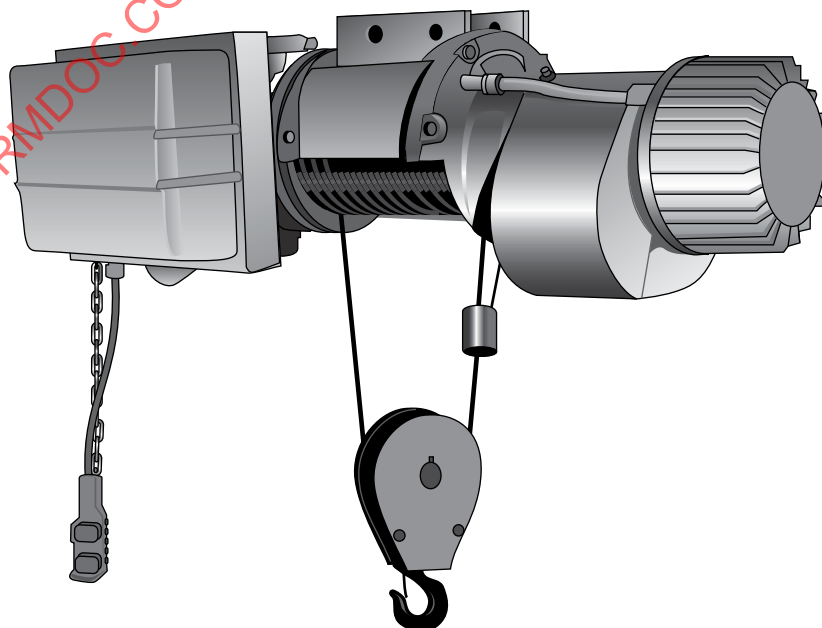

- (e) wall mounted
- (f) ceiling mounted

Fig. NUM-III-7100-2 Hand-Chain Hoist


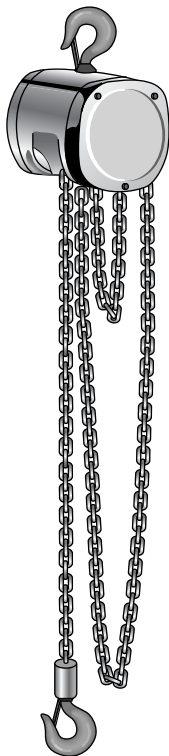


Fig. NUM-III-7100-3 Electric-Chain Hoist

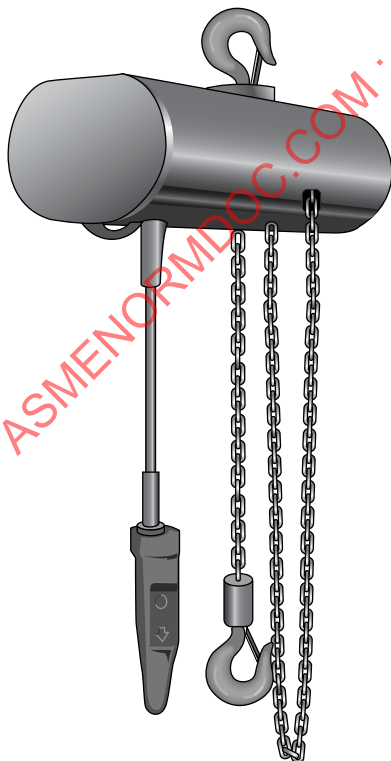

NUM-III-7220 Common Design Considerations

For design considerations common to all hoist types, refer to NUM-III-7900. The following is a list of applicable NUM-III references:

NUM-III-7910	General
NUM-III-7920	Application
NUM-III-7930	Design Considerations
NUM-III-7940	Mechanical
NUM-III-7941	Hooks and Load Blocks
NUM-III-7941.1	Hooks
NUM-III-7941.2	Load Blocks
NUM-III-7942	Wire Rope
NUM-III-7942.1	Sheaves
NUM-III-7942.2	Drums
NUM-III-7942.3	Reeving
NUM-III-7944	Bearings and Rotating Shafts
NUM-III-7944.1	Bearings
NUM-III-7944.2	Rotating Shafts
NUM-III-7945	Gearing
NUM-III-7946	Hoist Brakes
NUM-III-7946.1	Power-Operated Hoists
NUM-III-7947	Overtravel and Overload-Limiting Devices
NUM-III-7947.1	Overtravel Protection
NUM-III-7947.2	Overload-Limiting Devices
NUM-III-7948	Motor Size Selection
NUM-III-7950	Electrical
NUM-III-7951	General
NUM-III-7951.1	Hazardous Location
NUM-III-7951.2	Fungus Protection
NUM-III-7952	Motors
NUM-III-7953	Controllers
NUM-III-7953.1	Types of Control
NUM-III-7953.2	VFD Hoist Controls
NUM-III-7953.3	Contactors
NUM-III-7953.4	Pendant Control
NUM-III-7953.5	Pull-Cord Control
NUM-III-7954	Control Enclosures
NUM-III-7955	Resistors
NUM-III-7956	Current Conductor System
NUM-III-7970	Hoist Marking

NUM-III-7230 Specific Design Considerations

All design considerations for electric wire-rope hoists are covered in NUM-III-7900.

NUM-III-7300 HAND-CHAIN HOISTS

NUM-III-7310 General

This section applies to hand-chain manually operated chain hoists for vertical lifting service involving material handling of freely suspended, unguided loads using welded-link-type load chain as a lifting medium with

Fig. NUM-III-7100-4 Air-Operated Wire-Rope Hoist


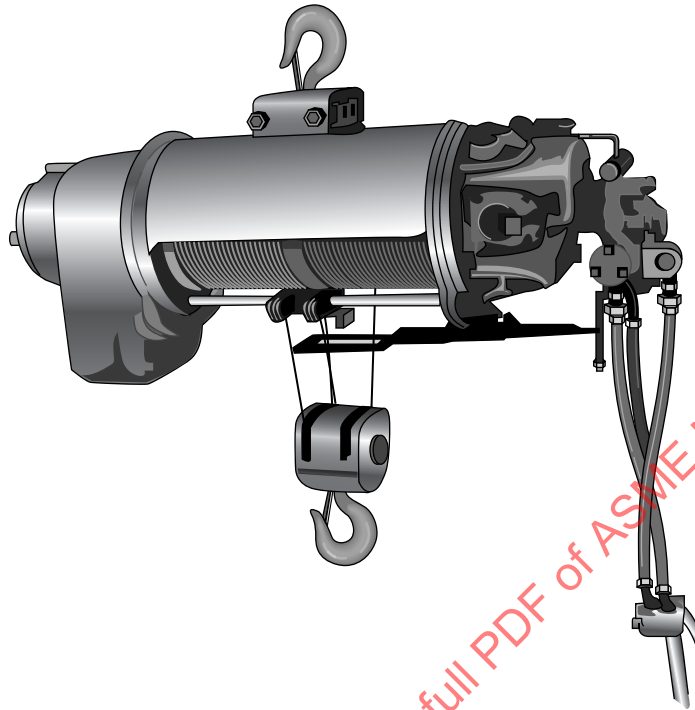



Fig. NUM-III-7100-5 Air-Operated Chain Hoist




Fig. NUM-III-7100-6 Under-Running Trolley

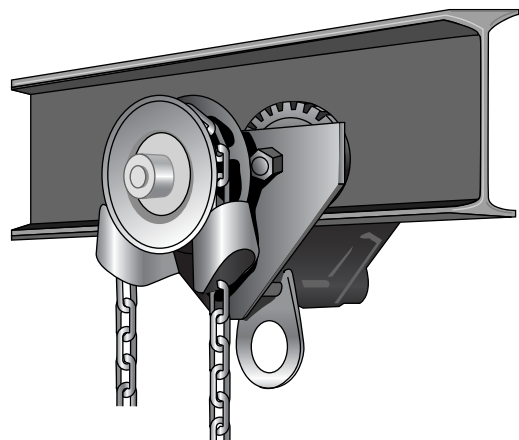

(16)

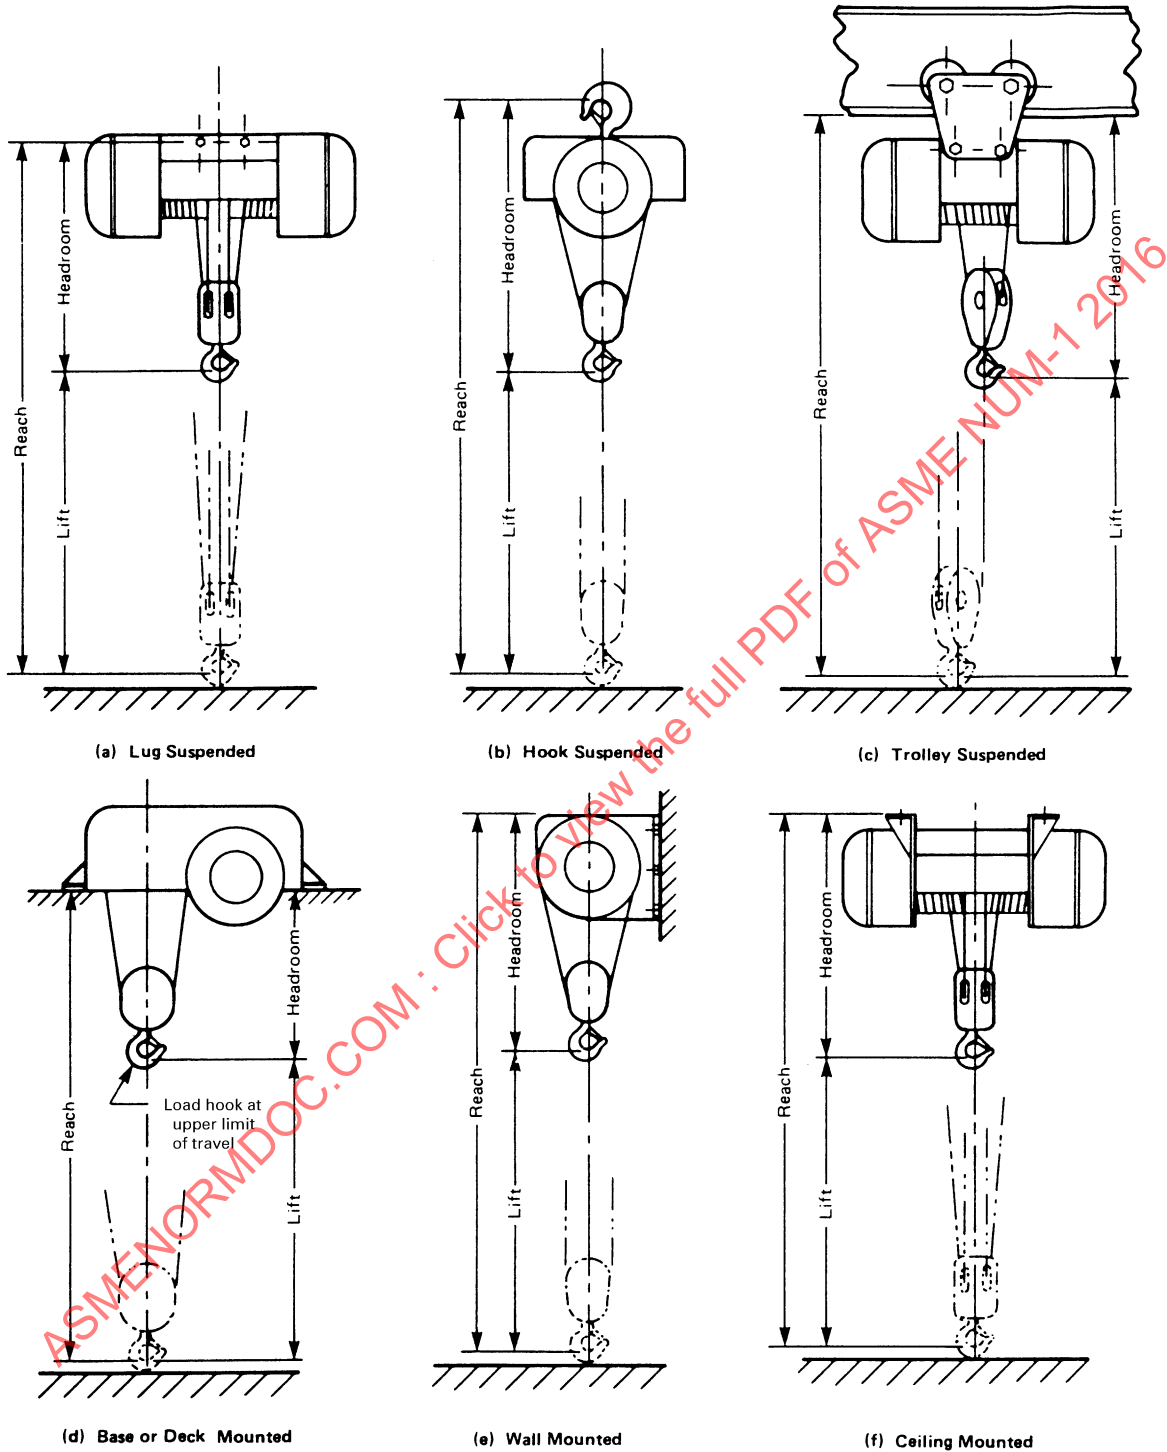Fig. NUM-III-7210-1 Electric Wire-Rope Hoist, Suspension Types

GENERAL NOTE: Illustrations shown are not intended to confine the use of single or double reeving. Each of the mountings may be used with either type of reeving.

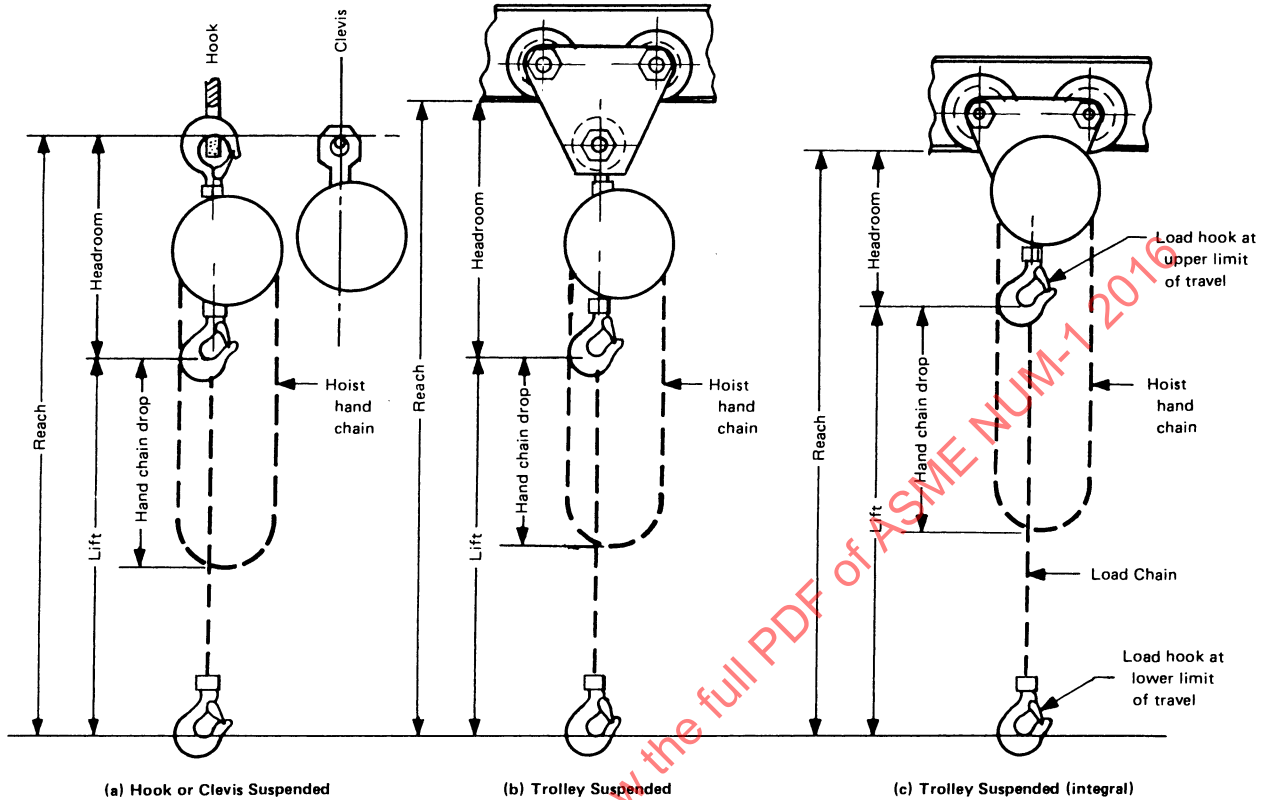Fig. NUM-III-7310-1 Hand-Chain Hoist, Suspension Types

one of the following types of suspensions (see Fig. NUM-III-7310-1):

- (a) clevis
- (b) hook
- (c) trolley

Differential pulley and self-locking worm-drive-type hoists are not included.

NUM-III-7320 Common Design Considerations

For design considerations common to all hoist types, refer to NUM-III-7900. The following is a list of paragraphs applicable to hand-chain hoists:

NUM-III-7910	General
NUM-III-7920	Application
NUM-III-7930	Design Considerations
NUM-III-7940	Mechanical
NUM-III-7941	Hooks and Load Blocks
NUM-III-7941.1	Hooks
NUM-III-7941.2	Load Blocks
NUM-III-7943	Chains
NUM-III-7943.1	Load Chains
NUM-III-7943.2	Load Sprockets
NUM-III-7943.3	Chain Containers
NUM-III-7944	Bearings and Rotating Shafts
NUM-III-7944.1	Bearings
NUM-III-7944.2	Rotating Shafts

NUM-III-7945	Gearing
NUM-III-7946	Hoist Brakes
NUM-III-7946.2	Manual-Operated Hoists
NUM-III-7947	Overtravel and Overload-Limiting Devices
NUM-III-7947.1	Overtravel Protection
NUM-III-7970	Hoist Marking

NUM-III-7330 Specific Design Considerations

For design considerations specific to hand-chain hoists, refer to the paragraphs below.

NUM-III-7340 Mechanical

NUM-III-7341 Hand Chains


(16)

(a) Hand chains shall be of the link-chain type. Each link shall be of uniform size and shape with an accurate pitch to reliably pass over and around the hand-chain wheels.

(b) Hand chains shall be endless-link chain and shall reach to within 18 in. to 24 in. of the operator's floor level or as specified by the owner.

(c) Hoist hand chains shall withstand, without permanent distortion, a pull of either three times the pull required to lift the rated load or 300 lb, whichever is greater.

(16)

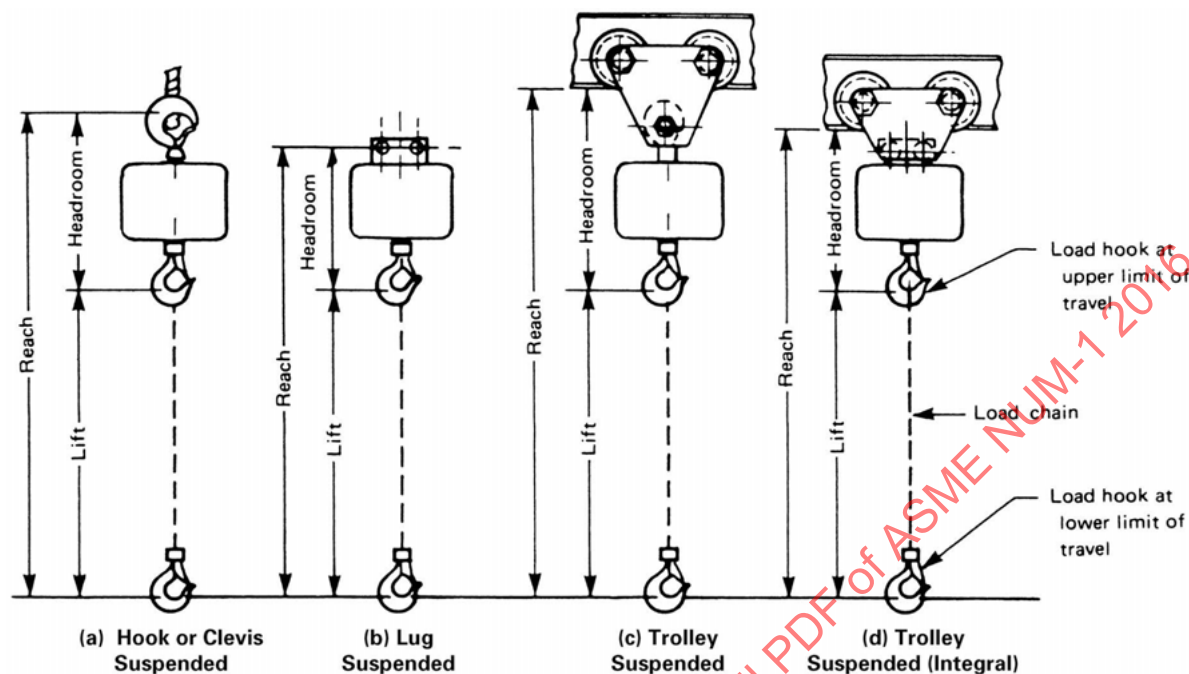Fig. NUM-III-7410-1 Electric-Chain Hoist, Suspension Types

(d) Typical hand-chain pull and overhaul characteristics are presented in Table NUM-A-4000-1.

NUM-III-7400 ELECTRIC-CHAIN HOISTS

NUM-III-7410 General

This section applies to electric-chain hoists for vertical lifting service involving material handling of freely suspended, unguided loads using load chain of the welded-link type with one of the following types of suspension (see Fig. NUM-III-7410-1):

- (a) hook or clevis
- (b) lug
- (c) trolley

NUM-III-7420 Common Design Considerations

For design considerations common to all hoist types, refer to NUM-III-7900. The following is a list of paragraphs applicable to electric-chain hoists:

NUM-III-7910	General
NUM-III-7920	Application
NUM-III-7930	Design Considerations
NUM-III-7940	Mechanical
NUM-III-7941	Hooks and Load Blocks
NUM-III-7941.1	Hooks
NUM-III-7941.2	Load Blocks
NUM-III-7943	Chains
NUM-III-7943.1	Load Chains
NUM-III-7943.2	Load Sprockets
NUM-III-7943.3	Chain Containers

NUM-III-7944	Bearings and Rotating Shafts
NUM-III-7944.1	Bearings
NUM-III-7944.2	Rotating Shafts
NUM-III-7945	Gearing
NUM-III-7946	Hoist Brakes
NUM-III-7946.1	Power-Operated Hoists
NUM-III-7947	Overtravel and Overload-Limiting Devices
NUM-III-7947.1	Overtravel Protection
NUM-III-7947.2	Overload-Limiting Devices
NUM-III-7948	Motor Size Selection
NUM-III-7950	Electrical
NUM-III-7951	General
NUM-III-7951.1	Hazardous Location
NUM-III-7951.2	Fungus Protection
NUM-III-7952	Motors
NUM-III-7953	Controllers
NUM-III-7953.1	Types of Control
NUM-III-7953.2	VFD Hoist Controls
NUM-III-7953.3	Contactors
NUM-III-7953.4	Pendant Control
NUM-III-7953.5	Pull-Cord Control
NUM-III-7954	Control Enclosures
NUM-III-7955	Resistors
NUM-III-7956	Current Conductor System
NUM-III-7970	Hoist Marking

NUM-III-7430 Specific Design Considerations

All design considerations for electric-chain hoists are covered in NUM-III-7900.

NUM-III-7500 AIR-OPERATED WIRE-ROPE HOISTS**NUM-III-7510 General**

This section applies to air-operated wire-rope hoists for vertical lifting service involving material handling of freely suspended unguided loads using wire rope as a lifting medium with one of the following types of suspension (see Fig. NUM-III-7510-1):

- (a) lug
- (b) hook
- (c) trolley
- (d) base or deck mounted
- (e) wall mounted
- (f) ceiling mounted

NUM-III-7520 Common Design Considerations

For design considerations common to all hoist types, refer to NUM-III-7900. The following is a list of paragraphs applicable to air-operated wire-rope hoists:

NUM-III-7910	General
NUM-III-7920	Application
NUM-III-7930	Design Considerations
NUM-III-7940	Mechanical
NUM-III-7941	Hooks and Load Blocks
NUM-III-7941.1	Hooks
NUM-III-7941.2	Load Blocks
NUM-III-7942	Wire Rope
NUM-III-7942.1	Sheaves
NUM-III-7942.2	Drums
NUM-III-7942.3	Reeving
NUM-III-7944	Bearings and Rotating Shafts
NUM-III-7944.1	Bearings
NUM-III-7944.2	Rotating Shafts
NUM-III-7945	Gearing
NUM-III-7946	Hoist Brakes
NUM-III-7946.1	Power-Operated Hoists
NUM-III-7947	Overtravel and Overload-Limiting Devices
NUM-III-7947.1	Overtravel Protection
NUM-III-7947.2	Overload-Limiting Devices
NUM-III-7948	Motor Size Selection
NUM-III-7960	Pneumatic
NUM-III-7961	Air Motors
NUM-III-7962	Air Motor Controls
NUM-III-7962.1	Pendant Control
NUM-III-7962.2	Pull Control
NUM-III-7962.3	Rod Control
NUM-III-7970	Hoist Marking

NUM-III-7530 Specific Design Considerations

All design considerations for air-operated wire-rope hoists are covered in NUM-III-7900.

NUM-III-7600 AIR-OPERATED CHAIN HOISTS**NUM-III-7610 General**

This section applies to air-powered chain hoists for vertical lifting service involving material handling of freely suspended unguided loads using load chain of the welded-link type with one of the following types of suspension (see Fig. NUM-III-7610-1):

- (a) hook or clevis
- (b) lug
- (c) trolley

NUM-III-7620 Common Design Considerations

For design considerations common to all hoist types, refer to NUM-III-7900. The following is a list of paragraphs applicable to air-operated chain hoists:

NUM-III-7910	General
NUM-III-7920	Application
NUM-III-7930	Design Considerations
NUM-III-7940	Mechanical
NUM-III-7941	Hooks and Load Blocks
NUM-III-7941.1	Hooks
NUM-III-7941.2	Load Blocks
NUM-III-7943	Chains
NUM-III-7943.1	Load Chains
NUM-III-7943.2	Load Sprockets
NUM-III-7943.3	Chain Containers
NUM-III-7944	Bearings and Rotating Shafts
NUM-III-7944.1	Bearings
NUM-III-7944.2	Rotating Shafts
NUM-III-7945	Gearing
NUM-III-7946	Hoist Brakes
NUM-III-7946.1	Power-Operated Hoists
NUM-III-7947	Overtravel and Overload-Limiting Devices
NUM-III-7947.1	Overtravel Protection
NUM-III-7947.2	Overload-Limiting Devices
NUM-III-7948	Motor Size Selection
NUM-III-7960	Pneumatic
NUM-III-7961	Air Motors
NUM-III-7962	Air Motor Controls
NUM-III-7962.1	Pendant Control
NUM-III-7962.2	Pull Control
NUM-III-7962.3	Rod Control
NUM-III-7970	Hoist Marking


NUM-III-7630 Specific Design Considerations

All design considerations for air-operated chain hoists are covered in NUM-III-7900.

NUM-III-7700 UNDER-RUNNING TROLLEYS**NUM-III-7710 General**

This section applies to plain-type, hand-chain-operated, and motor-driven under-running trolleys. Trolleys may be suspended from multiple girders or


(16)

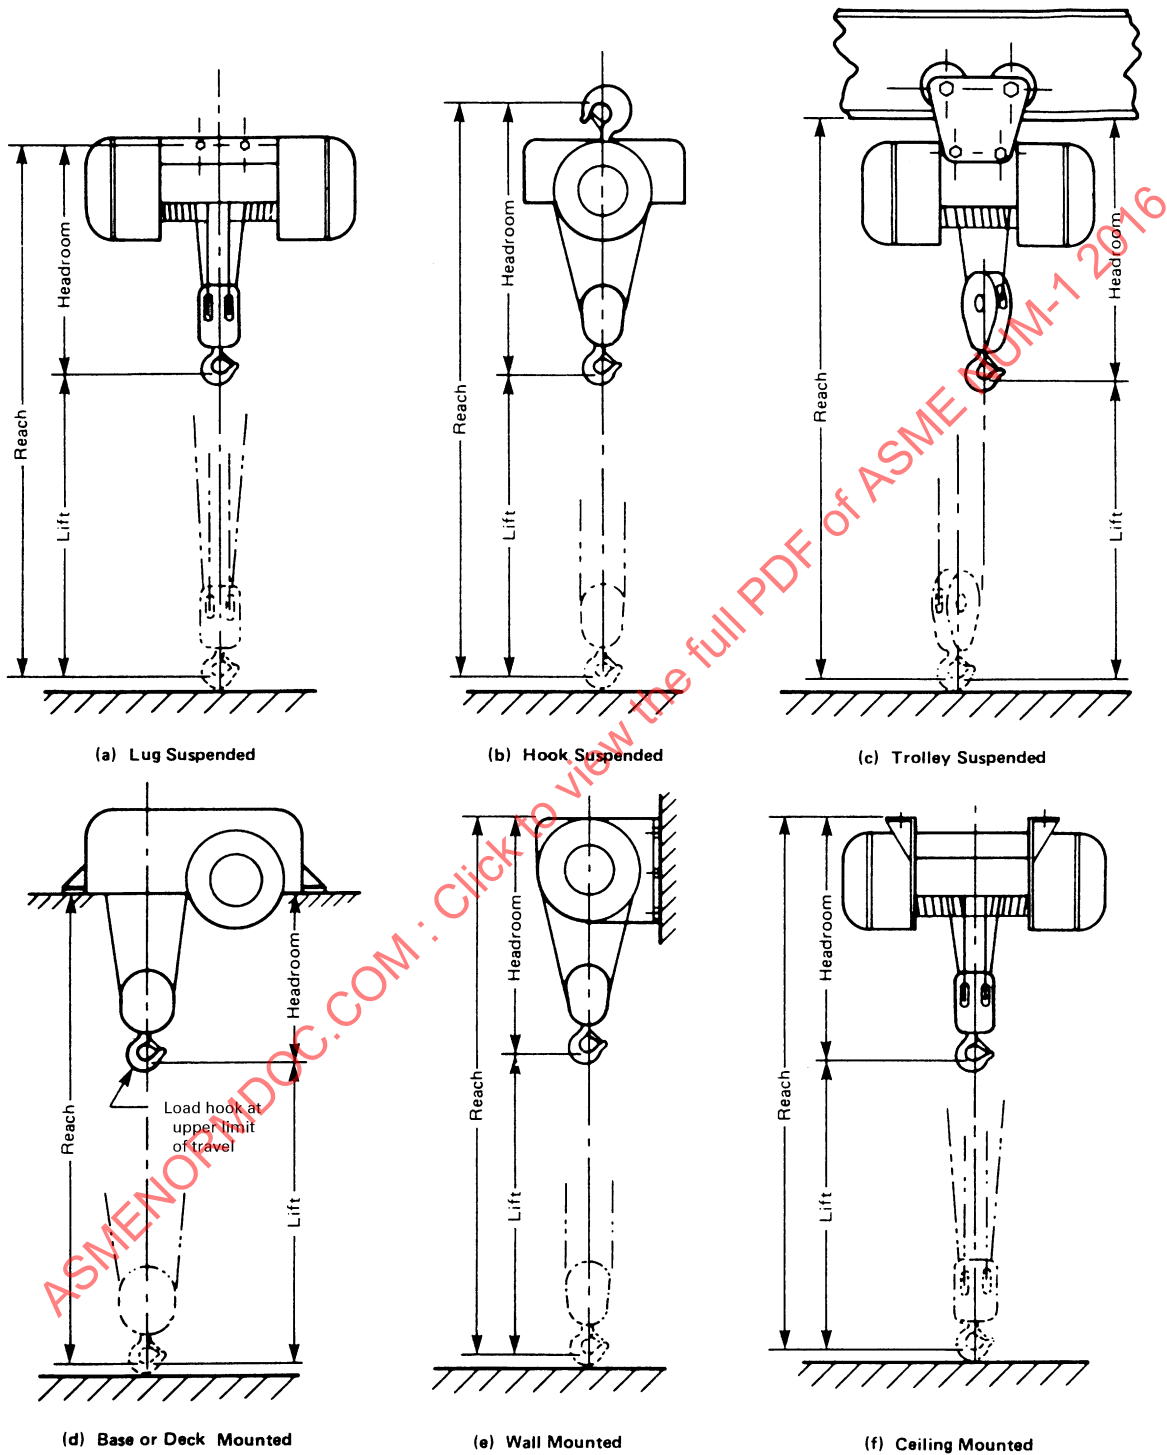Fig. NUM-III-7510-1 Air-Operated Wire-Rope Hoist, Suspension Types

GENERAL NOTE: Illustrations shown are not intended to confine the use of single or double reeving. Each of the mountings may be used with either type of reeving.

Fig. NUM-III-7610-1 Air-Operated Chain Hoist, Suspension Types

(16)

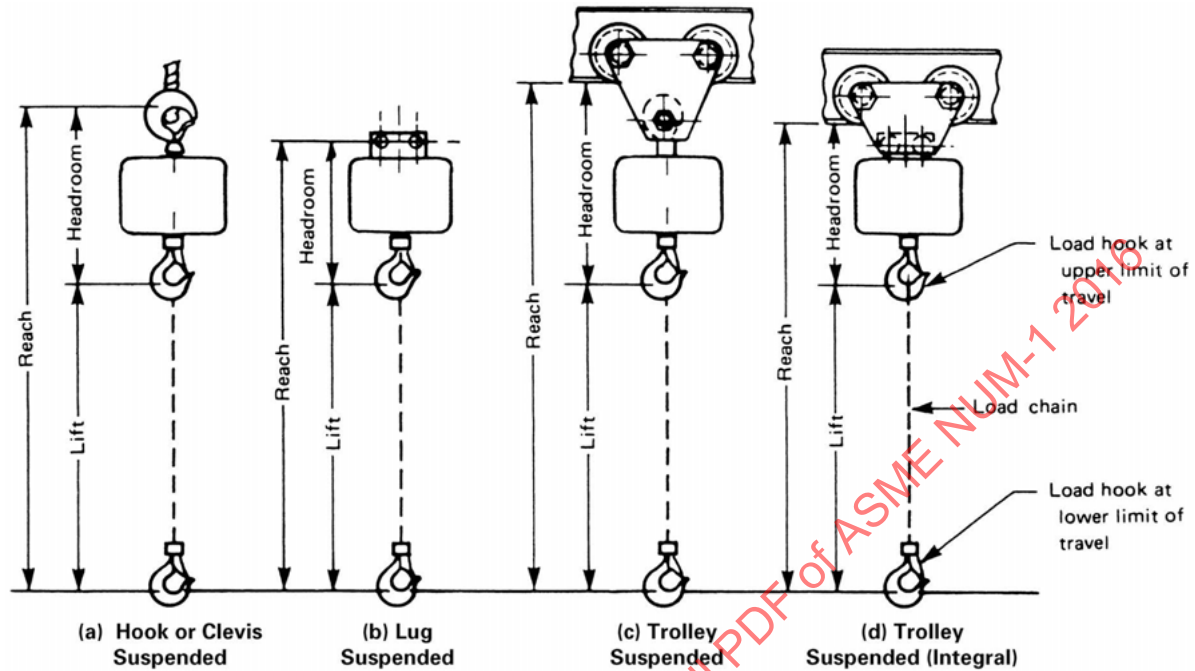

from a single girder. Trolleys may be either integral with a hoist or furnished as separate units to which a hoist or load could be attached.

NUM-III-7711 Design Considerations. Factors to be considered in the design of the trolley include curved beams, beam switches, exceptionally long runs, and continuous operation.

(16) NUM-III-7720 Application

See NUM-A-5000 regarding under-running trolley application.

NUM-III-7730 Structural Design

All structural design shall be in accordance with NUM-III-8200.

NUM-III-7731 Impact Allowance. Where powered hoists are used, an impact allowance shall be 0.5% of the rated load for each foot per minute of hoisting speed with a minimum allowance of 15% and a maximum of 50%.

NUM-III-7732 Trolley Frames

(a) Safety lugs or brackets should be provided on the trolley frame to limit the drop to no greater than 1 in. should an axle or wheel fail.

(b) The trolley frame shall be of rigid construction such that lifted loads do not cause deflections that impair the proper operation of machinery.

NUM-III-7740 Mechanical

NUM-III-7741 Trolley Drives

NUM-III-7741.1 Plain (Push) Type. Trolley motion is induced by pushing/pulling the load or by use of a tag line.

NUM-III-7741.2 Hand-Chain Operated

(a) Trolley motion is induced by pulling on an endless-link chain driving a sprocket wheel. The motion of the sprocket wheel shall be transmitted through suitable gearing to wheel-gear pinion sets. A minimum of two wheels shall be driven on each trolley.

(b) The chain pull required to move the trolley shall not exceed 60 lb. The hand chain shall reach to within 18 in. to 24 in. of the operator's floor level or as specified by the owner.

(c) Trolley hand chains shall withstand, without permanent distortion, a force of three times the pull required to traverse the trolley at rated load or 300 lb, whichever is greater.

(d) The hand chains shall be guided to guard against disengagement from the hand-chain wheel and to permit operation of the hand chain from an angle 10 deg out from either side of the chain wheel.

NUM-III-7741.3 Motor-Operated Trolleys. Motor-operated trolleys shall be one of the following arrangements:

(a) a driving mechanism where traction is dependent upon the wheel load of the driving wheels running on the top side of the lower flange.

(b) a tractor drive that provides traction by pressure of the driving wheel or wheels on the underside of the track. The pressure of the driving wheel or wheels on the tractor drive shall be adjustable. Tractor drives may be separate units or combined with the load-supporting wheels.

(c) a cushioned start or variable-speed drive is recommended for trolley speeds above 100 ft/min and for trolleys used on beams with curved sections.

NUM-III-7742 Wheels. Trolley wheels shall be in accordance with NUM-III-8344.

NUM-III-7743 Drive Shafts. Trolley drive shafts shall be in accordance with NUM-III-8343.

NUM-III-7744 Bearings

(a) Wheel bearings shall be in accordance with NUM-III-8344.4.

(b) Bearings for motorized trolleys shall be selected to provide a minimum L10 life of 1,250 hr for Class A service, 2,500 hr for Class B service, 5,000 hr for Class C service, and 10,000 hr for Class D service. (For service class, refer to NUM-G-3200.)

(c) Bearing life shall be based on 75% of the wheel load (impact not included) for full rated speed of motor-propelled trolleys. For manually propelled trolleys, use a speed of 150 ft/min.

(d) Bearings other than wheel bearings shall be in accordance with NUM-III-8342.

NUM-III-7745 Gearing. Trolley gearing other than chain sprockets shall be in accordance with NUM-III-8341.

NUM-III-7746 Brakes. Trolley brakes, when specified, shall be in accordance with NUM-III-8332.

NUM-III-7747 Bumpers. Bumpers, if specified, shall be in accordance with NUM-III-8333.

NUM-III-7748 Mechanical Component Design. All other mechanical components shall be designed in accordance with NUM-III-8320.

NUM-III-7750 Motors

Motors shall be in accordance with NUM-III-8400 for electric motors and NUM-III-7961 for air motors.

NUM-III-7751 Motor Controls. Controls shall be in accordance with NUM-III-7950 (electric) or NUM-III-7960 (air).

NUM-III-7800 INSPECTION AND TESTING

Perform inspection and testing of hoists and under-running trolleys in accordance with NUM-III-8500.

NUM-III-7900 HOIST COMMON REQUIREMENTS

NUM-III-7910 General

This section applies to all requirements that are common to all (electric or air) manual and power-operated hoists for vertical lifting service involving material handling of freely suspended, unguided loads, using wire rope or welded-link-type load chains as a lifting medium.

NUM-III-7920 Application

Hoists shall be capable of vertical lifting or lowering a freely suspended unguided load within their rated load. The supporting structure, including trolley, mono-rail, or crane, if any, shall be designed to withstand the loads and forces imposed by the hoists during operation at rated loads and speeds.

NUM-III-7930 Design Considerations

(a) The hoist and its means of suspension supplied with the hoist shall be designed to withstand all stresses imposed under normal operating conditions while handling the rated load.

(b) All load-carrying parts for power-operated hoists shall be designed so that the static stress calculated for the rated load shall not exceed 20% of the average ultimate strength of the material.

(c) For power-operated hoists, the power transmission parts shall be designed so that the dynamic stresses calculated for the rated load shall not exceed the fatigue and endurance limits established in accordance with NUM-III-8340 for the specified service class.

(d) All load-carrying parts for manually operated hoists shall be designed so that the static stress calculated for the rated load shall not exceed 25% of the average ultimate material strength.

(e) Modifications to upgrade, rerate, or modernize hoist equipment shall be as authorized only by the original equipment manufacturer or a qualified person.

NUM-III-7940 Mechanical

Mechanical component connections shall be designed to accommodate all dynamic forces, such as those induced by motor starting (where applicable) and braking applications.

NUM-III-7941 Hooks and Load Blocks

NUM-III-7941.1 Hooks

(a) If the hooks are of the swiveling type, they shall be capable of rotating through 360 deg when supporting the rated load, unless otherwise specified by the owner.

(b) Hook latches shall be provided, unless the application makes use of the latch impractical. When required, a hook latch shall be provided to bridge the throat opening of the hook for the purpose of retaining slings, chains, etc., under slack conditions. Depending on the conditions of service, consideration shall be given to the

use of hook latches constructed of corrosion-resistant materials.

(c) All hooks and latches shall comply with ASME B30.10.

NUM-III-7941.2 Load Blocks. Load blocks shall be of the guarded/enclosed type and shall guard against rope or load-chain jamming under normal operating conditions.

NUM-III-7942 Wire Rope

(a) Wire rope shall be of a type and construction suitable for hoist service.

(b) The rated load divided by the number of parts of the rope shall not exceed 20% of the nominal strength of the rope as defined in the Wire Rope Users Manual.

(c) The rope ends shall be attached to the hoist in such a manner as to prevent disengagement throughout rated hook travel.

(d) End terminations shall be in accordance with the Wire Rope Users Manual.

(e) Rope clips shall be drop forged. Clip application shall be in accordance with the Wire Rope Users Manual.

(f) If a load is supported by more than one part of rope, the tension on all parts shall be equalized.

(g) Rope fleet angles for the drum shall be limited to 4 deg.

(h) Rope fleet angles for sheaves shall be limited to 4 deg 45 min.

NUM-III-7942.1 Sheaves

(a) Sheave grooves shall be smooth and free from surface irregularities that could cause rope damage. The cross-sectional radius at the bottom of the groove should be such as to form a close-fitting saddle for the size of the rope used, and the sides of the groove should be tapered outwardly to facilitate entrance of the rope into the groove. Flanges shall be rounded, and the rims shall run true about the axis of rotation.

(b) Sheaves shall be mounted and guarded to protect against the entrance of foreign objects, wire-rope jamming, and wire-rope displacement during normal operation.

(c) All running sheaves shall use antifriction bearings. All running sheave bearings, except permanently lubricated bearings, shall be equipped with means for lubrication.

(d) Equalizer sheaves shall be provided with bronze bushings, oil-impregnated bearings, antifriction bearings with grease fittings, or other means to ensure that the sheave bearing remains lubricated, ensuring its capability to provide the rotation required to equalize the reeving.

(e) The pitch diameter of running sheaves shall not be less than that indicated in Table NUM-III-7942.1-1.

(f) The pitch diameter of nonrunning sheaves (equalizers) shall not be less than 12 times the rope diameter.

NUM-III-7942.2 Drums

(a) Rope drums shall be grooved and the grooves shall be smooth and free from surface irregularities that could cause rope damage. The cross-sectional radius at the bottom of the groove should form a close-fitting saddle for the size of the rope used. The top edge of the grooves shall be rounded to minimize rope damage and wear.

(b) Rope drums shall be flanged to guard against ropes sliding over the ends of the drum. Drums that are mounted in the hoist structure such that the rope cannot slip over the drum ends do not require flanges.

(c) All rope drums shall have only one layer of rope and the drum shall be designed to store the entire length of rope for the rated lift with the load block in its uppermost position.

(d) No less than two wraps of rope shall remain on each anchorage of the hoist drum when the hook is in its lowest position unless a lower limit device is provided, in which case no less than one wrap shall remain on each anchorage of the hoist drum.

(e) Minimum drum groove depth shall be 0.5 times the rope diameter.

(f) The minimum drum groove pitch is either 1.14 times the rope diameter or the rope diameter plus $\frac{1}{8}$ in., whichever is smaller.

(g) The rope drum pitch diameter shall not be less than that indicated in Table NUM-III-7942.2-1.

NUM-III-7942.3 Reeving. Hoist reeving may be either single or double and may be one part or multiple parts.

(a) On single-reeved hoists, one end of the rope is attached to the drum. Continuous drum grooving runs in one direction. The load block moves laterally in the direction of the axis of the drum as the rope winds onto or off of the drum. Refer to Fig. NUM-III-7942.3-1.

(b) On double-reeved hoists, both ends of the rope are attached to the drum. The drum is grooved with left-hand and right-hand grooves beginning at both ends of the drum, then grooving toward the center of the drum. The load block will follow a true vertical path (true vertical lift) as the ropes wind toward or away from each other onto or off of the drum. Refer to Fig. NUM-III-7942.3-1.

NUM-III-7943 Chains

NUM-III-7943.1 Load Chains

(a) Load chain shall be alloy steel and of the link-chain type suitable for hoisting applications. The chain links shall be electric or forge welded. Each link shall be of uniform size and shape, and free from scale and laminations at the welds.

(b) Chains shall pass over and around the load sprockets without binding or other malfunctions.

(c) The ends of the load chain shall be securely attached to the hoist or provided with a means to prevent the end of the chain from passing through the hoist. The

Table NUM-III-7942.1-1 Minimum Pitch Diameter of Running Sheaves

Hoist Class	6 × 37 Class Rope	6 × 19 Class Rope
H1 and H2	16 <i>d</i>	20 <i>d</i>
H3	18 <i>d</i>	24 <i>d</i>
H4	20 <i>d</i>	24 <i>d</i>
H5	24 <i>d</i>	30 <i>d</i>

GENERAL NOTE: *d* = rope diameter.**Table NUM-III-7942.2-1 Minimum Pitch Diameter of Drums**

Hoist Class	6 × 37 Class Rope	6 × 19 Class Rope
H1 and H2	16 <i>d</i>	20 <i>d</i>
H3	18 <i>d</i>	24 <i>d</i>
H4	20 <i>d</i>	24 <i>d</i>
H5	24 <i>d</i>	30 <i>d</i>

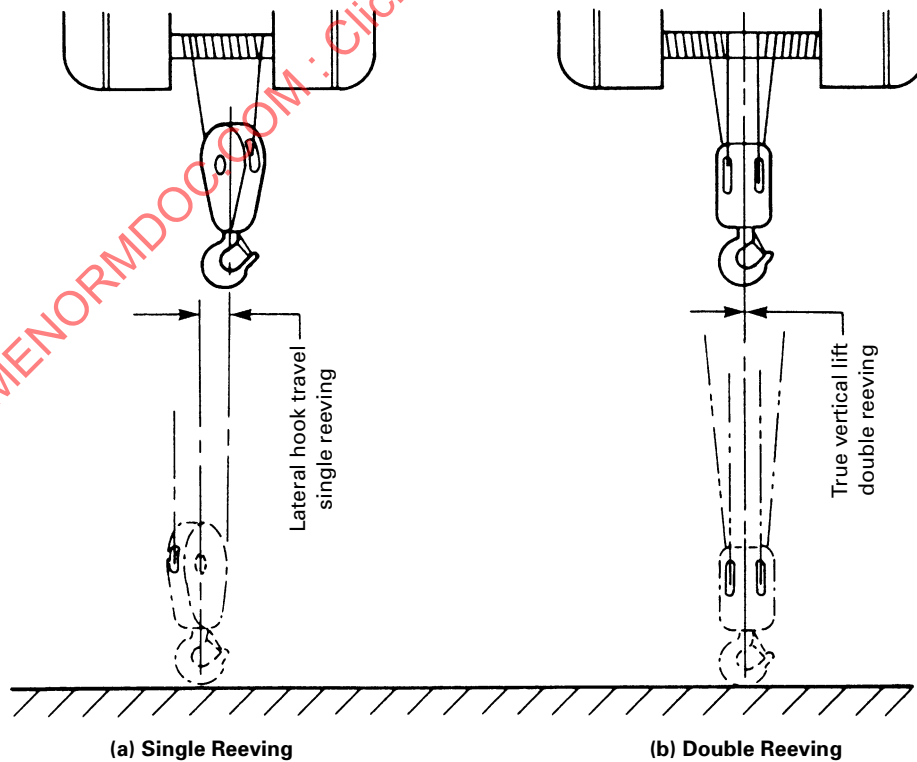
GENERAL NOTE: *d* = rope diameter.**Fig. NUM-III-7942.3-1 Single and Double Reeving**

Table NUM-III-7944.1-1 Bearing Life Expectancy

Class	Minimum Life Expectancy, hr
H1	1,250
H2	2,500
H3	5,000
H4	10,000
H5	20,000

chain shall also be designed to allow easy removal and replacement.

(d) Load chains shall be proof tested by the chain manufacturer or hoist manufacturer with a load at least equivalent to $1\frac{1}{2}$ times the hoist's rated load divided by the number of chain parts supporting the load.

(e) If a load is supported by more than one part of load chain, the tension on the parts shall be equalized.

(f) Load chain should be lubricated.

NUM-III-7943.2 Load Sprockets

(a) Load sprockets shall have pockets formed to allow proper and reliable engagement of the load chain.

(b) Load sprockets shall be guarded to minimize the entrance of foreign objects.

(c) Provision shall be made to guard against load chain jamming.

NUM-III-7943.3 Chain Containers. If provided, chain containers shall be as follows:

(a) sized to store all the "not in use" portion of the load chain and maintain tension in the slack chain between the chain guide and the stored chain when the hook is in its highest position

(b) constructed with drains when used for outdoor applications

NUM-III-7944 Bearings and Rotating Shafts

NUM-III-7944.1 Bearings

(a) *All Hoists*

(1) Shaft bushings or bearings shall be enclosed against entry of dirt, dust, and other foreign material.

(2) All bearings and bushings shall be provided with means of lubrication.

(b) *Power-Operated Hoists*

(1) Bearings shall be selected to give a minimum B10 life expectancy based on full rated speed from Table NUM-III-7944.1-1.

(2) Bearing loads, for life computation purposes, shall be determined using a mean effective load factor of 0.65.

Table NUM-III-7945-1 Hoist Service Factor, C_d

Class of Service	C_d
H1	0.64
H2	0.72
H3	0.80
H4	0.90
H5	1.00

NUM-III-7944.2 Rotating Shafts. Rotating shafts shall be supported by antifriction, lubricated, or self-lubricated bearings or bushings. All sliding surfaces shall be lubricated.

NUM-III-7945 Gearing

(16)

(a) *All Hoists*

(1) Gears shall be constructed of steel or other material of adequate strength and durability to meet the requirements for the intended class of service. For the purpose of this specification, the strength and durability shall be based on the torque required to lift the rated load.

(2) Means shall be provided to ensure adequate and proper lubrication on all gearing.

(3) All gearing not enclosed in gear cases shall be guarded with provision for lubrication and inspection.

(b) *Power-Operated Hoists*

(1) Due consideration shall be given to the maximum brake torque that can be applied to the drive.

(2) The horsepower rating for all spur, helical, and herringbone gearing shall be based on AGMA 2001-C95 and manufactured to AGMA quality class 6 or better. For the purpose of this specification, the power formula is as follows:

Allowable strength horsepower

$$P_{at} = \frac{N_p d}{126,000} \times \frac{FS_{at} J}{K_v K_m P_d S_f K_B} \quad (3)$$

Allowable durability horsepower

$$P_{ac} = \frac{N_p F I}{126,000 K_v K_m C_d K_v} \times \left(\frac{S_{ac} d C_h}{C_p} \right)^2 \quad (4)$$

where

C_d = hoist service factor (durability); see Table NUM-III-7945-1

C_h = hardness factor (durability)

C_p = elastic coefficient

d = pitch diameter of pinion, in.

F = net face width of the narrowest of the mating gears

Table NUM-III-7945-2 Hoist Service Factor, S_f

Class of Service	S_f
H1	0.75
H2	0.85
H3	0.90
H4	0.95
H5	1.00

I = geometry factor (durability)

J = geometry factor (strength)

K_B = rim thickness factor

K_m = load distribution factor

K_v = dynamic factor

K_w = mean effective load factor that equals 0.67

N_p = pinion speed, rpm

P_{ac} = allowable durability, horsepower

P_{at} = allowable strength, horsepower

P_d = transverse diametral pitch, 1/in.

S_{ac} = allowable contact stress number (durability)

S_{at} = allowable bending stress for material, psi (strength)

S_f = hoist service factor (strength), see Table NUM-III-7945-2

The values for I , J , C_H , C_P , K_B , K_m , K_v , S_{ac} , and S_{at} can be determined from the tables and curves in the appropriate AGMA specification; S_f is in Table NUM-III-7945-2; and the remaining values are physical characteristics pertaining to the gears for their operational characteristics.

(3) When worm gearing is called for, it shall be rated with appropriate service factors.

NUM-III-7946 Hoist Brakes

NUM-III-7946.1 Power-Operated Hoists

(a) The braking system shall consist of a brake and a control braking means and shall perform the following functions under normal operating conditions with rated load and under rated test conditions:

(1) stop all hook motion and hold the load when the controls are released

(2) limit the speed of the load during lowering to a maximum speed of 120% of rated lowering speed for the rated load

(3) stop and hold the load hook in the event of a complete power failure

(b) Hoist holding brakes shall have minimum torque ratings, stated as a percentage of the rated load hoisting torque, at the point where the holding brake is applied as follows:

(1) 125% when used with a control braking means other than mechanical

(2) 100% when used with mechanical control braking means

(3) 100% for each holding brake if two holding brakes are provided

(c) Each independent hoisting unit, except worm-gear hoists, the angle of whose worm is such as to prevent the load from accelerating in the lowering direction, shall be equipped with control braking means to control lowering speeds. Control braking means shall be mechanical, hydraulic, pneumatic, or electric power (such as eddy current, dynamic, regenerative, or counter-torque). All methods shall be capable of maintaining controlled lowering speeds. The inherent regenerative controlled braking means of a squirrel-cage motor may be used if the holding brake is designed to meet the additional requirement of retarding a descending load upon power removal.

(d) The braking system shall have thermal capacity for the frequency of operation required by the hoist duty service classification.

(e) The hoist holding brakes shall have provision for adjustment to compensate for lining wear.

NUM-III-7946.2 Manual-Operated Hoists

(a) The hoist shall be equipped with a mechanical load brake that shall perform the following functions under normal and rated test loads:

(1) stop and hold the load when the hand chain(s) is released

(2) permit smooth, controlled lowering of the load when manual power is applied to the hand chains

(b) The mechanical load brake shall have provision for adjustment to compensate for wear.

(c) The mechanical load brake shall have heat dissipation capability for the specified frequency of operation.

NUM-III-7947 Overtravel and Overload-Limiting Devices

NUM-III-7947.1 Overtravel Protection

(a) *Power-Operated Hoists*

(1) A lift-limiting device shall be provided so that the load hook, either loaded or empty, shall not exceed the upper limit of travel.

(2) A lower-limiting device of the geared type should be provided to prevent the wire rope or chain from completely unwinding from the drum.

(b) *Manual-Operated Hoists.* The load chain shall be restrained to prevent it from being completely run out of the hoist. The restraint, with no load on the hook, shall be designed to withstand the chain load developed by applying a hand-chain force in the downward direction equal to two times the force required to lift the rated load. With rated load on the hoist, the restraint shall withstand a hand-chain force in the downward direction equal to the force required to lift the load.

NUM-III-7947.2 Overload-Limiting Devices

(a) An overload-limiting device, when furnished, shall be designed to permit operation of the hoist within its rated load and to limit the amount of overload that can be lifted by a properly maintained hoist, under normal operating conditions.

(b) The overload-limiting device may allow the lifting of an overload, but shall be designed to prevent the lifting of an overload that could cause damage to the hoist. This does not imply that any overload is to be intentionally applied to the hoist.

(c) The overload-limiting device is an emergency device and shall not be used to measure the maximum load to be lifted and shall not be used to sense the overload imposed by a constrained load.

(d) The overload device is actuated only by loads incurred when lifting a freely suspended load on the hook. Therefore, an overload device cannot be relied upon to render the hoisting mechanism inoperative if other sources, such as, but not limited to, snagging of the load, two-blocking of the load block, or snatching a load, induce loads into the hoisting system.

(e) The overload-limiting device is connected into the hoisting control circuit and, therefore, will not prevent damage to the hoist, trolley, or crane if excessive overloads are induced into the hoisting system when the hoisting mechanism is in a nonoperating or static mode.

NUM-III-7948 Motor Size Selection. Electric and air motors shall have a required rated motor horsepower not less than that given by the following formula:

$$HP_{\text{required}} = HP_{\text{mechanical}} \times K_c \quad (5)$$

where

$$HP_{\text{mechanical}} = \frac{WV}{33,000E} \quad (6)$$

and

E = mechanical efficiency between the load and the motor, expressed in decimal form, where

$$E = E_g^n \times E_s^m$$

E_g = efficiency per gear reduction

= 0.97 for spur, herringbone, and helical gearing supported on antifriction bearings

= 0.93 for spur, herringbone, and helical gearing supported on sleeve bearings (for worm gearing, consult the gear and hoist manufacturer)

E_s = rope system efficiency per rotating sheave

= 0.99 for rotating sheaves supported on antifriction bearings

= 0.98 for rotating sheaves supported on sleeve bearings

K_c = control factor, which is a correction value that accounts for the effects the control has on motor torque and speed

= 1 for the majority of controls, such as AC wound rotor magnetic or static systems where there are no secondary permanent slip resistors, systems for squirrel-cage motors, and constant potential magnetic systems with DC power shop supplies

m = the number of rotating sheaves between the drum and equalizer passed over by each part of moving rope attached to the drum

n = the number of gear reductions

V = specified speed when lifting weight W , ft/min

W = total weight to be lifted, lb (rated load plus the weight of the load block)

K_c values for AC wound rotor systems, magnetic or static control, with secondary permanent slip resistors, shall be as follows:

$$K_c = \frac{\text{motor-rated full load, rpm}}{\text{motor operating rpm, at rated torque with permanent slip resistors, when hoisting}}$$

K_c values for power supplies rectified on the hoist shall be determined by consulting with the motor and control manufacturers.

NUM-III-7950 Electrical

NUM-III-7951 General. All electrical equipment furnished shall conform to the applicable sections of the latest issue of NFPA 70. The owner shall specify the voltage, frequency, and phase of the power supply. The supply voltage shall be maintained within $\pm 10\%$ of the rated motor voltage of the hoist with motor operating at rated load.

NUM-III-7951.1 Hazardous Location. When hoists are used in hazardous locations as defined by NFPA 70 (latest issue) or other special codes, modifications or additional safety precautions not covered by this Standard may be required. Only hoists designed for the conditions encountered shall be used in these locations.

NUM-III-7951.2 Fungus Protection. In tropical areas or other warm and humid atmospheres, fungus growth may occur on unprotected organic materials or on accumulations of dust. There are materials and procedures that will minimize these effects.

NUM-III-7952 Motors

(a) Motors shall be reversible, with torque characteristics suitable for hoist or trolley service, and capable of operation at rated loads and speeds in accordance with the class of service specified.

(b) Temperature rise of motors shall be in accordance with the latest NEMA standards for the class of insulation and enclosure used. The hoist manufacturer will assume 104°F (40°C) ambient temperature unless otherwise specified by the owner.

Table NUM-III-7952-1 Standard Rated Motor Voltages

Power Supply	Nominal System, V	Rated Motor Voltages, V	Permissible Motor Operating Range, V
AC, single phase 60 Hz	120	115	104 to 126
	240	230	207 to 253
AC, polyphase 60 Hz	208	200	180 to 220
	240	230	207 to 253
	480	460	414 to 506
	600	575	518 to 632
AC, polyphase 50 Hz	208	200	180 to 220
	230	220	198 to 242
	400	380	342 to 418
DC	125	115	104 to 126
	125	120	108 to 132
	250	230	207 to 253
	250	240	216 to 264

(c) All AC motors at rated frequency and all DC motors shall be capable of operation within $\pm 10\%$ of rated motor voltage, but not necessarily at rated voltage performance.

(d) Standard rated motor voltage shall be in accordance with Table NUM-III-7952-1.

(e) For nominal system voltages other than shown in Table NUM-III-7952-1, the rated motor voltage should not be less than 95% or more than 100% of the nominal system voltage.

(f) For additional general motor requirements, see NUM-III-8422.

NUM-III-7953 Controllers

NUM-III-7953.1 Types of Control. The type of control supplied for a hoist and trolley shall result in operation complying with the performance as defined in Section NUM-G-3000. See NUM-III-8421 for control selection and requirements.

(16) NUM-III-7953.2 VFD Hoist Controls

(a) The VFD control shall incorporate a speed feedback device to detect loss of speed control during any motor operating condition, unless the hoist has a mechanical control braking means. When speed feedback is provided, upon detection of unacceptable speed deviation or complete loss of speed feedback, the VFD shall post a fault, discontinue outputting voltage to the motor(s), and set the brake(s). Hoists with mechanical load brakes are exempt from this requirement.

(b) VFD controls for hoists with one holding brake and no mechanical control braking means shall incorporate hoist holding brake failure detection. The detection of a brake failure shall be annunciated and shall limit hoist full speed in the up direction. When a hoist that is equipped with a brake failure detection circuit detects a brake failure and requires system power to prevent

the load from dropping, additional means may be used to maintain power to the hoist system if power is removed from the mainline contactor. These means shall not override or bypass the push button or switch controlling the mainline contactor.

(c) Control dynamic braking shall be sized for a minimum of 150% of motor full-load torque, but shall not, under any circumstances, be less than the torque (or corresponding current) limit setting of the VFD in the hoisting direction.

NOTE: Control dynamic braking on hoists with mechanical load brakes shall be sized such that the combined retarding torque in the lower direction of the dynamic braking and the mechanical load brake are equal to or greater than the torque (or corresponding current) limit setting of the VFD in the hoisting direction.

(d) Control shall sense sufficient motor torque (or corresponding current) before releasing holding brake(s) (i.e., torque proving). Hoists with mechanical load brakes are exempt from this requirement.

(e) Control shall maintain speed control under all motor operating conditions to within $\pm 5\%$ of the commanded speed.

(f) If specified by the owner, control shall be capable of operating at higher than base speed as a function of load (constant horsepower operation) for loads less than 100% rated load.

NUM-III-7953.3 Contactors. Each magnetic control shall have contactors sized for the specified service. Reversing contactors shall be interlocked to guard against line-to-line faults.

NUM-III-7953.4 Pendant Control

(a) Motion control actuators shall automatically return to the OFF position.

(b) The pendant control station shall be mechanically supported to protect the electrical conductors against strain.

(c) The pendant control station shall be clearly marked to indicate the function of each actuator.

(d) The order of control functions, unless otherwise specified and as applicable, from top to bottom, should be

(1) stop-start (off-on, power off–power on) (the stop/off/power off control actuator shall be red)

(2) hoist

(3) trolley

(4) other functions

(e) Any pendant station that might present a hazard to the operator if a ground fault occurs shall be grounded.

(f) The maximum voltage in the pendant control station shall be 150 V AC or 300 V DC.

(g) Unless otherwise specified by the owner, the control station shall be 3 ft to 4 ft above the specified operating level.

NUM-III-7953.5 Pull-Cord Control

(a) Pull-cord control, when furnished, shall consist of a self-centering, return-to-neutral controller or master switch for the motion of hoist or trolley. Two nonconducting pull cords with suitable handles, clearly marked for direction, shall be provided for operation of each controller or master switch.

(b) Unless otherwise specified by the owner, the pull-cord control station shall be 3 ft to 5 ft above the specified operating level.

NUM-III-7954 Control Enclosures. Control enclosures, unless otherwise specified by the owner, shall be NEMA Type 1, general purpose for indoor applications, in accordance with NEMA ICS 6. Other types, as defined by NEMA, include, but are not limited to

(a) NEMA Type 3: watertight, dust-tight, and sleet (ice) resistant; outdoor

(b) NEMA Type 3R: rainproof and sleet resistant; outdoor

(c) NEMA Type 4: watertight and dust-tight; indoor and outdoor

(d) NEMA Type 4X: watertight, dust-tight, and corrosion resistant; indoor and outdoor

(e) NEMA Type 7: Class I, Groups A, B, C, and D; indoor hazardous locations (explosive atmosphere)

(f) NEMA Type 9: Class II, Groups E, F, and G; indoor hazardous locations (explosive atmosphere)

(g) NEMA Type 12: industrial use; dust-tight and drip-tight; indoor

NUM-III-7955 Resistors. Resistors, when furnished, shall have sufficient thermal capacity for the class of service specified. Enclosures for resistors shall provide

means for heat dissipation and shall be installed to minimize the accumulation of combustible matter. Provision shall be made to contain broken resistor parts or molten metal.

NUM-III-7956 Current Conductor System. Current conductor systems are not normally supplied with electric wire-rope hoists. When required, they shall be specified by the owner. Standard systems include the following:

(a) flexible cable

(b) coiled cord

(c) festooned cable arrangement

(d) cable reel

(e) rigid conductor

NUM-III-7960 Pneumatic

NUM-III-7961 Air Motors. The air motor shall be an air-driven piston or rotary vane type and shall be provided with an air inlet connection fitted for the use of air hose assemblies. Also, the air motor shall be provided with an oiler and air filter between the motor and the air inlet connection. The motor shall have adequate capacity to lift 125% of the rated load.

NUM-III-7962 Air Motor Controls. Hoists and air-operated trolleys shall have pendant, pull, or rod control. Control actuators shall automatically return to the OFF position when released. Unless otherwise specified by the owner, the control station shall be 3 ft to 5 ft above the specified operating level.

NUM-III-7962.1 Pendant Control. The pendant control station shall be supported to protect the pneumatic hoses and connections against strain. The pendant control station shall be clearly marked to indicate the function of each actuator.

NUM-III-7962.2 Pull Control. Pull control shall consist of two pull chains or cords with suitable handle(s) clearly marked for direction.

NUM-III-7962.3 Rod Control. Rod control shall permit control of hoist or trolley (air operated) motion by linear or rotary movement of the rod handle, or a combination of both. Rod handle shall be clearly marked for direction of motion.

NUM-III-7970 Hoist Marking

(a) The rated load of the hoist shall be marked on the hoist or load block.

(b) Hoists shall have additional markings in accordance with ASME B30.16.

Section NUM-III-8000

Common Requirements and Criteria

NUM-III-8100 DESCRIPTION

The common equipment requirements included under this Section are divided into the following four categories: structural, mechanical, electrical, and inspection and testing.

The requirements of Section NUM-III-8000 apply to all cranes and monorails as described in the specific equipment Sections, NUM-III-2000 through NUM-III-6000. (Requirements for hoists and underhung trolleys are given in Section NUM-III-7000.)

NUM-III-8200 STRUCTURAL

NUM-III-8210 General

This section covers the design, design criteria, materials, and fabrication procedures for the structural components that apply for all Type III equipment.

NUM-III-8211 Nomenclature. All terms and definitions used in equations are defined in their respective sections.

NUM-III-8212 Descriptions of Loads

(a) *Load Categories.* Loads acting on the structure are divided into the following four categories:

- (1) principal loads, such as dead loads, lifted loads, and inertia
- (2) additional loads, such as dead loads, lifted loads, and inertia forces
- (3) extraordinary loads, such as stored wind loads and collision forces
- (4) extreme environmental loads, such as tornado wind loads

(b) *Other Loads.* In addition to the load categories above, torsional forces and moments, bridge end truck loads, and abnormal event loads shall be considered during design. Test loads are specified in NUM-III-8583.

NUM-III-8212.1 Principal Loads

(a) *Dead Load (DL).* The weight of all effective parts of the bridge structure, the machinery parts, and the fixed equipment supported by the structure.

(b) *Trolley Load (TL).* The weight of the trolley and the equipment attached to the trolley.

(c) *Lifted Load (LL).* The lifted load consists of the working load and the weight of the lifting devices used for handling and holding the working load, such as the load block, lifting beam, bucket, magnet, grab, and other supplemental devices.

(d) *Vertical Inertia Forces for Motorized Cranes and Hoists.* The vertical inertia forces include those due to the motion of the cranes or crane components and those due to lifting or lowering of the hoist load. These additional loadings may be included in a simplified manner by the application of a separate factor for the dead load and for the hoist load by which the vertical acting loads, the member forces, or the stresses due to them must be multiplied.

(1) *Dead Load Factor (DLF).* This factor covers only the dead loads of the crane, trolley, and their associated equipment and shall be taken according to the following:

$$DLF = 1.1 \leq 1.05 + \frac{\text{travel speed, ft/min}}{2,000} \leq 1.2$$

(2) *Hoist Load Factor (HLF).* This factor applies to the motion of the rated load in the vertical direction and covers inertia forces, the mass forces due to the sudden lifting of the hoist load, and the uncertainties in allowing for other influences. The hoist load factor is 0.5% of the hoisting speed in feet per minute, but not less than 15% or more than 50%, except for bucket and magnet cranes for which the impact value shall be taken as 50% of the rated capacity of the bucket or magnet hoist.


$$HLF = 0.15 \leq 0.005 \times \text{hoist speed} \leq 0.5$$

(e) *Inertia Forces From Motorized Drives (IFD).* The inertia forces occur during acceleration or deceleration of horizontal drive motions and depend on the driving and braking torques applied by the drive units and brakes during each cycle.

The lateral load due to acceleration or deceleration shall be a percentage of the vertical load and shall be considered as 7.8 times the lateral acceleration or deceleration rate (ft/sec²) but not less than 2.5% of the vertical load. This percentage shall be applied to both the live and dead loads, exclusive of the end trucks. The live load shall be located in the same position as when calculating the vertical moment. The moment of inertia of the entire girder section about its vertical axis shall be used to determine the stresses due to lateral forces. The inertia forces during acceleration and deceleration shall be calculated in each case with the trolley in the worst position for the component being analyzed.

NUM-III-8212.2 Additional Loads

(a) *Operating Wind Load (WLO).* Lateral load due to wind shall be considered as an operating load of 5 lb/ft²

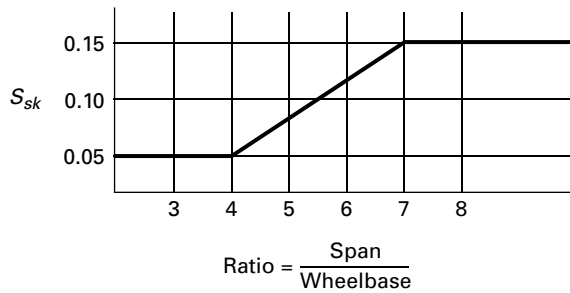Fig. NUM-III-8212.2-1 Wheel-Skewing Forces (From CMAA 74)

of projected area. Where multiple surfaces are exposed to the wind, such as crane girder and auxiliary girder, and the horizontal distance between surfaces is greater than the depth of the member on the windward side, consideration shall be given to increasing the effective area exposed to the wind. For single surfaces, such as cabs, a projected area shall be considered to be 1.2 times the projected area to account for negative pressure on the far side of the enclosure.

(b) *Forces due to Skewing (SK).* When wheels roll along a rail, the horizontal forces normal to the rail and those tending to skew the structure shall be taken into consideration. The horizontal forces shall be obtained by multiplying the vertical load exerted on each wheel by coefficient S_{sk} , which depends on the ratio of the span to the wheel base (see Fig. NUM-III-8212.2-1). The wheel base is the distance between the outermost wheels.

(16) NUM-III-8212.3 Extraordinary Loads

(a) *Stored Wind Load (WLS).* This is the maximum wind that a crane is designed to withstand during out-of-service condition. The speed and test pressure vary with the height of the crane above the surrounding ground level, geographical location, and degree of exposure to prevailing winds (see ASCE/SEI 7).

(b) *Collision Forces (CF).* Special loading of the crane structure resulting from the bumper stops shall be calculated with the crane at 0.4 times the rated speed, assuming the bumper system is capable of absorbing the energy within its design scope. Load suspended from lifting equipment and free oscillating load need not be taken into consideration. Where the load cannot swing, the bumper effect shall be calculated in the same manner, taking into account the value of the load. The kinetic energy (KE) released on the collision of two cranes with the moving masses of M_1 and M_2 and a 40% maximum traveling speed of V_{T1} and V_{T2} shall be determined from the following equation:

$$KE = \frac{M_1 M_2 (0.4 V_{T1} + 0.4 V_{T2})^2}{2 (M_1 + M_2)} \quad (7)$$

The bumper forces shall be distributed in accordance with the bumper characteristics and the freedom of the

motion of the structure with the trolley in its worst position. Should the crane application require that maximum deceleration rates and/or stopping forces be limited due to suspended load or building structure considerations, or if bumper impact velocities greater than 40% of maximum crane velocity are to be provided for, such conditions shall be defined at the time of the crane purchase.

NUM-III-8212.4 Extreme Environmental Loads.

Tornado wind loads (WLT) are not applicable to Type III cranes unless specifically required by the owner. The wind speed varies with the height of the crane above the surrounding ground level, geographical location, and degree of exposure. Additional tornado-generated loads that should be considered are pressure drop and tornado missiles.

NUM-III-8212.5 Torsional Forces and Moments

(a) *Due to the Starting and Stopping of the Bridge Motors.* The twisting moment due to the starting and stopping of bridge motors shall be considered as the starting torque of the bridge motor at 200% of full-load torque multiplied by the gear ratio between the motor and cross shaft.

(b) *Due to Vertical Loads.* Torsional moment due to vertical forces acting eccentric to the vertical neutral axis of the girder shall be considered as those vertical forces multiplied by the horizontal distance between the centerline of the forces and the shear center of the girder.

(c) *Due to Lateral Loads.* The torsional moment due to the lateral forces acting eccentric to the horizontal neutral axis of the girder shall be considered as those horizontal forces multiplied by the vertical distance between the centerline of the forces and the shear center of the girder.

NUM-III-8212.6 Abnormal Event Load, A_e .

Abnormal event loads are loads caused by failure of plant equipment that impose jet or missile loads on the crane. The owner shall be responsible for the effects of, and shall establish the criteria for, these loads.

(16) **NUM-III-8213 Load Combinations.** The following tabulated load designations are described in NUM-III-8212 and are listed in Table NUM-III-8213-1. The various load combinations, using the load designations, are listed herein. The crane operational loads and the construction load combinations are applicable to Type III cranes. Also listed is the loading combination involving tornado wind, which is to be used if required by the owner.

(a) *Principal Loads (Stress Level 1): Case 1.* Crane in regular use under principal loading (stress level 1)

$$DL(DLF_B) + TL(DLF_T) + LL(1 + HLF) + IFD$$

where DLF_B and DLF_T refer to the bridge and trolley load factors.

Table NUM-III-8213-1 Load Designations

Load	Load Designation
Trolley dead load	TL
Bridge dead load	DL
Rated load	LL
Inertia forces from drives	IFD
Forces due to skewing	SK
Operating wind load	WLO
Stored wind load	WLS
Tornado wind load	WLT

(b) *Additional Loads (Stress Level 2): Case 2.* Crane in regular use under principal and additional loading (stress level 2)

$$DL(DLF_B) + TL(DLF_T) + LL(1 + HLF) + IFD + WLO + SK$$

(c) *Extraordinary Loads (Stress Level 3): Case 3.* Crane subjected to out-of-service wind

$$DL + TL + WLS$$

Crane in collision

$$DL + TL + LL + CF$$

(d) *Extreme Environmental Loads (Stress Level 4): Case 4.* Crane subject to tornado wind load

$$TL + DL + WLT$$

NUM-III-8214 Tolerances. Dimensions on the clearance drawings are the maximum dimensions of the crane and shall not be exceeded by the manufacturer. Height and end dimensions shall be shown in relationship to the operating surface and centerline of the beam or rail. Cumulative measurements of crane components are permitted.

The runway shall be straight, parallel, level, and at the same elevation within the tolerances given in Fig. NUM-III-8214-1 or Fig. NUM-III-8214-2. The crane manufacturer shall design the crane to operate properly within the runway tolerances given in Figs. NUM-III-8214-1 and NUM-III-8214-2.

NUM-III-8220 Materials and Connections

All materials of the structural components of the crane shall be an accepted type, suitable for the purpose for which the materials are to be used, and shall be in compliance with any additional requirements specified herein for the materials.

NUM-III-8221 Base Materials. The base materials for the components of Type III cranes shall be structural steel and shall conform to ASTM A36 specifications or be an accepted type for the purpose for which the steel is to be used and for the operations to be performed on it.

NUM-III-8222 Fastener Materials

(a) The fastener materials for structural components of cranes shall be in accordance with NUM-III-8231.5.

(b) The fastener finish and tolerances shall be suitable for the type of connection in which they are employed.

NUM-III-8223 Welding Materials. All welding materials shall be in compliance with the requirements of AWS D1.1 or AWS D14.1, as applicable.

NUM-III-8224 Connections

NUM-III-8224.1 Welded Connections. Welded connections shall comply with the requirements of AWS D1.1 or AWS D14.1, as applicable.

NUM-III-8224.2 Bolted Connections

NUM-III-8224.2.1 Structural Joints Using ASTM A325 or A490 Bolts. Structural joints using ASTM A325 or A490 bolts shall be designed and installed in accordance with the Specification for Structural Joints Using ASTM A325 and A490 Bolts, as included in The AISC Manual of Steel Construction: Allowable Stress Design. Bolt holes shall not be burned. Standard holes shall have a maximum diameter $\frac{1}{16}$ in. in excess of the nominal bolt diameter. Holes for alignment (bound) bolts shall be reamed to close tolerances as required. Slotted bolt holes shall not be used for connections of end trucks.

NUM-III-8224.2.2 Structural Joints Using Bolts Other Than ASTM A325 or A490. Structural joints using bolts other than ASTM A325 or A490 shall be bearing type, and shall comply with the requirement for non-high-strength bolts specified in the Specification for Structural Steel for Buildings — Allowable Stress Design and Plastic Design, as included in The AISC Manual of Steel Construction: Allowable Stress Design. All bolts shall be torqued to a pre-tension load on the bolt of 60% to 70% of the minimum yield strength of the bolt materials. Standard holes shall have a maximum diameter $\frac{1}{16}$ in. in excess of the nominal bolt diameter. Holes for alignment (bound) bolts shall be reamed to close tolerances as required.

NUM-III-8224.2.3 Gauge and Edge Distances.

The minimum gauge between centers of bolt holes and minimum and maximum edge distances from the center of a bolt hole to any edge shall be as stipulated in the Specification for Structural Steel for Buildings — Allowable Stress Design and Plastic Design, as included in The AISC Manual of Steel Construction: Allowable Stress Design.

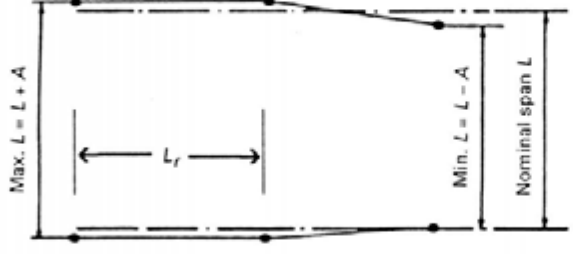
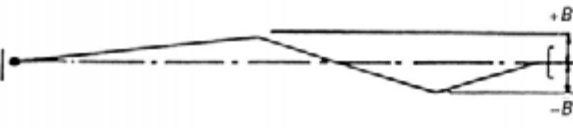
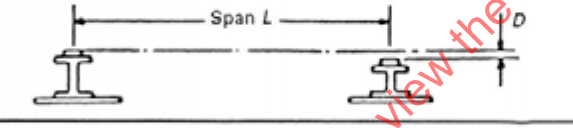
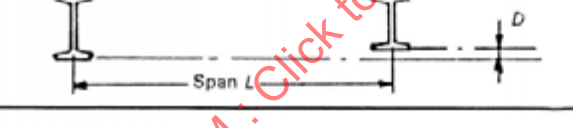
NUM-III-8224.3 Field Connections. All field connections of structural components shall be bolted unless

Fig. NUM-III-8214-1 Building Runway Alignment Tolerance for Patent Track

(16)

Item	Figure	Overall Tolerance
Crane span (L) measured at crane wheel contact surface		$A = 1/8$ in. in any support span
Span (3 or more runways)		$B = 1/8$ in. in any support span
Straightness		$C = 1/8$ in. in any support span
Elevation		$D = 1/8$ in. in any support span
Rail-to-rail elevation		$E = 1/8$ in. between adjacent rails

(16) Fig. NUM-III-8214-2 Building Runway Alignment Tolerance (From CMAA 74)

Item	Figure	Overall Tolerance	Maximum Rate of Change
Crane span (L) measured at crane wheel contact surface		$L \leq 50 \text{ ft} \quad A = 3/16 \text{ in.}$ $L > 50 \text{ ft} \leq 100 \text{ ft} \quad A = 1/4 \text{ in.}$ $L > 100 \text{ ft} \quad A = 3/8 \text{ in.}$	$1/4 \text{ in. in}$ 20 ft 0 in.
Straightness (B)		$B = 3/8 \text{ in.}$	$1/4 \text{ in. in}$ 20 ft 0 in.
Elevation (C)		$C = 3/8 \text{ in.}$	$1/4 \text{ in. in}$ 20 ft 0 in.
Top-running transverse rail-to-rail elevation (D)		$L \leq 50 \text{ ft} \quad D = \pm 3/16 \text{ in.}$ $50 \text{ ft} < L \leq 100 \text{ ft} \quad D = \pm 1/4 \text{ in.}$ $L > 100 \text{ ft} \quad D = \pm 3/8 \text{ in.}$	$1/4 \text{ in. in}$ 20 ft 0 in.
Transverse girder-to-girder elevation underrunning (D)			

otherwise approved by the owner. The manufacturer shall provide sufficient information on drawings or in installation manuals on the requirements for all field connections.

NUM-III-8230 Design Criteria

NUM-III-8231 Basic Allowable Stresses for Structural Steel Members

NUM-III-8231.1 Members Not Controlled by Buckling. For members not controlled by buckling, the basic allowable stresses in structural steel members of the crane shall not exceed the values in Table NUM-III-8231.1-1.

where

$$C_c = \sqrt{\frac{2\pi^2 E}{\sigma_y}}$$

and

C_c = column slenderness ratio separating elastic and inelastic buckling

E = modulus of elasticity

k = effective length factor

l = unbraced length of compression member

r = radius of gyration of member

σ_y = yield point

The allowable axial compression stress, σ_a , is

$$\sigma_a = \left[1 - \frac{\left(\frac{kl}{r} \right)^2}{2C_c^2} \right] \left(\frac{\sigma_y}{DF} \right) \quad (9)$$

(16) **NUM-III-8231.2 Compression Members Controlled by Buckling.** For compression members with an equivalent slenderness ratio

$$\frac{kl}{r} < C_c \quad (8)$$

Table NUM-III-8231.1-1 Allowable Stresses (Members Not Controlled by Buckling)

Stress Loading and Case (All Expressed in Terms of σ_y)	Stress Type			
	Tension	Compression [Note (1)]	Shear	Bearing
Principal — 1	0.60	0.60	0.35	0.75
Additional — 2	0.66	0.66	0.375	0.80
Extraordinary — 3	0.75	0.75	0.43	0.90
Extreme environment — 4	0.90	0.90	0.50	n/a

NOTE:

(1) For gross section.

**Table NUM-III-8231.2-1
Modifying Coefficient, N**

Principal	Additional	Extraordinary	Extreme Environment
1.2	1.2	0.9	0.67

where

 DF = design factor

The required design factor shall be equal to

$$FS = N \left\{ \frac{5}{3} + \frac{3}{8} \left[\frac{\left(\frac{kl}{r} \right)}{C_c} \right] - \frac{1}{8} \left[\frac{\left(\frac{kl}{r} \right)}{C_c} \right]^3 \right\} \quad (10)$$

Values of N , the modifying coefficient for each loading condition, can be found in Table NUM-III-8231.2-1.

For compression members with an equivalent slenderness ratio

$$\frac{kl}{r} \geq C_c \quad (11)$$

The allowable axial compression stress shall not exceed the value

$$\sigma_a = \frac{12\pi^2 E}{23N \left(\frac{kl}{r} \right)^2} \quad (12)$$

NUM-III-8231.3 Bending Stress. The allowable bending stress shall conform to AISC Part 5, Chapter F, Beams and Other Flexural Members, divided by 1.12N for the different loading conditions.

- (16) **NUM-III-8231.4 Welds.** Basic allowable stresses in welds shall be as specified in AWS D14.1. Allowable stresses for all types of welds may be increased for extraordinary load combinations by a factor of 1.33 and increased for extreme environmental load combinations by a factor of 1.50.

Table NUM-III-8231.5-1 Bolt Allowable Stresses

Loading Condition (Expressed in Terms of Ultimate Strength)	Stress Type	
	Tension	Shear
Principal	0.33	0.17
Additional	0.33	0.17
Extraordinary	0.44	0.23
Extreme environment	0.50	0.26

NUM-III-8231.5 Bolts

(a) *ASTM A325 or A490 Bolts.* Allowable working stresses for operational or construction loads shall be in accordance with the Specification for Structural Joints Using ASTM A325 and A490 Bolts, as included in The AISC Manual of Steel Construction: Allowable Stress Design. Allowable working stresses for other loadings shall be as follows:

(1) *Bearing-Type Joints.* Allowable working stresses for bearing-type joints may be increased by a factor of 1.33 for extraordinary loadings and by a factor of 1.50 for extreme environmental loadings.

(2) *Friction-Type Joints.* Allowable working stresses for friction-type joints shall not be increased for extraordinary loadings or extreme environmental loadings.

(b) *Bolts Other Than ASTM A325 or A490.* Allowable stresses shall be in accordance with Table NUM-III-8231.5-1.

NUM-III-8232 Combined Stresses**NUM-III-8232.1 Axial Compression and Bending. (16)**

Members subjected to both axial compression and bending stresses shall satisfy the following requirements:

$$\frac{\sigma}{\sigma_a} + \frac{C_{mx}\sigma_{bx}}{\left(1 - \frac{\sigma}{\sigma_{ex}}\right)\sigma_{abx}} + \frac{C_{my}\sigma_{by}}{\left(1 - \frac{\sigma}{\sigma_{ey}}\right)\sigma_{aby}} \leq 1.0 \quad (13)$$

$$\frac{\sigma}{\sigma_a} + \frac{\sigma_{bx}}{\sigma_{abx}} + \frac{\sigma_{by}}{\sigma_{aby}} \leq 1.0 \quad (14)$$

When $(\sigma/\sigma_a) \leq 0.15$, the following equation may be used in lieu of eqs. (13) and (14):

$$\frac{\sigma}{\sigma_a} + \frac{\sigma_{bx}}{\sigma_{abx}} + \frac{\sigma_{by}}{\sigma_{aby}} \leq 1.0 \quad (15)$$

In eqs. (13), (14), and (15), the subscripts x and y , combined with subscripts b , m , and e , indicate the axis of bending about which a particular stress or design property applies, and

σ_a , σ_{ab} = allowable axial and bending stresses, respectively

(See NUM-III-8231.1.) It is to be noted that

$\sigma_a = \sigma_{ab}$ in NUM-III-8231.1 and NUM-III-8231.2

$\sigma_{ac} = \sigma_a$ as given in NUM-III-8231.1 only

$$\sigma_e = \frac{12\pi^2 E}{23N \left(\frac{kl}{r}\right)^2} \quad (16)$$

where

C_m = a coefficient whose value shall be as given in (a), (b), and (c) below

k = the effective length factor in the plane of bending

l = the actual unbraced length in the plane of bending

N = a loading condition factor given in NUM-III-8231.2

r = the corresponding radius of gyration

σ = computed axial stress

σ_b = computed compressive bending stress at the section under consideration

(a) For compression members in frames subject to joint translation, $C_m = 0.85$.

(b) For rotationally restrained compression members in frames braced against joint translation and not subject to transverse loading between their supports in the plane of bending

$$C_m = 0.6 - 0.4 \left(\frac{M_1}{M_2} \right) \quad (17)$$

but not less than 0.4, where M_1/M_2 is the ratio of the smaller to larger moments at the ends of that portion of the member unbraced in the plane of bending under consideration. M_1/M_2 is positive when the member is bent in reverse curvature and negative when it is bent in a single curvature.

(c) For compression members in frames braced against joint translation in the plane of loading and subjected to transverse loading between their supports, the value of C_m may be determined by analysis; however, in lieu of such analysis, the following values may be used:

(1) for members whose ends are restrained against rotation in the plane of bending, $C_m = 0.85$

(2) for members whose ends are unrestrained against rotation in the plane of bending, $C_m = 1.0$

NUM-III-8232.2 Axial Tension and Bending. Members subject to both axial tension and bending stresses shall be proportioned at all points along their length to satisfy the following equation:

$$\frac{\sigma_t}{\sigma_{at}} + \frac{\sigma_{bx}}{\sigma_{abx}} + \frac{\sigma_{by}}{\sigma_{aby}} \leq 1.0 \quad (18)$$

where

σ_{abx} = the allowable bending stress about the member's x -axis

σ_{aby} = the allowable bending stress about the member's y -axis

σ_{at} = the allowable axial tension stress as determined from Table NUM-III-8231.1-1

σ_{bx} = the computed bending stress about the member's x -axis

σ_{by} = the computed bending stress about the member's y -axis

σ_t = the computed axial tension stress

However, the computed bending compressive stress arising from an independent load source relative to the axial tension, taken above, shall not exceed the applicable value required in NUM-III-8231.3.

NUM-III-8232.3 Local Bending of Flanges due to Wheel Loads (16)


(a) Each wheel load shall be considered as a concentrated load applied at the center of the wheel contact with the flange [see Fig. NUM-III-8232.3-1, illustration (a)]. Local flange bending stresses in the lateral (x) and longitudinal (y) directions at certain critical points may be calculated from the following formulas. Other suitable formulas/analysis in lieu of the below may be adopted to address the local flange bending stresses.

(1) Underside of flange at flange-to-web transition, Point 0

$$\sigma_{x0} = C_{x0} \frac{P}{t_a^2} \quad (19)$$

$$\sigma_{y0} = C_{y0} \frac{P}{t_a^2} \quad (20)$$

Fig. NUM-III-8232.3-1 Local Bending of Flanges due to Wheel Loads (From CMAA 74)

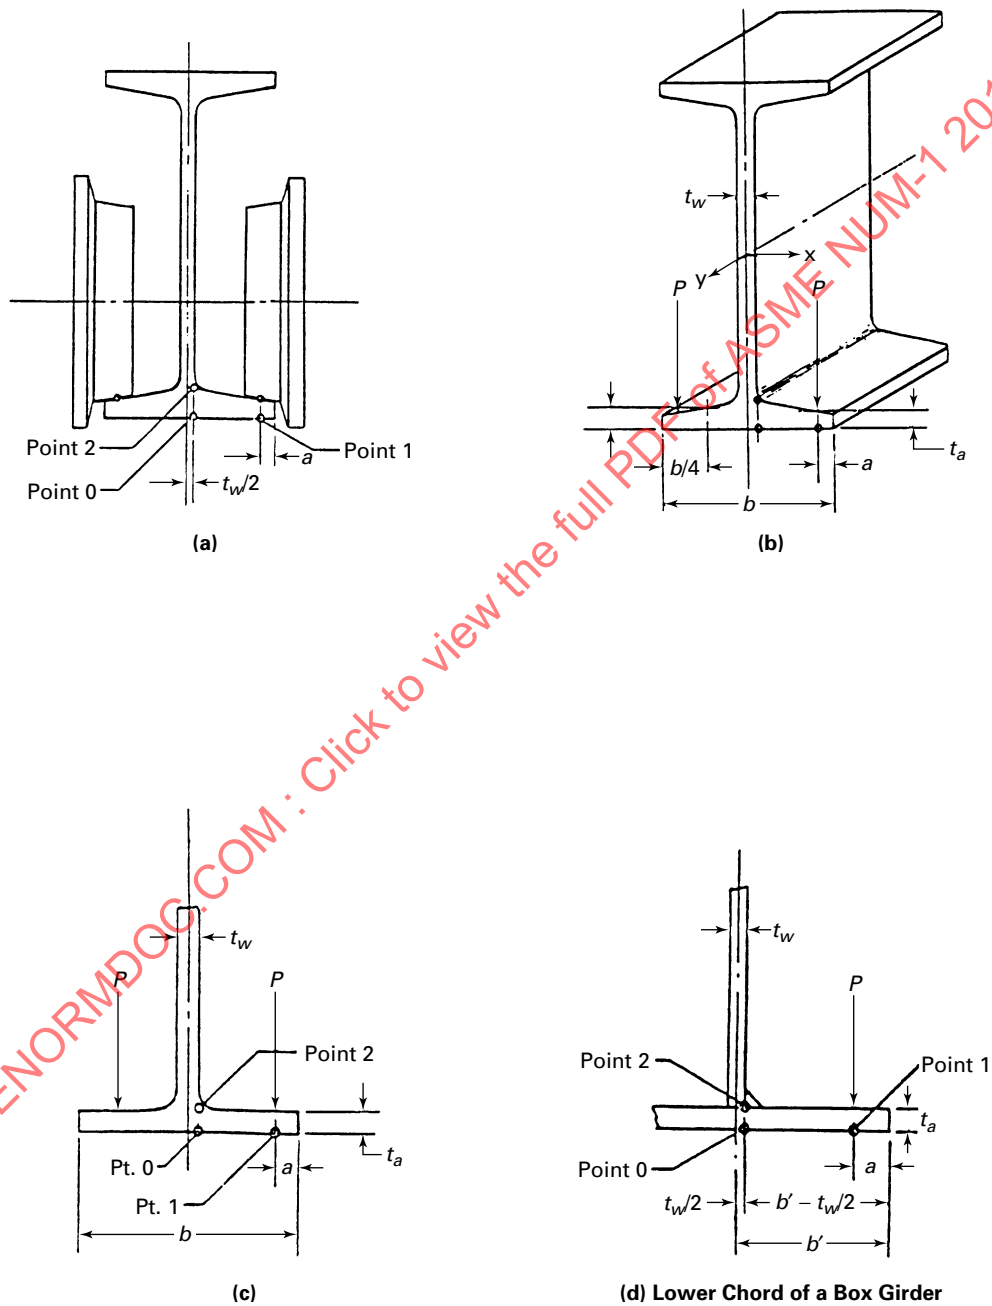

(2) Underside of flange directly beneath wheel contact point, Point 1

$$\sigma_{x1} = C_{x1} \frac{P}{t_a^2} \quad (21)$$

$$\sigma_{y1} = C_{y1} \frac{P}{t_a^2} \quad (22)$$

(3) Topside of flange at flange-to-web transition, Point 2

$$\sigma_{x2} = -\sigma_{x0} \quad (23)$$

$$\sigma_{y2} = -\sigma_{y0} \quad (24)$$

(4) For tapered flange sections [see Fig. NUM-III-8232.3-1, illustration (b)]

$$C_{x0} = -1.096 + 1.095\lambda + 0.192e^{-6.0\lambda} \quad (25)$$

$$C_{x1} = 3.965 - 4.835\lambda - 3.965e^{-2.675\lambda} \quad (26)$$

$$C_{y0} = -0.981 - 1.479\lambda + 1.120e^{1.322\lambda} \quad (27)$$

$$C_{y1} = 1.810 - 1.150\lambda + 1.060e^{-7.70\lambda} \quad (28)$$

$$t_a = t_f - \left(\frac{b}{24}\right) + \left(\frac{a}{6}\right) \quad (29)$$

for standard "S" section, where

t_f = published flange thickness for standard "S" section, in.

(5) For parallel flange section [Fig. NUM-III-8232.3-1, illustrations (c) and (d)]

$$C_{x0} = -2.110 + 1.977\lambda + 0.0076e^{6.53\lambda} \quad (30)$$

$$C_{x1} = 10.108 - 7.408\lambda - 10.108e^{-1.364\lambda} \quad (31)$$

$$C_{y0} = 0.050 - 0.580\lambda + 0.148e^{3.015\lambda} \quad (32)$$

$$C_{y1} = 2.230 - 1.490\lambda + 1.390e^{-18.33\lambda} \quad (33)$$

(6) For single-web symmetrical sections [Fig. NUM-III-8232.3-1, illustrations (b) and (c)]

$$\lambda = \frac{2a}{b - t_w} \quad (34)$$

where

b = section width across flanges, in.

(7) For other cases [Fig. NUM-III-8232.3-1, illustration (d)]

$$\lambda = \frac{a}{b' - \left(\frac{t_w}{2}\right)} \quad (35)$$

where

a = distance from edge of flange to point of wheel load application, in. (center of wheel contact)

b' = distance from centerline of web to edge of flange, in.

P = load per wheel including *HLF*, lb

t_a = flange thickness at point of load application, in.

t_w = web thickness

NOTE: If $\frac{1}{2}b - a <$ centerline distance between adjacent wheels, then the load P is equal to the maximum single wheel load without considering the effect of the adjacent wheel. Conversely, if $\frac{1}{2}b - a \geq$ centerline distance between adjacent wheels, then the loading of the two adjacent wheels shall be combined into a single load.

(b) The localized stresses due to local bending effects imposed by wheel loads calculated at Points 0 and 1 are to be combined with the stresses due to Case 2 loading specified in NUM-III-8213 of this specification.

When calculating the combined stress, the flange bending stresses shall be diminished to 75% of the value calculated per (a) above.

The combined stress value (σ_t) obtained by the method prescribed in (f) below shall not exceed the allowable Case 2 stress level of $0.66\sigma_y$ where σ_y = yield strength of the material.

(c) Additionally, in the case of welded plate girders only, the localized stresses on the top side of the flange at the flange-to-web transition (Point 2) shall be combined with the stresses due to the Case 2 loading specified in NUM-III-8213 of this specification.

The combined stress value (σ_v) in the weld at Point 2 obtained by the method prescribed in (f) below shall not exceed the allowable weld stress specified in NUM-III-8224.1, nor shall the stress range in the weld exceed the value specified in Table NUM-III-8234.1-1 for joint category E.

(d) The local flange bending criteria per NUM-III-8232.3 shall be met in addition to the general criteria of NUM-III-8213 and NUM-III-8231.

(e) At load transfer points, consideration should be given to lower flange stresses that are not calculable by the formulae presented in NUM-III-8232.3.

(f) *Combined Stresses*. Where a state of combined plane stresses exists, the reference stress, σ_t , can be calculated from the following formula:

$$\sigma_t = \sqrt{\sigma_x^2 + \sigma_y^2 - \sigma_x\sigma_y + 3\tau_{xy}^2} \leq \sigma_{all} \quad (36)$$

where

σ_{all} = allowable stress

σ_x, σ_y = normal stress in respective x and y directions

τ_{xy} = shear stress in plane

For welds, the maximum combined stress, σ_v , shall be calculated as follows:

$$\sigma_v = \frac{1}{2} \left(\sigma_x + \sigma_y \right) \pm \frac{1}{2} \sqrt{(\sigma_x - \sigma_y)^2 + 4\tau^2} \leq \sigma_{all} \quad (37)$$

See NUM-B-4000 for a lower flange bending calculation example.

NUM-III-8232.4 Shear and Tension of Bolts

(a) Bolts subject to combined shear and tension shall be so proportioned that the tension stress, in psi, produced by forces applied to the connected parts, shall not exceed the allowable tension value, σ_{at} .

Table NUM-III-8232.4-1
Bolt Shear and Tension Factor, R

Principal	Additional	Extraordinary	Extreme Environmental Conditions
1	1	1.33	1.50

For A325 bolts in bearing-type joints

$$\sigma_{at} = 55,000R - 1.8\tau \leq 44,000R \quad (38)$$

For A490 bolts in bearing-type joints

$$\sigma_{at} = 68,000R - 1.8\tau \leq 54,000R \quad (39)$$

For other bolting materials in bearing-type joints

$$\sigma_{at} = 0.6\sigma_{yR} - 1.6\tau \quad (40)$$

where τ (the shear stress produced by the same forces) shall not exceed the value for the shear given in NUM-III-8231.5. The variable σ_y is the yield stress (the proof stress may be used). R is given in Table NUM-III-8232.4-1.

(b) For bolts used in friction-type joints, the shear stress (τ_a) allowed in NUM-III-8231.5 shall be reduced so that

for A325 bolts

$$\tau_a \leq 15,000 (1 - \sigma_\tau A_b / T_b) \quad (41)$$

for A490 bolts

$$\tau_a \leq 20,000 (1 - \sigma_\tau A_b / T_b) \quad (42)$$

where

A_b = the tensile stress area

T_b = the specified pre-tension load of the bolt

σ_τ = the average tensile stress due to a direct load applied to all of the bolts in a connection

In friction-type joints, the allowable shear stress shall not be increased due to environmental conditions.

NUM-III-8232.5 Shear and Bending. The maximum combined shear stress due to shear, bending, and direct stresses shall not exceed the allowable values for shear as given in NUM-III-8231.1.

NUM-III-8233 Buckling

NUM-III-8233.1 Local Buckling or Crippling of Flat Plates. The structural design of the crane to avoid local buckling of plates shall conform to ASME NOG-1, paras. NOG-4331 through NOG-4332.1.

(16) **NUM-III-8233.2 Proportion for Fabricated Box Girders.** The ratio of l/h shall not exceed 25; the ratio

of l/b shall not exceed 60; and the ratio of b/t shall not exceed

$$\sqrt{\frac{(2.62 \times 10^7) K_\sigma}{\sigma_P}} \times \frac{2}{DFB} \text{ (operating condition)}$$

(where b is the unsupported plate width between longitudinal stiffeners, webs, or cover plate) or $30.99\sqrt{K_\sigma(2/DFB)}$ operating condition for A36 steel and where

b = distance between web plates, in.

h = depth of web, in.

l = span, in.

t = thickness of web plate, in.

NUM-III-8233.3 Spacing of Transverse Stiffeners. (16)

The spacing of the transverse stiffeners, a , in., shall not exceed the amount given by the formula

$$a = \frac{11,068t}{\sqrt{\pi}} \quad (43)$$

where

c = spacing coefficient (see table below)

t = thickness of the web plate, in.

τ = shear stress in plate, psi

nor shall it exceed 72 in., or h , the depth of the web, whichever is greater.

Loading Condition	Spacing Coefficient, c
Operating	1
Construction	1
Severe environment	0.75
Extreme environment	0.6

NUM-III-8233.4 Stiffness of Longitudinal and Transverse Stiffeners. (16) The required stiffness of the longitudinal stiffener and the stiffness of the transverse stiffeners shall be in accordance with CMAA 74.

NUM-III-8233.5 Girder Deflection. The total vertical deflection of the girder during operational loading for the rated live load plus trolley ($P_{dt} + P_{ln}$), and not including impact or dead load of the girder, shall not exceed $1/1,000$ of the span.

The total vertical deflection of the girder during constructional loading for the construction load plus trolley ($P_{dt} + P_{cn}$), and not including impact or dead load of the girder, shall not exceed $1/600$ of the span.

The total vertical or lateral deflection of the girder during environmental loading shall be limited such that displacements do not cause the girder or any of its attachments to become dislodged or to leave the crane.

NUM-III-8233.6 Girder Camber. Girders shall be cambered an amount equal to the dead load deflection, plus $1/2$ of the deflection caused by the live load, plus trolley [camber = $\Delta(P_{db}) + 0.5\Delta(P_{dt} + P_{ln})$].

(16)

Table NUM-III-8234.1-1 Allowable Stress Ranges

CMAA Service Class	Allowable Stress Range $F_s\sigma$, kips/in. ² [Note (1)]					
	Joint Category					
	A	B	C	D	E	F
A	63	49	35	28	22	15
B	50	39	28	22	18	14
C	37	29	21	16	13	12
D	31	24	17	13	11	11

GENERAL NOTE: Allowable stress ranges from CMAA 74.

NOTE:

(1) Stress range values are independent of material yield stress.

NUM-III-8234 Fatigue Requirements. If the owner determines that more than 20,000 full-load cycles are required, the owner shall specify the cycles and load class per NUM-III-8234.1. The allowable stresses for the appropriate service level shall be used, but shall not exceed the basic operating stress allowables specified in NUM-III-8231.

NUM-III-8234.1 Allowable Stress Range, Repeated Loads. Members and fasteners subject to repeated loads shall be designed so that the stress range (maximum stress minus minimum stress) does not exceed allowable values for various categories as listed in Table NUM-III-8234.1-1. The minimum stress is considered as negative if it is opposite in sign to the maximum stress. The categories are described in Table NUM-III-8234.1-2 with joint configuration illustrations shown in Fig. NUM-III-8234.1-1. The allowable stress range shall be based on the condition most nearly approximated by the description and illustration.

NUM-III-8235 Hardness. The minimum Brinell hardness (BHN) of the lower load-carrying (tension) flange shall be 195 for patented track systems. For A36 material, the normal hardness produced by normal mill processing shall be sufficient.

NUM-III-8236 Stability. The crane shall be stable under all loading conditions. A factor of safety of 1.5 shall be provided against the combination of loads producing maximum overturning forces.

NUM-III-8240 Components Design

NUM-III-8241 Footwalks, Handrails, Platforms, Stairs, and Ladders

NUM-III-8241.1 General. Platforms and footwalks shall be provided as required for access and maintenance. Dimensions and clearances for footwalks, handrails, platforms, stairs, and ladders shall be in accordance with the latest edition of ASME B30.17.

NUM-III-8241.2 Materials. Materials for construction of footwalks, handrails, platforms, stairs, and ladders shall meet the requirements of NUM-III-8220.

NUM-III-8241.3 Design. Footwalks, handrails, platforms, stairs, and ladders shall be designed for the appropriate dead load and the live loads as specified in ASME B30.17. Structural design shall be in accordance with NUM-III-8230.

NUM-III-8242 Operator's Cab (When Specified)

NUM-III-8242.1 General

(a) The general arrangement of the cab and the location of the control and protective equipment shall be such that all operating control devices are within convenient reach of the operator when facing the area to be served by the load block or when facing the direction of travel of the cab. The operator's cab shall be open type for indoor service unless otherwise specified.

(b) The cab shall be clear of all fixed structures within its area of possible movement. Clearances shall be in accordance with the latest edition of ASME B30.11 and ASME B30.17. The cab shall be so located as not to interfere with the hook approach.

(c) The arrangement of equipment in the cab should be approved by the owner.

(d) Cabs shall be designed for maximum operator visibility. The arrangement of the cab should allow the operator a full view of the load block in all positions. A visibility diagram shall be furnished to the owner for approval when requested.

(e) The operator's cab shall have a clear height, with equipment installed, of not less than 7 ft, except where dimensional interferences or other design considerations require the use of a smaller cab. Cab heights of less than 7 ft shall be approved by the owner, and in no case shall be less than 5 ft.

Provision shall be made in the operator's cab for placement of the necessary equipment, wiring, and fittings.

Table NUM-III-8234.1-2 Fatigue Stress Provisions — Tension (T) or Reversal (Rev) Stresses

(16)

General Condition	Situation	Joint Category	Example of a Situation [Note (1)]	Kind of Stress
Plain material	Base metal with rolled or cleaned surfaces. Oxygen-cut edges with ANSI smoothness of 1,000 or less	A	1, 2	T or Rev
Built-up members	Base metal and weld metal in members without attachments, built up; of plates or shapes connected by continuous complete or partial joint penetration groove welds or by continuous fillet welds parallel to the direction of applied stress	B	3, 4, 5, 7	T or Rev
	Calculated flexural stress at toe of transverse stiffener welds on girder webs or flanges	C	6	T or Rev
	Base metal at end of partial length welded cover plates having square or tapered ends, with or without welds across the ends	E	7	T or Rev
Groove welds	Base metal and weld metal at complete joint penetration groove welded splices of rolled and welded sections having similar profiles when welds are ground and weld soundness established by UT or RT examination	B	8, 9	T or Rev
	Base metal and weld metal in or adjacent to complete joint penetration groove welded splices at transitions in width or thickness, with welds ground to provide slopes no steeper than 1 to $2\frac{1}{2}$ and weld soundness established by UT or RT examination	B	10, 11	T or Rev
	Weld metal of partial penetration transverse groove welds based on effective throat area of the weld or welds	F	17	T or Rev
Groove welds	Base metal and weld metal in or adjacent to complete joint penetration groove welded splices either not requiring transition or when required with transitions having slopes no greater than 1 to $2\frac{1}{2}$ and when in either case reinforcement is not removed and weld soundness is established by UT or RT examination	C	8, 9, 10, 11	T or Rev

Table NUM-III-8234.1-2 Fatigue Stress Provisions (T) or Reversal (Rev) Stresses (Cont'd)

General Condition	Situation	Joint Category	Example of a Situation [Note (1)]	Kind of Stress
	Base metal and weld metal at complete joint penetration groove welded splices of sections having similar profiles or at transitions in thickness to provide slopes no steeper than 1 to 2½ with permanent backing bar parallel to the direction of stress when welds are ground and weld soundness established by UT or RT examination. Backing bar is to be continuous, and, if spliced, is to be joined by a full-penetration butt weld. Backing bar is to be connected to parent metal by continuous welds along both edges, except intermittent welds may be used in regions of compression stress	B	19, 20	...
Groove-welded connections	Base metal at details of any length attached by groove welds subjected to transverse or longitudinal loading, or both, when weld soundness transverse to the direction of stress is established by UT or RT examination, and the detail embodies a transition radius, R, with the weld termination ground when (a) for longitudinal loading $R \geq 24$ in. $24 \text{ in.} > R \geq 6 \text{ in.}$ $6 \text{ in.} > R \geq 2 \text{ in.}$ $2 \text{ in.} > R \geq 0$ (b) for transverse loading, materials having equal or unequal thickness sloped, welds ground web connections excluded $R \geq 24$ in. $24 \text{ in.} > R \geq 6 \text{ in.}$ $6 \text{ in.} > R \geq 2 \text{ in.}$ $2 \text{ in.} > R \geq 0$ (c) for transverse loading, materials having equal thickness, no ground, web connections excluded	B C D E B C D E	13 13 13 12, 13 13 13 13 12, 13	 T or Rev T or Rev T or Rev T or Rev

Table NUM-III-8234.1-2 Fatigue Stress Provisions — Tension (T) or Reversal (Rev) Stresses (Cont'd)

General Condition	Situation	Joint Category	Example of a Situation [Note (1)]	Kind of Stress
Groove-welded or fillet-welded connections	$R \geq 24$ in.	C	13	T or Rev
	24 in. $> R \geq 6$ in.	C	13	T or Rev
	6 in. $> R \geq 2$ in.	D	13	T or Rev
	2 in. $> R \geq 0$	E	12, 13	T or Rev
	(d) for transverse loading, materials having unequal thickness, not sloped or ground, including web connections			
	$R \geq 24$ in.	E	13	T or Rev
	24 in. $> R \geq 6$ in.	E	13	T or Rev
	6 in. $> R \geq 2$ in.	E	13	T or Rev
	2 in. $> R \geq 0$	E	12, 13	T or Rev
	Base metal at details attached by groove or fillet welds subject to longitudinal loading where the detail embodies a transition radius, R , less than 2 in., and when the detail length, L , parallel to the line of stress is			
	$L \leq 2$ in.	C	12, 14, 15, 16, 18	T or Rev
	2 in. $< L \leq 4$ in.	D	12, 18	T or Rev
	$L > 4$ in.	E	12, 18	T or Rev
	Base metal at details attached by fillet welds or partial penetration groove welds parallel to the direction of stress, regardless of length, when the detail embodies a transition radius, R , 2 in. or greater and with the weld termination ground. When			
	$R \geq 24$ in.	B	13	T or Rev
Fillet-welded connections	24 in. $> R > 6$ in.	C	13	T or Rev
	6 in. $\geq R > 2$ in.	D	13	T or Rev
	Base metal at junction of axially loaded members with fillet-welded end connections. Welds shall be disposed about the axis of the member so as to balance weld stresses	E	21, 22, 23	T or Rev

Table NUM-III-8234.1-2 Fatigue Stress Provisions — Tension (T) or Reversal (Rev) Stresses (Cont'd)


General Condition	Situation	Joint Category	Example of a Situation [Note (1)]	Kind of Stress
Fillet welds	Shear stress on throat of fillet welds	F	21, 22, 23 24, 25, 26 27, 28	S
	Base metal at intermittent welds attaching transverse stiffeners and stud-type shear connectors	C	7, 14	T or Rev
	Base metal at intermittent welds attaching longitudinal stiffeners or cover plates	E	7, 29	T or Rev
Stud welds	Shear stress on nominal shear area of stud-type shear connectors	F	14	S
Plug and slot welds	Base metal adjacent to or connected by plug or slot welds	E	30	T or Rev
	Shear stress on nominal shear area of plug or slot welds	F	30, 31	S
Mechanically fastened connections	Base metal at gross section of high-strength bolted friction-type connections, except connections subject to stress reversal and axially loaded joints that induce out-of-plane bending in connected material	B	32	T or Rev
	Base metal at net section of other mechanically fastened joints	D	33	T or Rev
	Base metal at net section of high-strength bolted bearing connections	B	32, 33	T or Rev

NOTE:

(1) Example numbers are from CMAA 74.

Fig. NUM-III-8234.1-1 Joint Configuration (From CMAA 74)

(16)

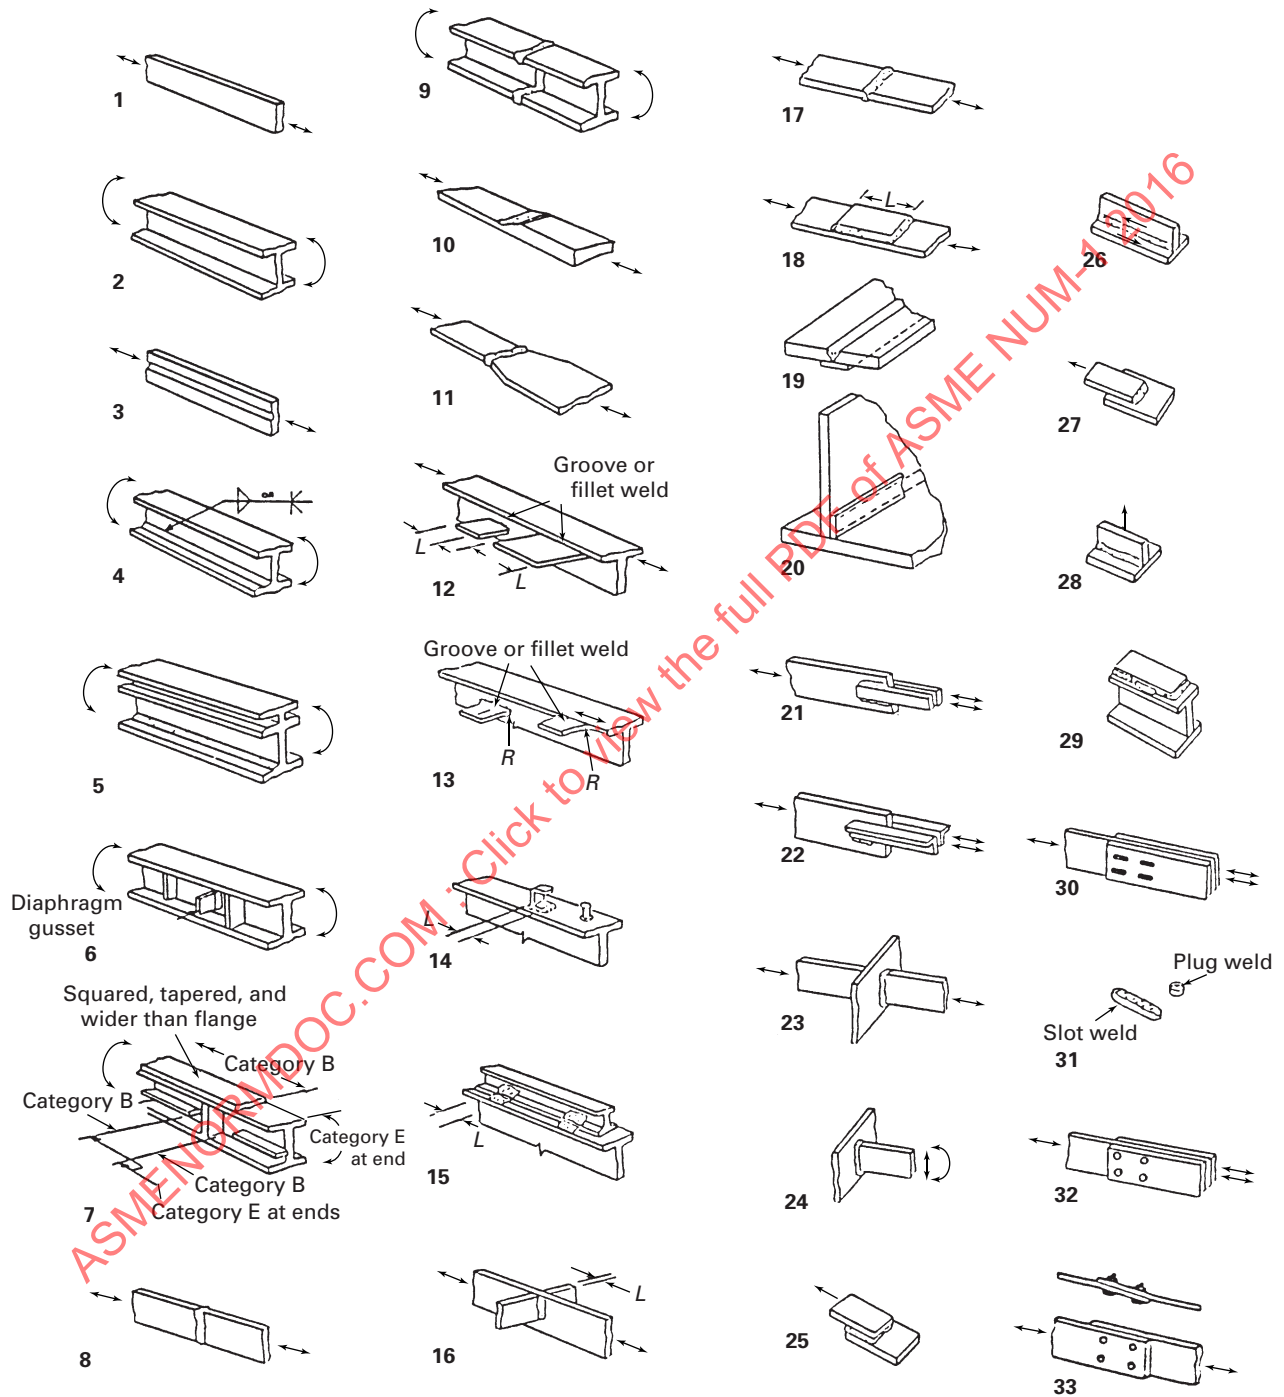

All cabs should be provided with a swiveled seat unless otherwise specified.

(f) There shall be means of egress from cab-operated cranes to permit departure under emergency conditions, at any cab location.

NUM-III-8242.2 Materials. Materials for construction of the operator's cab shall meet the requirements of NUM-III-8220.

NUM-III-8242.3 Design. The operator's cab shall be designed for dead and live loads as specified by the owner. Structural design shall be in accordance with NUM-III-8230.

NUM-III-8242.4 Construction

NUM-III-8242.4.1 General. Cabs shall be constructed in accordance with ASME B30.11 or ASME B30.17.

NUM-III-8242.4.2 Enclosed Cabs. Enclosed cabs shall have watertight plate roofs that slope to the rear, and shall be provided with sliding, hinged, or drop windows on the three sides, and with sliding or hinged doors. Steel plates for enclosing sides, when used, shall not be less than $\frac{1}{8}$ in. thick. Window sash shall be equipped with clear, shatterproof glass installed from the inside so that if it is dislodged it will fall in the cab.

Drop windows shall be protected from breakage by a $\frac{1}{8}$ -in. sheet steel guard, extending to within 2 in. of the floor, and shall be provided with handles and stops, which will prevent catching the operator's hands or toes when operating the windows. Drop windows shall be counterweighted.

NUM-III-8242.4.3 Open Cabs. Open cabs shall be enclosed with panels not less than $\frac{1}{8}$ in. thick or standard railing 42 in. high. Railing enclosures shall be provided with midrail and steel toe plate. Where the top rail, or top panel, interferes with the operator's vision, it may be lowered, with the owner's approval.

NUM-III-8300 MECHANICAL

NUM-III-8310 General

This section covers the mechanical requirements and criteria common to all cranes. Requirements for hoists are covered under NUM-III-7000.

NUM-III-8311 Lubrication Subject to Radiation. If the crane is subjected to radiation, the lubricants shall resist the effects of gamma or neutron radiation or provisions shall be made for changing the lubricants. If lubricants cannot be conveniently replaced, then lubricants shall be National Lubrication and Grease Institute (NLGI) Grade 0 oil containing molybdenum disulfate or NLGI Grade 1.5 grease with sodium aluminate thickener. Lubricants shall be oxidation and rust inhibited with the exception of lubricants for wire rope.

NUM-III-8320 Design and Performance Criteria

NUM-III-8321 Allowable Stresses. Load-carrying parts, except structural members and gears, shall be designed such that the calculated static stress in the material, based on rated load, shall not exceed 20% of the published average ultimate strength of the material. Castings, forgings, stampings, and fasteners shall be designed with allowable stress not to exceed 20% of the minimum ultimate strength of the material.

NUM-III-8322 Service Factors. All load combinations and factors including stress concentrations shall have service factors as stated for the design of specific mechanical components, as indicated in NUM-III-8340.

NUM-III-8330 Component Design

NUM-III-8331 Bridge Drives

NUM-III-8331.1 Types of Bridge Drives. Reference specific bridge sections for acceptable bridge drive arrangements.

NUM-III-8331.2 Bridge Drive Motors. Bridge drive motors shall be selected in accordance with NUM-III-8400.

NUM-III-8332 Bridge Brakes

NUM-III-8332.1 Design. On all powered cranes, a braking means shall be provided.

(a) A bridge brake or noncoasting mechanical drive shall be provided that is capable of stopping the motion of the bridge within a distance in feet equal to 10% of full-load speed in feet per minute when traveling at full speed with full load.

(b) The braking means shall have thermal capacity for the frequency of operation.

(c) Brakes shall be provided with adjustment to compensate for wear.

(d) If holding brakes are provided, they shall have a torque rating of at least 50% of the rated motor torque and be adjustable to a minimum of 25% of the rated motor torque.

NUM-III-8333 Bumpers and Stops

NUM-III-8333.1 Bumper Design

(a) Bridge bumpers should be provided.

(b) If bridge bumpers are specified by the owner, then they shall be designed and installed to minimize parts falling from the crane in case of breakage.

(c) For two cranes on the same runway, bumpers shall be designed and installed so that no other part of either crane will come in contact when the two cranes come together.

(d) Bumpers shall have the energy-absorbing (or energy-dissipating) capacity to stop the crane when traveling with power off in either direction at a speed of at least 40% of the rated-load speed. The bumpers shall

also be capable of stopping the crane (not including load block and lifted load) at a rate of deceleration not to exceed an average of 3 ft/sec when traveling with power off in either direction at 20% of rated-load speed.

NUM-III-8333.2 Stop Design

(a) Runway stops shall be provided and shall be located at the limits of the bridge travel, such that no part of the crane (with bumper fully compressed) will encroach upon the required clearance specified in NUM-G-2110.

(b) Runway stops shall be attached to withstand the force applied when contacted.

(c) Runway stops engaging the tread of the wheel shall not be used for motorized cranes.

NUM-III-8334 Couplings. Couplings shall be selected for the torque and alignment requirements at the point of application. Solid couplings shall be steel or minimum ASTM A48, Class 40 cast iron or equal material.

NUM-III-8335 Mounting of Bridge Drive Components

(a) Drive components, such as motors and gear reducers, shall not be mounted on multiple support structures, which can deflect relative to each other, unless the design specifically allows for this deformation.

(b) Drive components whose alignment is important to their operation shall not depend on friction, but shall use positive means, such as dowel pins, shear bars, or fitted bolts, to maintain alignment.

(c) Mechanical component connections shall be designed to accommodate all dynamic forces, such as those induced by motor starting and braking applications.

NUM-III-8336 Guards

(a) Exposed moving parts, such as gears, setscrews, projecting keys, chains, chain sprockets, and reciprocating components, that may constitute a hazard under normal operating conditions shall be guarded.

(b) Guards shall be securely fastened.

(c) Each guard shall be capable of supporting, without permanent deformation, a weight of 200 lb, unless the guard is located where it is not probable for a person to step on it.

NUM-III-8340 General Mechanical Components

NUM-III-8341 Gearing. Gearing shall be designed and manufactured in accordance with the procedures presented by the American Gear Manufacturers Association (AGMA).

When worm gearing is specified, it shall be rated with appropriate service factors. Consideration shall be given to lock up when selecting gear ratios for travel drives.

Table NUM-III-8341.2-1 Crane Service Factor, S_f

Crane Class	S_f
A	0.75
B	0.85
C	0.90
D	0.95

GENERAL NOTE: Crane service factor, S_f , from CMAA 74.

NUM-III-8341.1 Materials. All gears and pinions shall be constructed of steel or other material of adequate strength and durability to meet the requirements for the intended class of service, and manufactured to AGMA quality class 5 or better.

NUM-III-8341.2 Allowable Strength Horsepower. (16)

The horsepower rating for all spur, helical, and herringbone gearing shall be based on AGMA 2001-C95. For the purpose of this Standard, the power formula is as follows:

$$P_{at} = \frac{N_p d}{126,000} \times \frac{FS_{at} I}{K_v K_m P_d S_f K_B} \quad (44)$$

$$P_{ac} = \frac{N_p F I}{126,000 K_v K_m S_{fd}} \times \left(\frac{S_{ac} d C_h}{C_p} \right)^2 \quad (45)$$

where

C_h = hardness factor (durability)

C_p = elastic coefficient

d = pitch diameter of pinion, in.

F = net face width of the narrowest of the mating gears, in.

I = geometry factor (durability)

J = geometry factor (strength)

K_B = rim thickness factor

K_m = load distribution factor

K_v = dynamic factor

N_p = pinion speed, rpm

P_{ac} = allowable durability, horsepower

P_{at} = allowable strength, horsepower

P_d = transverse diametral pitch, 1/in.

S_{at} = allowable bending stress for material, psi (strength)

S_f = crane service factor (strength)

S_{fd} = crane service factor (durability)

The values for K_v , K_m , K_B , C_p , J , I , S_{ac} , and S_{at} can be determined from the tables and curves in the appropriate AGMA specification previously mentioned; S_f from Table NUM-III-8341.2-1; and the remaining values will be physical characteristics pertaining to the gears for their operation characteristics.

**Table NUM-III-8341.2-2
Machinery Service Factor, C_d**

Class of Service	C_d
A	0.64
B	0.72
C	0.80
D	0.90

GENERAL NOTE: Machinery service factor, C_d , from CMAA 74.

Table NUM-III-8342-1 AFBMA L10 Bearing Life

Class	Bearing Life, hr
A	1,250
B	2,500
C	5,000
D	10,000

GENERAL NOTE: AFBMA L10 bearing life from CMAA 74.

Crane service factor S_{fd} shall be determined from the formula $S_{fd} = C_d \times K_w$. For values of specific K_w , refer to eq (46), and for C_d , which is the machinery factor, refer to Table NUM-III-8341.2-2.

$$K_w = \frac{2(\text{maximum load}) + (\text{minimum load})}{3(\text{maximum load})} \quad (46)$$

NUM-III-8341.3 Lubrication. Means shall be provided to ensure adequate and proper lubrication on all gearing. All gearing, except the final reduction at the wheels, shall run in oil or be splash lubricated. Selection of lubricants shall be based on the guidelines found in AGMA 9005 or as recommended by the gear manufacturer.

NUM-III-8342 Antifriction Bearings

(a) Antifriction bearings shall be selected to give a minimum life expectancy based on full rated speed as shown in Table NUM-III-8342-1.

The crane service factors for strength in horsepower are shown in Table NUM-III-8341.2-2.

(b) Use K_w load factor for all applications.

(c) Due consideration shall be given to the selection of the bearing if a crane is used for a limited time at an increased service class, such as during a construction phase.

NUM-III-8342.1 Sleeve Bearings. Bronze sleeve bearings shall have a maximum allowable unit bearing pressure of 1,000 psi on the projected area.

NUM-III-8342.2 Lubrication. All bearings shall be provided with proper lubrication or means of lubrication. Bearing enclosures shall be designed to exclude dirt and prevent leakage of oil or grease.

NUM-III-8343 Bridge and Trolley Drive Shafts

NUM-III-8343.1 General. Drive shafting shall be designed for the maximum wheel load in combination with the maximum torque load.

NUM-III-8343.2 Material. All shafts, except the bridge cross-shaft sections, that do not carry gears, shall be of cold-rolled shafting quality or equivalent.

NUM-III-8343.3 Bearing Spacing for Rotating Shafts. The bearing spacing for rotating shafts less than 400 rpm shall not exceed that calculated per the following equation:

$$L = \sqrt[3]{\frac{432,000D^2}{N}} \quad (47)$$

where

D = shaft diameter, in.

L = distance between bearing centers, in.

When the shaft speed exceeds 400 rpm, the bearing spacing shall not exceed that determined by the following formula or the preceding formula, whichever is less, in order to avoid objectionable vibration at critical shaft speeds.

$$L = \sqrt{\frac{4,760,000D}{1.2N}} \quad (48)$$

where

N = maximum shaft speed, rpm

NUM-III-8343.4 Torsional Deflection of the Bridge.

The torsional deflection of the bridge cross shaft shall not exceed 0.10 deg/ft when 67% (A-1 Drive), 50% (A-2 Drive), 100% (A-4 Drive) full-load bridge drive rated motor torque, increased by any gear reduction between the motor and the shaft, is applied. In addition, this applied torque shall result in a bridge drive wheel movement no greater than 1% of the wheel circumference or $\frac{1}{2}$ in., whichever is less.

NUM-III-8343.5 Stress Calculations. All shafting shall be designed to meet the stresses encountered in actual operation, including the effects of brake torque. When significant stresses are produced by other forces, these forces shall be positioned to provide the maximum stresses at the section under consideration. Impact shall not be included. (16)

(a) *Static Stress Check for Operating Conditions*

(1) For shafting subjected to axial loads, the stress shall be calculated as follows (for shafting not limited by buckling):

$$\sigma = \frac{P}{A} \quad (49)$$

where

A = cross-sectional area of shaft, in.²
 P = total axial load, lb

This axial stress shall not exceed

$$\frac{S_u}{5}$$

(2) For shafting loaded in bending, the stress shall be calculated as follows:

$$\sigma = \frac{Mr}{I} \quad (50)$$

where

I = bending moment of inertia at point of examination
 M = bending moment at point of examination, in.-lb
 r = outside radius of shaft at point of examination, in.

This bending stress shall not exceed

$$\frac{S_u}{5}$$

(3) For shafting loaded in torque, the shear stress shall be calculated as follows:

$$\tau = \frac{T_r}{J} \quad (51)$$

where

J = polar moment of inertia of shaft at point of examination
 T = torque at point of examination, in.-lb

This shear stress shall not exceed

$$\frac{S_u}{5\sqrt{3}}$$

(4) Transverse shear stress in shafting shall be calculated as follows:

For solid shaft

$$\tau = \frac{1.33V}{A} \quad (52)$$

where

A = cross-sectional area at point of examination, in.²
 V = shear load at point of examination, lb

For hollow shafts

$$\tau = \frac{2V}{A} \quad (53)$$

These shear stresses shall not exceed

$$\frac{S_u}{5\sqrt{3}}$$

(5) When combinations of stresses are present on the same element, they shall be combined as follows:
 For axial and bending stresses

$$\sigma = \sigma_1 + \sigma_2 + \sigma_3 \dots + \sigma_n$$

and shall not exceed

$$\frac{S_u}{5}$$

For shear stresses

$$\tau = \tau_1 + \tau_2 + \tau_3 \dots + \tau_n$$

and shall not exceed

$$\frac{S_u}{5\sqrt{3}}$$

For axial and bending with shear

$$\sigma_t = \sqrt{\sigma^2 + 3\tau^2} \quad (54)$$

and shall not exceed

$$\frac{S_u}{5}$$

Note that bending and torsional stresses are maximum on the outer fibers of the shaft and must be combined. The transverse shear stresses are maximum at the center of the shaft and do not combine with bending or torsional stresses.

(b) *Fatigue Stress Check for Fluctuating, Operating Stresses.* Any shafting subjected to fluctuating stresses, such as the bending in rotating shafts or the torsion in reversing drives, shall be checked for fatigue. This check shall be performed at points of geometric discontinuity where stress concentrations exist, such as fillets, holes, keys, press fits, etc. Pure stresses shall be calculated using appropriate stress multiplication factors. The allowable stresses are as follows:

(1) Tensile and bending stress

$$\sigma K_t \leq \frac{S_e}{K_c} \quad (55)$$

(2) Shear and combined shear

$$\tau K_s \leq \frac{S_e}{K_c\sqrt{3}} \quad (56)$$

(3) For combined stresses, where all of the shear and bending are fluctuating

$$\sigma_t = \sqrt{(K_t\sigma)^2 + 3(K_s\tau)^2} \leq \frac{S_e}{K_c} \quad (57)$$

Table NUM-III-8343.5-1 Crane Class Factor, K_c

Crane Class	K_c
A	1.000
B	1.015
C	1.030
D	1.060

GENERAL NOTE: Crane class factor, K_c , from CMAA 74.

Table NUM-III-8343.5-2 Surface Condition Factor, K_{sc}

K_{sc}	Shafting Type
1.40	For polished, heat-treated, and inspected shafting
1.00	For machined, heat-treated, and inspected shafting
0.75	For machined, general-use shafting

GENERAL NOTE: Surface condition factor, K_{sc} , from CMAA 74.

(4) For combined shear and bending, where only part of the stresses are fluctuating

$$\sigma_t = \sqrt{\left(\sigma_{av} + \frac{K_t S_{yp} \sigma_r}{S_e}\right)^2 + 3\left(\tau_{av} + \frac{K_s S_{yp} \tau_r}{S_e}\right)^2} \leq \frac{S_{yp}}{K_c} \quad (58)$$

where

K_c = crane class factor (see Table NUM-III-8343.5-1)

K_s = stress amplification factor for shear

K_{sc} = surface condition factor (see Table NUM-III-8343.5-2)

K_t = stress amplification factor for tension or bending

S_e = endurance strength of shaft material
 $= 0.36 S_u K_{sc}$

S_u = average tensile strength of shaft material

S_u' = minimum tensile strength of shaft material

S_{yp} = minimum yield strength of shaft material

σ_{av} = that part of the bending stress not due to fluctuating loads

σ_r = that part of the bending stress due to fluctuating loads

τ_{av} = that part of the shear stress not due to fluctuating loads

τ_r = that part of the shear stress due to fluctuating loads

(c) *Bearing Stress in Shafts.* Shafting in bearings shall be checked for operating conditions. The bearing stress is calculated by dividing the radial load by the projected area

$$\frac{P}{dL}$$

where

d = the shaft diameter

L = the length in bearing

This bearing stress shall not exceed 50% of the minimum yield for nonrotating shafting.

This bearing stress shall not exceed 20% of the minimum yield for oscillating shafting when not limited by the bushing material.

NUM-III-8344 Wheel Assembly

NUM-III-8344.1 Top-Running Bridge Wheel Design

(a) Unless other means of restricting lateral movement are provided (such as side rollers), wheels shall be double flanged with treads accurately machined. Bridge wheels may have either straight treads or tapered treads assembled with the large diameter toward the center of the span. Drive wheels shall be machined in pairs within 0.001 in./in. of diameter with a maximum of 0.010 in. on the diameter, whichever case is smaller.

(b) *Sizing of Wheels and Rails.* Wheels shall be designed to carry the maximum wheel load under normal conditions without undue wear. The maximum wheel load is that wheel load produced with the trolley handling the rated load in the position to produce the maximum reaction at the wheel, not including impact. When sizing wheels and rails, the following parameters shall be considered:

D = wheel diameter, in.

K = hardness coefficient of the wheel

= BHN $\times 5$ (for wheels with BHN < 260)

= $1300(\text{BHN}/260)^{0.33}$ (for wheels with BHN > 260)

W = effective rail head width, in.

The bridge and trolley durability wheel loadings for different wheel hardnesses and sizes in combination with different rail sizes are shown in Table NUM-III-8344.1-1. The values in the table are established by the product of KDW .

(c) To use Table NUM-III-8344.1-1, first determine the equivalent durability wheel load P_e .

P_e = maximum wheel load $\times K_{wl}$

$K_{wl} = K_{bw} C_s S_m$

(d) Load factor K_{bw} can be determined as follows:

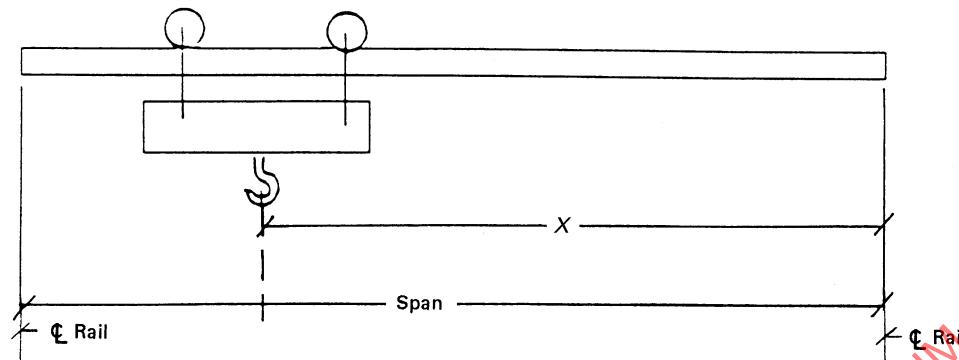
$$K_{bw} = \frac{0.75(BW) + f(LL) + 0.5(TW) - 0.5f(TW)}{0.75(BW) + 1.5f(LL)} \quad (59)$$

Table NUM-III-8344.1-1 Bridge Wheel Loadings, lb; *P*; *KDW*

Wheel BHN	Wheel Diameter, <i>D</i> , in.	ASCE 20 lb	ASCE 25 lb	ASCE 30 lb	ASCE 40 lb	ARA-A 90 lb	ASCE 60 lb and 70 lb, ARA-B 100 lb	ASCE 80 lb and 85 lb, ARA-A 100 lb F, BETH 104 lb, USS 105 lb	ASCE 100 lb	BETH and USS 135 lb
200	5	4,200	5,000	5,300	...	...	...	...	...	...
	6	5,050	6,000	6,400	7,500	...	...	...	...	...
	8	6,750	8,000	8,500	10,000	...	...	...	...	...
	9	7,600	9,000	9,550	11,250	14,900	15,750	...	...	...
	10	8,450	10,000	10,650	12,500	16,550	17,500	...	...	...
	12	...	12,000	12,750	15,000	19,850	21,000	22,500	25,500	...
	15	...	...	15,950	18,750	24,850	26,250	28,150	31,850	...
	18	...	...	19,150	22,500	29,800	31,500	33,750	38,250	40,500
260	5	5,500	6,500	6,900	...	...	...	...	...	...
	6	6,600	7,800	8,300	9,750	...	...	...	...	...
	8	8,800	10,400	11,050	13,000	...	...	...	...	...
	9	9,850	11,700	12,450	14,600	19,400	20,450	...	...	...
	10	10,950	13,000	13,800	16,250	21,550	22,750	...	...	...
	12	...	15,600	16,600	19,500	25,850	27,300	29,250	33,150	...
	15	...	...	20,750	24,400	32,300	34,100	36,550	41,450	...
	18	...	...	24,850	29,250	38,750	40,950	43,850	48,700	52,650
320	5	5,850	6,950	7,400	...	...	...	...	...	...
	6	7,050	8,350	8,900	10,450	...	...	...	...	...
	8	9,400	11,150	11,850	13,900	...	...	...	...	...
	9	10,550	12,550	13,300	15,650	20,750	21,950	...	...	...
	10	11,750	13,900	14,800	17,400	23,050	24,350	...	...	...
	12	...	16,700	17,750	20,900	27,650	29,250	31,300	35,500	...
	15	...	...	22,200	26,100	34,600	36,550	39,150	44,400	...
	18	...	...	26,650	31,300	41,500	43,850	47,000	53,250	86,400
58 RC (615 BHN)	5	7,300	8,650	9,200	...	...	...	...	...	...
	6	8,750	10,350	11,000	12,950	...	...	...	...	...
	8	11,650	13,800	14,700	17,250	...	...	...	...	...
	9	13,200	15,550	16,500	19,450	25,750	27,200	...	...	...
	10	14,600	17,250	18,350	21,600	28,600	30,200	...	...	...
	12	...	20,700	22,050	25,900	34,300	36,250	38,850	44,050	...
	15	...	...	27,550	32,400	42,900	45,350	48,750	55,050	...
	18	...	...	33,050	38,850	51,500	54,400	58,300	66,050	69,950
Effective width of rail head, <i>W</i> (top of head minus corner), in.		0.844	1.000	1.083	1.250	1.654	1.750	1.875	2.125	2.250

GENERAL NOTE: Bridge wheel loadings, lb; *P*; *KDW* from CMAA 74.

Fig. NUM-III-8344.1-1 Bridge Span (From CMAA 74)

Table NUM-III-8344.1-2 Bridge Load Factor, K_{bw}

Bridge Span, ft	Capacity, ton						
	3	5	7.5	10	15	20	30
20	0.812	0.782	0.762	0.747	0.732	0.722	0.716
30	0.817	0.785	0.767	0.750	0.736	0.725	0.718
40	0.827	0.794	0.777	0.760	0.744	0.732	0.723
50	0.842	0.809	0.791	0.771	0.758	0.740	0.731
60	0.861	0.830	0.807	0.790	0.773	0.754	0.741
70	0.877	0.844	0.825	0.807	0.789	0.768	0.752
80	0.888	0.857	0.835	0.818	0.802	0.779	0.761

GENERAL NOTES:

- (a) K based on worst case with trolley against stop.
 (b) Bridge load factor, K_{bw} , from CMAA 74.

where

BW = bridge weight
 f = X/span (See Fig. NUM-III-8344.1-1)
 LL = trolley weight + rated load
 TW = trolley weight

See Table NUM-III-8344.1-2.

(e) The speed factor, C_s , depends on the rotational speed of the wheel and is listed in Table NUM-III-8344.1-3. These factors are obtained from the following formulas:

for $\text{rpm} \leq 31.5$

for $\text{rpm} \geq 31.5$

$$C_s = 1 + \left(\frac{\text{rpm} - 31.5}{328.5} \right) \quad (60)$$

(f) The wheel service factor, S_{mr} , is equal to 1.25 times the machinery service factor, C_d , and is shown in Table NUM-III-8344.1-4. This factor recognizes that the interaction between rail and wheel is more demanding in terms of durability than well-aligned and lubricated interaction of machined parts.

(g) The wheel load service coefficient is

$$K_{wl} = K_{bw} C_s S_m$$

and K_{wl} may not be smaller than the K_{wl} minimum shown in Table NUM-III-8344.1-4.

(h) The equivalent durability wheel load, P_e , shall not exceed the wheel load in Table NUM-III-8344.1-1.

(i) *Proper Clearance for Bridge Wheels.* A total of approximately $\frac{3}{4}$ in. to 1 in. wider than the rail head is

Table NUM-III-8344.1-3 Speed Factor, C_s

Wheel Diameter, in.	Speed, ft/min								
	30	50	75	100	125	150	175	200	250
5	0.952	1.020	1.078	1.136	1.194	1.252	1.310	1.368	1.485
6	0.932	1.001	1.049	1.098	1.146	1.194	1.243	1.291	1.388
8	0.907	0.958	1.013	1.049	1.086	1.122	1.158	1.195	1.267
9	0.898	0.944	1.001	1.033	1.066	1.098	1.130	1.163	1.227
10	0.892	0.932	0.984	1.020	1.049	1.079	1.108	1.137	1.195
12	0.882	0.915	0.958	1.001	1.025	1.049	1.074	1.098	1.146
15	0.872	0.898	0.932	0.967	1.001	1.020	1.040	1.059	1.098
18	0.865	0.887	0.915	0.944	0.973	1.001	1.017	1.033	1.066

GENERAL NOTE: Speed factor, C_s , from CMAA 74.

**Table NUM-III-8344.1-4
Wheel Service Factor, S_m , and Minimum Load
Service Factor, K_{wl}**

Class of Crane Service	K_{wl} , min.	S_m
A	0.75	0.80
B	0.75	0.90
C	0.80	1.00
D	0.85	1.12

GENERAL NOTE: Wheel service factor, S_m , and minimum load service factor, K_{wl} , from CMAA 74.

the proper clearance. Tapered tread wheels may have a clearance over the rail head of 150% of the clearance provided for straight tread wheels.

(j) When rotating axles are used, wheels shall be mounted on the axle with press fit alone, press fit and keys, or keys alone.

NUM-III-8344.2 Under-Running Bridge Wheel Design

(a) All under-running bridge truck wheels shall be designed to suit the surface on which they run. Drive wheels shall be the same diameter within a tolerance of 0.010 in.

(b) When flangeless wheels are used, they shall be provided with a side roller arrangement.

(c) Wheels shall be designed to carry the maximum wheel load under normal conditions. The wheel load shown in Table NUM-III-8344.2-1 is that load produced with the trolley handling the rated load, in a position to exert the maximum load, not including impact.

NOTE: A reduction in the allowable wheel load may be necessary to satisfy the runway lower flange stress requirements.

NUM-III-8344.3 Material. Wheels shall be cast iron or rolled, forged, or cast steel with a minimum hardness

of 200 BHN. For special applications, other materials may be used with permission of the owner and with consideration of hardness, impact strength, and brittleness.

NUM-III-8344.4 Bearings. Wheel bearings shall be single or double row, combination radial and thrust, anti-friction precision type. Bearings shall be prelubricated and sealed or provided with fittings and seals for pressure lubrication.

NUM-III-8344.5 Safety Lugs. All wheel sets shall have drop plates limiting the movement of the immediate structure to 1 in. in the event of axle or bearing failure.

NUM-III-8350 Miscellaneous

NUM-III-8351 Hand-Chain Wheels

(a) Hand-chain wheels shall have pockets formed to allow proper engagement of the hand chain.

(b) The wheels shall be equipped with a chain guide that will permit operation of the hand chain from an angle 10 deg out from either side of the chain wheel without slipping or jumping the wheel rim.

(c) All hand chains shall be guided to guard against disengagement from the hand-chain wheel.

Table NUM-III-8344.2-1 Maximum Wheel Loads/I Beams and Wide Flange Beams

(16)

Wheel Diameter, <i>D</i> , in.	Contour Tread, in. [Note (1)]				Convex Tread, in.			
	$W = \frac{1}{2}$	$W = 1$	$W = 1\frac{1}{2}$	$W = 2$	$W = \frac{1}{2}$	$W = 1$	$W = 1\frac{1}{2}$	$W = 2$
4	2,000	4,000	6,000	8,000	1,200	2,400	3,600	4,800
5	2,500	5,000	7,500	10,000	1,500	3,000	4,500	6,000
6	3,000	6,000	9,000	12,000	1,800	3,600	5,400	7,200
7	3,500	7,000	10,500	14,000	2,100	4,200	6,300	8,400
8	4,000	8,000	12,000	16,000	2,400	4,800	7,200	9,600
9	4,500	9,000	13,500	18,000	2,700	5,400	8,100	10,800
10	5,000	10,000	15,000	20,000	3,000	6,000	9,000	12,000

GENERAL NOTES:

- (a) For contour tread, P (wheel load) = 1,000 WD , lb.
 (b) For convex tread, P (wheel load) = 600 WD , lb.
 (c) W = width of wheel tread exclusive of flange, in.; D = diameter of wheel, in.
 (d) Charted values are based on wheels with BHN of 200. Larger wheel loads are obtainable with suitable material and with higher BHN.
 (e) Maximum wheel loads/I beams and wide flange beams from CMAA 74.

NOTE:

- (1) Where wheel tread matches the rolling surface of the lower flange of the track beam.

NUM-III-8352 Hand Chains

(a) Hand chains shall be of the link-chain type. Each link shall be of uniform size and shape and have an accurate pitch to reliably pass over and around the hand-chain wheels.

(b) Hand chains shall be endless-link chain and shall have a drop that is approximately 2 ft above the operator's floor level.

(c) Hand chains shall withstand, without permanent distortion, a force of three times the pull required to rotate the boom with a capacity load on the boom.

NUM-III-8400 ELECTRICAL**NUM-III-8410 General**

This section covers the electrical requirements and criteria common to all cranes. Requirements for hoists are covered under NUM-III-7000.

NUM-III-8420 Electrical Components

NUM-III-8421 Crane Controls. The type of control supplied for a traverse drive shall result in operation complying with the specified performance as defined in NUM-G-3000.

NUM-III-8421.1 Types of Control

(a) Common control systems may be one of the following:

(1) single-speed AC magnetic reversing, which uses an AC squirrel-cage induction motor (also see NUM-III-8421.2).

(2) two-speed AC magnetic reversing, which uses a dual-wound AC squirrel-cage induction motor. Speed ratios under any load are normally 3 to 1, but may also

be furnished in other ratios, such as 2 to 1 or 4 to 1 (also see NUM-III-8421.2).

(3) variable-speed AC magnetic reversing, which is a type of constant potential AC control that uses resistance in the secondary of an AC wound rotor induction motor. Three to five speed steps are normally provided, with the speed at each step varying depending on the load.

(4) AC variable-frequency control, which uses an AC squirrel-cage induction motor and provides either stepped or stepless speed control by varying the motor frequency (see NUM-III-8421.6).

(b) *Other Control Systems.* Other control systems, such as adjustable-voltage DC and adjustable-voltage AC, may be required depending on the specific application or owner specifications.

NUM-III-8421.2 Cushioned Start Devices

(a) Cushioned start devices are used with single-speed and two-speed AC magnetic-reversing controls in order to control the rate of acceleration by limiting the starting voltage of the AC squirrel-cage induction motor.

(b) A cushioned start device should be used on single-speed and two-speed applications that require load swing to be minimized.

(c) A cushioned start device shall be used for the following applications:

(1) single-speed drives greater than 100 ft/min

(2) two-speed drives greater than 100 ft/min that do not use a time delay between the two speeds

(d) Standard cushioned start devices are as follows:

(1) solid-state reduced-torque starters, which provide for the adjustment of the initial torque upon starting and adjustment of the time for reaching full motor torque