

INTERNATIONAL STANDARD

**Luminaires –
Part 1: General requirements and tests**

IECNORM.COM : Click to view the full PDF of IEC 60598-1:2020



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2020 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

IECNORM.COM : Click to view the full PDF of IEC 60598-1:2020

INTERNATIONAL STANDARD

**Luminaires –
Part 1: General requirements and tests**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 29.140.40

ISBN 978-2-8322-8682-1

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD	9
SECTION 0: GENERAL INTRODUCTION	12
0.1 Scope	12
0.2 Normative references	13
0.3 General requirements	16
0.4 General test requirements and verification	16
0.5 Components of luminaires	17
0.6 List of parts of IEC 60598-2	18
0.7 Information for luminaire design in light sources standards	19
SECTION 1: TERMS AND DEFINITIONS	20
1.1 General	20
1.2 Terms and definitions	20
SECTION 2: CLASSIFICATION OF LUMINAIRES	36
2.1 General	36
2.2 Classification according to type of protection against electric shock	36
2.3 Classification according to degree of protection against ingress of dust, solid objects and moisture	36
2.4 Classification according to material of supporting surface for which the luminaire is designed	36
2.5 Classification according to the circumstances of use	37
SECTION 3: MARKING	38
3.1 General	38
3.2 Marking on luminaires	38
3.3 Additional information	44
3.4 Test of marking	47
SECTION 4: CONSTRUCTION	48
4.1 General	48
4.2 Replaceable components	48
4.3 Wireways	48
4.4 Lampholders	48
4.5 Starterholders	50
4.6 Terminal blocks	50
4.7 Terminals and supply connections	51
4.8 Switches	53
4.9 Insulating linings and sleeves	53
4.10 Double and reinforced insulation	54
4.11 Electrical connections and current-carrying parts	56
4.12 Screws and connections (mechanical) and glands	57
4.13 Mechanical strength	60
4.14 Suspensions, fixings and means of adjustment	63
4.15 Flammable materials	67
4.16 Luminaires for mounting on normally flammable surfaces	68
4.17 Drain holes	70
4.18 Resistance to corrosion	70
4.19 Ignitors	70
4.20 Rough service luminaires – Vibration requirements	71

4.21	Protective shield	71
4.22	Attachments to lamps.....	72
4.23	Semi-luminaires	72
4.24	Photobiological hazards	72
4.25	Mechanical hazard	73
4.26	Short-circuit protection	73
4.27	Terminal blocks with integrated screwless protective earthing contacts	74
4.28	Fixing of thermal sensing controls	74
4.29	Luminaire with non-replaceable light source.....	75
4.30	Luminaires with non-user replaceable light sources	75
4.31	Insulation between circuits	75
4.32	Overvoltage protective devices	77
4.33	Luminaire powered via information technology communication cabling.....	78
4.34	Electromagnetic fields (EMF)	78
4.35	Protection against moving fan blades	78
4.36	Track-mounted luminaires	78
SECTION 5: EXTERNAL AND INTERNAL WIRING		79
5.1	General.....	79
5.2	Supply connection and other external wiring	79
5.3	Internal wiring	87
5.4	Test to determine suitability of conductors having a reduced cross-sectional area	89
SECTION 6: Void		91
SECTION 7: PROVISION FOR EARTHING		92
7.1	General.....	92
7.2	Provision for earthing.....	92
SECTION 8: PROTECTION AGAINST ELECTRIC SHOCK		95
8.1	General.....	95
8.2	Protection against electric shock.....	95
SECTION 9: RESISTANCE TO DUST, SOLID OBJECTS AND MOISTURE		99
9.1	General.....	99
9.2	Tests for ingress of dust, solid objects and moisture	99
9.3	Humidity test.....	103
SECTION 10: INSULATION RESISTANCE AND ELECTRIC STRENGTH, TOUCH CURRENT AND PROTECTIVE CONDUCTOR CURRENT		105
10.1	General.....	105
10.2	Insulation resistance and electric strength	105
10.3	Touch current, protective conductor current and electric burn	109
SECTION 11: CREEPAGE DISTANCES AND CLEARANCES		111
11.1	General.....	111
11.2	Creepage distances and clearances.....	111
SECTION 12: ENDURANCE TEST AND THERMAL TEST.....		115
12.1	General.....	115
12.2	Selection of lamps and ballasts	115
12.3	Endurance test.....	115
12.4	Thermal test (normal operation)	117
12.5	Thermal test (abnormal operation)	122
12.6	Thermal test (failed windings in lamp controlgear)	127

12.7	Thermal test in regard to fault conditions in lamp controlgear or electronic devices incorporated in thermoplastic luminaires	129
SECTION 13: RESISTANCE TO HEAT, FIRE AND TRACKING.....		132
13.1	General.....	132
13.2	Resistance to heat.....	132
13.3	Resistance to flame and ignition	132
13.4	Resistance to tracking.....	133
SECTION 14: SCREW TERMINALS.....		134
14.1	General.....	134
14.2	Terms and definitions.....	134
14.3	General requirements and basic principles.....	135
14.4	Mechanical tests	137
SECTION 15: SCREWLESS TERMINALS AND ELECTRICAL CONNECTIONS.....		141
15.1	General.....	141
15.2	Terms and definitions.....	141
15.3	General requirements	141
15.4	General instructions on tests.....	143
15.5	Terminal and connections for internal wiring	143
15.6	Terminals and connections for external wiring.....	146
Annex A (normative) Test to establish whether a conductive part can cause an electric shock.....		173
Annex B (normative) Test lamps		174
B.1	General.....	174
B.2	Filament lamps within the scope of IEC 60432-1 and IEC 60432-2.....	174
B.3	Halogen lamps within the scope of IEC 60432-3	176
B.4	Tubular fluorescent and other discharge lamps	176
B.5	LED modules within the scope of IEC 62031	176
Annex C (normative) Abnormal circuit conditions		177
Annex D (normative) Thermal testing		180
D.1	Draught-proof enclosure	180
D.2	Mounting surface and test recess.....	180
D.3	Alternative test procedure for adjustment of measured temperatures for luminaire rating(s).....	183
Annex E (normative) Determination of winding temperature rises by the increase-in-resistance method		185
Annex F (normative) Test for resistance to stress corrosion of copper and copper alloys.....		186
F.1	Test cabinet.....	186
F.2	Test solution	186
F.3	Test piece	186
F.4	Test procedure.....	186
Annex G (normative) Measurement of touch current and protective conductor current		188
Annex H (xxx) (Void).....		192
Annex I (xxx) (Void)		193
Annex J (informative) Explanation of IP numbers for degrees of protection		194
Annex K (informative) Temperature measurement.....		196
K.1	Temperature measurements of the luminaire	196
K.2	Temperature measurement of the insulation parts of lampholders	197

Annex L (informative) Guidelines for good practice in luminaire design	199
L.1 General.....	199
L.2 Plastics in luminaires	199
L.3 Rust resistance	200
L.4 Corrosion resistance	200
L.5 Chemically corrosive atmospheres.....	201
L.6 Reflector design.....	201
L.7 Components in different kinds of luminaires	202
L.8 Recommendations for electromagnetic ballast protection for end of life phenomenon of HID lamps	202
L.9 Resistance against the effects of vibration	203
L.10 Flammability of components.....	203
Annex M (normative) Determination of creepage distances and clearances	204
Annex N (informative) Explanation of marking for luminaires that are not suitable for mounting on normally flammable surfaces and covering with insulation materials	205
N.0 General.....	205
N.1 Protection against flame	205
N.2 Protection against heat	205
N.3 Thermal protectors.....	206
N.4 Deletion of the F mark requirements	207
Annex O (xxx) (Void)	208
Annex P (normative) Absorption requirements for the protective shield to be fitted to luminaires designed for metal halide lamps which emit a high level of UV radiation	209
P.1 General.....	209
P.2 Procedure A.....	209
P.3 Procedure B.....	210
Annex Q (informative) Conformity testing during manufacture	211
Q.1 General.....	211
Q.2 Testing	211
Annex R (normative) Schedule of amended clauses and subclauses containing more serious/critical requirements which call for products to be retested	213
Annex S (normative) Requirements for the identification of a family or range of luminaires for type testing.....	214
S.1 General.....	214
S.2 Range or family of luminaires.....	214
Annex T (xxx) (Void)	215
Annex U (informative) Additional requirements for luminaires where a higher degree of availability (impulse withstand category III) may be requested	216
U.1 General.....	216
U.2 Requirements for impulse withstand category III	216
Annex V (normative) Additional test requirements for terminal blocks with integrated screwless protective earthing contact for direct connection to the luminaire housing or to parts of the body.....	218
V.1 Additional requirements to 7.2.1.....	218
V.2 Additional requirements to 7.2.3.....	218
Annex W (normative) Alternative thermal test for thermoplastic luminaires.....	220
W.1 Thermal test in regard to fault conditions in lamp controlgear or electronic devices without temperature sensing controls in thermoplastic luminaires for fluorescent lamps ≤ 70 W.....	220

Annex X (normative) Requirements for insulation between active parts of circuits and accessible conductive parts	222
Annex Y (informative) Information regarding power sourcing equipment powering class III luminaires via information technology communication cabling	224
Y.0 General.....	224
Y.1 Insulation of the mains supply	224
Y.2 Electrical limits of a PSE	224
Bibliography.....	226
Figure 34 – Circuit for checking electrical contact between socket outlet and plug	85
Figure 33 – Test to determine suitability of conductors having a reduced cross-sectional area	90
Figure 1 – Symbols	149
Figure 2 – Terminal block arrangement for installation test for luminaires with connecting leads (tails)	152
Figure 3 – Void	152
Figure 4 – Illustration of the requirements of 4.15	152
Figure 5 – Void	152
Figure 6 – Apparatus for proving protection against dust.....	153
Figure 7 – Apparatus for testing protection against rain and splashing	154
Figure 8 – Nozzle for spray test	155
Figure 9 – Relation between winding temperature and mounting surface temperature.....	156
Figure 10 – Ball-pressure apparatus	157
Figure 11 – Arrangement and dimensions of the electrodes for the tracking test	157
Figure 12 – Pillar terminals	158
Figure 13 – Screw terminals and stud terminals	159
Figure 14 – Saddle terminals	161
Figure 15 – Lug terminals	162
Figure 16 – Mantle terminals.....	163
Figure 17 – Construction of electrical connections	164
Figure 18 – Examples of spring-type screwless terminals	164
Figure 19 – Further examples of screwless terminals.....	165
Figure 20 – Illustration of the terms "lopping-in" and "through wiring".....	166
Figure 21 – Apparatus for ball impact tests	167
Figure 22 – Examples of self-tapping, thread-cutting and thread-forming screws (from ISO 1891)	167
Figure 23 – Void	167
Figure 24 – Illustration of creepage and clearance measurements at a supply terminal.....	168
Figure 25 – Void	168
Figure 26 – Test circuit for safety during insertion.....	168
Figure 27 – Ignition temperatures of wood as a function of time	169
Figure 28 – Example of permitted degree of soldering	170
Figure 29 – Test chain	170
Figure 30 – Example of a thread forming screw used in a groove of a metallic material	171
Figure 31 – Electro-mechanical contact system with plug/socket connection.....	172

Figure 32 – Test circuit for luminaires incorporating fluorescent lamp ≤ 70 W	172
Figure C.1 – Circuit for testing rectifying effect (some capacitive starterless ballasts only)	178
Figure C.2 – Circuit for testing rectifying effect (ballasts for single pin lamps)	178
Figure C.3 – Circuit for testing rectifying effect of some high pressure sodium and some metal halide lamps	179
Figure D.1 – Example of test recess where a luminaire comprises separate parts, in accordance with Clause D.2 a)	181
Figure D.2 – Example of test recess where a luminaire comprises separate parts, in accordance with Clause D.2 b)	182
Figure D.3 – Correct test box size (insulating ceilings) for settable and adjustable luminaires	183
Figure G.1 – Test configuration: single-phase equipment on star TN or TT system	190
Figure G.2 – Measuring network, touch current weighted for perception or reaction	190
Figure G.3 – Measuring network, touch current weighted for let-go (for portable class I luminaires)	191
Figure G.4 – Measuring network, weighted for high frequency	191
Figure K.1 – Placing of thermocouples on a typical lampholder	198
Figure V.1 – Arrangement for voltage drop test	219
Figure X.1 – Declaration of LV_{supply} and U_{out} and the insulation barriers between the light source and accessible parts	222
Table 3.1 – Marking	39
Table 3.2 – Identification of extra-low-voltage DC leads and terminations	41
Table 4.6 – Overview of required Y capacitors	55
Table 4.1 – Torque tests on screws	58
Table 4.2 – Torque tests on cable glands	60
Table 4.3 – Impact energy and spring compression	61
Table 4.4 – Test on semi-luminaires	65
Table 4.5 – Test on adjusting devices	66
Table 5.1 – Supply cord	80
Table 5.3 – Wiring dimension	81
Table 5.2 – Tests for cord anchorage	84
Table 9.1 – Solid-object-proof luminaire test	101
Table 10.1 – Minimum insulation resistance	106
Table 10.2 – Electric strength	108
Table 10.3 – Limits of touch current or protective conductor current and electric burn	110
Table 11.1.A – Minimum creepage distances for AC sinusoidal voltages up to 30 kHz (to be used in conjunction with Annex M)	113
Table 11.1.B – Minimum clearance for working voltages (to be used in conjunction with Annex M)	114
Table 11.2 – Minimum distances for ignition pulse voltages or equivalent peak voltage U_p	114
Table 12.1 – Maximum temperatures under the test conditions of 12.4.2, for principal parts	120
Table 12.2 – Maximum temperatures under the test conditions of 12.4.2, for common materials used in luminaires	122

Table 12.3 – Maximum temperatures under the test conditions of 12.5.1	125
Table 12.4 – Maximum temperature of windings under abnormal operating conditions and at 110 % of rated voltage for lamp controlgear	126
Table 12.5 – Maximum temperature of windings under abnormal operating conditions and at 110 % of rated voltage for lamp controlgear marked "D6"	126
Table 12.6 – Temperature overshoot time limitation	128
Table 14.1 – Nominal cross-sectional areas of conductors according to terminal sizes	136
Table 14.2 – Nominal cross-sectional areas of conductors according to maximum current	136
Table 14.3 – Composition of conductors	137
Table 14.4 – Torque to be applied to screws and nuts	139
Table 14.5 – Pull to be applied to conductor	140
Table 15.1 – Conductor rating	146
Table 15.2 – Conductor pull force	147
Table F.1 – pH value of the test solution	186
Table G.1 – Position of switch e, n and p for the measurements of the different classes of luminaires	189
Table J.1 – Degrees of protection indicated by the first characteristic numeral	194
Table J.2 – Degrees of protection indicated by the second characteristic numeral	195
Table L.1 – Damaging influences	199
Table M.1 – Determination of creepage distances and clearances (see Table 11.1)	204
Table N.1 – Guidance on when to use the symbol and its explanation on the luminaire or in the manufacturer's instructions provided with the luminaire	205
Table N.2 – Thermal protection operation	207
Table Q.1 – Minimum values for electrical tests	212
Table U.1 – Minimum clearance distances for AC sinusoidal working voltages impulse withstand category III	216
Table U.2 – Overview of required Y capacitors	217
Table X.1 – Insulation requirements between active parts and accessible conductive parts	223
Table Y.1 – Limits for the electrical parameters of a PSE	224
Table Y.2 – Electrical parameters for communication cable/connectors	225

INTERNATIONAL ELECTROTECHNICAL COMMISSION

LUMINAIRES –

Part 1: General requirements and tests

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 60598-1 has been prepared by subcommittee 34D: Luminaires, of IEC technical committee 34: Lamps and related equipment.

This ninth edition cancels and replaces the eighth edition published in 2014 and Amendment 1:2017. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) Revision of Clause 4.30, Fixing cover live parts of non-user replaceable light source;
- b) Subclause 4.24.2, Blue Light Hazard: removal of Risk Group 0;
- c) Subclause 5.2.16: additional requirements for AC mains appliance inlets related to IEC 61984;
- d) Addition of Subclause 3.3.25, UV protection of cable;
- e) Addition of Clause 4.34, Inclusion of EMF safety requirements (IEC 62493);

- f) Revision of the requirements for functional earth and protective earth;
- g) Addition of Clause 4.35, Protection against fast rotating parts;
- h) Revision of Clause 3.2, Rated voltage marking;
- i) Revision of Subclause 5.2.10, Cord anchorage;
- j) Revision of Annex G for touch current and protective conductor current test set-up;
- k) Addition of requirements for constant light output function and programmable current output;
- l) Revision of Subclause 8.2.3 c), touch voltage limits for interrupted DC voltage;
- m) Introduction of PELV;
- n) Introduction of Ethernet power supply connection for luminaires (PoE);
- o) Section 9, Introduction of IPX9;
- p) Addition of Subclause 3.3.26 for wall mounted luminaires;
- q) Revision of Annex D introducing alternative thermal tests for luminaires with t_a marking higher than 25°C;
- r) Revision of Table 10.3 and Subclause 3.3.19 for protective conductor current limits;
- s) Track-mounted luminaires: cross reference to Annex A of IEC 60570:2003/AMD2:2019;
- t) Revision of Subclause 10.2.2, alternative DC electric strength test;
- u) Revision of Annex D for recessed luminaires;
- v) Subclause 4.12.5: revision of Table 4.2 for torque test on metal glands;
- w) Revision of use of bridging capacitors in luminaires;
- x) Revision of electrical connection to class III plugs.

The major changes which may affect certification are given in Annex R.

Annex R shows where a new text has been included which contains more serious/critical requirements requiring products to be re-tested.

The text of this International Standard is based on the following documents:

FDIS	Report on voting
34D/1546/FDIS	34D/1560/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts in the IEC 60598 series, published under the general title *Luminaires*, can be found on the IEC website.

NOTE In this document, the following print types are used:

- requirements: in roman type;
- *test specifications: in italic type;*
- notes: in small roman type.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

IECNORM.COM : Click to view the full PDF of IEC 60598-1:2020

LUMINAIRES –

Part 1: General requirements and tests

SECTION 0: GENERAL INTRODUCTION

0.1 Scope

This Part 1 of IEC 60598 specifies general requirements for luminaires, incorporating electric light sources for operation from supply voltages up to 1 000 V. The requirements and related tests of this document cover: classification, marking, mechanical construction, electrical construction and photobiological safety.

Each section of this Part 1 is read in conjunction with this Section 0 and with other relevant sections to which reference is made.

Each part of IEC 60598-2 details requirements for a particular type of luminaire or group of luminaires on supply voltages not exceeding 1 000 V. These parts are published separately for ease of revision and additional sections will be added as and when a need for them is recognized.

The presentation of photometric data for luminaires is under consideration by the International Commission on Illumination (CIE) and is not, therefore, included in this Part 1.

Requirements are included in this Part 1 for luminaires incorporating ignitors with nominal peak values of the voltage pulse not exceeding those of Table 11.2. The requirements apply to luminaires with ignitors built into ballasts and to luminaires with ignitors separate from ballasts. For luminaires with ignitors built into lamps, the requirements are under consideration.

Requirements for semi-luminaires are included in this Part 1.

In general, this Part 1 covers safety requirements for luminaires. The object of this Part 1 is to provide a set of requirements and tests which are considered to be generally applicable to most types of luminaires and which can be called up as required by the detail specifications of IEC 60598-2. This Part 1 is thus not regarded as a specification in itself for any type of luminaire, and its provisions apply only to particular types of luminaires to the extent determined by the appropriate part of IEC 60598-2.

The parts of IEC 60598-2, in making reference to any of the sections of Part 1, specify the extent to which that section is applicable and the order in which the tests are performed; they also include additional requirements as necessary.

The order in which the sections of Part 1 are numbered has no particular significance as the order in which their provisions apply is determined for each type of luminaire or group of luminaires by the appropriate part of IEC 60598-2. All parts of IEC 60598-2 are self-contained and therefore do not contain references to other parts of IEC 60598-2.

Where the requirements of any of the sections of Part 1 are referred to in the parts of IEC 60598-2 by the phrase "The requirements of section... of IEC 60598-1 apply", this phrase is interpreted as meaning that all the requirements of that section of Part 1 apply except those which are clearly inapplicable to the particular type of luminaire covered by that part of IEC 60598-2.

For explosion proof luminaires, as covered by IEC 60079, the requirements of IEC 60598 (selecting the appropriate parts 2) are applied in addition to the requirements of IEC 60079. In the event of any conflict between IEC 60598 and IEC 60079, the requirements of IEC 60079 take priority.

Improvements in safety to take into account the state of the art technology are incorporated in the standards with revisions and amendments on an ongoing basis. Regional standardization bodies can include statements in their derived standards to cover products which have complied with the previous document as shown by the manufacturer or standardization body. The statements may require that for such products, the previous standard may continue to apply to production until a defined date after which the new standard shall apply.

0.2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60061 (all parts), *Lamp caps and holders together with gauges for the control of interchangeability and safety* (available at <http://std.iec.ch/iec60061>)

IEC 60061-2, *Lamp caps and holders together with gauges for the control of interchangeability and safety – Part 2: Lampholders* (available at <http://std.iec.ch/iec60061>)

IEC 60061-3, *Lamp caps and holders together with gauges for the control of interchangeability and safety – Part 3: Gauges* (available at <http://std.iec.ch/iec60061>)

IEC 60065:2014, *Audio, video and similar electronic apparatus – Safety requirements*

IEC 60068-2-6:2007, *Environmental testing – Part 2-6: Tests – Test Fc: Vibration (sinusoidal)*

IEC 60068-2-14:2009, *Environmental testing – Part 2-14: Tests – Test N: Change of temperature*

IEC 60068-2-31:2008, *Environmental testing – Part 2-31: Tests – Test Ec: Rough handling shocks, primarily for equipment-type specimens*

IEC 60068-2-75, *Environmental testing – Part 2-75: Tests – Test Eh: Hammer tests*

IEC TR 60083, *Plugs and socket-outlets for domestic and similar general use standardized in member countries of IEC*

IEC 60085, *Electrical insulation – Thermal evaluation and designation*

IEC 60112:2003, *Method for the determination of the proof and the comparative tracking indices of solid insulating materials*

IEC 60155, *Glow-starters for fluorescent lamps*

IEC 60227 (all parts), *Polyvinyl chloride insulated cables of rated voltages up to and including 450/750 V*

IEC 60238:2016, *Edison screw lampholders*

IEC 60245 (all parts), *Rubber insulated cables – Rated voltages up to and including 450/750 V*

IEC 60320 (all parts), *Appliance couplers for household and similar general purposes*

IEC 60360, *Standard method of measurement of lamp cap temperature rise*

IEC 60384-14, *Fixed capacitors for use in electronic equipment – Part 14: Sectional specification – Fixed capacitors for electromagnetic interference suppression and connection to the supply mains*

IEC 60417, *Graphical symbols for use on equipment* (available at <http://www.graphical-symbols.info/equipment>)

IEC 60432-1:1999, *Incandescent lamps – Safety specifications – Part 1: Tungsten filament lamps for domestic and similar general lighting purposes*

IEC 60432-1:1999/AMD1:2005

IEC 60432-1:1999/AMD2:2011

IEC 60432-2:1999, *Incandescent lamps – Safety specifications – Part 2: Tungsten halogen lamps for domestic and similar general lighting purposes*

IEC 60432-2:1999/AMD1:2005

IEC 60432-2:1999/AMD2:2012

IEC 60529, *Degrees of protection provided by enclosures (IP Code)*

IEC 60570:2003, *Electrical supply track systems for luminaires*

IEC 60570:2003/AMD1:2017

IEC 60570:2003/AMD2:2019

IEC 60598-2 (all parts), *Luminaires – Part 2: Particular requirements*

IEC 60598-2-4:2017, *Luminaires – Part 2-4: Particular requirements – Portable general purpose luminaires*

IEC 60603 (all parts), *Connectors for frequencies below 3 MHz for use with printed boards*

IEC 60662, *High-pressure sodium vapour lamps – Performance specifications*

IEC 60664-4:2005, *Insulation coordination for equipment within low-voltage systems – Part 4: Consideration of high-frequency voltage stress*

IEC 60684 (all parts), *Flexible insulating sleeving*

IEC 60695-2-11, *Fire hazard testing – Part 2-11: Glowing/hot-wire based test methods – Glow-wire flammability test method for end-products (GWEPT)*

IEC 60695-11-5, *Fire hazard testing – Part 11-5: Test flames – Needle-flame test method – Apparatus, confirmatory test arrangement and guidance*

IEC 60989, *Separating transformers, autotransformers, variable transformers and reactors*

IEC 60990, *Methods of measurement of touch current and protective conductor current*

IEC 60998-2-1, *Connecting devices for low-voltage circuits for household and similar purposes – Part 2-1: Particular requirements for connecting devices as separate entities with screw-type clamping units*

IEC 60998-2-2, *Connecting devices for low-voltage circuits for household and similar purposes – Part 2-2: Particular requirements for connecting devices as separate entities with screwless-type clamping units*

IEC 61032:1997, *Protection of persons and equipment by enclosures – Probes for verification*

IEC 61058-1:2000¹, *Switches for appliances – Part 1: General requirements*

IEC 61167, *Metal halide lamps – Performance specification*

IEC 61249 (all parts), *Materials for printed boards and other interconnecting structures*

IEC 61347 (all parts), *Lamp controlgear*

IEC 61347-1:2015, *Lamp controlgear – Part 1: General and safety requirements*
IEC 61347-1:2015/AMD1:2017

IEC 61347-2-9, *Lamp controlgear – Part 2-9: Particular requirements for electromagnetic controlgear for discharge lamps (excluding fluorescent lamps)*

IEC 61535:2009², *Installation couplers intended for permanent connection in fixed installations*

IEC 61558 (all parts), *Safety of power transformers, power supplies, reactors and similar products*

IEC 61558-1:2005³, *Safety of power transformers, power supplies, reactors and similar products – Part 1: General requirements and tests*

IEC 61558-2-6, *Safety of transformers, reactors, power supply units and similar products for supply voltages up to 1 100 V – Part 2-6: Particular requirements and tests for safety isolating transformers and power supply units incorporating safety isolating transformers*

IEC 61643-11, *Low-voltage surge protective devices – Part 11: Surge protective devices connected to low-voltage power systems – Requirements and test methods*

IEC 61984:2008, *Connectors – Safety requirements and tests*

IEC 62368-3:2017, *Audio/video, information and communication technology equipment – Part 3: Safety aspects for DC power transfer through communication cables and ports*

IEC 62493:2015, *Assessment of lighting equipment related to human exposure to electromagnetic fields*

IEC 62680 (all parts), *Universal serial bus interfaces for data and power*

¹ Withdrawn.

² Withdrawn.

³ Withdrawn.

IEC TR 62778, *Application of IEC 62471 for the assessment of blue light hazard to light sources and luminaires*

IEC 80416-1, *Basic principles for graphical symbols for use on equipment – Part 1: Creation of graphical symbol for registration*

0.3 General requirements

0.3.1 Luminaires shall be so designed and constructed that in normal use they function safely and cause no danger to persons or surroundings. In general, compliance is checked by carrying out all the tests specified.

0.3.2 A luminaire shall comply with a part of IEC 60598-2. If, however, an appropriate part of IEC 60598-2 does not exist for a particular luminaire or group of luminaires, the nearest applicable part of IEC 60598-2 may be used as a guide to the requirements and tests.

Where the design of a luminaire is such that two or more parts of IEC 60598-2 are applicable, the luminaire shall comply with both or all of the appropriate sections.

0.3.3 Semi-luminaires should be regarded as luminaires for test purposes.

0.4 General test requirements and verification

0.4.1 Tests according to this document are type tests. For the definition of a "type test", see Section 1.

The requirements and tolerances permitted by this document are related to testing of a type test sample submitted for that purpose. Compliance of the type test sample does not ensure compliance of the whole production of a manufacturer. Compliance for production is the responsibility of the manufacturer and may include routine tests and quality assurance in addition to type testing.

0.4.2 Except where otherwise specified in the sections of this document or relevant part of IEC 60598-2, luminaires shall be tested as delivered, and installed as for normal use, in an ambient temperature of between 10 °C and 30 °C, having regard to the manufacturer's installation instructions. The lamp (or lamps) is (are) not included except where essential for the test.

Luminaires cannot be regarded as meeting the requirements of this document unless all internal wiring is complete.

In general, the tests are made on a single sample luminaire or, where a range of similar luminaires is involved, on a single luminaire of each rated wattage in the range or on a representative selection from the range as agreed with the manufacturer (see Annex S). This selection shall include the luminaire, together with any attachments, which represents the most unfavourable combination from a testing point of view.

Each sample luminaire shall comply with all the relevant tests. In order to reduce the time of testing and to allow for any tests which may be destructive, the manufacturer may submit additional luminaires or parts of luminaires, provided that these are of the same materials and design as the original luminaire and that the results of the test are the same as if carried out on an identical luminaire. Where the test for compliance is shown as being "by inspection", this shall include any necessary handling.

For track-mounted luminaires the manufacturer shall provide, together with the luminaire, a sample of the appropriate track, connector and adaptors for the luminaire to be connected.

Combination luminaires are tested for safety requirements with that assemblage of parts which gives the most unfavourable result.

Certain parts of luminaires, such as joints, raising and lowering devices, may be tested separately provided that the design of these parts is such that their performance is not dependent upon the other parts of the luminaires.

Luminaires intended to be used with supply cords are tested with the flexible supply cord connected to the luminaire.

For luminaires intended to be used with a shade, but not normally supplied with a shade, the manufacturer shall provide a shade, typical of the type that might be used with the luminaire.

0.4.3 Verification and tests

Luminaires for testing to the requirements of this document may have earlier test reports updated in accordance with this document by submitting a new sample for test together with the previous test reports.

Full type testing need not generally be necessary and the product and the previous test results shall be reviewed only against any amended clauses marked "R" and scheduled in Annex R.

NOTE Clauses marked "R" and scheduled in Annex R will be included in future amendments/editions.

0.5 Components of luminaires

0.5.1 Components, other than integral components, shall comply with the requirements of the relevant IEC standards, if any.

Components which comply with the requirements of the relevant IEC standard and marked with individual ratings are checked to establish that they suit the conditions which may occur in use. Aspects of use not covered by the respective standard shall require them to satisfy the additional relevant requirements of this document.

Compliance is checked by inspection and the relevant tests.

Integral components shall comply as far as is reasonable with the IEC component standards, as part of the luminaire.

NOTE 1 This does not imply that components need to be separately tested before approval of the luminaire.

NOTE 2 Guidance on the selection of components in different kinds of luminaires can be found in Annex L.

Internal wiring of a luminaire shall comply with the requirements in 5.3.

NOTE 3 This does not exclude the use of standardized cables.

0.5.2 Components complying with the requirements of their own standard and used in accordance with their intended use, shall only be tested to the requirements of this document where there are no requirements in the component standard (covering the requirement heading of this document).

A valid test report is considered adequate to show compliance.

Lampholders and starterholders shall additionally comply with the gauging and interchangeability requirements of the appropriate IEC component standard where applicable after building into the luminaire.

For terminal blocks with an integrated screwless protective earthing contact for direct connection to the luminaire or to parts of the body, special requirements apply according to Annex V.

0.5.3 Components for which no appropriate IEC standard exists shall satisfy the relevant requirements of this luminaire standard as part of the luminaire. Lampholders and starterholders shall additionally comply with the gauging and interchangeability requirements of the appropriate IEC component standard where applicable.

NOTE Examples of components are lampholders, switches, transformers, ballasts, flexible cables and cords and plugs.

0.5.4 Compliance with this document can only be ensured if protective shields of identical specification are used.

0.6 List of parts of IEC 60598-2

- Part 2-1 Fixed general purpose luminaires
- Part 2-2 Recessed luminaires
- Part 2-3 Luminaires for road and street lighting
- Part 2-4 Portable general purpose luminaires
- Part 2-5 Floodlights
- Part 2-6 Luminaires with built-in transformers for tungsten filament lamps⁴
- Part 2-7 Portable luminaires for garden use⁵
- Part 2-8 Handlamps
- Part 2-9 Photo and film luminaires (non-professional)⁶
- Part 2-10 Portable luminaires for children
- Part 2-11 Aquarium luminaires
- Part 2-12 Mains socket-outlet mounted nightlights
- Part 2-13 Ground recessed luminaires
- Part 2-14 Luminaires for cold cathode tubular discharge lamps (neon tubes) and similar equipment
- Part 2-15 Not used at present
- Part 2-16 Not used at present
- Part 2-17 Luminaires for stage lighting, television and film studios (outdoor and indoor)
- Part 2-18 Luminaires for swimming-pools and similar applications
- Part 2-19 Air-handling luminaires (safety requirements)
- Part 2-20 Lighting chains
- Part 2-21 Rope lights
- Part 2-22 Luminaires for emergency lighting
- Part 2-23 Extra-low-voltage lighting systems for filament lamps
- Part 2-24 Luminaires with limited surface temperatures
- Part 2-25 Luminaires for use in clinical areas of hospitals and health care buildings

⁴ Withdrawn.

⁵ Withdrawn.

⁶ Withdrawn.

0.7 Information for luminaire design in light sources standards

0.7.1 In accordance with IEC guidelines, IEC standards are divided into those covering either safety or performance.

0.7.2 In light source safety standards, "information for luminaire design" is given for the safe operation of light sources; this shall be regarded as normative when testing luminaires in accordance with this document.

0.7.3 In light source performance standards, "information for luminaire design" is given for the correct performance of light sources; this shall be regarded as informative when testing luminaires in accordance with this document. Testing of light source performance is not required as part of the type test approval for luminaires.

IECNORM.COM : Click to view the full PDF of IEC 60598-1:2020

SECTION 1: TERMS AND DEFINITIONS

1.1 General

This section gives general definitions applicable to luminaires.

1.2 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

NOTE 1 Other definitions related to lamps can be found in the relevant lamp standards.

NOTE 2 Where the terms "voltage" and "current" are used, they imply the RMS values unless otherwise stated.

1.2.1

luminaire

apparatus which distributes, filters or transforms the light transmitted from one or more lamps and which includes all the parts necessary for supporting, fixing and protecting the lamps, but not the lamps themselves, and where necessary, circuit auxiliaries together with the means for connecting them to the supply

Note 1 to entry: A luminaire with integral non-replaceable lamps is regarded as a luminaire, except that the tests are not applied to the integral lamp or integral self ballasted lamp.

1.2.2

main part of luminaire

part that is fixed to the mounting surface or is directly suspended from it or standing on it

Note 1 to entry: It may or may not carry the lamps, lampholders and auxiliary gear.

Note 2 to entry: In luminaires for tungsten filament lamps, the part carrying the lampholder is normally the main part.

1.2.3

ordinary luminaire

luminaire providing protection against accidental contact with live parts but without any other special protection against dust, solid objects or moisture

1.2.4

general purpose luminaire

luminaire which is not designed for a special purpose

Note 1 to entry: Examples of general purpose luminaires include pendants, some spotlights and certain fixed luminaires for surface or recessed mounting. Examples of special purpose luminaires are those for rough usage, photo and film applications and swimming-pools.

1.2.5

adjustable luminaire

luminaire, the main part of which can be turned or moved by means of joints, raising and lowering devices, telescopic tubes or similar devices

Note 1 to entry: An adjustable luminaire may be fixed or portable.

1.2.6**basic luminaire**

smallest number of assembled parts that can satisfy the requirements of any of the parts of IEC 60598-2

1.2.7**combination luminaire**

luminaire consisting of a basic luminaire in combination with one or more parts which may be replaced by other parts, or used in a different combination with other parts and changed either by hand or with the use of tools

1.2.8**fixed luminaire**

luminaire which cannot easily be moved from one place to another, either because the fixing is such that the luminaire can only be removed with the aid of a tool, or because it is intended for use out of arms reach

Note 1 to entry: In general, fixed luminaires are designed for permanent connection to the supply, but connection may also be made by means of a plug or similar device.

1.2.9**portable luminaire**

luminaire which, in normal use, can be moved from one place to another while connected to the supply

Note 1 to entry: Luminaires for wall mounting provided with a supply cord for connection to a plug and luminaires which may be fixed to their support by means of a wing screw, a clip or a hook so that they can easily be removed from their support by hand, are considered to be portable luminaires.

1.2.10**recessed luminaire**

luminaire intended by the manufacturer to be fully or partly recessed into a mounting surface

Note 1 to entry: The term applies both to luminaires for operation in enclosed cavities and to luminaires for mounting through a surface such as a suspended ceiling.

1.2.11**rated voltage**

supply voltage or voltages assigned to the luminaire by the manufacturer

1.2.11.1**rated constant input voltage**

input voltage or voltages assigned by the manufacturer for luminaires not equipped with controlgear

Note 1 to entry: The rated constant input voltage of the luminaire corresponds to the rated output voltage of the constant voltage controlgear.

1.2.12**supply current**

current at the supply terminals when the luminaire has stabilized in normal use at the rated voltage and frequency

1.2.12.1**rated constant input current**

input current or currents assigned by the manufacturer for luminaires not equipped with controlgear

Note 1 to entry: The rated constant input current of the luminaire corresponds to the rated output current for constant current controlgear.

1.2.13

rated wattage

number and rated wattage of the lamps for which the luminaire is designed

1.2.14

supply cord

external flexible cable or cord, for supply purposes, that is fixed to the luminaire

Note 1 to entry: Luminaires may be provided with the supply cord or designed for attachment of a supply cord e.g. type X or Y attachment.

Note 2 to entry: It is the intention to amend each Part 2 of IEC 60598 to align with this modification; however, this will be done when each Part 2 is amended for other reasons. In the meantime, therefore, wherever a Part 2 makes reference to a "non-detachable flexible cable or cord" read "supply cord".

1.2.15

live part

conductive part which may cause an electric shock in normal use

Note 1 to entry: The test to determine whether or not a conductive part is a live part which may cause an electric shock is given in Annex A.

Note 2 to entry: The neutral conductor is, however, regarded as a live part.

1.2.16

basic insulation

insulation applied to live parts to provide basic protection against electric shock

Note 1 to entry: Basic insulation does not necessarily include insulation used exclusively for functional purposes.

1.2.17

supplementary insulation

independent insulation applied in addition to basic insulation in order to provide protection against electric shock in the event of a failure of basic insulation

1.2.18

double insulation

insulation comprising both basic insulation and supplementary insulation

1.2.19

reinforced insulation

single insulation system applied to live parts, which provides a degree of protection against electric shock equivalent to double insulation

Note 1 to entry: The term "insulation system" does not imply that the insulation needs to be one homogeneous piece. It may comprise several layers which cannot be tested singly as supplementary or basic insulation.

1.2.20

protective impedance device

component or assembly of components used to bridge double or reinforced insulation and the impedance and construction of which are such as to ensure that steady state touch current and charge are limited to a non-hazardous level

1.2.21

(Void)

1.2.22**class I luminaire**

luminaire in which protection against electric shock does not rely on basic insulation only, but which includes an additional safety precaution in such a way that means are provided for the connection of accessible conductive parts to the protective (earthing) conductor in the fixed wiring of the installation in such a way that accessible conductive parts cannot become live in the event of a failure of the basic insulation

Note 1 to entry: For a luminaire intended for use with a flexible cord or cable, this provision includes a protective conductor as part of the flexible cord or cable.

Note 2 to entry: Class I luminaires may have parts with double insulation or reinforced insulation.

Note 3 to entry: Class I luminaires may have parts in which protection against electric shock relies on operation at safety extra-low voltage (SELV) or protective extra-low voltage (PELV).

1.2.23**class II luminaire**

luminaire in which protection against electric shock does not rely on basic insulation only, but in which additional safety precautions such as double insulation or reinforced insulation are provided, there being no provision for protective earthing or reliance upon installation conditions

Note 1 to entry: Such a luminaire may be of one of the following types:

- a) A luminaire having a durable and substantially continuous enclosure of insulating material which envelops all metal parts with the exception of small parts such as nameplates, screws and rivets which are isolated from live parts by insulation at least equivalent to reinforced insulation. Such a luminaire is called an insulation encased class II luminaire.
- b) A luminaire having a substantially continuous enclosure of metal, insulated from live parts by insulation at least equivalent to double or reinforced insulation. Such a luminaire is called a metal-encased class II luminaire.
- c) A luminaire which is a combination of types a) and b) above.

Note 2 to entry: The enclosure of an insulation-encased class II luminaire may form a part or the whole of the supplementary insulation or the reinforced insulation.

Note 3 to entry: If functional earthing is provided to assist starting, or for EMC reasons, but is not connected to an accessible metal part, the luminaire may still be deemed to be of class II. Accessible metal parts in compliance with the appropriate IEC lamp specification and other metal parts not normally earthed and not normally accessible during normal use are not regarded to be conductive parts which may cause an electric shock unless the tests of Annex A show them to be live parts.

Note 4 to entry: If a luminaire with double insulation and/or reinforced insulation throughout has a protective earthing terminal or a protective earthing contact, it is a class I construction. However, a fixed class II luminaire may have an internal terminal or contact for maintaining the electrical continuity (e.g. for looping in or through wiring) of a protective earthing conductor, provided that the terminal is insulated from accessible metal parts by class II insulation.

Note 5 to entry: Class II luminaires may have parts in which protection against electric shock relies on operation at safety extra-low voltage (SELV) or protective extra-low voltage (PELV).

1.2.24**class III luminaire**

luminaire in which protection against electric shock relies on supply at safety extra-low voltage (SELV) or protective extra-low voltage (PELV) and in which voltages higher than those of SELV or PELV are not generated

Note 1 to entry: An ES1 PSE fulfilling the requirements of IEC 62368-3:2017 can be regarded as SELV.

1.2.25**rated maximum ambient temperature**

t_a

temperature assigned to a luminaire by the manufacturer to indicate the highest sustained temperature in which the luminaire may be operated under normal conditions

Note 1 to entry: This does not preclude temporary operation at a temperature not exceeding $(t_a + 10)$ °C.

1.2.26

rated maximum operating temperature

t_c

<of a controlgear or capacitor> highest permissible temperature which may occur on the outer surface (at the indicated place if marked) of the component under normal operating conditions at the rated voltage or maximum of the rated voltage range

1.2.27

rated maximum operating temperature

t_w

<of a lamp controlgear winding> winding temperature assigned by the manufacturer as the highest temperature at which 50/60 Hz lamp controlgear may be expected to have a service life of at least 10 years continuous operation

1.2.28

ballast

unit inserted between the supply and one or more discharge lamps which, by means of inductance, capacitance or resistance, single or in combination, serves mainly to limit the current of the lamp(s) to the required value

Note 1 to entry: It may also include means for transforming from the supply voltage and arrangements which help to provide starting voltage and preheating current, prevent cold starting, reduce stroboscopic effect, correct the power factor and suppress radio interference.

1.2.29

independent lamp controlgear

lamp controlgear consisting of one or more separate elements so designed that it, or they, can be mounted separately outside a luminaire with protection according to the marking on the lamp controlgear and without any additional enclosure

1.2.30

built-in lamp controlgear

lamp controlgear designed to be built into a luminaire and not intended to be mounted outside a luminaire without special precautions

1.2.31

integral lampholder

part of a luminaire which supports the lamp and provides electrical contact with it and which is designed as part of the luminaire

1.2.32

(Void)

1.2.33

translucent cover

light-transmitting parts of the luminaire which may also protect the lamps and other component parts including diffusers, lens panels and similar light-control elements

1.2.34

fixed wiring

cable which is part of the fixed installation to which the luminaire is connected

Note 1 to entry: Fixed wiring may be brought into the luminaire and connected to terminals, including terminals of lampholders, switches and the like.

1.2.35**appliance coupler**

means enabling a flexible cable to be connected at will to the luminaire consisting of two parts: a connector provided with contact tubes which is the part integral with or designed to be attached to the flexible cable connected to the supply and an appliance inlet, provided with contact pins, which is the part incorporated in or fixed to the luminaire

1.2.36**external wiring**

wiring generally outside the luminaire but delivered with it

Note 1 to entry: External wiring may be used for connecting the luminaire to the supply, to other luminaires, or to any external ballast.

Note 2 to entry: External wiring is not necessarily outside the luminaire for its full length.

1.2.37**internal wiring**

wiring generally inside the luminaire and delivered with it, which forms the connection between terminations for external wiring or supply cords and terminations of lampholders, switches and similar components

Note 1 to entry: Internal wiring is not necessarily inside the luminaire for its full length.

1.2.38**normally flammable material**

material having an ignition temperature of at least 200 °C and which will not deform or weaken at this temperature

EXAMPLE Wood and materials based on wood of more than 2 mm thickness.

Note 1 to entry: The ignition temperature and the resistance of normally flammable materials to deformation or weakening are based on widely accepted values determined during a test period of 15 min.

1.2.39**readily flammable material**

material which cannot be classified as either normally flammable or non-combustible

EXAMPLE Wood fibre and materials based on wood of up to 2 mm thickness.

1.2.40**non-combustible material**

material incapable of supporting combustion

Note 1 to entry: For the purposes of this document, materials such as metal, plaster and concrete are regarded as non-combustible materials.

1.2.41**flammable material**

material which does not comply with the glow-wire test requirements of 13.3.2

1.2.42**ELV****extra-low voltage**

voltage which does not exceed 50 V AC RMS or 120 V ripple free DC between conductors, or between any conductor and earth (voltage band I of IEC 60449)

Note 1 to entry: "Ripple free" is conventionally defined for sinusoidal ripple voltage as a ripple content of not more than 10 % RMS: the maximum peak value does not exceed 140 V for a nominal 120 V ripple-free DC system, respectively 70 V for a nominal 60 V ripple-free DC system, and 35 V for a nominal 30 V ripple-free system.

Note 2 to entry: For interrupted DC, for frequencies between 10 Hz and 200 Hz, this document applies a maximum 50 V peak limit for ELV, this limit includes a possible ripple. For frequencies outside this frequency range, the limits of direct current apply.

Note 3 to entry: The requirements for the frequency range between 10 Hz and 200 Hz comes from a 1936 research paper, entitled "Electric Shock Effects of Frequency", authored by W.B. Kouwenhoven, D.R. Hooker and E.L. Lotz.

1.2.42.1

FELV

functional extra-low voltage

ELV in a circuit provided for functional purposes and not fulfilling the requirements for SELV (or PELV)

1.2.42.2

SELV system

safety extra-low-voltage system

electric system in which the voltage cannot exceed the value of extra-low voltage

- under normal conditions and
- under single fault conditions, including earth faults in other electric circuits

Note 1 to entry: In this document the term "SELV" is used when a SELV system is meant.

Note 2 to entry: Maximum voltage lower than 50 V AC RMS or 120 V ripple free DC may be specified in particular requirements, especially when direct contact with current-carrying parts is allowed.

[SOURCE: IEC 60050-826:2004, 826-12-31, modified – The notes have been added.]

1.2.42.3

PELV system

protective extra-low-voltage system

electric system in which the voltage cannot exceed the value of extra-low voltage

- under normal conditions and
- under single fault conditions, except earth faults in other electric circuits

Note 1 to entry: In this document the term "PELV" is used when a PELV system is meant.

[SOURCE: IEC 60050-826:2004, 826-12-32, modified – The note has been added.]

1.2.43

working voltage

highest RMS voltage which may occur across any insulation at rated supply volts, transients being neglected, in open-circuit conditions or during normal operation

1.2.43.1

maximum working peak output voltage

\hat{U}_{out}

maximum repetitive occurring peak working voltage between the output terminals or between the output terminals and earth, during normal or abnormal operating condition and with transients neglected

[SOURCE: IEC 61347-1:2015, 3.45]

1.2.43.2

ignition voltage

peak voltage applied to ignite a discharge lamp

[SOURCE: IEC 61347-1:2015, 3.46]

1.2.43.3**ignition pulse voltage**

peak ignition voltage with a total duration of $\leq 750 \mu\text{s}$ (summation of all pulses durations) within 10 ms with the duration time (width) of each pulse being measured at the level of 50 % of the maximum absolute peak value

Note 1 to entry: Ignition pulse waveforms, which are considered as ignition pulse voltage, should not contain any dominant frequency above 30 kHz or should be usually highly damped (after 20 μs the peak voltage level should be less than one half of the maximum peak voltage). For the assessment of the dominant frequency IEC 60664-4:2005, Annex E should be consulted.

[SOURCE: IEC 61347-1:2015, 3.46.1]

1.2.43.4**equivalent transformed peak voltage** U_p

transformed output peak voltage, which is converted for the worst case peak voltage with its related frequency into an ignition pulse voltage

Note 1 to entry: The value of the declared equivalent transformed output peak voltage is the essential parameter for selecting the associated components.

Note 2 to entry: See 1.2.43.3.

[SOURCE: IEC 61347-1:2015, 3.47, modified – Notes 3 and 4 have been deleted.]

1.2.44**type test**

test or series of tests made on a type test sample, for the purpose of checking compliance of the design of a given product with the requirements of the relevant standard

1.2.45**type test sample**

sample consisting of one or more similar units submitted by the manufacturer or the responsible vendor for the purpose of a type test

1.2.46**by hand**

not requiring the use of a tool

1.2.47**terminal**

that part of a luminaire or component which is necessary to make electrical connection to a conductor

Note 1 to entry: See Sections 14 and 15.

1.2.48**looping-in**

system of mains supply connection to two or more luminaires where each supply conductor is taken into and out of the same terminal

Note 1 to entry: A supply conductor may be cut to facilitate connections to a terminal (see Figure 20).

1.2.49**through wiring**

wiring which passes through the luminaire intended for interconnection of a row of luminaires

Note 1 to entry: Some countries do not permit joints in through wiring.

Note 2 to entry: The luminaire may or may not be electrically connected to the through wiring (see Figure 20).

1.2.50 starting device

apparatus that, by itself or in combination with other components in the circuit, provides the appropriate electrical conditions to start a discharge type of lamp

1.2.51 starter

starting device, usually for fluorescent lamps, that provides for the necessary preheating of the electrodes and in combination with the series impedance of the ballast, causes a surge in the voltage applied to the lamp

1.2.52 ignitor

starting device that generates voltage pulses to start a discharge lamp and that does not provide for preheating of electrodes

1.2.53 terminal block

assembly of one or more terminals in or on a housing or body of insulating material to facilitate interconnection between conductors

1.2.54 rough service luminaire

luminaire designed to withstand severe mechanical handling

Note 1 to entry: The luminaire may:

- be permanently fixed, or
- be temporarily fixed on a construction or stand, or
- incorporate an integral stand or handle.

Note 2 to entry: Such luminaires are for use where normally rough circumstances occur, or where temporary lighting is required, for example on building sites, in engineering workshops and similar applications.

1.2.55 electro-mechanical contact system

connection system within a luminaire by which the main part carrying the lampholder is electrically and mechanically connected to the base plate or suspension device

SEE: Figure 31 describes an electro-mechanical contact system as defined in 1.2.55. As such the requirements of 4.11.6 and 7.2.1 apply. Because, in the situation described, the base and gear tray are unique and non-interchangeable, the base plate does not require marking with the rated current of the electrical connection, as specified in 3.2.

Note 1 to entry: The system can incorporate an adjusting device.

Note 2 to entry: The system can be dedicated to a specific luminaire design or can provide for connection of a variety of luminaire types.

1.2.56 (Not used at present)

1.2.57 mounting surface

part of any building, furniture or other structure which a luminaire may in any way be attached to, suspended from, stood on or placed upon in normal use and which will or is intended to support the luminaire

1.2.58 integral component

component which forms a non-replaceable part of a luminaire and which cannot be tested separately from the luminaire

1.2.59**self-ballasted lamp**

unit which cannot be dismantled without being permanently damaged, provided with a lamp cap and incorporating a light source and any additional elements necessary for starting and stable operation of the light source

Note 1 to entry: The light source component of a self-ballasted lamp is not replaceable.

Note 2 to entry: The ballast component is part of the self-ballasted lamp; it is not part of the luminaire. It is discarded at the end of the life of the unit.

Note 3 to entry: For test purposes, self-ballasted lamp units should be regarded as conventional lamps.

Note 4 to entry: For examples and further information, see IEC 60972.

1.2.60**semi-luminaire**

unit similar to a self-ballasted lamp but designed to utilize a replaceable light source and/or starting device

Note 1 to entry: The light source component and/or starting device of a semi luminaire is readily replaceable.

Note 2 to entry: The ballast component is not replaceable and is not disposed of each time a light source is replaced.

Note 3 to entry: A lampholder is required for a supply connection.

Note 4 to entry: For examples and further information, see IEC 60972.

1.2.61**plug-in independent controlgear**

independent controlgear provided with an integral plug as the means of connection to the electrical supply

1.2.62**mains socket-outlet-mounted luminaire**

luminaire provided with an integral plug as the means of both mounting and connection to the electrical supply

1.2.63**clip-mounted luminaire**

integral assembly of a luminaire and resilient spring clip, securing the luminaire in position on its mounting surface by a single hand action

1.2.64**lamp connectors**

set of contacts specially designed to provide a means of electrical contact but not to support the lamp

1.2.65**mains socket-outlet**

accessory having socket-contacts designed to engage with the pins or blades of a mains plug and having terminals for the connection of cables or cords

1.2.66

(Void)

1.2.67

(Void)

1.2.68

lamp controlgear

devices employed for the control of lamps, for example ballasts, transformers and step-down convertors

Note 1 to entry: The definition does not include devices for the switching of lamps or the control of brightness such as dimmers and daylight sensors.

1.2.69

(Void)

1.2.70

dummy lamp

device incorporating a cap which is in compliance with the requirements of IEC 60061 (all parts) where applicable

1.2.71

self-shielded lamp

tungsten halogen lamp or metal halide lamp for which the luminaire needs no protective shield for protection against UV emission or lamp shattering

1.2.72

external flexible cable or cord

flexible cable or cord for external connection to the input or output circuit, fixed to or assembled with, the luminaire according to a type X (1.2.72.1), Y (1.2.72.2) or Z (1.2.72.3) method of attachment

1.2.72.1

type X attachment

method of attachment of the cable or cord such that it can be easily replaced

Note 1 to entry: The flexible cable or cord may be specially prepared and only available from the manufacturer or his service agent.

Note 2 to entry: A specially prepared cable or cord may also include a part of the luminaire.

1.2.72.2

type Y attachment

method of attachment of the cable or cord such that any replacement can only be made by the manufacturer, his service agent or similarly qualified person

Note 1 to entry: Type Y attachment may be used either with an ordinary or a special flexible cable or cord.

1.2.72.3

type Z attachment

method of attachment of the cable or cord such that it cannot be replaced without breaking or destroying the luminaire

1.2.73

earthing

1.2.73.1

protective earthing

earthing of a point or points in a system or in an installation or in equipment, for purposes of electrical safety

[SOURCE: IEC 60050-195:2001, 195-01-11]

1.2.73.2**functional earthing**

earthing of a point in a system or in an installation or in equipment, which is necessary for the proper function, but does not form part of the protection against electric shock

1.2.74**inter-connecting cable**

wiring or wiring assembly between two main parts of a luminaire as supplied by the luminaire manufacturer and which can be regarded as being part of the luminaire

Note 1 to entry: A wiring assembly may contain a combination of different wiring, e.g. to feed through the supply voltage, to provide earthing, to supply starting and working voltages and wiring providing functional connection. Examples of applications are: between a luminaire and a controlgear box, a mounting box or a connector fitting to a track system.

1.2.75**ferrule**

mechanical fixture, generally a rigid tube, used to confine the stripped end of a cable

1.2.76**impulse withstand category****overvoltage category**

numeral defining a transient overvoltage condition

Note 1 to entry: Impulse withstand categories I, II, III and IV are used.

Note 2 to entry: The following explanation is taken from IEC 60364-4-443 (withdrawn).

a) Purpose of classification of impulse withstand categories

Impulse withstand categories are to distinguish different degrees of availability of equipment with regard to required expectations on continuity of service and on an acceptable risk of failure.

By selection of impulse withstand levels of equipment insulation, coordination can be achieved in the whole installation reducing the risk of failure to an acceptable level providing a basis for overvoltage control.

A higher characteristic numeral of an impulse withstand category indicates a higher specific impulse withstand of the equipment and offers a wider choice of methods for overvoltage control.

The concept of impulse withstand categories is used for equipment energized directly from the mains.

b) Description of impulse withstand categories

Equipment of impulse withstand category I is equipment which is intended to be connected to the fixed electrical installations of buildings. Protective means are taken outside the equipment – either in the fixed installation or between the fixed installation and the equipment – to limit transient overvoltages to the specific level.

Equipment of impulse withstand category II is equipment to be connected to the fixed electrical installations of buildings.

Equipment of impulse withstand category III is equipment which is part of the fixed electrical installations and other equipment where a higher degree of availability is expected.

Equipment of impulse withstand category IV is for use at or in the proximity of the origin of the electrical installations of buildings upstream of the main distribution board.

1.2.77**circuits and circuit characteristics****1.2.77.1****primary circuit**

circuit that is directly connected to the AC mains supply

Note 1 to entry: It includes, for example, the means for connection to the AC mains supply, the primary windings of transformers, motors and other loading devices.

[SOURCE: IEC 60950-1:2005, 1.2.8.4, modified – Additional information has been transferred to a note to entry and the existing note has been deleted]

1.2.77.2

secondary circuit

circuit that has no direct connection to a primary circuit and derives its power from a transformer, converter or equivalent device, or from a battery

Note 1 to entry: In autotransformers, although having direct connection to a primary circuit, the tapped part of the transformer is also deemed to be a secondary circuit in the above sense.

Note 2 to entry: Mains transients in such a circuit are attenuated by the corresponding primary windings. Inductive ballasts also reduce the mains transient voltage height. Therefore, components located after a primary circuit or after an inductive ballast can be suited for an impulse withstand category of one step lower, see Annex U.

[SOURCE: IEC 60950-1:2005, 1.2.8.5, modified – In the definition, the word "isolation" has been deleted from "equivalent isolation device" and the note has been replaced with the notes to entry.]

1.2.78

touch current

electric current passing through a human body or through an animal body when it touches one or more accessible parts of an installation or equipment

Note 1 to entry: In this document, the human body is represented by the networks in Figure G.2 or Figure G.3.

[SOURCE: IEC 60050-826:2004, 826.11.12, modified – The word "electrical" has been deleted from "electrical installation or electrical equipment" and a note to entry has been added.]

1.2.79

protective conductor current

current which flows in a protective conductor

Note 1 to entry: This current may have an influence on the operation of RCDs (residual current protection devices) connected in the same circuit.

1.2.80

electric burn

burning of the skin or an organ caused by an electric current along its surface or through it

[SOURCE: IEC 60050-195:1998, 195-03-01]

1.2.81

means of adjustment

part of a luminaire, which may be the lamp compartment, obviously intended to be manipulated by the user during use of the luminaire, for example to redirect the light beam

1.2.82

arm's reach

zone of accessibility to touch extending from any point on a surface where persons usually stand or move about to the limits which a person can reach with the hand, in any direction, without assistance

Note 1 to entry: IEC 60364-4-41 incorporates a drawing representing the zone of accessibility. In general terms, the height is 2,5 m from the floor, and the width is 1,25 m in all horizontal directions from the locations a person may be.

[SOURCE: IEC 60050-195:1998, 195.06.12, modified – The note to entry has been added.]

1.2.83

terminal block with integrated screwless protective earthing contact

terminal with earthing connection performed by means of an integrated contact or by means of an auxiliary contact without additional assembly actions (e.g. screwing) when fitted

1.2.84**detachable cord**

flexible cable or cord, for supply or interconnection, intended to be connected to the luminaire by means of a suitable appliance connector

Note 1 to entry: A detachable cord is considered to be easily replaceable.

1.2.85**tool**

screwdriver, coin or other object that may be used to operate a screw or similar fixing means

1.2.86**specially prepared cord**

flexible cable or cord the replacement of which with another non-special cable or cord would create a hazard or diminish safety

1.2.87**settable luminaire**

fixed luminaire, the main part of which can be turned or moved by means of joints, raising and lowering devices, telescopic tubes or similar devices, but which has a locking device (or devices) operated by a tool and is not intended to be adjusted during use

1.2.88**light source**

lamp, provided with a lamp-cap, or module (LED) or other light source made in order to produce an optical visible radiation to be used or incorporated into the luminaire

1.2.88.1**replaceable light source**

lamp, provided with a lamp-cap, or light source designed to be connected by terminals, connector or similar devices and designed to be replaced during normal use or during maintenance of the luminaire

EXAMPLE All kinds of lamps provided with lamp caps.

Note 1 to entry: Built-in LED modules according to IEC 62031 are normally considered as replaceable light sources unless the requirements for non-replaceable or non-user replaceable light sources are fulfilled.

1.2.88.2**non-replaceable light source**

light source which is a non-replaceable part of the luminaire either because it cannot be replaced without breaking or destroying the luminaire or because it is enclosed under a cover fixed by a screw or similar fixing means designed to be used only once and which is not possible to be opened

1.2.88.3**non-user replaceable light source**

light source which can only be replaced by the manufacturer, his service agent, or similar qualified person

1.2.89**controllable luminaire**

luminaire having a control terminal for the purpose of controlgear information exchange and/or setting of controlgear functions

1.2.90**control terminal**

control terminal connections, other than power supply terminals to the electronic controlgear, which are used to exchange information with the controlgear

Note 1 to entry: The power supply terminals can also be used to exchange information with the controlgear.

1.2.91

LV supply

circuits, wiring or part of them connected to the low voltage (LV) public distribution network and whose voltage corresponds to the voltage band II of IEC 60449

EXAMPLE 230 V distribution network.

Note 1 to entry: SELV, PELV and FELV are not included in the definition given here for LV supply.

Note 2 to entry: High voltage (HV) supply corresponding to band III of IEC 60449 is not included in the definition given here for LV supply.

1.2.92

connecting leads tails

internal wiring of luminaires intended to be connected to fixed wiring through separate terminals which are to be enclosed inside the luminaire or connecting box

1.2.93

rated value

value of a quantity used for specification purposes, established under standard test conditions as declared by the manufacturer or responsible vendor

[SOURCE: IEC 62504:2014, 3.33, modified – the note has been deleted.]

1.2.94

input power

electrical power consumed by the luminaire

1.2.95

constant light output function

function where the current passing through a LED module is gradually increased through life to compensate for the gradual light output degradation of the LED module that could be expected to occur

Note 1 to entry: Constant light output functions can be controlled by a programmed software algorithm based on the expected gradual light output degradation or on feedback from a connected sensor such as a photocell.

1.2.96

interrupted DC voltage

DC voltage changing between zero and a DC level with a certain frequency, where the time of the signal being at the DC level can vary within one period

1.2.97

power sourcing equipment

PSE

equipment generating power to supply other equipment through information technology communication cabling providing ES1 according to IEC 62368 (all parts)

Note 1 to entry: The IEEE 802.3-2012 standard provides a similar but different definition.

1.2.98

power over Ethernet

PoE

powering of a device with a PSE according to IEC 62368-3, via twisted pair Ethernet cabling including the appropriate connectors

Note 1 to entry: Typical examples of cables are CAT 5 cables and CAT 7 cables.

1.2.99**universal serial bus****USB**

communication interface including appropriate connectors for communication and powering devices, according to IEC 62680 (all parts)

Note 1 to entry: A class III luminaire is an example of a device as given in the definition.

Note 2 to entry: Several versions exist (USB 1.0, 2.0, 3.0).

1.2.100**information technology communication cabling**

any cable, meant for data transfer, provided with a connector defined by an industry standard that permits DC power transfer between equipment, even if communication does not take place

Note 1 to entry: Examples are USB or Ethernet cables.

1.2.101**track-mounted luminaire**

luminaire designed to be used on a track system, for which the electrical and mechanical connection is ensured either with an adaptor or by a luminaire supply connector together with a luminaire suspension device

Note 1 to entry: Class I and Class II luminaires may be used with Class I track systems/sectors, Class III luminaires can only be used with Class III track systems/sectors.

Note 2 to entry: Track-mounted luminaires can have control interface facilities.

IECNORM.COM : Click to view the full PDF of IEC 60598-1:2020

SECTION 2: CLASSIFICATION OF LUMINAIRES

2.1 General

This section describes the classification of luminaires.

Luminaires are classified according to the type of protection against electric shock, the degree of protection against ingress of dust, solid objects and moisture, the material of the supporting surface and the circumstances of use.

2.2 Classification according to type of protection against electric shock

Luminaires shall be classified according to the type of protection against electric shock provided, as class I, class II or class III (see definitions in Section 1).

Luminaires shall have only a single classification. For example, for a luminaire with a built-in extra-low-voltage transformer with provision for protective earthing, the luminaire shall be classified as class I and no part of the luminaire shall be classified as class III even though the lamp compartment is separated by a barrier from the transformer compartment.

Semi-luminaires shall comply with all relevant requirements for class II luminaires without being provided with the class II symbol.

Unless a luminaire has been specifically designed for use with semi-luminaires, the luminaire manufacturer is not responsible for continued IEC 60598 conformity in the situation where the user has replaced specified lamp types with semi-luminaires. The semi-luminaire manufacturer has a responsibility to provide information with respect to limitations of use.

NOTE The class II symbol is omitted in order to avoid the symbol being applied to the complete luminaire in which the semi-luminaire is used.

2.3 Classification according to degree of protection against ingress of dust, solid objects and moisture

Luminaires shall be classified in accordance with the "IP number" system of classification described in IEC 60529.

Tests for the degrees of protection are given in Section 9.

NOTE Luminaires classified as watertight are not necessarily suitable for operation under water. Pressure watertight luminaires can be used for such applications.

2.4 Classification according to material of supporting surface for which the luminaire is designed

Luminaires shall be classified according to whether they are suitable for direct mounting on normally flammable surfaces or are only suitable for mounting on non-combustible surfaces as follows:

Classification	Symbol
– Luminaires suitable for direct mounting on normally flammable surfaces	No symbol required
– Luminaires not suitable for direct mounting on normally flammable surfaces	Relevant symbol – see Figure 1

NOTE Readily flammable surfaces are not suitable for the direct mounting of luminaires. Requirements for luminaires classified as primarily intended for direct mounting on normally flammable surfaces are given in Section 4 and related tests in Section 12.

2.5 Classification according to the circumstances of use

Luminaires shall be classified according to whether they are intended for normal use or for rough service.

Classification	Symbol
– Luminaires for normal use	No symbol
– Luminaires for rough service	Symbol – see Figure 1

IECNORM.COM : Click to view the full PDF of IEC 60598-1:2020

SECTION 3: MARKING

3.1 General

This section specifies the information to be marked on luminaires or given by instruction.

Any written instructions related to safety shall be in a language which is acceptable in the country in which the equipment is to be installed.

3.2 Marking on luminaires

The following information shall be distinctly and durably marked on the luminaire (see Table 3.1). Each marking in Table 3.1 shall be read with the corresponding subclause as detailed in the table.

- a) Marking to be observed when replacing lamps or other replaceable components, shall be visible on the outside of the luminaire (except the mounting side) or behind a cover which is removed during lamp or other component replacement and with the lamp removed.
- b) Marking to be observed during installation shall be visible during installation on the outside of the luminaire or behind a cover or part which is removed during installation.
- c) Marking to be observed after installation shall be visible with the luminaire assembled and installed as for normal use and with the lamp in place.

Marking may be on ballasts provided the conditions under a) or b) above, as appropriate, are fulfilled. See Table 3.1 for details.

Table 3.1 – Marking

Markings belonging to item a)	Markings belonging to item b)	Markings belonging to item c)
3.2.8 ^a Rated wattage	3.2.1 – 3.2.2 ^b	3.2.13 Lighted objects ^d
3.2.10 Special lamps	3.2.3 Ambient temperature	3.2.14 Rough service
3.2.11 Cool beam	3.2.4 – 3.2.5	3.2.20 Means of adjustment
	3.2.6 IP number	3.2.23 Do not stare at light source ^e
3.2.15 Bowl mirror	Type reference	
3.2.16 Protective shield	3.2.8.2 Rated input power	
3.2.18 Ignition warning	3.2.9 Symbols	
Self-shielded lamp	Relevant symbol for luminaires not suitable for direct mounting on normally flammable surfaces	
3.2.22 Internal replaceable fuse(s)	3.2.12 Termination	
3.2.23 Do not stare at light source ^e	3.2.17 ^c Interconnected luminaires	
3.2.24 Symbol for electric shock risk	3.2.21 Relevant symbol for luminaires not suitable for covering with thermally insulating material	
	3.2.25 Rated input constant voltage ^f	
	3.2.26 Rated input constant current and value of U_{out} ^g	

^a 3.2.8 Rated wattage. For luminaires for discharge lamps with remote controlgear, the marking may be replaced by the instruction: "For lamp designation, see controlgear".

^b 3.2.2 Rated voltage. For luminaires for discharge lamps, if the ballast is not built into the luminaire, the luminaire shall be marked with the working voltage instead of the mains voltage.

^c 3.2.17 Interconnected luminaires. For fixed luminaires, this information may alternatively be provided within the installation instructions.

^d 3.2.13 Lighted objects. Only the symbol shall be provided on the luminaire. The explanation of the symbol shall be provided in the instruction accompanying the luminaire, where not already provided on the luminaire.

^e 3.2.23 The different conditions of this marking for fixed, portable and handheld luminaires are given in 3.2.23.

^f 3.2.25 for constant voltage operation of the luminaire.

^g 3.2.26 for constant current operation of the luminaire.

The earthing symbol referred to in 3.2.12 may be marked on the ballast, instead of the luminaire, if the ballast is of a non-replaceable type. The height of graphical symbols shall not be less than 5 mm, except for symbols for class II and class III classification which may be reduced to a minimum of 3 mm where the space available for marking is restricted. The height of letters and numerals either shown separately or with or as part of symbols shall not be less than 2 mm.

For combination luminaires where the type references or the rated inputs are different for different combinations, the main part and the alternative parts may be marked with a type reference or a rated input, as appropriate, provided that the type can be identified and the rated input of the complete unit may be established from a catalogue or a similar document.

For luminaires with electro-mechanical contact systems, the base plate shall be marked with the rated current of the electrical connection if the system can be used with a variety of different luminaire types.

3.2.1 Mark of origin (this may take the form of a trade mark, the manufacturer's identification mark or the name of the responsible vendor).

3.2.2 Rated voltage(s) in volts.

Portable class III luminaires shall be marked with the rated voltage on the outside of the luminaire.

Luminaires with built-in transformers or convertors, shall be marked with the nominal voltage and/or current of the light source to ensure correct replacement. This marking shall be positioned in accordance with 3.2.8.

Where marking is provided in accordance with 3.2.25 or 3.2.26, additional marking of the rated voltage is not required.

Luminaires supplied via an external PSE shall have a marked rated voltage, which is within the voltage range of the values given in Table Y.2, for the chosen communication cable/connectors.

3.2.3 Rated maximum ambient temperature t_a , if other than 25 °C (see Figure 1).

3.2.4 Symbol for class II luminaires where applicable (see Figure 1).

For portable luminaires provided with a supply cord, the symbol for class II construction, if applicable, shall be on the outside of the luminaire.

The class II symbol shall not be applied to semi-luminaires.

3.2.5 Symbol for class III luminaires where applicable (see Figure 1).

3.2.6 Marking (if applicable) with IP numbers for degree of protection against ingress of dust, solid objects and moisture (see Figure 1 and Annex J). Where X is used in an IP number in Figure 1, it indicates a missing numeral in the example, but both of the appropriate numerals shall be marked on the luminaire.

In cases where different IP numbers apply to distinct parts of the luminaire, the lower number shall be marked on the type label on the luminaire, even if IP20, whereas the higher number shall be marked separately on the part concerned. In cases where shades or similar devices for upgrading are used, for example an IP20 luminaire to a higher IP rating when mounted, the IP20 marking shall be made invisible by the device in question without destroying the marking and the device shall visibly be provided with a new IP rating. The instruction sheet supplied with the luminaire shall include details of the IP numbers applying to the various parts of the luminaire. The use of different IP numbers on different parts of a luminaire or devices, to upgrade the IP rating, for example to a higher IP rating, is only applicable to fixed luminaires.

For recessed luminaires with two IP ratings, both ratings shall be visible during installation and it shall be obvious to which parts of the luminaire the ratings refer. The relevant information shall be provided even if the rating is IP20 or the lower rating is specified as ordinary

Marking of IP20 on ordinary luminaires is not required.

3.2.7 Maker's model number or type reference.

3.2.8 Luminaires shall be marked with information for the maximum rated light source power or maximum input power according to 3.2.8.1, 3.2.8.2 and 3.2.8.3.

3.2.8.1 Luminaires for tungsten filament lamps shall be marked with the maximum rated wattage and number of lamps.

Marking of maximum rated wattage for luminaires for tungsten filament lamps with more than one lampholder may be in the form:

" $n \times \text{MAX... W}$ ", n being the number of lampholders.

3.2.8.2 Luminaires designed for non-replaceable or non-user replaceable light sources shall be marked with the rated input power of the luminaire.

NOTE The intention of the marking with the rated input power is to give guidance to installers. This document does not specify a test for the input power.

3.2.8.3 For all other luminaires, rated wattage of the lamp or the designation as indicated on the lamp data sheet of the type or types of lamp for which the luminaire is designed. Where the lamp wattage alone is insufficient, the number of lamps and the type shall also be given.

3.2.9 Where applicable, relevant symbol (see Figure 1) for luminaires not suitable for direct mounting on normally flammable surfaces. The symbol shall be explained on the luminaire or in the manufacturer's instructions provided with the luminaire. See Table N.1. The minimum size of the symbol shall be 25 mm for each side.

3.2.10 Information concerning special lamps, if applicable.

In particular, this applies to the symbols (see Figure 1) for luminaires for use with high-pressure sodium lamps having either an internal starting device or requiring an external ignitor where the lamp is required to be marked with the same symbol according to IEC 60662.

3.2.11 Symbol (see Figure 1), if applicable, for luminaires for lamps of similar shape to "cool beam" lamps but where the use of a dichroic reflectorized "cool beam" lamp might impair safety.

3.2.12 Except for type Z attachments, terminations shall be marked to identify live, neutral and earth in case of connection of the luminaire to the supply mains to ensure safe and satisfactory operation.

Symbols, when applied, indicating mains supply terminations shall be according to IEC 60417.

The earthing termination shall be marked by the relevant symbol of IEC 60417 only.

NOTE 1 Appropriate symbols from IEC 60417 are: Earth (IEC 60417-5017:2006-08), Functional earthing (IEC 60417-5018:2011-07) and Protective earth (IEC 60417-5019:2006-08).

Where terminals are provided in a Class II luminaire for the continuity or termination of a protective earth conductor, such terminals shall be marked with the letter E.

NOTE 2 Examples of such terminals are those used for looping or through wiring.

Leads (tails) and terminations used for the connection to extra-low voltage DC supplies shall indicate their intended connection choosing one of the below mentioned combination (see Table 3.2):

Table 3.2 – Identification of extra-low-voltage DC leads and terminations

Positive	Negative
"+"	"–"
Colour coded red ^a	Colour coded black ^a
^a Use of labels or sleeving fixed to the leads to give one of the above identification is acceptable.	

NOTE 3 Terminations can be found at leads (tails), connection or terminal blocks and terminals of another construction.

Luminaires with supply cords which are not fitted with a plug shall include with the manufacturer's instructions any information necessary to ensure safe connection, for example deviations from the national standardized colour coding of the cores where this does not create the possibility of an unsafe situation during installation, use or maintenance.

NOTE 4 In some countries, luminaires with supply cords which are intended to be connected to the supply via a socket-outlet and which are not fitted with a plug are not permitted.

3.2.13 Symbol (see Figure 1) for minimum distance from lighted objects, if applicable, for luminaires which might otherwise overheat the lighted objects due to, for example, the applied lamp type, the shape of the reflector, the adjustability of the mounting means or the location of mounting as indicated in the installations instructions.

The minimum distance marked shall be determined by the temperature test described in item j) of 12.4.1.

The distance is measured on the optical axis of the luminaire from that part of the luminaire or lamp which is nearest to the lighted object.

The symbol for minimum distance and explanation of its meaning shall also be given either on the luminaire or in the instructions with the luminaire.

3.2.14 Symbol (see Figure 1), if applicable, for rough service luminaires.

3.2.15 Symbol (see Figure 1), if applicable, for luminaires which are designed for use with bowl mirror lamps.

NOTE Separate bowls for attachment to GLS lamps without reference to luminaire testing are not within the scope of this document.

3.2.16 Luminaires incorporating a protective shield shall be marked either with:

- "Replace any cracked protective shield", or
- the relevant symbol (see Figure 1).

3.2.17 The maximum number of luminaires that may be interconnected or the maximum total current that may be drawn by means of couplers provided for looping-in connection to the mains supply. For fixed luminaires, this information may alternatively be provided within the installation instructions.

3.2.18 A warning symbol or notice for luminaires with ignitors intended for use with double-ended high pressure discharge lamps and luminaires with double-capped Fa8 tubular lamps if the voltage measured according to Figure 26 exceeds 34 V peak:

- a) warning symbol in accordance with IEC 60417-5036:2002-10 visible during replacement of the lamp. The symbol shall be explained on the luminaire or in the manufacturer's instructions provided with the luminaire, or
- b) a warning notice near to the holder of a replaceable ignitor or replaceable switching element, if any: "Attention, remove replaceable device before replacement of lamp. After lamp-replacement reinsert replaceable device".

3.2.19 Symbol (see Figure 1) for luminaires which are designed to be used only with self-shielded tungsten halogen lamps or self-shielded metal halide lamps.

3.2.20 Where necessary, the means of adjustment where not obvious, needs to be identified.

NOTE Appropriate marking includes symbols (e.g. arrows) to indicate direction of movement, descriptive text or colours.

3.2.21 Relevant symbol (see Figure 1) for luminaires not suitable for covering with thermally insulated material. The symbol shall be explained on the luminaire or in the manufacturer's instructions provided with the luminaire. See Table N.1 The minimum size of the symbol shall be 25 mm for each side.

3.2.22 Symbol (see Figure 1) if applicable, for luminaires with internal replaceable fuses. Such a luminaire shall, in addition, be provided with information regarding the rated current (in A or mA) of the fuse. Where the time/current characteristic of the fuse is important for safety, the rating and type of every fuse shall be marked on the holder or in the proximity of the fuse in accordance with what is stated in the relevant fuse standard.

3.2.23 Warning symbol "Do not stare at the operating light source" (see Figure 1) for portable and handheld luminaires that have been classified as having a threshold illuminance E_{thr} in accordance with IEC TR 62778. This marking shall be visible as detailed by condition 'c' of Clause 3.2 and Table 3.1. In addition, the symbol should be positioned so that it can be read without looking into the operating light source. This requirement is applicable only when E_{thr} is reached at a distance further than 200 mm from the luminaire.

For fixed luminaires that have been classified as having a threshold illuminance E_{thr} in accordance with IEC TR 62778, the manufacturer's instructions provided with the luminaire shall give the following text, where x m is the distance at which the threshold illuminance E_{thr} condition occurs. This requirement is applicable only when E_{thr} is reached at a distance further than 200 mm from the luminaire.

"The luminaire should be positioned so that prolonged staring into the luminaire at a distance closer than x m is not expected".

NOTE 1 According to IEC TR 62778, x m is the distance d_{thr} between the light source and the eyes of the viewer and it is calculated from the lighting distribution measurement of the luminaire.

NOTE 2 Prolonged staring is not expected due to the natural aversion response to bright light sources. Momentary exposure is not considered as prolonged staring.

NOTE 3 According to IEC 62471:2006, 6.1.3, "the philosophical basis for the Risk Group 2 (Moderate-Risk) classification is that the lamp does not pose a hazard due to the aversion response to very bright light sources (...)".

NOTE 4 The above marking requirements have been established following IEC TR 62471-2:2009.

In addition, luminaires incorporating replaceable or non-user replaceable light sources that have been classified as having a threshold illuminance E_{thr} condition in accordance with IEC TR 62778 and which are directly visible during luminaire maintenance shall be marked with the warning symbol "Do not stare at the operating light source" (see Figure 1). This marking shall be visible as detailed by conditions 'a' of Clause 3.2 and Table 3.1.

3.2.24 Where required for protection against electric shock, covers fixed over non-user replaceable light sources shall be marked with the 'caution, risk of electric shock' symbol given by IEC 60417-6042:2010-11. The minimum height of this symbol shall be 15 mm (see Figure 1).

3.2.25 Rated constant input voltage when a luminaire is operated from a constant voltage controlgear not provided with the luminaire.

3.2.26 Rated constant input current when the luminaire is operated from a constant current controlgear not provided with the luminaire. Luminaires supplied with constant current shall also be marked with the highest allowed U_{out} value of the controlgear.

3.2.27 For luminaires operating a LED light source and containing built-in controlgear, the maximum rated electrical output characteristics from the controlgear (e.g. current for constant current controlgear), for which the luminaire has been designed, shall be marked as required in the first column of Table 3.1 belonging to item a). For luminaires incorporating a constant light output function, this marking shall indicate the maximum operating conditions for which the luminaire has been designed. For luminaires using external independent controlgear delivered with the luminaire, this marking shall be visible according to the second column of Table 3.1 belonging to item b).

NOTE This marking is additional to any information already marked on the controlgear.

3.3 Additional information

In addition to the above marking, all details which are necessary to ensure proper installation, use and maintenance shall be given either on the luminaire, semi-luminaire or on built-in ballasts or in the manufacturer's instructions provided with the luminaire for instance:

3.3.1 For combination luminaires, the permissible ambient temperature, the class of protection or the protection against ingress of dust, solid objects and moisture of an alternative part if not at least equal to that of the basic luminaire.

3.3.2 Nominal frequency in hertz.

3.3.3 Operating temperatures:

- a) The rated maximum operating temperature (of a winding) t_w in degrees Celsius.
- b) The rated maximum operating temperature (of a capacitor) t_c in degrees Celsius.
- c) The maximum temperature to which the insulation of supply cables and interconnecting cables will be subjected within the luminaire under the most unfavourable conditions of normal operation, if in excess of 90 °C (see footnote c to Table 12.2 relating to unsleeved fixed wiring). The symbol to indicate this requirement is given in Figure 1.
- d) Spacing requirements to be observed during installation.

3.3.4 Not used.

3.3.5 A wiring diagram, except where the luminaire is suitable for direct connection to the mains supply.

3.3.6 Special conditions for which the luminaire, including the ballast, is suitable, for instance, whether or not the luminaire is intended for looping-in.

3.3.7 Luminaires provided with metal halide lamps shall, if applicable, be provided with the following warning notice:

"The luminaire shall only be used complete with its protective shield".

3.3.8 The manufacturer of semi-luminaires shall supply information on limitations of use of such devices, particularly where overheating may be caused by the position or thermal distribution of the replaceable light source being different from the light sources they will replace.

3.3.9 In addition, the manufacturer shall be prepared to supply information on the power factor and the supply current.

For connections suitable for both resistive and inductive loads, the rated current for the inductive load shall be indicated between brackets and shall immediately follow the rated current for the resistive load. The marking may accordingly be as follows:

$$3(1)A\ 250\ V\ \text{or}\ 3(1)/250\ \text{or}\ \frac{3(1)}{250}$$

NOTE This marking is in accordance with IEC 61058-1.

The rated current values do not apply to circuits in general but only to the rating of the luminaire as a whole.

3.3.10 Suitability for use "indoors" including the related ambient temperature.

3.3.11 For luminaires using remote controlgear, the range of lamps for which the luminaire is designed.

3.3.12 For clip-mounted luminaires, a warning when the luminaire is not suitable for mounting on tubular material.

3.3.13 The manufacturer shall provide the specifications of all protective shields.

3.3.14 Where necessary for correct operation, the luminaire shall be marked with the symbol for nature of supply (see Figure 1).

3.3.15 The rated current at rated voltage shall be declared by the manufacturer for any socket outlet incorporated in the luminaire, if less than the rated value.

3.3.16 The information about rough service luminaires concerning:

- the connection to IPX4 rated socket outlets;
- the correct mounting taking into account the temporary installation;
- the correct fixing to a stand, and also where the stand is not supplied with the luminaire, the maximum height of a possible stand, and its required stability by the indication of the number and minimum length of the legs.

3.3.17 For luminaires with type X, Y or Z attachments, the mounting instructions shall contain the substance of the following information.

- For type X attachments having a specially prepared cord:
if the external flexible cable or cord of this luminaire is damaged, it shall be replaced by a special cord or cord exclusively available from the manufacturer or his service agent.
- For type Y attachments:
if the external flexible cable or cord of this luminaire is damaged, it shall be exclusively replaced by the manufacturer or his service agent or a similar qualified person in order to avoid a hazard.
- For type Z attachments:
the external flexible cable or cord of this luminaire cannot be replaced; if the cord is damaged, the luminaire shall be destroyed.

3.3.18 Luminaires which are other than ordinary, provided with a PVC supply cord, shall be provided with information about the intended use, i.e. "For indoor use only".

3.3.19 For Class I luminaires having a supply current > 20 A, which generate a protective conductor current greater than 10 mA and intended for permanent connection, the protective conductor current shall be clearly stated in the manufacturers' instructions.

NOTE In Australia and New Zealand there is no allowance for protective conductor current greater than 10 mA.

3.3.20 Wall mounted, settable and adjustable luminaires not intended to be mounted within arm's reach shall be provided with information to advise their correct installation, i.e. "Only to be installed outside arm's reach".

3.3.21 For luminaires with non-replaceable and non-user replaceable light source, the instruction sheet shall contain the substance of the following information:

- For non-replaceable light sources:
"The light source of this luminaire is not replaceable; when the light source reaches its end of life the whole luminaire shall be replaced";
- For non-user replaceable light sources:
"The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person".

3.3.22 For controllable luminaires the classification of insulation that has been maintained between LV supply and control conductors shall be provided (e.g. basic insulation, reinforced insulation).

NOTE Maintenance of the declared insulation barrier for the luminaire can also be dependent on other external components/products connected to the same control bus. This is the responsibility of the control system designer, not the luminaire manufacturer.

3.3.23 Luminaires delivered without controlgear shall be provided with the necessary information for the selection of the appropriate component (in particular the maximum wiring distance and size between controlgear and luminaire), together with the highest allowed U_{out} value of the controlgear and the maximum U_p or equivalent peak voltage U_p where pulse voltages are used. In addition, the classification of insulation of the external controlgear that has been maintained between LV supply and secondary output shall be provided if there is a need for at least basic insulation.

- For luminaires that require no insulation between LV supply and output of the external controlgear no additional information is required.
- For luminaires that require basic insulation between the primary and secondary part of the controlgear the substance of the following information is required:
External controlgear shall provide at least basic insulation between LV supply and output.
- For luminaires that are not classified as Class III but require double or reinforced insulation between the primary and secondary part of the controlgear the substance of the following information is required:
External controlgear shall provide at least double or reinforced insulation between LV supply and output.
- For luminaires that are classified as Class III, an indication that the controlgear shall be SELV/PELV is required, except where exposed parts have a voltage higher than 12 V AC or 30 V DC, where an indication that the controlgear shall be SELV only is required.

3.3.24 Where the terminal block is not supplied with the luminaire, the packaging shall contain the following wording:

"Terminal block not included. Installation must be performed by a qualified person."

3.3.25 Luminaire manufacturers shall provide information about the protection for on-site mains wiring for luminaires employing light sources that emit UV on the mains wiring insulation. The information shall contain the substance of the following:

"For installation, the use of additional UV resistant sleeves is required for on-site mains supply cables which are not UV resistant (in particular some halogen-free low smoke cable)."

NOTE It is not expected that light sources for general lighting other than fluorescent, metal halide, high pressure mercury lamps will emit level of UV that could damage the insulation of the cables.

3.3.26 For fixed wall mounted and portable wall mounted luminaires using an external flexible cable or cord longer than 30 cm, the manufacturer's instructions shall include the substance of the following wording: "To reduce the risk of strangulation the flexible wiring connected to this luminaire shall be effectively fixed to the wall if the wiring is within arm's reach".

3.4 Test of marking

Compliance with the requirements of 3.2 and 3.3 is checked by inspection and by the following test:

The durability of the marking is checked by trying to remove it by rubbing lightly for 15 s with a piece of cloth soaked with water and, after drying, for a further 15 s with a piece of cloth soaked with petroleum spirit and by inspection after the tests detailed in Section 12 have been completed.

After the test, the marking shall be legible, marking labels shall not be easily removable and they shall show no curling.

NOTE The petroleum spirit used typically consists of a solvent hexane with a content of aromatics of maximum 0,1 % by volume, a value of 29 % for kauri-butanol, an initial boiling-point of approximately 65 °C, a dry-point of approximately 69 °C and a density of approximately 0,68 g/cm³.

IECNORM.COM : Click to view the full PDF of IEC 60598-1:2020

SECTION 4: CONSTRUCTION

4.1 General

This section specifies general constructional requirements for luminaires. See also Annex L.

4.2 Replaceable components

Luminaires incorporating components or parts intended to be replaceable shall be so designed that there is sufficient space to permit replacement of such components or parts without difficulty and without impairing safety.

NOTE Sealed-in components and riveted parts are not replaceable components.

4.3 Wireways

Wireways shall be smooth and free from sharp edges, burrs, flashes and the like, which might cause abrasion of the insulation of the wiring. Parts such as metal set screws shall not protrude into wireways.

Compliance is checked by inspection and, if necessary, by dismantling and reassembling the luminaire.

4.4 Lampholders

4.4.1 The requirements for electrical safety of integral lampholders shall be those applicable to the luminaire as a whole with the lampholder and lamp in fully assembled position, as for normal use.

In addition, integral lampholders shall, when mounted in the luminaire, comply with the requirements concerning safety during insertion of the lamp as specified in the appropriate lampholder standard.

4.4.2 Connection of wiring to integral lampholder contacts may be made by any method giving reliable electrical contact over the service life of the lampholder.

4.4.3 Luminaires for tubular fluorescent lamps designed for end-to-end mounting shall be so designed that the lamp may be changed in the middle luminaire of a row without adjusting any other luminaire. In multi-lamp luminaires for tubular fluorescent lamps, the changing of any one lamp shall not impair the security of the other lamps.

Compliance with the requirements of 4.4.1 to 4.4.3 is checked by inspection.

4.4.4 Lampholders which are put into position by the user shall be capable of easy and correct positioning.

The distance between the pair of fixed lampholders for a fluorescent lamp intended to be set in a fixed position shall comply with the relevant standard sheet of IEC 60061-2 or (if IEC 60061-2 does not apply), the lampholder manufacturer's mounting instructions. Lampholders for tungsten filament lamps and lampholders for single-capped fluorescent lamps shall be adequately fixed to the body of the luminaire. The fixing device of lampholders shall have adequate mechanical strength so as to withstand such rough handling as may be expected in normal use. These requirements apply both to lampholders put in position by the user and to lampholders put in position by the luminaire manufacturer.

Compliance is checked by inspection, measuring and, if applicable, by the following mechanical tests.

i) *Lampholders for a fluorescent lamp, with a test-cap in position, are subjected, for 1 min, to a pressure applied to the centre of the cap in the direction of its axis of:*

- 15 N for G5 lampholders;
- 30 N for G13 lampholders;
- 30 N for lampholders for single-capped fluorescent lamps (G23, G10q, GR8 etc.).
Values for other lampholders are under consideration.

NOTE For these tests, caps from standardized lamps can be used as the test caps.

After the test, the distance between the holders shall comply with the relevant standard sheet of IEC 60061-2 and the lampholder shall show no damage. The test-cap for this test shall comply with the following standard sheets in IEC 60061-3:

7006-47C for G5 lampholders,

7006-60C for G13 lampholders,

test-caps for other lampholders are under consideration.

After the test on lampholders for single-capped fluorescent lamps, the lampholder shall not have moved from its position and the fixing device shall show no permanent deformation, so that the lamp, when reinserted, will come in its intended position.

ii) *Mounting brackets for Edison screw or bayonet-capped lampholders are subjected to testing for 1 min, to the following bending moments:*

for E14 and B15 lampholders 1,2 Nm;

for E26, E27 and B22 lampholders 2,0 Nm;

for E39 and E40 lampholders 4,0 Nm.

After the test, the lampholder shall not have moved from its position and the fixing device shall show no permanent deformation, so that the lamp, when reinserted, shall be in its intended position.

4.4.5 For luminaires with ignitors, the peak pulse voltage occurring across contacts in lampholders which are part of the pulse voltage circuit shall not be greater than the pulse voltage marked on the lampholder or, in the absence of such marking, shall not be greater than:

- for 250 V rated lampholders 2,5 kV;
- for 500 V rated ES lampholders 4 kV;
- for 750 V rated ES lampholders 5 kV.

Compliance is checked by measurement of the voltage occurring across the lampholder contacts during the pulse test of 10.2.2 for luminaires with ignitors.

4.4.6 For luminaires with ignitors incorporating Edison screw lampholders, the centre contact of the lampholder shall be connected to the lead which supplies the pulse voltage.

Compliance is checked by inspection.

4.4.7 The insulating parts of lampholders and plugs incorporated in rough service luminaires shall be of a material resistant to tracking.

Compliance is checked by the test of 13.4.

4.4.8 Lamp connectors shall comply with all the requirements for lamp holders other than those related to retaining the lamp in position. Means for retaining the lamp shall be provided by other parts of the luminaire.

Compliance is checked by inspection and test as required by 4.4.1 to 4.4.7.

NOTE The difference between lamp connectors and lampholders is clearly identified on the relevant data sheets of IEC 60061 (all parts).

4.4.9 Caps or bases originally developed for single-capped ELV lamps shall not be used in luminaires intended for use with general purpose tungsten halogen lamps with rated voltages higher than 50 V.

NOTE Examples of such ELV fits are: G4, GU4, GY4, GX5.3, GU5.3, G6.35, GY6.35, GU7 and G53.

Luminaires intended for use with GU10 lamps only (with aluminized reflector) shall be provided with GU10 lampholders only.

Compliance is checked by inspection.

4.4.10 The use of a light source or light sources, designed to be connected by a lampholder or connector according to IEC 60061 (all parts), but used without the relevant lampholder or connector and with the electrical connections made in another way (e.g. with the wire soldered directly to the pins), is not allowed.

Compliance is checked by inspection.

4.5 Starterholders

Starterholders in luminaires other than class II shall accept starters which comply with IEC 60155.

Class II luminaires may require starters of class II construction.

For class II luminaires where the starter can be touched with the standard test finger when the luminaire is fully assembled for use or open for the replacement of lamps or starters, the starterholder shall be one accepting only starters complying with the requirements for starters for class II luminaires given in IEC 60155.

Compliance is checked by inspection.

4.6 Terminal blocks

If luminaires are provided with connecting leads (tails) requiring a separate terminal block for the connection to the fixed wiring, adequate space for this terminal block shall be provided within the luminaire, or within a box delivered with the luminaire, or specified by the manufacturer.

This requirement applies to terminal blocks for connecting leads (tails) with conductor nominal cross-sectional areas not exceeding 2,5 mm².

Compliance is checked by measurement and by an installation test, using one terminal block for each two conductors to be connected together, as shown in Figure 2, and fixed wiring having a length of approximately 80 mm. The dimensions of the terminal blocks are those specified by the manufacturer or, in the absence of such a specification, 10 mm × 20 mm × 25 mm.

Unsecured terminal blocks are permitted when they are designed and insulated such that creepage distances and clearances in accordance with Section 11 are always maintained for any position of the terminal block, and that damage to internal wiring is prevented.

4.7 Terminals and supply connections

4.7.1 In portable luminaires of class I and II and in fixed luminaires of class I and II that are frequently adjusted, adequate precautions shall be taken to prevent metal parts from becoming live due to a detached wire or screw. This requirement applies to all terminals (including supply terminals).

NOTE The requirement can be met by securing the wires adjacent to their entry to the terminals, by suitable dimensioning of the enclosure for the terminals, by the use of an enclosure of insulating material or by the provision of an insulating lining in the enclosure.

Examples of methods deemed efficient to prevent a wire from becoming detached are:

- a) wires are retained by a cord anchorage adjacent to the terminals;
- b) conductor is clamped by a spring type screwless terminal;
- c) the wire conductor is anchored before soldering;
- d) wires are twisted together in a reliable manner;
- e) wires are fastened together by insulation tape, sleeves, or the like;
- f) the wire conductor is inserted into a hole in a printed board, bent and soldered, the hole having a diameter slightly greater than the conductor;
- g) the wire conductor is securely wrapped around the terminal by means of a special tool (see Figure 19);
- h) the wire conductor is crimped to the terminal by means of a special tool (see Figure 19).

The methods a) to h) apply to internal wiring and the methods a) and b) to rewirable external flexible cords.

Compliance is checked by inspection and based upon the assumption that only one conductor can become detached at the same time.

4.7.2 Supply terminals shall be located or shielded in such a way that, if a wire of a stranded conductor escapes from a terminal when the conductors are fitted, there is no risk of contact between live parts and metal parts which can be touched with the standard test finger when the luminaire is fully assembled for use or open for the replacement of replaceable light sources or starters.

Compliance is checked by inspection and by the following test.

An 8 mm length of insulation is removed from the end of a flexible conductor having the largest cross-sectional area specified in Section 5. One wire of the stranded conductor is left free and the remainder are fully inserted and clamped in the terminal. The free wire is bent, without tearing the insulation back, in every possible direction, but without making sharp bends around barriers.

The free wire of a conductor connected to a live terminal shall not touch any metal part which is accessible or connected to an accessible metal part, and the free wire of a conductor connected to an earthing terminal shall not touch any live part.

This test does not apply to lampholders which have been separately approved in accordance with an appropriate IEC standard and to terminals of components where the construction method justifies a shorter length of free wire.

4.7.3 Terminals for supply cords, shall be suitable for connection to be made by means of screws, nuts or equally effective devices.

Connecting leads (tails) shall comply with the requirements of Clause 5.3.

NOTE 1 For luminaires designed to be connected by means of rigid (solid or stranded) conductors, screwless terminals of the spring type are effective devices, including the earth connection. No requirements are specified at present for using such terminals for the connection of supply cords.

NOTE 2 For luminaires designed to be connected by means of a supply cord and having a rated current not exceeding 3 A, soldered, welded, crimped and similar connections, including snap-on connectors, are effective devices, including an earth connection. Other similar connections include screwless terminals, insulation piercing or insulation displacement clamping terminals.

NOTE 3 For luminaires having a rated current exceeding 3 A, snap-on connectors are suitable if the connection can also be made without making use of the receptacle, for example, by means of a screwed connection for which a threaded hole is provided in the tab.

4.7.3.1 Welding method and material

The conductor shall be stranded or solid wire of copper materials. For thin wires, a ferrule may be used.

The welding method shall be spot welding only.

NOTE Other methods of welding are under consideration.

Welding of wire and plate is allowed, but welding of wires together is not allowed.

Welded connections are used in Type Z attachments only.

Welded connections shall withstand the mechanical, electrical and heat test in normal use.

Compliance is checked by inspection and by the following tests.

a) *Mechanical test*

Apply the test of 15.6.2.

If the wire is fixed by a cord anchorage, the mechanical test is not applicable.

b) *Electrical test*

Apply the tests of 15.6.3.

c) *Heat test*

Apply the tests of 15.6.3.2.3 and 15.6.3.2.4.

4.7.4 Terminals, other than those for supply connection, which are not covered by separate standards for components, shall comply with the requirements of Sections 14 and 15.

Terminals of lampholders, switches and similar parts used for multiple connection of internal wiring shall have dimensions adequate for the purpose and shall not be used for the connection of external wiring.

Compliance is checked by inspection and by the tests of Sections 14 and 15.

4.7.5 If the external wiring or supply cord is unsuitable for the temperatures reached inside the luminaire, either a connection shall be provided at the point of entry of the external wiring into the luminaire for the use of heat-resistant wiring after this point, or heat-resisting parts shall be supplied with the luminaire to cover the part of the wiring placed inside it, which exceeds the wiring temperature limit.

Compliance is checked by inspection.

4.7.6 If during the installation or maintenance of a luminaire, electrical connections are made by a multi-pole plug and socket, unsafe connections shall be prevented.

Compliance is checked by inspection and by trying to make unsafe connections, for example by shifting the plug positions. The force applied to the plug during compliance checks shall take into account forces up to 30 N in any direction.

4.8 Switches

Switches shall be adequately rated and so fixed that they are secured against rotation and cannot be removed by hand.

Switches in flexible cables or cords and switched lampholders shall not be used in luminaires which are other than ordinary, unless the degree of protection against dust, solid objects or moisture of the switch is in accordance with the classification of the luminaire.

For luminaires intended for use on a polarized supply and where the luminaire has a single-pole on/off switch, the switch shall be wired into the live side of the supply or the side other than that identified as the neutral side.

Electronic switches, when incorporated in or supplied with the luminaire, shall comply with the requirements of IEC 61058-1.

Compliance is checked by inspection.

4.9 Insulating linings and sleeves

4.9.1 Insulating linings and sleeves shall be so designed that they are reliably retained in position when switches, lampholders, terminals, wires or similar parts have been mounted.

NOTE Self-hardening resins, such as epoxy resins, can be used to fix linings.

Compliance is checked by inspection and by manual test.

4.9.2 Insulated linings, sleeves and similar parts shall have adequate mechanical, electrical and thermal strength.

Compliance is checked by inspection, by manual test and by the electric strength test in accordance with Section 10. The thermal properties of wire and sleeve are checked in accordance with Section 12. Heat resistant sleeves used as covering for wires attaining a temperature exceeding the values given in Table 12.2 of Section 12 shall comply with the requirements of IEC 60684 (all parts), taking into account the temperature measured on the wire in question. The sleeve shall be resistant to a temperature exceeding the temperature measured on the wire by 20 °C or withstand the following test.

- a) *Three test specimens of the sleeve, about 15 cm in length, are subjected to the humidity test of 9.3 and subsequently to the insulation resistance and electric strength tests according to Section 10. A suitable uninsulated copper conductor or metal rod is passed through the specimens, and the outside is covered by a metal foil in such a way that no flashover at the ends of the samples can occur. The measurement of the insulation resistance and the electric strength test is then made between the copper conductor/metal rod and the metal foil.*
- b) *After the copper conductors/metal rods and metal foils have been removed, the specimens are placed in a heating cabinet for 240 h at a temperature of $T + 20$ °C, T being the measured temperature of the wire.*
- c) *The specimens are allowed to cool to room temperature and are then prepared as indicated in item a) above.*

Measurement of the insulation resistance and electric strength is then made between the copper conductor/metal rod and the metal foil.

Compliance is checked by the insulation resistance values and test voltages specified in Tables 10.1 and 10.2 in Section 10.

4.10 Double and reinforced insulation

4.10.1 For metal encased class II luminaires, contact between:

- mounting surfaces and parts with basic insulation only,
- accessible metal parts and basic insulation,

shall be effectively prevented.

NOTE 1 This does not exclude the use of bare conductors if adequate protection is provided.

This wiring includes internal and external wiring of the luminaire, and fixed wiring of the installation.

Class II fixed luminaires shall be so designed that the required degree of protection against electric shock is not impaired as a result of the installation of the luminaire, for example by contact with metal conduits or metal sheaths of cables.

Capacitors shall not be connected between live parts and the body of metal encased class II luminaires, with the exception of interference suppression capacitors and switches meeting the requirements of 4.8.

NOTE 2 Contact between accessible metal parts and the basic insulation of internal wiring can be prevented by sleeves or similar parts which comply with the requirements for supplementary insulation.

Compliance is checked by inspection.

4.10.2 Any assembly gap with a width greater than 0,3 mm in supplementary insulation shall not be coincidental with any such gap in basic insulation, nor shall any such gap in reinforced insulation give straight access to live parts.

Openings larger than 0,3 mm in double or in reinforced insulation shall be designed so that live parts cannot be touched with the conical pin of test probe 13 shown in Figure 9 of IEC 61032:1997.

NOTE In order to ensure effective forced ventilation or water draining in luminaires, it can be necessary to provide openings in the double or reinforced insulation.

In addition, compliance shall be ensured with the required degree of protection against electric shock in accordance with the IP classification of the luminaire.

Compliance is checked by inspection and measurement using the relevant probe(s) in accordance with the required degree of protection against electric shock.

4.10.3 Parts of class II luminaires which serve as supplementary insulation or reinforced insulation, shall either:

- be fixed so that they cannot be removed without being seriously damaged; or
- be unable to be replaced in an incorrect position.

Where sleeving is used as supplementary insulation on internal wiring, and where insulated linings are used in lampholders as supplementary insulation on external or internal wiring, the sleeving and lining shall be retained in position by positive means.

A sleeve is considered to be fixed by positive means if it can only be removed by breaking or cutting or if it is clamped at both ends or its movement on internal wiring is restricted by neighbouring components. A lining is considered to be fixed by positive means if it can only be removed by breaking or cutting or by dismantling the lampholder.

Parts, such as a tube of insulating material provided with a shoulder and used as a liner inside the nipple of a lampholder, are considered to provide supplementary insulation on external or internal wiring if they can be removed only by dismantling the lampholder.

Compliance is checked by inspection and by manual test.

Lining metal enclosures with a coating of lacquer or with any other material in the form of a coating which can be easily removed by scraping is not considered to meet this requirement.

4.10.4 Protective impedance device

Parts separated by insulation (e.g. where basic, supplementary or double or reinforced insulation is required), may be bridged (conductive bridge) by resistors. For basic and supplementary insulation, they may consist of one single resistor. For double or reinforced insulation, they shall consist of at least two separate resistors connected in series of the same rated resistance, each one rated for the total working voltage so that their impedance is unlikely to change significantly during the individual lifetime of the luminaire.

They shall comply with the requirements of test (a) in 14.2 of IEC 60065:2014.

Parts separated by insulation (e.g. where basic, supplementary or double or reinforced is required), may be bridged by a number of Y capacitors in series according to Table 4.6.

Y1, Y2 and Y4 capacitors shall comply with the relevant requirements of IEC 60384-14.

Table 4.6 – Overview of required Y capacitors

AC mains voltage RMS ^a	Impulse withstand category	Bridged insulation	Capacitor type	Required number of capacitors
$U \leq 150 \text{ V}$	II	B or S	Y4	1
$U \leq 150 \text{ V}$	II	B or S	Y2	1
$U \leq 150 \text{ V}$	II	B or S	Y1	1
$U \leq 150 \text{ V}$	II	D or R	Y4	2
$U \leq 150 \text{ V}$	II	D or R	Y2	2
$U \leq 150 \text{ V}$	II	D or R	Y1	1
$150 \text{ V} < U \leq 300 \text{ V}$	II	B or S	Y2	1
$150 \text{ V} < U \leq 300 \text{ V}$	II	B or S	Y1	1
$150 \text{ V} < U \leq 300 \text{ V}$	II	D or R	Y2	2
$150 \text{ V} < U \leq 300 \text{ V}$	II	D or R	Y1	1
$300 \text{ V} < U \leq 500 \text{ V}$	II	B or S	Y2	1
$300 \text{ V} < U \leq 500 \text{ V}$	II	B or S	Y1	1
$300 \text{ V} < U \leq 500 \text{ V}$	II	D or R	Y2	2
$300 \text{ V} < U \leq 500 \text{ V}$	II	D or R	Y1	1

^a In the case of capacitors connected between active parts of circuits insulated from the mains and accessible parts, the voltage to be considered is the voltage indicated in Table X.1.

Key

B = Basic insulation

S = Supplementary insulation

R = Reinforced insulation

D = Double insulation

4.11 Electrical connections and current-carrying parts

4.11.1 Electrical connections shall be so designed that contact pressure is not transmitted through insulating material other than ceramic, pure mica or other material with characteristics which are at least equivalent, unless there is sufficient resilience in the metallic parts to compensate for any possible shrinkage of the insulating material.

Compliance is checked by inspection.

4.11.2 Self-tapping screws shall not be used for the connection of current-carrying parts, unless they clamp these parts directly in contact with each other, and are provided with a suitable means of locking.

Thread-cutting screws and self-tapping screws shall not be used for the interconnection of current-carrying parts of metal which is soft or liable to creep, such as zinc or aluminium.

Self-tapping screws may be used to provide protective earthing continuity, if it is not necessary to disturb the connection in normal use.

Compliance is checked by inspection.

NOTE See Figure 22 for some examples of screws.

4.11.3 Screws and rivets which serve as electrical as well as mechanical connections shall be locked against loosening. Spring washers may provide satisfactory locking. For rivets, a non-circular shank or an appropriate notch may be sufficient.

Sealing compound which softens on heating provides satisfactory locking only for screw connections not subject to torsion in normal use.

Compliance is checked by inspection and manual test.

4.11.4 Current-carrying parts shall be of copper, an alloy containing at least 50 % copper, or a material having at least equivalent characteristics.

NOTE Aluminium conductors can be accepted as having at least equivalent characteristics subject to an assessment of suitability being made in each individual case.

This requirement does not apply to screws which do not essentially carry current, such as terminal screws.

Current-carrying parts shall be resistant to, or adequately protected against, corrosion.

Copper and copper alloys containing at least 50 % copper are considered to meet this requirement.

Compliance is checked by inspection and, if necessary, by chemical analysis.

4.11.5 Current-carrying parts shall not be in direct contact with the mounting surface or wood.

Compliance is checked by inspection.

4.11.6 Electro-mechanical contact systems shall withstand the electrical stresses occurring in normal use.

Compliance is checked by subjecting the electro-mechanical contact systems to 100 operations at a speed which corresponds to practical usage (an operation is either making or

breaking the contact). The test is made with alternating current at rated voltage, and the test current shall be 1,25 times the rated current of the electrical contact system. The power factor of the load shall be approximately 0,6, unless a different rated current is marked for resistive loads, in which case the load power factor shall be unity.

Where a luminaire is marked for both resistive and inductive loads, it shall be subjected to tests at power factors of both unity and 0,6.

Before and after the tests, the electro-mechanical contact systems shall be loaded with 1,5 times the rated current, and the voltage drop across each contact shall not exceed 50 mV.

Following completion of these tests, the electro-mechanical contact system shall withstand an electric strength test made in accordance with Clause 10.2.

After the test, the samples shall show:

- no wear impairing their further use;*
- no deterioration of enclosures or barriers;*
- no loosening of electrical or mechanical connections.*

For electro-mechanical contact systems, the mechanical test of 4.14.3 is carried out simultaneously with this electrical test.

4.12 Screws and connections (mechanical) and glands

4.12.1 Screws and mechanical connections, the failure of which might cause the luminaire to become unsafe, shall withstand the mechanical stresses occurring in normal use.

Screws shall not be made of a material which is soft or liable to creep.

NOTE Examples are zinc, some grades of aluminium and several thermoplastics.

Screws which are operated for maintenance purposes shall not be of insulating material if their replacement by a metal screw could impair supplementary or reinforced insulation.

Screws used to provide protective earthing continuity, for example fixing screws for ballasts and other components, shall comply with the requirement in the first paragraph of 4.12.1 as far as the ballast is concerned, as at least one screw retaining the ballast will have a mechanical and electrical function.

Changing the screw retaining the ballast is not considered to be maintenance.

Screws of insulating material used in cord anchorages can be accepted bearing directly on the cable or cord, as replacement of such screws is not regarded as maintenance.

Compliance is checked by inspection, and screws and nuts transmitting contact pressure or which are likely to be tightened by the user shall be tightened and loosened five times. Screws and nuts of insulating material shall be removed completely during each operation of loosening of the screws. During the test, no damage impairing the further use of the fixing or screwed connection shall occur. After the test, it shall still be possible to introduce the screw or nut made of insulation material in the intended manner.

The test is made by means of a suitable test screwdriver or spanner, applying a torque as specified in Table 4.1, except that for screws of insulating material used in cord anchorage and bearing directly on the cable or cord, the torque is 0,5 Nm.

Table 4.1 – Torque tests on screws

Nominal outer thread diameter of screw mm	Torque Nm		
	1	2	3
Up to and including 2,8	0,20	0,40	0,40
Over 2,8 up to and including 3,0	0,25	0,50	0,50
Over 3,0 up to and including 3,2	0,30	0,60	0,50
Over 3,2 up to and including 3,6	0,40	0,80	0,60
Over 3,6 up to and including 4,1	0,70	1,20	0,60
Over 4,1 up to and including 4,7	0,80	1,80	0,90
Over 4,7 up to and including 5,3	0,80	2,00	1,00
Over 5,3 up to and including 6,0	–	2,50	1,25
Over 6,0 up to and including 8,0	–	8,00	4,00
Over 8,0 up to and including 10,0	–	17,00	8,50
Over 10,0 up to and including 12,0	–	29,00	14,50
Over 12,0 up to and including 14,0	–	48,00	24,00
Over 14,0 up to and including 16,0	–	114,00	57,00

The shape of the blade of the screwdriver shall suit the head of the screw to be tested. The screws shall not be tightened in jerks. Damage to covers is neglected.

Column 1 of Table 4.1 applies to metal screws without heads if the tightened screw does not protrude from the hole;

Column 2 applies to:

- other metal screws and nuts;
- screws of insulating material
 - having a hexagonal head with the dimensions across flats exceeding the overall thread diameter;
 - having a cylindrical head and a key socket with a cross-corner dimension exceeding the overall thread diameter;
 - having a head with a slot or cross slots, the length of which exceeds 1,5 times the overall thread diameter.

Column 3 applies to other screws of insulating material.

The values given in Table 4.1 for screws over 6,0 mm diameter apply to steel screws and the like, which are used mainly in the mounting of the luminaire.

The values given in Table 4.1 for screws over 6,0 mm diameter do not apply to nipple threads of lampholders, the requirements for which are specified in Clause 15 of IEC 60238:2016.

The requirements of 4.12.1 do not apply to metal nuts used as means of fixing for push-button switches.

4.12.2 Screws transmitting contact pressure and screws which are operated when mounting or connecting the luminaires and having a nominal diameter less than 3 mm shall screw into metal.

Screws or nuts which are operated when mounting the luminaire or replacing lamps include screws or nuts for fixing covers, lids, etc. Connections for screwed conduits, screws for mounting the luminaire to its mounting surface, hand-operated fixing screws or nuts of glass covers and screwed lids are excluded.

Compliance is checked by inspection and for screws which are operated when mounting the luminaire or when replacing the lamps, by the test described in 4.12.1.

4.12.3 Void.

4.12.4 Screwed and other fixed connections between different parts of luminaires shall be made in such a way that they do not work loose through such torsion, bending stresses, vibration, etc., as may occur in normal use. Fixed arms and suspension tubes shall be securely attached.

NOTE Examples of means of preventing the loosening of connections are soldering, welding, lock nuts and set screws.

Compliance is checked by inspection and by attempting to loosen locked connections with a torque not exceeding:

- 2,5 Nm for thread size $\leq M 10$ or corresponding diameters;
- 5,0 Nm for thread sizes $> M 10$ or corresponding diameters.

For lampholders which are exposed to a rotary action during lamp replacement, compliance shall be checked by inspection and by attempting to loosen locked screwed mechanical connections. The test is not applied to lampholders retained in the luminaire by more than one fixing means (e.g. two fixing screws). The test torque shall be applied for 1 min in a clockwise and anti-clockwise direction with a torque not exceeding:

- 4,0 Nm for E40 lampholders;
- 2,0 Nm for E26, E27 and B22 lampholders;
- 1,2 Nm for E14 and B15 lampholders (except candle type);
- 0,5 Nm for E14 and B15 candle lampholders;
- 0,5 Nm for E10 lampholders.

For other lampholders exposed to a rotary action, a torque equal to two times the maximum withdrawal torque as specified in the lampholder requirements of IEC 60061-2 shall be applied for 1 min in a clockwise and anti-clockwise direction, but with a minimum of 1,2 Nm.

For push-button switches, the means of fixing are subjected to a torque not exceeding 0,8 Nm.

During the test, such screwed connections shall not loosen.

4.12.5 Screwed glands shall comply with the following test.

Screwed glands shall be fitted with a cylindrical metal rod having a diameter equal to the nearest whole number of millimetres below the internal diameter of the packing. The glands shall then be tightened by means of a suitable spanner, the moment given in Table 4.2 being applied to the spanner for 1 min.

Table 4.2 – Torque tests on cable glands

Diameter of test rod mm	Moment	
	Metal cable glands Nm	Moulded plastic cable glands Nm
Up to 7	4,00	2,5
Over 7 up to 14	6,25	3,25
Over 14 up to 20	7,50	5
Over 20	10	7,50

After the test, the luminaire and the glands shall show no damage.

4.13 Mechanical strength

4.13.1 Luminaires shall have adequate mechanical strength and be so constructed as to be safe after such rough handling as may be expected in normal use.

Compliance is checked by applying blows to the sample by means of the spring-operated impact test apparatus specified in IEC 60068-2-75 or by other suitable means giving equivalent results.

NOTE Equivalent impact energies obtained by different methods do not necessarily give the same test result.

The hammer spring shall be such that the product of the compression, in millimetres, and the force exerted, in newtons, equals 1 000, the compression being approximately 20 mm. The spring shall be adjustable so as to cause the hammer to strike with an impact energy and spring compression as given in Table 4.3:

Table 4.3 – Impact energy and spring compression

Impact level	Impact energy J		Compression mm	
	Fragile parts	Other parts	Fragile parts	Other parts
Level 1 (Low impact energy): applicable to luminaires that are normally subjected to a low mechanical impact because of their installation on a wall or on a ceiling ^a	0,2	0,35	13	17
Level 2 (medium impact energy): applicable to luminaires where a higher mechanical strength is required because of their mobility or because they are easily accessible in normal use ^b	0,35	0,50	17	20
Level 3 (high impact energy): applicable to luminaires where a higher mechanical strength is required because of their installation without any additional protection or because they are subject to frequent handling ^c	0,5	0,70	20	24
Rough service luminaires, handlamps, ground recessed luminaires, air-handling luminaires, lighting chains, rope lights, luminaires for emergency lighting and hand-held luminaires for use in clinical areas of hospitals (and health care buildings)	Other testing methods as specified in this document and/or in the specific parts of IEC 60598-2.			
Lampholders and other components are retested only insofar as they protrude beyond the projection of the outline of the luminaire. The front of the lampholders is never retested since in normal operation, this part is covered by the lamp.				
Fragile parts are parts such as glass and translucent covers providing only protection against dust, solid objects, moisture and/or UV. Fixing/closing mechanisms are not regarded as fragile parts.				
Protective shields required on account of 4.21 are regarded as fragile parts.				
^a Luminaires requiring Level 1 impact energy are: recessed luminaires, fixed general purpose luminaires, portable luminaires for wall mounting (for indoor use), and extra-low-voltage lighting systems.				
^b Luminaires requiring Level 2 impact energy are: portable floor and table luminaires for indoor use, photo and film luminaires and aquarium luminaires.				
^c Luminaires requiring Level 3 impact energy are: floodlights, road and street lighting luminaires, swimming-pool luminaires, portable luminaires for outdoor use, portable luminaires for children, mains socket-outlet mounted nightlights and luminaires for stage lighting, television and film studios (outdoor and indoor).				

NOTE 1 The level of impacts has been described for testing purposes only and are not considered as a product rating.

NOTE 2 The introduction of impact Levels 1, 2, 3 in this ninth edition of IEC 60598-1 does not represent any technical change to the standard compared with the requirements of Table 4.3 given in the previous edition.

Translucent covers, neither providing protection against electric shock and/or UV, nor forming part of the protection against dust, solid objects, moisture and lamps, are not tested.

The sample is mounted or supported as in normal use on a rigid wooden board, cable entries being left open, knockouts opened, and cover-fixing and similar screws tightened with a torque equal to two-thirds of that specified in Table 4.1.

Three blows shall be applied to the point which is likely to be the weakest, paying special attention to insulating material enclosing live parts and to bushings of insulating material, if any. Additional samples may be necessary to find the weakest point; in case of doubt, the test shall be repeated on a fresh sample to which three blows only are applied.

After the test, the sample shall show no damage, in particular:

- a) live parts shall not have become accessible;*
- b) the effectiveness of insulating linings and barriers shall not have been impaired;*
- c) the sample shall continue to afford the degree of protection against ingress of dust, solid objects and moisture, in accordance with its classification;*

- d) *it shall be possible to remove and to replace external covers without these covers or their insulating linings breaking.*

Breakage of an enclosure is, however, allowed if its removal does not impair safety.

In case of doubt, supplementary insulation or reinforced insulation is subjected to an electric strength test as specified in Section 10.

Damage to the finish, small dents which do not reduce creepage distances or clearances below the value specified in Section 11, and small chips which do not adversely affect the protection against electric shock, dust or moisture are neglected.

4.13.2 Metal parts enclosing live parts shall have adequate mechanical strength.

Compliance is checked by the appropriate tests of 4.13.3 to 4.13.5.

4.13.3 *A straight unjointed test finger is used, with the same dimensions as the standard test finger specified in IEC 60529. The finger is pressed against the surface with a force of 30 N.*

During the test, metal parts shall not touch live parts.

After the test, covers shall not be excessively deformed and the luminaire shall continue to meet the requirements of Section 11.

4.13.4 Rough service luminaires

Rough service luminaires shall have protection against ingress of solid objects and moisture of at least IP54.

Compliance is checked by inspection and the appropriate test of 9.2.0.

Rough service luminaires shall have adequate mechanical strength and shall not overturn under circumstances that may be expected during normal use. In addition, the fixation means of the stand to which the luminaire is connected shall have adequate mechanical strength.

Compliance is checked by tests a) to d) below.

a) Fixed rough service luminaires and portable rough service luminaires (not hand-held)

Each of three samples of the luminaire shall be subjected to three single impacts, at points likely to be the weakest, on any surface normally exposed. The sample without lamp (or lamps) is mounted as in normal use on a rigid supporting surface.

The impacts are produced by dropping a steel sphere 50 mm diameter weighing 0,51 kg from a height H (1,3 m) as shown in Figure 21, to produce an impact energy of 6,5 Nm.

Each of the three samples of a luminaire intended for outdoor use shall additionally be cooled to a temperature of $-5\text{ °C} \pm 2\text{ °C}$ and maintained at that temperature for 3 h.

Whilst the samples are at this temperature, they shall be subjected to the impact test specified above.

b) Hand-held luminaires

The luminaire is caused to fall four times from a height of 1 m onto a concrete floor. The falls are made from four different horizontal starting positions, the luminaire being turned through 90° around its axis between each fall. Lamps are removed, but protective glasses, if any, are not removed for this test.

After the test of 4.13.4 a) or 4.13.4 b), the luminaire shall show no damage impairing safety and its further use. The parts protecting the lamp against damage shall not have loosened.

NOTE These parts may have become deformed. Breakage of a protective glass or translucent cover is ignored if the glass or cover is not the sole means of protecting the lamp against damage.

c) *Luminaires delivered with a stand*

Any lamp(s) are removed before the tests.

The luminaire and stand shall not overturn at an angle of 6° from the vertical.

The luminaire shall withstand the impacts resulting from overturning four times from an angle up to 15° from the vertical.

The fixation means of the stand shall withstand a force of four times the weight of the luminaire in the most onerous direction.

If the luminaire overturns during the test on the plane inclined at an angle of 15° from the vertical, the test of 12.5.1 is made with the luminaire on a horizontal surface, in the most unfavourable of the overturned positions that may reasonably be expected in practice.

d) *Luminaires for temporary installations and suitable for mounting on a stand*

The luminaire shall withstand four impacts resulting from the following test.

Any lamp(s) are removed before the test.

The luminaire is suspended by an aluminium rod along a concrete or brick wall. The length of the rod is that of the stand as indicated for a possible stand in the mounting instruction.

The luminaire is lifted until the rod is in the horizontal plane and then allowed to fall freely against the wall.

After the test, there shall be no impairing of the safety.

4.13.5 Not used.

4.13.6 Plug-in independent controlgear and mains socket-outlet mounted luminaires shall not impose undue strain on socket-outlets.

Compliance is checked by the following test, which is made in a tumbling barrel in accordance with IEC 60068-2-31:2008, 5.3 (free fall repeated – procedure 2), according to the following details:

Height of the falls: 500 mm;

- 100 falls if the mass of the sample does not exceed 100 g;*
- 50 falls if the mass of the sample is > 100 g and ≤ 250 g;*
- 25 falls if the mass of the sample exceeds 250 g.*

Socket-outlet mounted luminaires shall be equipped with the appropriate light source.

NOTE The number of falls is not that considered in the conformity criteria of IEC 60068-2-31:2008.

After the test, the sample shall continue to comply with the requirements of this document, but need not be operative and any damage to the light source in the mains socket-outlet mounted luminaires shall be ignored. Provided that the protection against electric shock is not affected, small pieces which may have broken off the sample shall be ignored.

Distortion of pins and damage to the finish and small dents which do not reduce the creepage distances or clearances below the values specified in Section 11 shall be ignored.

4.14 Suspensions, fixings and means of adjustment

4.14.1 Mechanical suspensions, fixings and connections shall have adequate factors of safety.

Compliance is checked by the appropriate tests from the following.

Test A: The fixings of the luminaire to the installation mounting surface and the fixings of other external parts held by the luminaire shall be securely kept in place. The following test is applicable to:

- suspended, fixed luminaire or track-mounted luminaire (ceiling – wall) – tested with four times the weight of the complete luminaire in addition to its weight;*
- external parts fixed to the luminaire (e.g. diffuser, glass, reflector, louvre) – tested with four times the weight of the part being held, in addition to its weight. It is not necessary to test all external parts if compliance with the requirement of 4.14.1 is obvious from available information and by visual inspection for example parts fixed by several screws.*

A constant, evenly distributed load equal to four times the weight either of the luminaire, or of the relevant part, as applicable, shall be added to their fixings in the normal direction of the load for a period of 1 h. There shall be no appreciable deformation of the components of the suspension and fixing system at the end of this period. Where alternative means of fixing or suspension are provided, each shall be tested separately.

Test B: For rigid suspension luminaires: A torque of 2,5 Nm is applied to the luminaires for a period of 1 min, first in a clockwise and then in an anticlockwise direction. For this test, it shall not be possible to rotate the luminaire relative to the fixed part by more than one revolution in either direction.

Test C: For rigid suspension brackets: Details of the test for rigid suspension brackets are as follows.

- a) For heavy-duty brackets (for example workshop brackets), a force of 40 N shall be applied for 1 min, in various directions at the free end, with the bracket arm fixed as in normal use. The bending moment resulting from this test shall be not less than 2,5 Nm. When the test force has been removed, the bracket arm shall not be permanently displaced or deformed so as to endanger safety.*
- b) For light-duty brackets (for example domestic brackets), a similar test to item a) shall be applied for 1 min, but with a force of 10 N, and the bending moment resulting from this test shall be not less than 1,0 Nm.*

Test D: For track-mounted luminaires: The mass of the luminaire shall not exceed the value, recommended by the track manufacturer, of the maximum loading for which the luminaire suspension devices are suitable.

Test E: For clip-mounted luminaires: A pull is applied to the cable without jerk for 1 min in the most unfavourable direction in normal use. During the test, the clip is mounted on standard test "shelves" made of ordinary window glass, one with a nominal thickness of 10 mm and one with the maximum thickness onto which the clip can be mounted. For this test, the thickness of the test shelf is increased by multiples of 10 mm. The clip shall not fall off the glass at a pull of 20 N.

Clip-mounted luminaires shall, in addition, be tested on the metal rod having a polished chromium plated finish and a nominal diameter of 20 mm. The luminaire shall not rotate under its own weight and shall not fall off the rod when a pull of 20 N is applied on the cable. The test on a polished metal rod is not applied to luminaires marked "not suitable for mounting on tubular material".

NOTE 1 The increase in the thickness of the test sheet, by 10 mm steps for the maximum thickness limits the possibility of forcing the clip onto the test shelf.

NOTE 2 The test shelf for a maximum thickness test can comprise layers of glass and wood, provided that the surfaces that are gripped by the clip of the luminaire are of glass.

Provided guidance and/or means is given by the manufacturer for the safe installation and use of a fixed luminaire or independent controlgear without fixing devices (holes, brackets, etc), (see 3.3), this equipment can be regarded as complying with the requirements of this document.

It is not the intention of 4.14.1 to check the mechanical strength of the installation mounting surface. Any damage to the mounting surface is not a failure.

4.14.2 The mass of the luminaire suspended by flexible cables or cords shall not exceed 5 kg per flexible cable or cord. The total nominal cross-sectional area of the conductors of flexible cables or cords suspending pendants shall be such that the stress in the conductors does not exceed 15 N/mm². When more than one flexible cable or cord is used, the mounting instructions shall state all necessary information to prevent any overloading of any cable or cord and ensure the even distribution of the load.

For the calculation of the stress, only the conductors are considered.

When the mass of the luminaire suspended by flexible cables or cords exceeds 5 kg per flexible cable or cord, the design of the luminaire or of the flexible cable or cord shall be such as to prevent any tension being applied to the conductors.

EXAMPLE A cable which incorporates suitable load-carrying cores.

For the semi-luminaires intended for connection to Edison screw or bayonet lampholders, the mass and effective bending moment shall not exceed the maximum value given in Table 4.4. The bending moment is relative to the point of contact, in the fully inserted position, of the semi-luminaire contact(s) with the centre contact of an Edison screw lampholder or the plungers of a bayonet lampholder.

Table 4.4 – Test on semi-luminaires

Lampholders	Luminaires	
	Maximum mass	Maximum bending moment
E14 and B15	1,8 kg	0,9 Nm
E27 and B22	2,0 kg	1,8 Nm
NOTE These values are lower than those to which a lampholder would normally be tested to provide a safety margin.		

Compliance is checked by inspection, by measurements and by calculation.

4.14.3 Requirements for adjusting devices are given below.

- a) Adjusting devices and means of adjustment, for example joints, hoisting devices, adjusting brackets or telescopic tubes, shall be so constructed that cords or cables are not pressed, clamped, damaged or twisted along the longitudinal axis by more than 360° during operation.

If a luminaire has more than one joint the 360° limit applies to each joint if they are not too close together. Each case needs to be judged on its own merits.

Compliance is checked by the following test and inspection:

The adjusting device, equipped with the appropriate cable or cord shall be operated in accordance with Table 4.5. A cycle of operation is a movement from one extreme of the range to the other and back to the starting position. The rate of movement shall not cause the device to heat appreciably and shall not exceed 600 cycles per hour.

For electromechanical contact systems, this test is conducted simultaneously with the electrical connection test of 4.11.6.

During the test the values according to Table 5.2 shall not be exceeded.

After the test, not more than 50 % of the strands in a conductor shall be broken nor shall there be any serious damage to the insulation, if any, of the flexible cord. The cord or cable shall be subjected to, and shall satisfy, the insulation resistance and high-voltage tests specified in Section 10.

Ball-joints and the like, where the clamping means can be adjusted, are tested with the joints only lightly clamped to avoid excessive friction. If necessary, the clamping areas are readjusted during the test.

For adjusting devices that consist of a flexible tube, the range of adjustment for this test is normally 135° in both directions from the vertical. However, where this adjustment cannot be achieved without using unreasonable force, the flexible tube is bent only to the positions where it will remain by itself.

- b) Luminaires with a means of adjustment intended to be installed within arm's reach, shall allow the operation of its intended function without impairing the stability of the luminaire or causing deformation of any part of the construction, nor cause injury due to temperatures above those specified in Table 12.1.

Compliance is checked by manipulating or handling the luminaire, by the means of adjustment as expected to represent normal use and by measurement of the temperatures during the test of 12.4.

- c) For luminaires intended to be mounted within arm's reach, the space surrounding any means of adjustment, except the light beam aperture, up to 5 cm away from the means of adjustment in any direction, shall comply with the temperature limits for the means of adjustment, as specified in Table 12.1. The same temperature limits apply also to any means of adjustment which are lit after the positioning of the luminaire light beam aperture.

Compliance is checked by positioning the luminaire light beam aperture and by measurement of the temperatures during the test of 12.4.

Table 4.5 – Test on adjusting devices

Type of luminaire	Number of cycles of operation
Luminaires intended to be frequently adjusted, for example drawing board luminaires	1 500
Luminaires intended to be occasionally adjusted, for example shop-window spotlights	150
Settable luminaires	45

4.14.4 Cords or cables passing through telescopic tubes shall not be fixed to the outer tube. Means shall be provided for avoiding strain on the conductors at the terminals.

Compliance is checked by inspection.

4.14.5 Guide pulleys for flexible cords shall be dimensioned to prevent damage to the cords by excessive bending. Grooves in the pulleys shall be well rounded, the diameter of the pulley at the bottom of the groove being at least three times the diameter of the cord. With the exception of SELV or PELV supplied luminaires, accessible metal pulleys shall be connected to a protective earth.

Compliance is checked by inspection.

4.14.6 Plug-in independent controlgear and mains socket-outlet mounted luminaire shall not impose undue strain on socket-outlets.

Compliance is checked by the following test. The plug-in independent controlgear or mains socket-outlet mounted luminaire is inserted, as in normal use, into a fixed socket-outlet pivoted about a horizontal axis through the centre lines of the contact tubes at a distance of 8 mm behind the engagement face of the socket-outlet. During this test, the plug-in independent controlgear shall be provided with 1 m of the cable supplying the luminaire in question or a cable specified by the manufacturer. The cable shall be free hanging during the test.

The additional torque which has to be applied to the socket-outlet to maintain the engagement face in the vertical plane shall not exceed 0,25 Nm.

For settable and adjustable mains socket-outlet mounted luminaires, the total torque transmitted to the socket-outlet during adjustment shall not exceed 0,5 Nm.

The socket-outlet used for the test shall have the earth contact (if any) removed unless the socket has shuttered pin receptacles that are uncovered by the action of inserting the earth pin.

4.15 Flammable materials

4.15.1 Covers, shades and similar parts not having an insulation function and which do not withstand the 650 °C glow-wire test of 13.3.2 shall be adequately spaced from any heated part of the luminaire which could raise the material to its ignition temperature. These parts made of flammable material shall have suitable fastenings or supporting devices to maintain this spacing.

The spacing from heated parts mentioned above shall be at least 30 mm, unless the material is protected by a screen spaced at least 3 mm from the heated parts. This screen shall comply with the needle-flame test of 13.3.1, shall have no holes, and shall have a height and a length at least equal to the corresponding dimensions of the heated parts. A screen is not required in cases where the luminaire provides an effective barrier to burning drops.

NOTE The requirements of 4.15.1 are illustrated in Figure 4.

Materials which burn fiercely, such as celluloid, shall not be used.

The requirements of 4.15.1 do not apply to small parts such as wiring clips and resin-bonded paper parts used inside the luminaire.

Spacing is not required from electronic circuits if, under abnormal conditions, the operating current does not exceed normal conditions current by more than 10 %.

Spacing is not required from parts of luminaires incorporating a temperature sensing control which provides protection against overheating of the covers, shades or similar parts.

The requirements of 4.15.1 do not apply to a transformer supplied within an enclosure of its own, that is IP20 or higher, complying with the relevant part of IEC 61558 or with IEC 60989.

Compliance is checked by inspection, by measurement and by operating the luminaire in the abnormal condition with a slowly and steadily increasing current through the windings of the ballast or transformer, until the temperature sensing control operates. During and after this test, covers, shades and similar parts shall not catch fire and accessible parts shall not become live.

To check whether accessible parts have become live, a test in accordance with Annex A is made.

4.15.2 Luminaires made of thermoplastic materials shall withstand temperature rises due to fault conditions in ballasts/transformers and electronic devices, so that no danger occurs when mounted as in normal use.

This requirement shall be met by one of the following measures.

- a) Constructive measures ensuring that:
 - during failure conditions, the components are kept in place, for example by mechanical temperature-independent supports;
 - luminaire parts cannot be overheated in such a way that live parts can become accessible.

Compliance is checked by inspection and/or the test of 12.7.1.

- b) The use of a temperature sensing control to limit the temperature of the ballast/transformer and electronic device fixation points and exposed parts of the luminaire to a safe value. The temperature sensing control may be either an auto-reset thermal cut-out, a manual-reset thermal cut-out, or a thermal link.

Compliance is checked by the test of 12.7.2.

- c) The thermoplastic materials used for the luminaires shall be suitable for the maximum surface temperature permitted by the use of thermally protected ballasts complying with the relevant controlgear standard.

Compliance shall be checked by the test of 12.7.2.

4.16 Luminaires for mounting on normally flammable surfaces

Luminaires classified as suitable for mounting on a normally flammable surface shall comply with one of the following requirements of 4.16.1, 4.16.2 or 4.16.3.

NOTE 1 Annex N gives guidance on when to use the symbols and warnings.

The requirements of Clause 4.16 are not applicable to a transformer supplied within an enclosure of its own, i.e. IP20 or higher complying with IEC 61558 (all parts). For shaver transformers or shaver supply units incorporated in a luminaire and complying with IEC 61558-2-5, the requirements of 4.16.1 apply. Electronic lamp controlgear and small wound devices that may be incorporated into these components are exempt from the requirements of Clause 4.16.

NOTE 2 Examples of small wound devices are windings having ferrite or non-laminated cores, these being normally mounted on a printed circuit board.

For luminaires incorporating lamp controlgear, compliance with this requirement shall be met by spacing the lamp controlgear from the mounting surface in accordance with 4.16.1, or by the use of thermal protection in accordance with 4.16.2, or by compliance with 4.16.3.

For luminaires that do not contain lamp controlgear, the requirements are met by compliance with Section 12.

Because of their application, luminaires which are provided with an adaptor for mounting on a track shall meet the requirements for direct mounting on normally flammable surfaces.

4.16.1 The lamp controlgear shall be spaced from the mounting surface by a minimum distance of either:

- a) 10 mm, including the thickness of the luminaire case material when the spacing includes a minimum of 3 mm air space between the outer surface of the luminaire case and the mounting surface of the luminaire in the region of the lamp controlgear, and a minimum of 3 mm air space between the lamp controlgear case and the inner surface of the luminaire case. If there is no controlgear case, the distance of 10 mm shall apply from the active part, for example windings of the lamp controlgear.

The luminaire case should be continuous in the projected area of the lamp controlgear to prevent a direct path of less than 35 mm between an active part of the lamp controlgear and the mounting surface, otherwise the requirement of item b) applies.

or

- b) 35 mm.

NOTE The spacing of 35 mm is primarily to take into account stirrup-mounted luminaires where the lamp controlgear to the mounting surface distance is often much greater than 10 mm.

In both instances, the luminaire shall be so designed that any necessary air space is automatically obtained when it is mounted as in normal use.



Compliance is checked by inspection and by measurements.

4.16.2 The luminaire shall incorporate a temperature sensing control to limit the temperature of the mounting surface of the luminaire to a safe value. This temperature sensing control may be either external to the lamp controlgear or be part of a thermally protected lamp controlgear in accordance with the relevant controlgear standard.

The temperature sensing control may be either a self-resetting thermal cut-out, a manual reset thermal cut-out or a thermal link (a thermal cut-out which operates only once and then requires replacement).

A temperature sensing control external to the lamp controlgear shall not be of the plug-in type or an otherwise easily replaceable type. It shall be kept in a fixed position with regard to the ballast/transformer.

Compliance is checked by inspection and by the test of 12.6.2.

The requirements of 4.16.2 are deemed to be complied with for luminaires incorporating "class P" thermally protected ballast/transformer(s), marked with the symbol , and temperature declared thermally protected ballast/transformer(s), symbol  with a marked value equal to or below 130 °C, in accordance with the relevant auxiliary standard, without any further tests.

Luminaires incorporating ballast/transformer(s) without the symbol for thermally protected ballasts or with a marked value above 130 °C shall comply with the requirements of 4.16.1 or 4.16.3.

4.16.3 If the luminaire does not comply with the spacing requirements of 4.16.1, and does not incorporate thermal cut-outs in accordance with 4.16.2, it shall be so designed that it satisfies the test of 12.6.

NOTE This requirement and its test are based on the assumption that, during failure of the ballast/transformer, for instance owing to short-circuited windings or a short-circuit to the case, the ballast/transformer winding will not exceed 350 °C for a duration of more than 15 min and therefore that the temperature of the mounting surface will not exceed 180 °C for a duration of more than 15 min.

4.17 Drain holes

Drip-proof, rain-proof, splash-proof and jet-proof luminaires shall be so designed that if water accumulates in the luminaire it can drain out effectively, for example by opening one or more drain holes. Watertight luminaires shall have no provision for draining.

Compliance is checked by inspection and by the tests of Section 9.

NOTE A drain hole in the back of a luminaire for surface mounting is effective only if the design ensures a clearance of at least 5 mm from the mounting surface, for example, by means of projections from the back.

4.18 Resistance to corrosion

NOTE Since the tests of 4.18 and Annex F may be destructive, they can be carried out on separate samples in accordance with 0.4.2.

4.18.1 Ferrous parts of drip-proof, rain-proof, splash-proof, jet-proof, watertight and pressure-watertight luminaires, the rusting of which might cause the luminaire to become unsafe, shall be adequately protected against rusting.

Compliance is to be checked by the following test.

All grease is removed from the parts to be tested. The parts are then immersed for 10 min in a 10 % solution of ammonium chloride in water at a temperature of $20\text{ }^{\circ}\text{C} \pm 5\text{ }^{\circ}\text{C}$. Without drying, but after shaking off any drops, the parts are placed for 10 min in a box containing air saturated with moisture at a temperature of $20\text{ }^{\circ}\text{C} \pm 5\text{ }^{\circ}\text{C}$.

After the parts have been dried for 10 min in a heating cabinet at a temperature of $100\text{ }^{\circ}\text{C} \pm 5\text{ }^{\circ}\text{C}$, their surfaces shall show no signs of rust.

NOTE Traces of rust on sharp edges and any yellowish film removable by rubbing are ignored.

For small helical springs and the like, and for inaccessible parts exposed to abrasion, a layer of grease may provide sufficient protection against rusting. Such parts are subjected to the test only if there is doubt about the effectiveness of the grease film, and the test is then made without previous removal of the grease.

4.18.2 Contacts and other parts made of rolled copper or copper alloy sheet, the failure of which might cause the luminaire to become unsafe, shall be free from stress corrosion.

Compliance is checked by the test given in Annex F which shall be made on samples not subjected to any other test.

4.18.3 Parts of aluminium or aluminium alloy in drip-proof, rain-proof, splash-proof, jet-proof, watertight and pressure-watertight luminaires, shall be resistant to corrosion, if the luminaire might otherwise become unsafe.

NOTE Guidance on resistance to corrosion is given in Annex L.

4.19 Ignitors

Ignitors used in luminaires shall be electrically compatible with the associated ballast in the luminaire.

Compliance is checked by inspection.

4.20 Rough service luminaires – Vibration requirements

Rough service luminaires shall have adequate resistance to vibrations.

Compliance is checked by the following vibration test (as specified in IEC 60068-2-6).

The luminaire is fastened in its most onerous but normal position of installation to a vibration generator.

The direction of vibration is in the most onerous direction and the severity is:

<i>duration:</i>	<i>30 min,</i>
<i>amplitude:</i>	<i>0,35 mm,</i>
<i>frequency range:</i>	<i>10 Hz, 55 Hz, 10 Hz,</i>
<i>sweep rate:</i>	<i>approximately one octave per minute.</i>


After the test, the luminaire shall have no loosened parts which could impair the safety.

4.21 Protective shield

4.21.1 Because of the possible risk of lamp shattering, luminaires designed for tungsten halogen lamps and luminaires designed for metal halide lamps shall be fitted with a protective shield. For tungsten halogen lamps, the shield shall be of glass.


Luminaires designed to be used with self-shielded lamps only are exempt from this requirement, but shall be marked with the appropriate symbol (see Figure 1).

NOTE 1 Lamps needing a protective shield as part of the luminaire construction are supplied with an appropriate cautionary notice or their packaging is marked with the symbol shown hereafter:



[SOURCE: IEC 60417-6071:2011-09 – Caution, unprotected lamp]

NOTE 2 For lamps not needing a protective shield as part of the luminaire construction (self-shielded lamps) their packaging is marked with the symbol shown hereafter:



[SOURCE: IEC 60417-6030:2009-11 – Self-shielded lamp, general]

4.21.2 Parts of the lamp compartment shall be so designed that particles from a shattering lamp cannot impair safety.

4.21.3 All openings in the luminaire shall be such that no parts of a shattered lamp can leave the luminaire by a direct path (direct line of sight), including the rear of recessed luminaires.

4.21.4 Compliance with 4.21.1 to 4.21.3 is checked by inspection and by the following tests:

- the protective shield shall comply with the impact test of 4.13.1 with the impact energy of Table 4.3 for fragile parts. In case the mounting means of the glass shield is solely designed to withstand impacts from the inside, the test of 4.13.1 should be performed in that direction if possible;
- parts of the lamp compartment, if of insulating material, shall comply with the resistance to flame and ignition test of 13.3.2.

NOTE 1 This is intended to improve safety by eliminating the hazards due to chance failure of a lamp or incorrect application. Existing open luminaires not fitted with a protective shield do not necessarily present a hazard.

NOTE 2 The impact test of 4.13.1, which is performed from the outside, is regarded to be more severe than the impacts of glass particles. A specific test simulating the latter is therefore not necessary.

4.22 Attachments to lamps

Luminaires shall not incorporate attachments to lamps which might cause overheating or damage to the lamps, lamp caps or holders, luminaires or attachments.

Attachments to fluorescent lamps are only allowed if supplied or approved by the luminaire manufacturer. The total weight of the lamp plus attachment shall not exceed:

- 200 g for lamps with cap G5, and
- 500 g for lamps with cap G13.

Compliance is checked by inspection, by weighing and by thermal measurements, if appropriate.

NOTE Examples of attachments to incandescent lamps which might not comply with these requirements are bowl mirror reflectors, reflectors around lamps. Examples which might be permitted are springs for attachment of lightweight shades to lamps and similar devices.

4.23 Semi-luminaires

Semi-luminaires shall comply with all relevant requirements for class II luminaires.

NOTE The class II symbol is omitted to avoid it being considered as applying to the complete luminaire in which the semi-luminaire is used.

4.24 Photobiological hazards

4.24.1 UV radiation

Luminaires designed for tungsten halogen lamps and luminaires designed for metal halide lamps shall not emit excessive UV radiation when used with the lamp. For self-shielded lamps, this requirement is met by the lamp design.

For tungsten halogen lamps and most metal halide lamps, when needing a protective shield, any glass will reduce the UV radiation to a sufficiently low level.

See IEC 60432-3 and IEC 62035 for lamp marking.

For some metal halide lamps, emitting a high level of radiation, Annex P describes methods to provide adequate shielding for UV radiation by the luminaire.

NOTE See Annex P, procedure A or B for method of calculation to provide effective radiation shielding.

4.24.2 Retinal blue light hazard

Luminaires with light sources, where the safety standard does not exclude the lamp from retinal blue light hazard assessment, shall be assessed according to IEC TR 62778.

The use of light sources with a blue light risk group rating greater than RG2 is not expected. Additional more onerous requirements for the management of these types of light sources would need to be applied.

NOTE 1 At the present time, the only light source types where a blue light hazard needs to be considered are: LED; metal halide and some specialist tungsten halogen types.

NOTE 2 Requirements for luminaires using RG3 light sources are not yet developed because these products are not generally available on the market. Further requirements will be developed if needed in the future.

For luminaires using light sources not exceeding RG1 unlimited rating in accordance with IEC TR 62778, and for luminaires fully assembled for use which have been assessed as not exceeding RG1, under the same conditions, no requirements for retinal blue light hazard apply.

For luminaires having a threshold illuminance E_{thr} assessed in accordance with IEC TR 62778 the following requirements apply.

- a) For fixed mounted luminaires, an additional assessment in accordance with IEC TR 62778 shall be made to find the distance x m between the luminaire and the borderline between RG2 and RG1. The luminaire shall be marked and have instructions in accordance with 3.2.23 of this document.
- b) Portable and handheld luminaires exceeding RG1 at 200 mm assessed in accordance with IEC TR 62778 are required to be marked in accordance with 3.2.23 of this document.

NOTE 3 Where applicable, blue light hazard information is provided for the light source as required by the light source safety standard.

NOTE 4 In some luminaire designs e.g. luminaires with integral light sources, it can be necessary for the complete luminaire to be tested.

NOTE 5 The manufacturers' declared photometric data for the luminaire can be used as the basis for the assessment detailed under item 'a'.

Portable luminaires for children, covered by IEC 60598-2-10, and mains socket-outlet nightlights, covered by IEC 60598-2-12, shall not exceed RG1 at 200 mm, in accordance with IEC TR 62778.

NOTE 6 Future amendments specific to IEC 60598-2-10 and IEC 60598-2-12 in this respect will follow.

4.25 Mechanical hazard

Luminaires shall have no sharp points or edges that could, during installation, normal use, or maintenance, create a hazard for the user.

Compliance is checked by inspection.

4.26 Short-circuit protection

4.26.1 Adequate means shall be provided to prevent the impairing of safety due to unintended short-circuiting of uninsulated accessible SELV or PELV parts of opposite polarity.

NOTE Class III luminaires supplied from a separate unspecified SELV or PELV supply can have one conductor insulated. Where insulation is not provided, the luminaire manufacturer can declare the maximum VA output and type reference of the SELV or PELV source, and the test in 4.26.2 can be conducted with this transformer/converter.

4.26.2 A type test sample is operated at 0,9 to 1,1 times its rated voltage with its nominal load. In case the supply source is an ES1 PSE, no short-circuit is needed. A test chain as

specified in 4.26.3 is hung over accessible uninsulated SELV or PELV parts. The test chain shall form the shortest possible path by being loaded at each end, subject to a maximum of 250 g with a weight equal to:

$$(15 \cdot X) \text{ g}$$

where 'X' is the distance between conductors in the unloaded state, in centimetres.

The test chain shall not melt through, nor shall any part of the type test sample reach a temperature exceeding the values of Tables 12.1 and 12.2.

4.26.3 Test chain: A chain of sufficient length of an uncoated metal, having links in accordance with Figure 29 and made of 63 % Cu/37 % Zn. The chain shall have a resistance value of 2,5 Ω /m with a tolerance of ± 20 % when stretched with a load of 200 g/m. The resistance value of the test chain should be checked before each measurement.

4.27 Terminal blocks with integrated screwless protective earthing contacts

Terminal blocks with integrated screwless protective earthing contacts shall be mounted in accordance with the requirements specified by the manufacturer with reference to Annex V.

Compliance is checked by inspection.

4.28 Fixing of thermal sensing controls

Any temperature sensing control external to the lamp controlgear shall not be of the plug-in or an otherwise easily replaceable type. It shall be reliably kept in its specified position with regard to the controlgear.

Adhesive fixing of temperature sensing controls shall not be used where UV radiation emitted from a lamp could degrade the reliability of the fixing during the life of the luminaire. Temperature sensing controls shall not be mounted outside of the luminaire enclosure.

Compliance is checked by inspection and, for temperature sensing controls with adhesive fixing, according to the following test.

The temperature sensing control, together with the ballast/transformer to which it is fixed, is subjected to the temperature change test in accordance with IEC 60068-2-14:2009, test Na, according to the following details.

The specimen shall be subjected to 100 cycles between the minimum and the maximum values as given below.

The maximum temperature is the temperature measured on the adhesive material when the ballast/transformer is loaded by a current equal to 0,95 times the value of the lowest current that causes the protective device to operate in steady state conditions;

The minimum test temperature is 0°C.

The duration of exposure of the two temperatures is 30 min each.

As specified in IEC 60068-2-14:2009, the standard transfer time is between 2 min and 3 min. A transfer time (t_2) of less than 30 s is allowed, if an automatic test system is used

During the test the temperature sensing control shall not undergo any change in fixing impairing its further use, especially with respect to its operating temperature. After the test, the temperature sensing control shall not be detached/moved from its designed position.

Transformers complying with IEC 61558 (all parts) are not subjected to this test.

4.29 Luminaire with non-replaceable light source

It shall not be possible to replace and/or to give access to live parts without breaking the luminaire or its parts.

Compliance is checked by the following test.

Parts of the luminaire giving access to the light source which is possible to open by hand or by using a tool shall be opened or dismantled.

Parts of the luminaire which are sealed, or glued, or fixed by screws which are designed and shaped to be used only once, or permanently embedded barriers, are not opened.

After removing all parts as detailed above, it shall not be possible to access live parts as checked with the test probe and test method according to Section 8.

4.30 Luminaires with non-user replaceable light sources

Where a protective cover is used over a non-user replaceable light source to provide protection against electric shock, and the cover is marked with the 'caution, electric shock risk' symbol detailed in 3.2.24, the cover shall be left in place during the tests and inspections detailed in Sections 7 and 8. The cover shall be held securely in position by at least one fixing means requiring the use of a tool for its removal.

4.31 Insulation between circuits

Luminaires incorporating transformers or controlgear providing insulation between circuits and luminaire using circuits insulated from an LV supply, shall provide suitable insulation between circuits and between these circuits and the external accessible conductive parts.

The same requirements apply to the circuits connected to the control terminals of a controllable luminaire where it is required to maintain the same level of insulation for all components. On the evaluation of the type of circuit to be considered, the information given by the controlgear manufacturer (see 7.1.k) of IEC 61347-1:2015 and IEC 61347-1:2015/AMD1:2017) shall be taken into account.

NOTE At present on the market the following types of control systems are available:

- FELV control signal, basic insulated to LV supply (e.g. Digital Addressable Lighting Interface and 1–10 V DC controls);
- SELV/PELV control signal, (e.g. DMX);
- control signal, not insulated to LV supply (e.g. Push button control / phase cut / step dim).

Compliance is checked by the following requirements.

4.31.1 SELV or PELV circuits

The following sources may be used to supply SELV or PELV circuits:

- a safety isolating transformer in accordance with IEC 61558-2-6 or equivalent Part 2 of IEC 61558;
- a controlgear providing SELV or PELV in accordance with IEC 61347 (all parts);
- an electrochemical source (e.g. a battery) or another source independent of a higher voltage circuit;
- a PSE providing ES1 in accordance with IEC 62368-1, fulfilling the requirements of IEC 62368-3:2017.

NOTE By using connectors in accordance with IEC 62680 (all parts) or IEC 60603 (all parts) the system will fulfil the requirements of SELV by default.

PELV circuits shall have one pole connected to earth for functional purposes. The connection between the PELV circuit and the earth (wire, PCB track) shall fulfil the requirements for functional earth.

The voltage in the circuits shall not be higher than the limits defined for ELV.

SELV or PELV circuits shall be insulated from the LV supply by double or reinforced insulation (based upon a working voltage equal to LV supply voltage).

SELV or PELV circuits shall be insulated from other non SELV or PELV circuits (excluding FELV) by double or reinforced insulation (based upon a working voltage equal to the highest voltage in the circuits).

SELV or PELV circuits shall be insulated from FELV circuits by supplementary insulation (based upon a working voltage equal to the LV supply voltage).

SELV or PELV circuits shall be insulated from other SELV or PELV circuits by basic insulation (based upon a working voltage equal to the highest voltage in the circuits).

SELV or PELV circuits shall be insulated from accessible conductive parts by an insulation according to Table X.1.

In the case of controlgear in accordance with IEC 61347 (all parts), the SELV or PELV voltage to be considered for insulating purposes is the maximum output voltage indicated on the controlgear as "U-OUT".

Compliance is checked by inspection and by the test required in Sections 8, 10 and 11.

Plugs and socket-outlets in SELV or PELV systems shall comply with the following requirements:

- plugs shall not be able to make any electrical contact with socket-outlets of other voltage systems;
- socket-outlets shall not admit plugs of other voltage systems;
- plugs and socket-outlets in SELV systems shall not have a protective conductor contact.

Compliance is checked by inspection and test.

4.31.2 FELV circuits

The following sources may be used to supply FELV circuits:

- a separating transformer in accordance with IEC 61558-2-1 or equivalent Part 2 of IEC 61558;
- a separating controlgear providing basic insulation between input and output circuits in accordance with IEC 61347 (all parts);
- an electrochemical source (e.g. a battery) or another source in circuit separated by the LV supply by basic insulation only.

The voltage in the circuits shall not be higher than the limits defined for ELV.

FELV circuits shall be insulated from the LV supply by at least basic insulation (based upon a working voltage equal to the LV supply voltage).

It is not required that FELV circuits shall be insulated from protective earth circuit except for functional purposes.

FELV circuits shall be insulated from accessible conductive parts by an insulation according to Table X.1.

Compliance is checked by inspection and by the tests required in Sections 8, 10 and 11.

Plugs and socket-outlets for FELV systems shall comply with the following requirements:

- plugs shall not be able to make any electrical contact with socket-outlets of other voltage systems;
- socket-outlets shall not admit plugs of other voltage systems;
- socket-outlets shall have a protective conductor contact.

Compliance is checked by inspection and test.

4.31.3 Other circuits

The insulation between circuits other than SELV, PELV or FELV and accessible conductive parts shall be in accordance with the requirements in Table X.1.

In class II construction, where equipotential bonding is used for the protection against indirect contacts with live parts (see Table X.1), the following requirements are applicable.

- All conductive parts are connected together so that two failures of the insulation result in a short circuit.
- To check whether the conductive parts are reliably connected together, the test in 7.2.3 (earth continuity test with 10 A) has to be carried out.
- In case of an insulation fault between live parts and accessible conductive parts, the conductive part shall not become a part that can cause an electric shock according to Annex A.
- For master/slave applications (the controlgear is mounted in the master luminaire and supplies the slave luminaires) an equipotential bonding between the luminaires shall be used to prevent dangerous voltages between accessible luminaires. For this reason a master luminaire shall be provided with a terminal to connect the accessible conductive parts of the slave luminaires and the slave luminaires shall be constructed as class I luminaires.

Compliance is checked by applying the requirements of this document to check the insulation required in Annex X.

NOTE Examples of this kind of circuits are:

- output circuits of ballast in accordance with IEC 61347 (all parts),
- circuits supplied by isolating transformer in accordance with IEC 61558-2-4 or equivalent,
- circuits supplied by separating transformers in accordance with IEC 61558-2-1 which do not fulfil the requirements for FELV,
- circuits supplied by separating controlgear (other than FELV) and isolating controlgear in accordance with IEC 61347 (all parts).

4.32 Overvoltage protective devices

Overvoltage protective devices shall comply with IEC 61643-11. Overvoltage protective devices which are external to controlgear and connected to earth, shall be used only in fixed luminaires and connected only to a protective earth.

4.33 Luminaire powered via information technology communication cabling

A luminaire powered via information technology communication cabling shall fulfill the requirements for class III.

The rated voltage of the luminaire shall be within the range of ES1 and shall not exceed the maximum voltage related to the used connector.

NOTE 1 Indoor use is expected to be the main application for luminaires powered via information technology communication cabling, however when used in other applications, additional requirements for outdoors and IP rating might be needed.

The luminaire shall be designed to be in line with the limits of the electrical parameters of a PSE. Information regarding the limits of a PSE is given in Annex Y.

The luminaire shall not create any hazard when supplied with

- 130 % of the rated input voltage of the luminaire at the relevant input port for circuits greater than 5 V_{DC}, with a minimum of 7,5 V_{DC} and
- 150 % of the rated input voltage of the luminaire at the relevant input port for circuits equal to/less than 5 V_{DC}.

Any consequential failure of components in the luminaire shall not create a hazard.

NOTE 2 This fault condition in the PSE is an abnormal condition for the luminaire.

Compliance is checked by the tests in Section 12.

4.34 Electromagnetic fields (EMF)

Luminaires shall not produce harmful electromagnetic fields.

Compliance is checked according to IEC 62493:2015.

NOTE Subclause 4.2.2 of IEC 62493:2015 details common types of luminaire constructions that are deemed to comply with the requirements of this EMF standard without the need for testing.

4.35 Protection against moving fan blades

Motor driven fan blades for active cooling of luminaires shall not be accessible when the luminaire has been installed and wired as in normal use, and when it is opened as necessary for replacing replaceable light sources or (replaceable) components. The test is carried out with a standard test finger (probe B according to Figure 2 of IEC 61032:1997), when inserted into openings with a force of 30 N. For portable luminaires test probe 19 according to Figure 13 of IEC 61032:1997 shall be used for this test. This test is not carried out for fans that have leading edges and tips rounded with a radius of not less than 0,5 mm and:

- if they have a hardness less than D60 Shore, or
- if they have a peripheral speed less than 15 m/s when supplied at rated voltage, or
- if the fan has an input power not exceeding 2 W when supplied at rated voltage.

NOTE D60 is referenced in ISO 48-4:2018.

Compliance with this requirement is checked by inspection and if necessary by testing with the relevant test probe. The test probe shall be applied in every possible position with the specified force. No contact to the fan blade shall be made.

4.36 Track-mounted luminaires

Additionally, track-mounted luminaires shall be tested in accordance with Annex A of IEC 60570:2003/AMD2:2019.

SECTION 5: EXTERNAL AND INTERNAL WIRING

5.1 General

This section specifies general requirements for the electrical connections to a supply and for the internal wiring of luminaires.

5.2 Supply connection and other external wiring

5.2.1 Luminaires shall be provided with one of the following means of connection to the supply:

a) fixed luminaires:

- devices for the connection of luminaires;
- terminals; plugs for engagement with socket-outlets;
- connecting leads (tails);

Where the luminaire is delivered with connecting leads (tails) and without a means of connection to the supply, the manufacturer of the luminaire shall specify which terminal block may be used which shall conform to IEC 60998-2-1 or IEC 60998-2-2; either the terminal block to be used shall be specified or the following shall be defined:

- the type of terminal (screw/screwless);
- number of terminals;
- rated voltage;
- rated connecting capacity;
- any necessary preparation of the ends of conductors
- any fixing method.

The requirements of Clause 4.6, 4.7.1, 4.7.2, 4.10.1, Clause 11.2, Section 12 and Clause 13.2 shall apply.

- supply cords;
- adapters for engagement with supply tracks;
- appliance inlets;
- installation couplers;
- class III luminaires where the power supplied via information technology communication cabling having the appropriate connectors, for instance plugs described in IEC 60603 (all parts) and IEC 62680 (all parts);

b) portable luminaires

- supply cords; with plugs; appliance inlets;
- class III luminaires where the power supplied via information technology communication cabling having the appropriate connectors, for instance plugs described in IEC 60603 (all parts) and IEC 62680 (all parts);

c) track-mounted luminaires

- adaptors or connectors;

d) semi-luminaires

- Edison screw or bayonet cap.

Portable luminaires intended for wall mounting and incorporating a junction box and cord anchorage may be delivered without a supply cord, if instructions for mounting are enclosed with the luminaire.

Luminaires declared by the manufacturer to be suitable for use outdoors shall not have PVC-insulated external wiring. This requirement is not applicable to Class III or SELV or PELV circuits in luminaires (up to 25 V AC/60 V DC/25 V peak interrupted DC voltage with a frequency between 10 Hz and 200 Hz) and to external wiring that is protected from the outdoor environment by other means, for example wiring between the lamp compartment and the connection to the incoming main supply inside (in its whole length) a lighting column.

NOTE 1 In Australia, Austria and Japan, PVC insulated cables are acceptable for outdoor use.

NOTE 2 A wall mounted luminaire can be portable if it is fixed to its support by means of a wing screw, a clip or a hook (see 1.2.9).

NOTE 3 In some countries, luminaires intended to be connected to the supply via a socket-outlet need to be fitted with the supply cord and appropriate plug.

5.2.2 Supply cords used as a means of connection to the supply, when supplied by the luminaire manufacturer, shall be at least equal in their mechanical and electrical properties to those specified in IEC 60227 (all parts) and IEC 60245 (all parts), as indicated in Table 5.1, and shall be capable of withstanding, without deterioration, the highest temperature to which they may be exposed under normal conditions of use.

Materials other than polyvinyl chloride and rubber are suitable if the above requirements are met, but in such cases, the particular specifications of IEC 60227-2 and IEC 60245-2 do not apply.

Unsheathed basic insulated conductors shall be subjected to the electric strength test specified in Section 10 for SELV or PELV (500 V).

Table 5.1 – Supply cord

Luminaire	Rubber	PVC	No insulation
Ordinary class I luminaires	60245 IEC 89 ^c	60227 IEC 52 ^c	
Ordinary class II luminaires	60245 IEC 53 ^c	60227 IEC 52 ^c	
Luminaires other than ordinary class I and II	60245 IEC 57 ^c	60227 IEC 52 ^{a c}	
Portable rough service luminaires	60245 IEC 66 ^c		
Class III or with SELV or PELV circuits luminaires AC: $U \leq 25 \text{ V}$ DC: $U \leq 60 \text{ V}$ Interrupted DC voltage for frequencies between 10 Hz and 200 Hz: $\leq 25 \text{ V peak}$			Uninsulated conductor ^b
Class III or with SELV or PELV circuits luminaires AC: $25 \text{ V} < U \leq 50 \text{ V}$ DC: $60 \text{ V} < U \leq 120 \text{ V}$	Unsheathed basic insulated conductor		
^a For indoor use only.			
^b In accordance with IEC 60364 (all parts) uninsulated conductors are not allowed in certain special installations and locations e.g. IEC 60364-7-701 "Locations containing a bath or shower".			
^c For supply voltages greater than 250 V, higher voltage grade cables and cords than those given in this table may be necessary.			

To provide adequate mechanical strength, the nominal cross-sectional area of the conductors of external wiring, for example supply cord and inter-connecting cables, shall be not less than specified in Table 5.3.

Table 5.3 – Wiring dimension

Condition	Minimum nominal conductor cross-section (mm ²) ⁱ	
	Ordinary luminaire	Other than ordinary luminaire
General	0,75	1,0
Declared to be "For indoor use only", in accordance with 3.3.18.	0,75	0,75
When luminaire is provided with a 10/16 A socket-outlet.	1,5	1,5
Class III luminaires or SELV or PELV circuits connections between parts of other luminaire types, with 2 A maximum rated current.	0,4 ^{a,c}	0,4 ^{a,c}
Class III luminaires or SELV or PELV circuits connections between parts of other luminaire types, with 2 A maximum rated current, consisting of cables with two or more conductors.	0,2 ^{a,b,c}	0,2 ^{a,b,c}
Conductors connected to SELV or PELV controlgear that limits output current to maximum 2 A.	< 0,2 (No minimum) ^{d,e,g,h}	< 0,2 (No minimum) ^{d,f,g,h}
^a Provided that current-carrying capacity and mechanical properties are adequate. ^b Able to withstand the normal and short circuit current provided by the associated controlgear. ^c Compliance is checked by inspection and by the test in 5.2.10. ^d Selected in relation to the maximum available current, compliance is checked by the test in 5.4.1. ^e Controlgear output voltage under load does not exceed 25 V RMS or 60 V ripple free DC and no-load voltage does not exceed 35 V peak or 60 V ripple free DC. ^f Controlgear output voltage not exceeding 12 V RMS or 30 V ripple free DC. ^g To check mechanical properties, the conductor assembly, fixed to the luminaire, shall be subjected to the test in 5.2.10.3. ^h The minimum insulation thickness shall be selected to withstand the voltage stress occurring, see Table X.1. ⁱ IEC 60228 specifies that the requirement associated with the nominal conductor cross-section is a maximum resistance value, not a physical measure of the area. For nominal sizes of 0,5 mm ² and above, these values are listed in IEC 60228. For lower cross-sections the resistance value needs to be calculated accordingly.		

If the luminaire is provided with a 10/16 A socket-outlet, the flexible conductor nominal cross-section area shall be at least 1,5 mm².

External cables of Class III luminaires or SELV or PELV circuits in luminaires, or those used for SELV or PELV connections between parts of other luminaire types, with a maximum rated current not exceeding 2 A, may have a cross-sectional area of less than 0,75 mm² or 1,0 mm², but not less than 0,4 mm², provided that the current-carrying capacity and mechanical properties are adequate. Cables provided with two or more conductors may have a cross-sectional area of each conductor of minimum 0,2 mm² if the cable can withstand the normal and short circuit current provided by the associated controlgear.

Compliance is checked by inspection and by the test in 5.2.10

5.2.3 Where the supply cord is provided with the luminaire, it shall be connected to the luminaire by one of the following methods:

- type X attachment;
- type Y attachment;
- type Z attachment.

5.2.4 *Compliance with the requirements of 5.2.1 to 5.2.3 is checked by inspection and, if necessary, by fitting the appropriate flexible cable or cord.*

5.2.5 Terminations within luminaires utilizing type Z attachment shall not be made by means of screwed connections.

5.2.6 Cable entries shall be suitable for the introduction of the conduit or the protective covering of the cable or flexible cord so that the cores are completely protected, and they shall provide the degree of protection against dust or moisture in accordance with the classification of the luminaire, when the conduit, cable or flexible cord is fitted.

5.2.7 Cable entries through rigid materials for external flexible cables and cords shall have smoothly rounded edges of minimum radius 0,5 mm.

Compliance with the requirements of 5.2.5 to 5.2.7 is checked by inspection and by manual tests.

5.2.8 If, in class II luminaires, in settable and adjustable luminaires or in portable luminaires other than those for wall mounting, a flexible cable or cord where entering or leaving the luminaire passes through accessible metal parts or through metal parts in contact with accessible metal parts, the opening shall be provided with a tough bushing of insulating material having smoothly rounded edges, so fixed that it cannot easily be removed. Bushings of material likely to deteriorate with age shall not be used in openings with sharp edges.

NOTE 1 The term "easily removable bushing" is used to describe a bushing which can be pulled out of its mounting by movement of the luminaire during its life or by inadvertent handling of the luminaire. Examples of accepted fixings include use of lock-nut, appropriate adhesive such as self-hardening resin, or properly sized push-fits.

NOTE 2 An example of materials known for deterioration with age is natural rubber.

If tubes or other guards are provided for the protection of flexible cables or cords at the entry to the luminaire, they shall be of insulating material.

Helical metal springs and similar components, even when covered with insulated material, are not guards.

Compliance is checked by inspection.

5.2.9 Bushings which screw into the luminaire shall be locked in position. If bushings are fixed with an adhesive, it shall be of the self-hardening resin type.

Compliance is checked by inspection.

5.2.10 Unless meeting the requirements of 5.2.10.4, luminaires provided with or designed for use with a supply cord or other external flexible cable or cord shall have a cord anchorage such that the conductors are relieved from strain, including twisting, where they are connected to the terminals, and such that their covering is protected from abrasion. It shall be clear how the relief from strain and the prevention of twisting is intended to be effected. For luminaires supplied without a cable or cord, suitable test cables or cords of the largest and smallest sizes recommended by the luminaire manufacturer shall be used for the tests.

It shall not be possible to push the flexible cable or cord into the luminaire to such an extent that the cable or cord is subjected to undue mechanical or thermal stress. Methods such as tying the cable or cord into a knot or tying the ends with string shall not be used.

Cord anchorages shall be of insulating material or be provided with a fixed insulating lining if an insulation fault on the cable or cord could make accessible metal parts live.

5.2.10.1 Cord anchorages for type X attachment cord shall be constructed and located such that:

- a) at least one part is fixed to, or is integral with, the luminaire;

NOTE A cord anchorage is described as fixed to or held by the luminaire if this is actually the case when the wiring is inserted and the luminaire is completely assembled.

- b) they are suitable for the different types of supply cord that are appropriate for connecting to the luminaire, except where the luminaire allows only one type of cable or cord to be fitted;
- c) they do not damage the supply cord and they are unlikely to be damaged when they are tightened or loosened in normal use;
- d) the whole supply cord with its covering, if any, is capable of being mounted into the cord anchorage;
- e) the supply cord does not touch clamping screws of the cord anchorage if these screws are of metal and are accessible or electrically connected to accessible metal parts;
- f) the supply cord is not clamped by a metal screw which bears directly on the cable or supply cord;
- g) replacement of the supply cord does not require the use of a tool specially designed for the purpose.

Glands shall not be used as cord anchorages in portable, settable or adjustable luminaires, unless they have provision for clamping all types and sizes of cables and cords which might be used for the supply connection. Anchorages of labyrinth type may be used if it is evident from the design or by means of suitable marking how the flexible cable or cord is to be mounted.

Compliance is checked by the test of 5.2.10.3.

5.2.10.2 For type Y and Z attachments, cord anchorages shall be adequate.

Compliance is checked by the test of 5.2.10.3. The test is carried out on the cable or cord supplied with the luminaire.

5.2.10.3

Compliance is checked by inspection and by the following tests which are made with the cable or cord which is fitted to the luminaire as delivered.

The conductors are introduced into the terminals and the terminal screws, if any, are tightened just sufficiently so as to prevent the conductors from easily changing their position.

The cord anchorage is used in the normal manner, clamping screws, if any, being tightened with a torque two-thirds of that specified in Table 4.1.

After this preparation, it shall not be possible to push the cable or cord into the luminaire in such a way as to cause movement of the cable or cord at the terminals, or to cause the cable or cord to come into contact with moving parts or parts which operate at a temperature higher than that permissible for the insulation of the conductors.

The cable or cord is then subjected 25 times to a pull of the value specified in Table 5.2.

The pulls are applied without jerks, each time for 1 s. The measurement of the longitudinal displacement of the cable or cord is made during this test. A mark is made on the cable or cord at a distance of approximately 20 mm from the cord anchorage while it is subjected to the first pull and during the 25th pull, the mark shall not have been displaced by more than 2 mm.

The cable or cord shall then be subjected to a torque of the value specified in Table 5.2.

During and after the above tests, the conductors shall not have moved noticeably in the terminals and the cable or cord shall not be damaged. If it can be assumed, that the terminals work partly as cord anchorage (for example because the wires between cord anchorage and terminal are elongated), the test shall be repeated with an opened connection between conductors and terminals, to ensure that the cord anchorage function is independent of the electrical connection.

Table 5.2 – Tests for cord anchorage

Total nominal cross-sectional area of all conductors together mm ²	Pull N	Torque Nm
Up to and including 0,4 mm ²	30	-----
Over 0,4 up to and including 0,75	30	0,08
Over 0,75 up to and including 1,5	60	0,15
Over 1,5 up to and including 3	60	0,25
Over 3 up to and including 5	80	0,35
Over 5 up to and including 8	120	0,35

5.2.10.4 Luminaires provided with or designed for use with a supply cord or other external flexible cable or cord may be exempt from the need for a cord anchorage if they have a maximum current of 2 A, including short circuit current, available in the circuit prior to the operation of an overcurrent limiting device and the following conditions and test requirement are met.

- ordinary Class III luminaire supplied with SELV at a voltage not exceeding 25 V RMS or 60 V ripple free DC;
- ordinary Class III luminaire supplied with PELV at a voltage not exceeding 12 V RMS or 30 V ripple free DC;
- other than ordinary Class III luminaire supplied at a voltage not exceeding 12 V RMS or 30 V ripple free DC.

The following test requirement shall be complied with.

Each conductor of a lead assembly connected to the circuit shall be subjected to a pull test of 30 N. The pull is applied without jerks, for 1 min, in the direction opposite to that used for the application or insertion of the conductor or lead assembly. During the test, the conductor or lead assembly shall not have moved noticeably in the terminals nor become disconnected in case of soldering. If the lead, cord or cable can be pushed inside the enclosure, contact with hazardous voltage circuits, hot parts exceeding the temperature rating of the lead, cord or cable, and contact with moving parts that may damage it, shall be prevented.

5.2.11 If external wiring passes into the luminaire, it shall comply with the appropriate requirements for internal wiring.

Compliance is checked by the tests of 5.3.

5.2.12 Fixed luminaires for looping-in shall be provided with terminals intended for maintaining the electrical continuity of supply cables feeding the luminaire, but not terminating in it.

Compliance is checked by inspection.

5.2.13 The ends of flexible stranded conductors may be tinned, but shall not have additional solder applied, unless a means is provided of ensuring that clamped connections cannot work loose owing to cold flow of the solder (see Figure 28).

EXAMPLE This requirement is met when spring terminals are used. Securing the clamping screws is not an adequate means of preventing the connection of soldered strands from working loose owing to cold flow of the solder.

Compliance is checked by inspection.

5.2.14 If a plug is supplied with the luminaire by the manufacturer, the plug shall have the same degree of protection against electric shock and degree of protection against ingress of dust, solid objects and moisture as the luminaire.

Moulded-on type plugs are deemed suitable for the IP luminaire requirements on other than ordinary luminaires intended for domestic use.

NOTE 1 In some countries (United Kingdom and Australia), where national legislation requires the fitting of a certain plug which does not provide the required ingress protection, the luminaire manufacturer shall provide adequate instructions for connection to the supply ensuring an equivalent degree of protection against harmful ingress of dust and moisture as that provided by the luminaire.

A class III luminaire shall not be provided with a plug which permits any electrical connection with a socket-outlet in accordance with IEC TR 60083 or mains appliance outlets or connectors in accordance with IEC 60320 (all parts).

There shall be no unsafe compatibility between couplers for class II and class III with systems specified in standard sheets of IEC 60320 (all parts) and with the national domestic plug and socket-outlet systems of the country where the luminaire is placed on the market.

NOTE 2 The manufacturer can provide the list of the countries where the luminaire is placed on the market where no risk of unsafe plug-socket compatibility has been verified.

Compliance is checked by inspection and by the following test (see Figure 34).

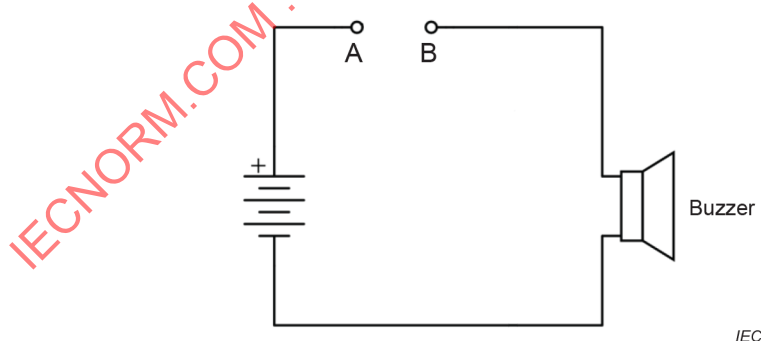


Figure 34 – Circuit for checking electrical contact between socket outlet and plug

Pole A is connected to all contacts of the outlet and Pole B is connected to all contacts of the plug. During insertion the buzzer shall not operate.

NOTE 3 Some national plug and socket-outlet systems are shown in IEC TR 60083.

Plugs and socket-outlets for class III luminaires, where a safety isolating transformer is delivered with the luminaire having a rated current ≤ 3 A and a rated voltage ≤ 25 V AC or 60 V DC and a power not exceeding 72 W, are allowed to comply only with the following requirements:

- plugs shall not be able to make any electrical contact with socket-outlets of other voltage systems (in accordance with IEC TR 60083);
- sockets-outlets shall not admit plugs of other voltage systems;
- socket-outlets shall not have the protective earth contact.

For this particular plug and socket-outlet system, the ball pressure test given in Section 13 is not applicable.

5.2.15 For Class III luminaires powered via information technology communication cabling, connection to the supply shall be made by means of connectors complying with IEC 60603 (all parts) or IEC 62680 (all parts).

NOTE The given requirements for PoE are adapted from IEC 62368-3:2017.

Compliance is checked by inspection.

5.2.16 AC mains appliance inlets incorporated into luminaires to connect to the LV supply shall comply with the requirements of IEC 60320 (all parts). For fixed luminaires installation, couplers according to IEC 61535 may alternatively be used. In this case it shall be verified that conditions of use advised by the coupler manufacturer have been observed (IEC 61535:2009, 8.6). For appliance inlet or connector systems according to IEC 61984 used in accordance with their intended use and ratings the following requirements apply additionally.

a) Polarization

There shall be no unsafe compatibility between any pole of connectors, in accordance with 6.3 of IEC 61984:2008.

b) Protection against electric shock

Enclosed connectors shall be used if the connector is accessible in normal use.

c) Mechanical locking

Connectors without a breaking capacity (COC), as defined in 3.9 of IEC 61984:2008, shall be provided with mechanical locking between the socket outlet and the plug. Locking devices, where the locking function can be enabled by hand are permitted. Connectors with a breaking capacity (CBC), as defined in 3.8 of IEC 61984:2008, may be provided without a locking device.

d) Early contact making

Early contact making of a protective earth contact is also required for connectors designed with contacts making only in a no-load condition.

e) Protection against short circuit of poles

If stranded wires are used, there shall be protection against an unintended short circuit caused by a free strand. The test of IEC 61535:2009, 12.8.1 applies with a strand length of 6 mm insulation removed.

f) Cable clamp

Connectors for external wiring shall be provided with cable clamp, in accordance with 6.17 of IEC 61984:2008.

Compliance is checked by inspection.

NOTE IEC 60320 (all parts) allows for other configurations which do not comply with the relevant standard data sheet.

5.2.17 Inter-connecting cables, if not made of standardized insulated and sheathed cables, shall consist of a defined assembly made by the luminaire manufacturer of wiring within a sleeve, tube or equivalent construction.

5.2.18 All portable luminaires and fixed luminaires or luminaires intended to be connected to the supply via a socket outlet, shall be fitted with a plug in accordance with IEC TR 60083, or with regional or national standards where applicable, appropriate to the classification of the luminaire.

Compliance is checked by inspection.

5.3 Internal wiring

5.3.1 Internal wiring shall be made with conductors of a suitable size and type to handle the power occurring during normal use. The insulation of the wiring shall be made of a material capable of withstanding the voltage and the maximum temperature to which it is subjected, without affecting the safety when properly installed and connected to the mains.

If cables with a common type of insulation (PVC or rubber) are used as through wiring, they do not need to be delivered with the luminaire if the way of mounting given in the manufacturer's instructions is clear. However, if special cables or sleeves, for example due to high temperatures, are necessary, the through wiring shall always be factory assembled. The requirements of 3.3.3 c) shall be taken into account in the latter case.

Wires coloured with green and yellow combination shall only be used for protective earth connections.

NOTE The temperature limits for the insulation are given in Table 12.2 of Section 12.

Sleeves in compliance with 4.9.2 are suitable to protect hot spots.

Compliance is checked by inspection and the following test, after the temperature and heating tests of Section 12.

The socket-outlet, if any, is loaded with the declared value specified by the manufacturer and, if not declared, with its rated current at rated voltage.

When stable conditions are reached, the voltage is increased until an over-wattage of 5 %, or an over-voltage of 6 % (depending on the type of lamp), is present.

When the new stable conditions are reached, all temperatures on components, cables, etc. which can be influenced by the self-heating of the conductor shall be checked in accordance with the requirements of Clause 12.4.

5.3.1.1 For wiring including connecting leads (tails) which is directly connected to the fixed wiring, for example via a terminal block, and where the disconnection from the mains is relied upon by the external protection device(s), the following is applicable.

For normal operating currents 2 A and higher:

- nominal cross-sectional area: minimum 0,5 mm²,
- for through-wiring of fixed luminaires: minimum 1,5 mm²,
- nominal insulation thickness: minimum 0,6 mm (PVC or rubber).

For mechanical protected wiring carrying normal operating currents lower than 2 A:

- nominal cross-sectional area: minimum 0,4 mm²,
- nominal insulation thickness: minimum 0,5 mm (PVC or rubber).

The required mechanical protection is regarded to be adequate when extra insulation is added at the following places where the wire insulation may be damaged:

- in small openings of pipes when, during production, the wires are slid through,
- when bending wires closely around metal not specially treated to produce smooth edges.

5.3.1.2 For wiring which is connected to the fixed wiring via an internal current-limiting device and limiting the current to 2 A maximum, for example lamp current control device, circuit cut-outs, fuses, protective impedance or isolating transformers, the following is applicable:

- the minimum cross-sectional area may be less than 0,4 mm² if overheating of the wire conductor insulation is prevented under normal and short circuit operating conditions in accordance with the tests of 5.4;
- the minimum insulation thickness, which may be less than 0,5 mm (PVC or rubber), shall be selected in relation to the voltage stress occurring, see Table X.1.
- the current limit rating of the protection device shall be a proven characteristic of the device used.

NOTE See also Clause 0.5.

5.3.1.3 In class II luminaires where the internal wiring has a live conductor and touches accessible metal parts under normal operating conditions, the insulation, at least at the places of contact, shall comply with the requirements for double or reinforced insulation relevant to the voltage stress, for example by applying sheathed cables or sleeves.

5.3.1.4 Conductors without insulation may be used provided that adequate precautions have been taken to ensure adherence to the creepage distances and clearance requirements of Section 11 and also with regard to the class of protection of Section 2.

5.3.1.5 The SELV or PELV current-carrying parts do not have to be insulated. However, if insulation is applied, they shall be tested as mentioned in Section 10.

5.3.1.6 When insulation materials are used which have insulating or mechanical properties higher than PVC or rubber, an insulation thickness shall be selected which gives the same degree of protection.

5.3.2 Internal wiring shall be so situated or protected that it cannot be damaged by sharp edges, rivets, screws and similar components, or by moving parts of switches, joints, raising and lowering devices, telescopic tubes and similar parts. Wiring shall not be twisted along the longitudinal axis of the cable through an angle exceeding 360°.

Compliance is checked by inspection (see also 4.14.4 and 4.14.5) and in accordance with the test of 4.14.3.

5.3.3 If in class II luminaires, in settable and adjustable luminaires, or in portable luminaires other than those for wall mounting, internal wiring passes through accessible metal parts or through metal parts in contact with accessible metal parts, the opening shall be provided with a tough bushing of insulating material, having smoothly rounded edges, so fixed that it cannot easily be removed. Bushings of material likely to deteriorate with age shall not be used in openings with sharp edges.

NOTE 1 The term "easily removable bushing" is used to describe a bushing which can be pulled out of its mounting by movement of the luminaire during its life or by inadvertent handling of the luminaire. Examples of accepted fixings include use of lock-nut, appropriate adhesive such as self-hardening resin, or properly sized push-fits.

NOTE 2 An example of materials known for deterioration with age is natural rubber.

If the cable entry openings have smoothly rounded edges and the internal wiring is not required to be moved in service, this requirement is met by the use of a separate protective sheath over a cable that has no special protective sheath, or by using a cable which incorporates a protective sheath.

5.3.4 Joints and junctions in internal wiring, excluding terminations on components, shall be provided with an insulating covering no less effective than the insulation of the wiring.

Compliance with the requirements of 5.3.3 and 5.3.4 is checked by inspection.

5.3.5 Where internal wiring passes out of the luminaire and the design is such that the wiring may be subject to strain, the requirements for external wiring apply. The requirements for external wiring do not apply to internal wiring of ordinary luminaires which has a length of less than 80 mm outside the luminaire. For luminaires which are other than ordinary, all wiring external to the enclosure shall comply with the external wiring requirements.

Compliance is checked by inspection, measurements and, if appropriate, in accordance with the tests and conditions of 5.2.10.1 or 5.2.10.4.

5.3.6 Wiring of settable and adjustable luminaires shall be fixed by means of wire carriers, clips or similar parts of insulating material at all places where it might otherwise rub against metal parts in the normal movement of the luminaire in such a way that the insulation may be damaged.

5.3.7 The ends of flexible stranded conductors may be tinned but shall not have additional solder applied unless a means is provided of ensuring that clamped connections cannot work loose owing to cold flow of the solder (see Figure 28).

EXAMPLE This requirement is met when spring terminals are used. Securing the clamping screws is not an adequate means of preventing the connecting of soldered strands from working loose owing to cold flow of the solder.


Compliance with the requirements of 5.3.6 and 5.3.7 is checked by inspection.

5.4 Test to determine suitability of conductors having a reduced cross-sectional area

To determine the suitability of conductors having a reduced cross-sectional area, connected to controlgear that limits the current to 2 A, the following test shall be conducted:

- a) disconnect the conductors being evaluated as close as practical to the lights source in the luminaire and attach a resistive load using minimum 1 mm² cross section test leads; these leads shall be routed out of the luminaire in a manner that will have the least impact on temperatures within the luminaire;
- b) adjust the resistive load to measure the maximum output current of the controlgear, maximum measured current shall not exceed 2,5 A;
- c) with the resistive load set to draw maximum output current, conduct the thermal test in accordance with Clause 12.4. (see Figure 33);
- d) the resistive load is then set to 0 Ω (short circuit) and the thermal test repeated in accordance with Clause 12.4 (see Figure 33);

In no case shall the temperature of the luminaire wiring insulation exceed the limits stated in Table 12.2 nor shall there be any indication of damage to the luminaire wiring.

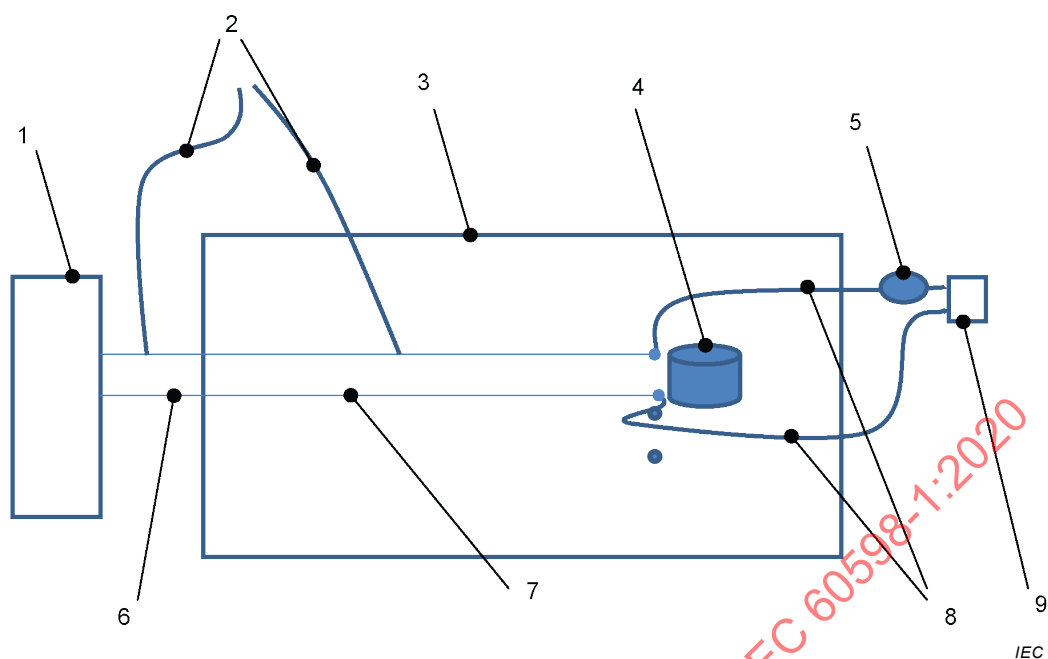

Key

- | | |
|-----------------------------------------|-------------------|
| 1 controlgear | 6 external wiring |
| 2 thermocouple thermal measuring system | 7 internal wiring |
| 3 luminaire | 8 test leads |
| 4 lightsource | 9 resistive load |
| 5 current meter | |

NOTE Controlgear can be internal to the luminaire.

Resistive load is adjustable and capable of presenting 0 Ω resistance.

Figure 33 – Test to determine suitability of conductors having a reduced cross-sectional area

SECTION 6: Void

IECNORM.COM : Click to view the full PDF of IEC 60598-1:2020

SECTION 7: PROVISION FOR EARTHING

7.1 General

This section specifies requirements, where applicable, for the earthing of luminaires.

7.2 Provision for earthing

7.2.1 Metal parts of class I luminaires which are accessible when the luminaire has been mounted, or is opened for replacement of a replaceable light source or replaceable starter or for cleaning purposes, and which may become live in the event of an insulation fault, shall be permanently and reliably connected to a protective earthing terminal or protective earthing contact.

Metal parts screened from live parts by metal parts which are connected to the protective earthing terminal or protective earthing contact, and metal parts separated from live parts by double insulation or by reinforced insulation, are not, for the purpose of this requirement, regarded as likely to become live in the event of an insulation fault.

NOTE 1 If a lamp breaks during a re-lamping operation, the breakage is not regarded as an insulation fault according to 7.2.1, as the lamp in this sense is not considered to be a part of the luminaire (see 0.4.2 and 8.2.3 item a) for clarification).

Metal parts of luminaires which may become live in the event of an insulation fault and which are not accessible when the luminaire has been mounted, but are liable to come into contact with the supporting surface, shall be permanently and reliably connected to a protective earthing terminal.

NOTE 2 The earthing of starters and lamp caps is not a requirement but earthing of lamp caps can be necessary as a starting aid.

The protective earthing connections shall be of low resistance.

Self-tapping screws may be used to provide protective earthing continuity, provided they comply with the requirements given in 4.12.1.

Thread-forming screws may be used to provide protective earthing.

A thread forming screw used in a groove of a metallic material could provide protective earth continuity for a luminaire if all the tests required within this document regarding protective earthing connection were passed. See Figure 30.

For class I luminaires with detachable parts provided with connectors or similar connection devices, the protective earth connection shall be made before the current-carrying contacts are made and the current-carrying contacts shall separate before the protective earth connection is broken.

For terminal blocks with integrated screwless protective earthing contacts, the additional tests of Annex V are to be applied.

It is allowed to earth built-in controlgear by means of fixing the controlgear to earthed metal parts of the luminaire. Connection to protective earthing of the luminaire via the built-in controlgear is not allowed.

7.2.2 Surfaces in settable and adjustable joints, telescopic tubes, etc., providing protective earthing continuity, shall be such that a good electrical contact is ensured.

7.2.3 *Compliance with the requirements of 7.2.1 and 7.2.2 is checked by inspection and, for protective earth, by the following test.*

A current of at least 10 A, derived from a source with a no-load voltage not exceeding 12 V, shall be passed between the earthing terminal or earthing contact and each of the accessible metal parts in turn.

The voltage drop between the earthing terminal or earthing contact and the accessible metal part shall be measured and the resistance calculated from the current and the voltage drop. In no case shall the resistance exceed 0,5 Ω . When type testing, the current shall be applied for a period of at least 1 min.

NOTE In the case of a luminaire with a supply cord, the earthing contact is at the plug or supply end of the flexible cable or cord.

7.2.4 Protective earthing terminals shall comply with the requirements of 4.7.3. The connection shall be adequately locked against accidental loosening.

For screw terminals, it shall not be possible to loosen the clamping means by hand.

For screwless terminals, it shall not be possible to loosen the clamping means unintentionally.

Compliance is checked by inspection, by manual test and by the tests specified in 4.7.3.

NOTE In general, the designs commonly used for current-carrying terminals provide sufficient resilience to comply with this requirement; for other designs, special provisions, such as the use of an adequately resilient part which is not likely to be removed inadvertently, can be necessary.

For terminal blocks with integrated screwless protective earthing contacts, the additional tests of Annex V apply.

7.2.5 For a luminaire provided with a connector socket for a mains supply, the earth contact shall be an integral part of the socket.

7.2.6 For a luminaire to be connected to supply cables (fixed wiring) or to a supply cord, the earth terminal shall be adjacent to the mains terminal.

NOTE Luminaires can be provided with type X or Y attachments.

7.2.7 For luminaires which are other than ordinary luminaires, all parts of a protective earth terminal shall be such as to minimize the danger of electrolytic corrosion resulting from contact with the earth conductor or any other metal in contact with them.

7.2.8 Either the screw or the other part of the protective earth terminal shall be made of brass or other non-rusting metal or a material with a non-rusting surface and the contact surfaces shall be of bare metal.

7.2.9 *Compliance with the requirements of 7.2.5 to 7.2.8 is checked by inspection and by manual test.*

7.2.10 If a fixed class II luminaire is provided with internal terminal(s) for maintaining the electrical continuity for example for looping in or through wiring of an earthing conductor, this (these) terminal(s) shall be insulated from accessible metal parts by double insulation or reinforced insulation.

A fixed connected class II luminaire may have an earth connection for functional purposes, for example for looping in, to assist the starting of a lamp or to avoid radio interference. The functional earth circuit shall be separated from live parts by double or reinforced insulation.

Compliance is checked by inspection.

7.2.11 When a class I luminaire is supplied with a supply cord, this cord shall have an earthing core coloured green-yellow.

The green-yellow core of a supply cord shall be connected to the earthing terminal of the luminaire and to the earthing contact of the plug if one is attached.

All conductors, whether internal or external, which are identified by the green and yellow colour combination shall only be connected to a protective earthing terminal.

For luminaires with supply cords, the arrangement of the terminals, or the length of the conductors between the cord anchorage and the terminals, shall be such that, should the cable or cord move out of the cord anchorage, the current-carrying conductor becomes taut before the protective earthing conductor.

Compliance is checked by inspection.

7.2.12 Where a PELV circuit is connected to a protective earth for functional purposes, this circuit shall not be used for interconnection with other luminaires to avoid overload of the circuit conductor.

NOTE The overload of the conductor can be caused by fault current coming from a different point of the earth circuit of a building to earth.

IECNORM.COM : Click to view the full PDF of IEC 60598-1:2020

SECTION 8: PROTECTION AGAINST ELECTRIC SHOCK

8.1 General

This section specifies requirements for protection against electric shock from luminaires. A test to determine whether a conductive part is a live part which may cause an electric shock is described in Annex A.

8.2 Protection against electric shock

8.2.1 Luminaires shall be so constructed that their live parts are not accessible when the luminaire has been installed and wired as in normal use, and when it is opened as necessary for replacing replaceable light sources or (replaceable) starters, even if the operation cannot be achieved by hand. Basic insulated parts shall not be used on the outer surface of the luminaire without appropriate protection against accidental contact.

NOTE 1 Examples of basic insulated parts are cables intended for internal wiring, control gear for building-in.

Where a protective cover is used over a non-user replaceable light source in accordance with Clause 4.30, the cover shall be left in place during the tests and inspections detailed by this section.

No access to live parts with the standard test finger is permitted when the assembled luminaire has been installed as for normal use and, in addition, under the following conditions:

- for portable, settable and adjustable luminaires, no access to basic insulated parts with the standard test finger is permitted, and
- for other types of luminaires, there shall be no access to basic insulated parts from the outside of the luminaire by means of a Ø,50 mm probe according to Figure 1 in IEC 61032:1997.

Lampholders and starterholders, if used in portable, settable and adjustable luminaires and if accessible as specified above, shall comply with the electrical strength test and creepage distance and clearance requirements for double or reinforced insulation.

NOTE 2 Sufficient creepage distances and clearances to outer accessible surfaces might only be achieved after mounting into the luminaire.

NOTE 3 Information on lampholders and starterholders complying with the above requirements can be taken from the manufacturer's literature.

Basic insulation may be accessible when the luminaire is opened for lamp or starter replacement.

If a component intended for building-in is used on the outside of a fully assembled luminaire which can be touched by the 50 mm sphere, it shall comply with the relevant requirements applied to an independent component (see 1.2.29).

Other than where specifically required, lamps, lampholders and starterholders complying with their own standard are exempt from the requirements of 8.2.1.

Protection against electric shock shall be maintained for all methods and positions of installation in normal use with regard to the limitations indicated in the manufacturer's installation instructions, and for all adjustments of settable and adjustable luminaires. Protection shall be maintained after removal of all parts which can be removed by hand, except lamps and the following parts of the lampholders:

- a) For bayonet lampholders:
 - 1) domes (terminal covers);

- 2) skirts.
- b) For Edison screw lampholders:
 - 3) domes (terminal covers) for cord grip types only;
 - 4) outer shells.

Covers in fixed luminaires that cannot be removed by a single action with one hand are not removed. However, covers which have to be removed for changing lamps or starters are removed for this test.

NOTE 4 A single action with one hand is normally taken to include removal of items such as a knurled headed screw or a shade retaining ring.

Supply conductors held by screwless terminals with push-button releasing devices shall not be removed for this test.

The use of push-button type terminal blocks without the use of a cover is not precluded by this requirement. This is possible as some specific actions are required in order to release wiring from these blocks.

Class I and class II luminaires intended for tubular tungsten filament lamps having a cap/base at each end shall incorporate a means of automatic double-pole disconnection operative when the lamp is being changed. This requirement does not apply if the relevant cap and holder combination(s) is (are) covered by standards which incorporate special requirements with regard to accessibility of live parts which may cause an electric shock.

The insulating properties of lacquer, enamel, paper and similar materials shall not be relied upon to give the required protection against electric shock and protection against short-circuit.

Luminaires with ignitors intended for use with double ended high pressure discharge lamps shall be tested according to Figure 26.

If the voltage measured according to Figure 26 exceeds 34 V (peak), the ignitor shall only be active if the lamp is fully inserted, or a warning according to 3.2.18 a) or b) respectively shall be fitted to the luminaire.

Luminaires for double-capped Fa8 tubular lamps shall comply with the marking requirement of 3.2.18.

8.2.2 For portable luminaires, protection against electric shock shall also be maintained after movable parts of the luminaires have been placed in the most unfavourable position, which can be effected by hand.

8.2.3 For protection against electric shock, the following additional requirements apply:

- a) Metal parts of class II luminaires which are insulated from live parts by basic insulation only are live parts for the purpose of this section. This requirement is applicable for the situations where no electrical insulation is provided between the LV supply and output circuits of the controlgear. Where the controlgear provides basic or double/reinforced insulation from the LV supply the required insulation from the live part to the accessible part shall comply with Table X.1.

This does not apply to the non-current carrying parts of caps which comply with their relevant IEC safety standard.

For class II luminaires, glass lamp bulbs are not regarded as having further protection against electric shock. If glass bowls and other protective glasses have to be removed when the lamp is replaced or if they do not withstand the test of Clause 4.13, they shall not be used as supplementary insulation.

- b) Metal lamp holders for bayonet cap lamps in class I luminaires shall be connected to a protective earth.
- c) SELV circuits may have exposed current carrying parts under the following conditions.

- For ordinary luminaires:
 - the no-load voltage and the voltage under load, does not exceed
 - for AC: 25 V RMS;
 - for DC: 60 V ripple-free;
 - for interrupted DC voltage for frequencies between 10 Hz and 200 Hz: 25 V peak.
 - where the voltage exceeds AC 25 V RMS or DC 60 V ripple-free, the touch current does not exceed:
 - for AC: 0,7 mA (peak);
 - for DC: 2,0 mA (non-interrupted DC only).

If the voltages or currents exceed the values given above, at least one of the conductive parts in the SELV circuit shall be insulated by insulation capable of withstanding a test voltage of 500 V RMS for 1 min.

- For luminaires which are other than ordinary the nominal voltage (under load and under no load) does not exceed 12 V RMS or 30 V ripple-free DC or 12 V peak interrupted DC voltage for frequencies between 10 Hz and 200 Hz. When the luminaire is opened for light source replacement, the voltage limits for ordinary luminaires are applicable (for parts only accessible during maintenance).
- d) PELV circuits may have exposed current carrying parts under the following conditions:
- for ordinary luminaires the voltage under load and under no load does not exceed 12 V RMS or 30 V ripple-free DC;
 - for luminaires which are other than ordinary, the voltage (under load and under no load) does not exceed 12 V RMS or 30 V ripple-free DC.

If the voltages exceed the values given above in the PELV circuit, only the pole connected to earth may be accessible. The other pole shall be protected by an insulation capable of withstanding a test voltage of 500 V RMS for 1 min in accordance with 10.2.2.

NOTE These limits are based on IEC 60364-4-41. See also Annex A.

Class III luminaires are accepted only for connection to a SELV source or PELV source.

8.2.4 Portable luminaires for connection to the supply by means of a supply cord and plug shall have protection against electric shock which is independent of the supporting surface.

8.2.5 *Compliance with the requirements of 8.2.1 to 8.2.4 is checked by inspection and, if necessary, by the test with the relevant test probe according to Figures 1 and 2 in IEC 61032:1997 or by means of the specific test probe specified for the component in question.*

This test probe shall be applied to every possible position, if necessary with a force of 10 N, an electrical indicator being used to show contact with live parts. Movable parts, including shades, shall be placed in the most unfavourable position by hand; if made of metal, they shall not touch live parts of the luminaire or of the lamps.

8.2.6 Covers and other parts providing protection against electric shock shall have adequate mechanical strength and shall be reliably secured so that they will not work loose with normal handling.

Compliance is checked by inspection, by manual test and by the tests of Section 4.

For wall mounted luminaires, portable, settable and adjustable luminaires where covers whose fixing is not dependent on screws and whose removal is obtained by applying a force in an approximately perpendicular direction to the mounting/supporting surface, shall comply with the following test:

A force is applied approximately perpendicular to the mounting/supporting surface. The force shall be 20 N when the opening of the cover gives access to basic insulated parts and 80 N when live parts are accessible.

During the test, the cover(s) shall not work loose.

8.2.7 Luminaires (other than those mentioned below) incorporating a capacitor of capacitance exceeding 0,5 μF shall be provided with a discharge device so that the voltage across the capacitor 1 min after disconnection of the luminaire from the source of supply at rated voltage does not exceed 50 V.

Portable luminaires designed to be connected to the supply by means of a plug, track adaptor connected luminaires, or luminaires with supply connector with contacts accessible with the standard test finger and incorporating a capacitor of capacitance exceeding 0,1 μF (or 0,25 μF for luminaires with a rated voltage less than 150 V) shall be provided with a discharge device so that 1 s after disconnection, the voltage between the pins of the plug or adaptor/connector contacts does not exceed 34 V.

Other luminaires connected to the supply by means of a plug and incorporating a capacitor exceeding 0,1 μF (or 0,25 μF for luminaires of rated voltage less than 150 V) and track adaptors mounted in luminaires shall discharge so that after 5 s, the voltage between the pins of the plug does not exceed 60 V RMS.

Subclause 0.4.2 requires that, unless otherwise specified, the tests of this document shall be conducted with the lamp in circuit. In the case of this subclause, the lamp shall be in circuit when the measurement of the voltage from the compensation capacitor is made, if it leads to a more onerous result.

The residual voltages referred to in this requirement shall be measured on only one luminaire, even if it is envisaged that such a luminaire may be installed in a multiple luminaire system.

Compliance is checked by measurement.

NOTE The discharge device (for all types of luminaire) can be incorporated on or within the capacitor or mounted separately within the luminaire.

SECTION 9: RESISTANCE TO DUST, SOLID OBJECTS AND MOISTURE

9.1 General

This section specifies the requirements and tests for luminaires classified as resistant to dust, solid objects and moisture in accordance with Section 2, including ordinary luminaires.

9.2 Tests for ingress of dust, solid objects and moisture

The enclosure of a luminaire shall provide the degree of protection against ingress of dust, solid objects and moisture in accordance with the classification of the luminaire and the IP number marked on the luminaire.

NOTE 1 The tests for the ingress of dust, solid objects and moisture specified in this document are not all identical to the tests in IEC 60529 because of the technical characteristics of luminaires. An explanation of the IP numbering system is given in Annex J.

Compliance is checked by the appropriate tests specified in 9.2.0 to 9.2.11, and for other IP ratings by the appropriate tests specified in IEC 60529.

Before the tests for the second characteristic numeral, with the exception of IPX8, the luminaire complete with lamp(s) shall be switched on and brought to a stable operating temperature at rated voltage.

The water for the tests shall be at a temperature of $15\text{ °C} \pm 10\text{ °C}$ except for IPX9 where the temperature shall be $80\text{ °C} (\pm 5\text{ °C})$ or $15\text{ °C} (\pm 10\text{ °C})$ following the marking of the luminaire.

Luminaires shall be mounted and wired as in normal use and placed in the most unfavourable position, complete with their protective translucent covers, if any, for the tests of 9.2.0 to 9.2.11.

Where connection is made by a plug or a similar device, then this shall be regarded as part of the complete luminaire and shall be included in the tests and similarly for any separate controlgear.

For tests of 9.2.3 to 9.2.11, a fixed luminaire intended for mounting with its body in contact with a surface shall be tested with an expanded metal spacer interposed between the luminaire and the mounting surface. The spacer shall be at least equal in overall size to the projection of the luminaire, and have dimensions as follows:

Longway of mesh	10 mm	to	20 mm
Shortway of mesh	4 mm	to	7 mm
Strand width	1,5 mm	to	2 mm
Strand thickness	0,3 mm	to	0,5 mm
Overall thickness	1,8 mm	to	3 mm

Luminaires having provision for draining water by means of drain holes shall be mounted with the lowest drain hole open unless otherwise specified in the manufacturer's installation instructions.

If the installation instructions indicate that a luminaire is for ceiling or under-canopy mounting, the luminaire shall be attached to the underside of a flat board or plate which extends 10 mm beyond that part of the luminaire perimeter in contact with the mounting surface.

For recessed luminaires, the parts in the recess and the parts protruding from the recess shall each be tested according to their IP classification as indicated in the manufacturer's mounting instructions. A box encapsulating the part in the recess may be necessary for the tests of 9.2.4 to 9.2.11.

NOTE 2 The claimed IP rating is only applicable to the enclosure of the luminaire. In the case of a recessed luminaire, the IP rating of the luminaire does not protect the integrity of any seals outside of the luminaire, e.g. between the lower and upper parts of the ceiling.

For IP2X luminaires, the enclosure denotes that part of the luminaire containing the main part other than the lamp and optical controls.

NOTE 3 Since luminaires have no hazardous moving parts, the level of safety as specified in IEC 60529 is achieved.

Portable luminaires, wired as in normal use, shall be placed in the most unfavourable position of normal use.

Glands, if any, shall be tightened with a torque equal to two-thirds of that applied to glands in the test of 4.12.5.

Fixing screws of covers, other than hand-operated fixing screws of glass covers, shall be tightened with a torque equal to two-thirds of that specified in Table 4.1.

Screwed lids shall be tightened with a torque having a value in newton metres numerically equal to one-tenth of the nominal diameter of the screw thread in millimetres. Screws fixing other caps shall be tightened with a torque equal to two-thirds of that specified in Table 4.1.

After completion of the tests, the luminaire shall withstand the electric strength test specified in Section 10, and inspection shall show:

- a) *no deposit of talcum powder in dust-proof luminaires, such that, if the powder were conductive, the insulation would fail to meet the requirements of this document;*
- b) *no deposit of talcum powder inside enclosures for dust-tight luminaires;*
- c) *no trace of water on electrical connections, current carrying parts or on insulation where it could become a hazard for the user or surroundings, for example where it could reduce the creepage distances below the values specified in Section 11; the only exception to this is for SELV or PELV conductors where the voltage under load does not exceed 12 V peak interrupted DC voltage for frequencies between 10 Hz and 200 Hz, 12 V RMS or 30 V ripple free DC and the conductors are protected from corrosion.*

NOTE 4 Some aspects of protection against corrosion are covered by Clause 4.18.

- 1) *For luminaires without drain holes, there shall be no water entry.*

NOTE 5 Care is taken not to mistake condensation for water entry.

- 2) *For luminaires with drain holes, water entry including condensation is allowed during the tests if it can drain out effectively and provided it does not reduce the creepage and clearance distances below the minimum levels specified in this document;*
- d) *no trace of water having entered in any part of a watertight or pressure watertight luminaire or high pressure and temperature water jet-proof luminaire or high pressure and cold water jet-proof luminaire;*
- e) *no contact permitted with live parts by the relevant test probe for first characteristic IP numeral 2;*
no entry into the luminaire enclosure by the relevant test probe for first characteristic IP numerals 3 and 4;

for luminaires with drain holes in accordance with Clause 4.17 and luminaires with ventilation slots for forced cooling, no contact with live parts is permitted through the drain holes and ventilation slots with the relevant test probe for the first characteristic IP numerals 3 and 4;

- f) no trace of water on any part of a lamp requiring protection from splashing water as indicated in the "information for luminaire design" section of the applicable lamp standard;
- g) no damage, for example, cracking or breakage of a protective shield or glass envelope, such that safety or protection against the ingress of moisture is impaired.

9.2.0 Tests

Solid-object-proof luminaires (first characteristic IP numeral 2) shall be tested with the standard test finger specified in IEC 60529 in accordance with the requirements of Sections 8 and 11.

Luminaires with first characteristic IP numeral 2 are not required to be tested with the sphere specified in IEC 60529.

Solid-object-proof luminaires (first characteristic IP numerals 3 and 4) shall be tested at every possible point (excluding gaskets) with a probe in accordance with test probe C or D of IEC 61032, applied with a force as specified in Table 9.1:

Table 9.1 – Solid-object-proof luminaire test

	Test probe according to IEC 61032	Probe wire diameter	Application force N
First IP numeral 3	C	2,5 mm $\begin{smallmatrix} +0,05 \\ 0,00 \end{smallmatrix}$ mm	3 with a tolerance of ± 10 %
First IP numeral 4	D	1 mm $\begin{smallmatrix} +0,05 \\ 0,00 \end{smallmatrix}$ mm	1 with a tolerance of ± 10 %

The end of the probe wire shall be cut at right angles to its length and be free from burrs.

9.2.1 Dust-proof luminaires (first characteristic IP numeral 5) shall be tested in a dust chamber similar to that shown in Figure 6, in which talcum powder is maintained in suspension by an air current. The chamber shall contain 2 kg of powder for every cubic metre of its volume. The talcum powder used shall be able to pass through a square-meshed sieve whose nominal wire diameter is 50 μm and whose nominal free distance between wires is 75 μm . It shall not have been used for more than 20 tests.

The test shall proceed as follows.

- a) The luminaire is suspended outside the dust chamber and operated at rated supply voltage until the operating temperature is achieved.
- b) The luminaire, whilst still operating, is placed with the minimum disturbance in the dust chamber.
- c) The door of the dust chamber is closed.
- d) The fan/blower causing the talcum powder to be in suspension is switched on.
- e) After 1 min, the luminaire is switched off and allowed to cool for 3 h whilst the talcum powder remains in suspension.

NOTE The 1 min interval between switching on the fan/blower and switching off the luminaire is to ensure that the talcum powder is properly in suspension around the luminaire during initial cooling, which is most important with smaller luminaires. The luminaire is operated initially as in item a) to ensure the test chamber is not overheated.

9.2.2 *Dust-tight luminaires (first characteristic IP numeral 6) are tested in accordance with 9.2.1.*

9.2.3 Drip-proof luminaires

9.2.3.1 Drip-proof luminaires (second characteristic IP numeral 1) are subjected for 10 min to an artificial rainfall of $1^{+0.5}_0$ mm/min, falling vertically from a height of 200 mm above the top of the luminaire.

9.2.3.2 Drip-proof luminaires (second characteristic IP numeral 2) are subjected for 10 min to an artificial rainfall of $3^{+0.5}_0$ mm/min, falling vertically from a height of 200 mm above the top of the luminaire, when the luminaire is in the most onerous position and tilted at any angle up to 15° on either side of the vertical.

9.2.4 *Rain-proof luminaires (second characteristic IP numeral 3) are sprayed with water for 10 min by means of a spray apparatus as shown in Figure 7. The radius of the semicircular tube shall be as small as possible and compatible with the size and position of the luminaire.*

The tube shall be perforated so that jets of water are directed towards the centre of the circle and the water flow rate at the inlet of the apparatus shall be approximately 0,07 l/min with a tolerance of ± 5 % per hole multiplied by the number of holes (approximately 80 kN/m²).

The tube shall be caused to oscillate through an angle of 120°, 60° on either side of the vertical, the time for one complete oscillation (2 × 120°) being about 4 s.

The luminaire shall be mounted above the pivot line of the tube so that the ends of the luminaire receive adequate coverage from the jets. The luminaire shall be turned about its vertical axis during the test at a rate of 1 r/min.

After this 10 min period, the luminaire shall be switched off and allowed to cool naturally whilst the water spray is continued for a further 10 min.

NOTE In Japan, the oscillating tube test and the spray nozzle test as specified in IEC 60529 are accepted.

9.2.5 *Splash-proof luminaires (second characteristic IP numeral 4) are sprayed from every direction with water for 10 min by means of the spray apparatus shown in Figure 7 and described in 9.2.4. The luminaire shall be mounted under the pivot line of the tube so that the ends of the luminaire receive adequate coverage from the jets.*

The tube shall be caused to oscillate through an angle of almost 360°, 180° on either side of the vertical, the time for one complete oscillation (2 × 360°) being about 12 s. The luminaire shall be turned about its vertical axis during the test at a rate of 1 r/min.

The support for the equipment under test shall be grid shaped in order to avoid acting as a baffle. After this 10 min period, the luminaire shall be switched off and allowed to cool naturally whilst the water spray is continued for a further 10 min.

NOTE In Japan, the oscillating tube test and the spray nozzle test as specified in IEC 60529 are accepted.

9.2.6 *Jet-proof luminaires (second characteristic IP numeral 5) are switched off and immediately subjected to a water jet for 15 min from all directions by means of a hose having a nozzle with the shape and dimensions shown in Figure 8. The nozzle shall be held 3 m away from the sample.*

The water pressure at the nozzle shall be adjusted to achieve a water flow rate of 12,5 l/min with a tolerance of ± 5 % (approximately 30 kN/m²).

9.2.7 *Powerful water jet-proof luminaires (second characteristic IP numeral 6) are switched off and immediately subjected to a water jet for 3 min from all directions by means of a hose having a nozzle with the shape and dimensions shown in Figure 8. The nozzle shall be held 3 m away from the sample.*

The water pressure at the nozzle shall be adjusted to achieve a water flow rate of 100 l/min with a tolerance of ± 5 % (approximately 100 kN/m²).

9.2.8 *Watertight luminaires (second characteristic IP numeral 7) are switched off and immediately immersed for 30 min in water, so that there is at least 150 mm of water above the top of the luminaire and the lowest portion is subjected to at least 1 m head of water. Luminaires shall be held in position by their normal fixing means. Luminaires for tubular fluorescent lamps shall be positioned horizontally, with the diffuser upwards, 1 m below the water surface.*

NOTE This treatment is not sufficiently severe for luminaires intended for operation under water.

9.2.9 *Pressure watertight luminaires (second characteristic IP numeral 8) are heated either by switching on the lamp or by other suitable means, so that the temperature of the luminaire enclosure exceeds that of the water in the test tank by between 5 °C and 10 °C.*

The luminaire shall then be switched off and subjected to a water pressure of 1,3 times that pressure which corresponds to the rated maximum immersion depth for a period of 30 min.

9.2.10 *High pressure and temperature water jet-proof luminaires (second characteristic IP numeral 9 (80 °C)) are switched off and immediately subjected to the high pressure and high temperature water jet. The test is made by spraying the luminaire with a stream of hot water from a standard test nozzle as described in IEC 60529. The water for the tests shall be at a temperature of (80 ± 5) °C. For small enclosures (largest dimension less than 250 mm), the test duration is in total 2 min. For large enclosures (largest dimension greater than or equal to 250 mm), the test duration is 1 min/m² of the calculated surface area of the enclosure (excluding any mounting surface), with a minimum duration of 3 min.*

9.2.11 *High pressure and cold water jet-proof luminaires (second characteristic IP numeral 9 (15 °C)) are switched off and immediately subjected to the high pressure and cold temperature water jet. The test is made by spraying the luminaire with a stream of water from a standard test nozzle as described in IEC 60529. The water for the tests shall be at a temperature of (15 ± 10) °C. For small enclosures (largest dimension less than 250 mm), the test duration is in total 2 min. For large enclosures (largest dimension greater than or equal to 250 mm), the test duration is 1 min/m² of the calculated surface area of the enclosure (excluding any mounting surface), with a minimum duration of 3 min.*

9.3 Humidity test

All luminaires shall be humidity-proof where humid conditions may occur in normal use.

Compliance is checked by the humidity treatment described in 9.3.1, followed immediately by the tests of Section 10.

Cable entries, if any, shall be left open; if knock-outs are provided, one of them shall be opened.

Parts which can be removed by hand (e.g. electrical components, covers, protective glasses), shall be removed and subjected, if necessary, to the humidity treatment with the main part.

9.3.1 *The luminaire is placed in the most unfavourable position of normal use, in a humidity cabinet containing air with a relative humidity maintained between 91 % and 95 %. The temperature of the air at all places where samples can be located shall be maintained within 1 °C of any convenient value "t" between 20 °C and 30 °C.*

Before being placed in the humidity cabinet, the sample shall be brought to a temperature between t and $(t + 4)$ °C. The sample shall be kept in the cabinet for 48 h.

NOTE In most cases, the sample can be brought to the specified temperature between t and $(t + 4)$ °C by keeping it in a room at this temperature for at least 4 h before the humidity treatment.

In order to achieve the specified conditions within the cabinet, it is necessary to ensure constant circulation of the air within, and in general to use a cabinet which is thermally insulated.

After this treatment, the sample shall show no damage affecting compliance with the requirements of this document.

IECNORM.COM : Click to view the full PDF of IEC 60598-1:2020

SECTION 10: INSULATION RESISTANCE AND ELECTRIC STRENGTH, TOUCH CURRENT AND PROTECTIVE CONDUCTOR CURRENT

10.1 General

This section specifies requirements and tests for the insulation resistance, electric strength, touch current and protective conductor current of luminaires.

10.2 Insulation resistance and electric strength

The insulation resistance and the electric strength of luminaires shall be adequate.

Compliance is checked by the tests of 10.2.1 and 10.2.2 in the humidity cabinet or the room in which the sample was brought to the specified temperature, after reassembly of those parts which may have been removed.

The switch, if any, shall be placed in the ON position for all tests, except for tests between live parts which are separated by the action of a switch.

During these tests, the following components shall be disconnected, so that the test voltages are applied to the insulation of the components, but not to the capacitive or inductive functional elements of these components, as appropriate:

- a) shunt-connected capacitors;*
- b) capacitors between live parts and the body;*
- c) protective impedance device;*
- d) chokes or transformers connected between live parts.*

If it is impossible to place metal foil in position on linings or barriers, the tests shall be made on three pieces of the lining or barrier which have been taken out and placed between two metal balls having a diameter of 20 mm, which shall be pressed together with a force of $2\text{ N} \pm 0,5\text{ N}$.

The conditions of test for transistorized ballasts shall be as specified in IEC 61347 (all parts).

For fixed Class 1 luminaires, overvoltage protective devices which comply with IEC 61643-11 shall be disconnected from the circuit.

The insulation between live parts and the body, as well as between accessible metal parts and metal foil on the inside of insulating linings and barriers, are tested according to the required type of insulation.

NOTE The term "body" includes accessible metal parts, accessible fixing screws and metal foil in contact with accessible parts of insulating material.

When carrying out the electric strength test on luminaires containing electronic controlgear, rated lamp circuit voltages greater than the luminaire supply voltage rating may be present. This is indicated by the rating U_{out} marked on the lamp controlgear. In these instances, the test voltage applied to parts of the lamp circuit shall be calculated from the U_{out} rating marked on the lamp controlgear instead of U , where U is the working voltage.

10.2.1 Test – Insulation resistance

The insulation resistance shall be measured with a DC voltage of approximately 500 V, 1 min after the application of the voltage.

For the insulation of SELV or PELV parts of luminaires, the DC voltage to be used for measurement is 100 V.

The insulation resistance shall be not less than the values specified in Table 10.1.

The insulation between live parts and the body of class II luminaires shall not be tested if the basic insulation and the supplementary insulation can be tested separately.

Table 10.1 – Minimum insulation resistance

Insulation of parts	Minimum insulation resistance MΩ		
	Class I luminaires	Class II luminaires	Class III luminaires
SELV/PELV:			
Between current-carrying parts of different polarity	a	a	a
Between current-carrying parts and the mounting surface *	a	a	a
Between current-carrying parts and metal parts of the luminaire***	a	a	a
Between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts	a	a	a
Insulating bushings as described in Section 5	a	a	a
Other than SELV/PELV:			
Between live parts of different polarity	b	b	-
Between live parts and the mounting surface *	b	b and c, or d	-
Between live parts and metal parts of the luminaire	b	b and c, or d	-
Between live parts which can become of different polarity through action of a switch	b **	b **	-
Between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts	b	c	-
Insulating bushings as described in Section 5	b	c	-
a Basic insulation for voltages of SELV/PELV	1		
b Basic insulation for voltages other than SELV/PELV	2		
c Supplementary insulation	2		
d Double or reinforced insulation	4		
* The mounting surface is covered with metal foil for the purpose of this test.			
** During the test, the switch may influence the result. In the case of electronic disconnection or micro disconnection according to 7.1.11 of IEC 61058-1:2000, it may be necessary to remove the switch from the circuit.			
*** This requirement does not exclude the connection of the PELV-circuits to earth for functional purposes.			

Insulating linings and barriers shall be tested only if the distance between live parts and accessible metal parts, without the lining or barrier, would be less than that specified in Section 11.

The insulation of bushings, cord anchorages, wire carriers or clips shall be tested in accordance with Table 10.1 and, during the test, the cable or cord shall be covered by metal foil or replaced by a metal rod of the same diameter.

These requirements do not apply to starting aids which are purposely connected to the mains if they are not live parts.

NOTE See Annex A for a test for live parts.

10.2.2 Test – Electric strength

A voltage of substantially sine-wave form, with a frequency of 50 Hz or 60 Hz and the value specified in Table 10.2, shall be applied for 1 min across the insulation shown in that table.

Initially, no more than half the specified voltage shall be applied, it is then raised gradually to the full value.

In the case of a luminaire where it is not possible to remove coupling capacitors, leading to an incorrect result in an AC test, an alternative dielectric strength test with a DC test voltage may be applied according to the following parameters/procedure:

- *The DC test voltage shall be substantially free of ripple. This requirement is fulfilled if the ratio between the peak value of the voltage and the average value is $(1,0 \pm 3) \%$. The average value of the DC test voltage shall be equal to the peak value of the AC test voltage as required in Table 10.2.*
- *The DC test voltage shall be raised uniformly from 0 V to the value specified above within 5 s and held at that value for 1 min.*

For the high-voltage source used for the test, when the output terminals are short-circuited after the output voltage has been adjusted to the appropriate test voltage, the output current shall be at least 200 mA.

The overcurrent relay shall not trip when the output current is less than 100 mA.

The value of the test voltage applied shall be measured within $\pm 3 \%$.

The metal foil shall be so placed that no flashover occurs at the edges of the insulation.

For class II luminaires incorporating both reinforced insulation and double insulation, the voltage applied to the reinforced insulation shall not overstress the basic insulation or the supplementary insulation.

Glow discharges without a drop in voltage are ignored.

No flashover or breakdown shall occur during the test.

These requirements do not apply to starting aids which are purposely connected to the mains if they are not live parts.

For luminaires with ignitors, the electric strength of parts of the luminaire that are stressed by the pulse voltage is tested with the ignitor operating, to ensure that the luminaire insulation, wiring and similar parts are adequate.

For luminaires with ignitors and lampholders which, according to the lampholder manufacturer's instructions, achieve their maximum impulse voltage protection only with a lamp inserted, a dummy lamp shall be inserted for this test.

NOTE 1 The dummy lamp can be supplied with the type test sample.

NOTE 2 This requirement enables the cap/holder design to be kept to a reasonable size while allowing the pulse voltage to rise to a level which will ensure hot restarting of a discharge lamp (for example in studio applications).

The luminaire with ignitors is connected to a supply of 100 % rated voltage, for a period of 24 h. Ignitors that become defective during this period are replaced immediately. The electric strength test with the values specified in Table 10.2 is then applied to the luminaire with all the terminals (except any earthing terminal) of the ignitor connected together.

For luminaires with manual ignitors such as push-buttons, the luminaire is connected to a supply of 100 % rated voltage and subjected to a "3 s on/10 s off" switching cycle for a total period of 1 h. Only one ignitor is used for this test.

Luminaires with ignitors provided with ballasts which are marked for exclusive use with an ignitor having a time limitation device, conforming to IEC 61347-2-9, shall be subjected to the same test but for a period consisting of 250 on/off cycles, keeping an off-period of 2 min.

No flashover or breakdown shall occur during the electric strength test.

When carrying out the electric strength test on luminaires containing electronic controlgear, rated lamp circuit voltages greater than the luminaire supply voltage rating may be present. This is indicated by the rating U_{out} marked on the lamp controlgear. In these instances, the test voltage applied to parts of the lamp circuit shall be calculated from the U_{out} rating marked on the lamp controlgear instead of U where U is the working voltage.

Furthermore, dependent on the type of insulation between the LV supply and output circuits of the controlgear, the value of working voltage U used for the electric test shall be based on U_{out} , LV supply, or U_{out} plus LV supply, as detailed by Table X.1.

Table 10.2 – Electric strength

Insulation of parts	Test voltage V		
	Class I luminaires	Class II luminaires	Class III luminaires
SELV/PELV:			
Between current-carrying parts of different polarity	a	a	a
Between current-carrying parts and the mounting surface*	a	a	a
Between current-carrying parts and metal parts of the luminaire****	a	a	a
Between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts	a	a	a
Insulating bushings as described in Section 5	a	a	a
Other than SELV/PELV:			
Between live parts of different polarity	b	b	-
Between live parts and the mounting surface*	b	b and c, or d*****	-
Between live parts and metal parts of the	b	b and c, or d*****	-

Insulation of parts	Test voltage V		
	Class I luminaires	Class II luminaires	Class III luminaires
luminaire			
Between live parts which can become of different polarity through action of a switch	b ***	b ***	-
Between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts	b	c	-
Insulating bushings as described in Section 5	b	c	-
a Basic insulation for voltages of SELV/PELV	500		
b Basic insulation for voltages other than SELV/PELV	2U ** + 1 000		
c Supplementary insulation	2U ** + 1 000		
d Double or reinforced insulation	4U ** + 2 000		
<p>* The mounting surface is covered with metal foil for the purpose of this test.</p> <p>** U in this case is the nominal line-to-neutral voltage of the neutral-earthed supply system. Advice can be found in IEC 60664-1.</p> <p>*** During the test, the switch may influence the result. In the case of electronic disconnection or micro disconnection according to 7.1.11 of IEC 61058-1:2000, it may be necessary to remove the switch from the circuit.</p> <p>**** This requirement does not exclude the connection of the PELV-circuits to earth for functional purposes.</p> <p>***** This table gives details for the situations where no electrical insulation is provided between the LV supply and output circuits of the controlgear. Where the controlgear provides basic or double/reinforced insulation from the LV supply, the required insulation from the live part to the accessible part, including the mounting surface, may be different. As a consequence of the requirements according to Table X.1, the test voltage may be modified.</p>			

10.3 Touch current, protective conductor current and electric burn

The touch current or protective conductor current that may occur during normal operation of the luminaire shall not exceed the values given in Table 10.3 when measured in accordance with Annex G:

Table 10.3 – Limits of touch current or protective conductor current and electric burn

Touch current		Max limit (peak)
All luminaires of class II		0,7 mA
Class I luminaires rated up to and including 16 A fitted with a plug connectable to an unearthed socket outlet ^a		0,7 mA
Metal parts of class I luminaires isolated by double or reinforced insulation		0,7 mA
Protective conductor current	Supply currents	Max limit (RMS)
Class I luminaires fitted with a single or multiphase plug, rated up to and including 32 A	≤ 4 A	2 mA
	> 4 A but ≤ 10 A	0,5 mA/A
	> 10 A	5 mA
Class I luminaires intended for permanent connection	≤ 7 A	3,5 mA
	> 7 A but ≤ 20 A	0,5 mA/A
	> 20 A	10 mA or according to manufacturer's instructions
Electric burn		u.c.
<p>NOTE In Australia and New Zealand there is no allowance for protective conductor current greater than 10 mA.</p> <p>^a Testing is not required where the manufacturer's instructions supplied with the luminaire advise that the luminaire must be earthed.</p>		

Compliance is checked in accordance with Annex G.

NOTE 1 For luminaires incorporating AC supplied electronic ballasts, the leakage current can be greatly dependent upon the spacing between the lamp and the earthed starting aid, due to the high frequency operation of the lamp.

NOTE 2 Further explanations regarding the measurement of touch current and protective conductor current can be found in IEC 60990 and IEC 61140:2001, Annex B.

SECTION 11: CREEPAGE DISTANCES AND CLEARANCES

11.1 General

Section 11 specifies minimum requirements for creepage distances and clearances in luminaires.

NOTE 1 The way in which creepage distances and clearances are measured is specified in IEC 60664-1.

NOTE 2 The calculation method and the structure of the creepage distances and clearances are taken from IEC 60664-1:2007 and IEC 60664-4.

NOTE 3 Annex U provides information about values for impulse withstand category III.

11.2 Creepage distances and clearances

11.2.1 General

Parts detailed in Table M.1 shall be adequately spaced. Creepage distances and clearances shall be not less than the values given in Tables 11.1.A, 11.1.B and 11.2. Creepage distances shall not be less than the required minimum clearance.

No values are specified for working voltages below 25 V RMS and 60 V DC as the test voltage of Table 10.2 is considered sufficient.

Distances between current-carrying parts of opposite polarity shall comply with the requirements for basic insulation.

The minimum distances specified are based on the following parameters:

- for use up to 2 000 m above sea level;
- pollution degree 2 where normally only non-conductive pollution occurs, but occasionally a temporary conductivity caused by condensation is to be expected;
- equipment of impulse withstand category II which is energy-consuming equipment to be supplied from the fixed installation.

For details of pollution degrees or impulse withstand categories, IEC 60664-1 should be consulted.

Compliance is checked by measurements made with and without conductors of the largest section connected to the terminals of the luminaires. Internal wiring terminals of luminaires shall be checked with actual conductors supplied with the luminaire fitted.

The contribution to the creepage distance of any groove less than 1 mm wide is limited to its width.

A creepage or a clearance distance may be split into several parts. Any air gap less than 1 mm wide is ignored in calculating the total distances, unless the total clearance is less than 3 mm where one third of the air gap width shall be taken into account.

For luminaires provided with an appliance inlet, the measurements are made with an appropriate connector inserted.

Distances through slots or openings in external parts of insulating material are measured with metal foil in contact with the accessible surface. The foil is pushed into corners and similar places by means of the standard test finger specified in IEC 60529, but it is not pressed into openings.

Reductions for creepage distances and clearances are allowed for luminaires which are (or have parts) protected against pollution by the use of coating or potting, if the requirements given in Annex P of IEC 61347-1:2015 and IEC 61347-1:2015/AMD1:2017 are fulfilled.

The values in Table 11.1.A and 11.1.B do not apply to components for which separate IEC publications exist, but do apply to mounting and accessibility distances to the component when it is incorporated in the luminaire.

Creepage distances at a supply terminal shall be measured from the live part in the terminal to any accessible metal parts, and the clearance shall be measured between incoming supply wiring and accessible metal parts, i.e. from a bare conductor of the largest cross-section to the metal parts which can be accessible. At the internal wiring side of the terminal, the clearance shall be measured between live parts of the terminal and accessible metal parts (see Figure 24).

NOTE The measurements of the clearances from supply and from internal wiring differ because the luminaire manufacturer does not have control over the length of insulation removed from the supply wiring by the installer.

When creepage distances and clearances are determined at bushings, cord anchorages, wire carriers or clips, the measurement shall be made with the cable fitted.

11.2.2 Creepage distances

The minimum values for creepage distances are listed in Table 11.1.A.

For the dimensioning of the creepage distances the RMS values of the working voltage shall be taken into account. In the case of an insulated circuit the requirements of Clause 4.31 and Annex X shall be taken into consideration to find the working voltage.

The values of Table 11.1.A are valid for voltages with a frequency below 30 kHz. For higher frequencies the following requirements shall apply.

- If the voltage and/or frequency requires higher creepage distances, the information provided by the controlgear manufacturer shall be followed, see footnote "c" of Table 11.1.A.
- If the luminaire is used in combination with or together with components or devices other than controlgear covered by IEC 61347 (all parts) and which produces frequency above 30 kHz, the requirements of IEC 60664-4 shall apply.

**Table 11.1.A – Minimum creepage distances for AC sinusoidal voltages up to 30 kHz
(to be used in conjunction with Annex M)**

Distances mm	RMS working voltage not exceeding V					
	50	150	250	500	750	1 000
Creepage distances ^{b c}						
– Basic or supplementary insulation PTI ^a						
≥ 600	0,6	0,8	1,3	2,5	3,8	5,0
< 600	1,2	1,6	2,5	5	7,6	10
– Reinforced insulation PTI ^a						
≥ 600	- ^d	1,6	2,6	5,0	7,6	10
< 600	- ^d	3,2	5,0	10	16	20
^a PTI (proof tracking index) in accordance with IEC 60112. ^b For creepage distances, the equivalent DC voltage is equal to the RMS value of the sinusoidal AC voltage. Linear interpolation between columns is allowed. ^c In the case of combination of voltage and frequency which require higher creepage than the values required in this table, the controlgear is marked with the details of this combination (U_{out} and frequency f_{Uout}) – see IEC 61347-1:2015 and IEC 61347-1:2015/AMD1:2017, 7.1, item w). For details and the required values for creepage see IEC 61347-1:2015 and IEC 61347-1:2015/AMD1:2017, 16.2.3. ^d Values under consideration.						

In the case of creepage distances to parts not energized, or not intended to be earthed, where tracking cannot occur, the values specified for material with a PTI ≥ 600 shall apply for all materials (independent of the real PTI).

For creepage distances subjected to working voltages of less than 60 s duration, the values specified for materials with a PTI ≥ 600 shall apply for all materials.

For creepage distances not liable to contamination by dust or moisture, the values specified for material with a PTI ≥ 600 shall apply (independent of the real PTI).

11.2.3 Clearances

The minimum values for clearances are listed in Tables 11.1.B and 11.2. Table 11.1.B shall be applied to all circuits taking into consideration the transient coming from the mains supply. Table 11.2 is applicable to circuits where peak voltages are generated by the equipment (internally or externally).

The values of Tables 11.1.B and 11.2 are valid for voltages having a frequency below 30 kHz. For higher frequencies the following requirements shall apply:

- If the voltage and/or the frequency requires higher clearance than the value in Tables 11.1.B and 11.2, the equivalent peak voltage (U_p) provided by the controlgear manufacturer shall be used. The value of U_p is directly comparable to the values given in Table 11.2. The value of U_p may be different for the evaluation of basic/supplementary and reinforced insulation.
- If the luminaire is used in combination with or together with components or devices other than controlgear covered by IEC 61347 (all parts) and which produces frequency above 30 kHz, the requirements of IEC 60664-4 shall apply.

**Table 11.1.B – Minimum clearance for working voltages
(to be used in conjunction with Annex M)**

Distances mm	RMS working voltage not exceeding V				
	50	150	300	600	1 000
Clearances with mains supply transients according to impulse withstand category II ^b					
– Basic or supplementary insulation	0,2	0,5	1,5	3	5,5
– Reinforced insulation	0,2	1,5	3	5,5	8
Clearances without mains supply transients ^{a b}					
– Basic or supplementary insulation	0,2	0,2	0,2	0,2	0,7
– Reinforced insulation	0,2	0,2	0,2	0,6	1,6
^a The values in this row are applicable to circuits where it is ensured that they are free from transient (e.g. battery circuits). ^b For clearances, the equivalent DC voltage is equal to the peak of the AC voltage. Interpolation between columns is not allowed, if transient according to the impulse withstand category II have to be considered for the main supply.					

Minimum clearance distances for ignition pulse voltages and equivalent peak voltage (U_p) are given in Table 11.2.

**Table 11.2 – Minimum distances for ignition pulse voltages
or equivalent peak voltage U_p**

	Rated ignition pulse voltage or equivalent peak voltage U_p								
	kV								
	2,0	2,5	3,0	4,0	5,0	6,0	8,0	10	12
Minimum clearance in mm ^a (basic and supplementary insulation)	1	1,5	2	3	4	5,5	8	11	14
Minimum clearance in mm ^a (reinforced insulation)	2,2	3,0	3,8	6,0	8,0	10,4	15	19,4	24
	Rated ignition pulse voltage or equivalent peak voltage U_p								
	kV								
	15	20	25	30	40	50	60	80	100
Minimum clearance in mm ^a	18	25	33	40	60	75	90	130	170
Minimum clearance in mm ^a (reinforced insulation)	31,4	44	60	72	98	130	162	No values available	
NOTE The distances in Table 11.2 are derived from IEC 60664-1:2007, Table F.2, case A, inhomogeneous field conditions.									
^a Linear interpolation between columns is allowed.									

For distances subjected to both sinusoidal voltage as well as non-sinusoidal pulses, the minimum required distance shall be not less than the highest value indicated in Tables 11.1.A, 11.1.B and 11.2.

SECTION 12: ENDURANCE TEST AND THERMAL TEST

12.1 General

This section specifies requirements relating to the endurance test and thermal tests of luminaires.

12.2 Selection of lamps and ballasts

Lamps used for the tests of this section shall be selected in accordance with Annex B.

The lamps used in the endurance test are operated above their rated wattage for extended periods, and shall not be used for the thermal tests. However, it is usually convenient to retain in the thermal test for abnormal operation those lamps that have been used in the thermal test for normal operation.

If the luminaire requires a separate ballast and this is not supplied with the luminaire, a ballast shall be selected for test purposes which is typical of normal production, and which complies with the relevant ballast specification. The power delivered to a reference lamp by the ballast under reference conditions shall be within $\pm 3\%$ of rated lamp power.

NOTE 1 For reference conditions, see the relevant IEC controlgear standard.

NOTE 2 In the relevant lamp performance standards, the rated wattage can still be indicated as "objective" wattage. This wording will be corrected in future editions of these standards.

12.3 Endurance test

Under conditions representing cyclic heating and cooling in service, the luminaire shall not become unsafe.

Compliance is checked by carrying out the test described in 12.3.1.

12.3.1 Test

- a) *The luminaire shall be mounted in a thermal enclosure with means for controlling the ambient temperature within the enclosure.*

The luminaire shall be positioned on a similar supporting surface (and in the same operating position) as for the normal operation thermal test (see 12.4.1).

- b) *The ambient temperature within the enclosure shall be maintained within $\pm 2\text{ }^{\circ}\text{C}$ of $(t_a + 10)\text{ }^{\circ}\text{C}$ during the test; t_a is $25\text{ }^{\circ}\text{C}$ unless otherwise marked on the luminaire.*

The ambient temperature within the enclosure shall be measured in accordance with Annex K. Ballasts for operation separate from the luminaire shall be mounted in free air, not necessarily in the thermal enclosure, and shall be operated in an ambient temperature of $25\text{ }^{\circ}\text{C} \pm 5\text{ }^{\circ}\text{C}$.

- c) *The luminaire shall be tested in the enclosure for a total duration of 168 h consisting of seven successive cycles of 24 h. Supply voltage as specified in item d) below shall be applied to the luminaire for the first 21 h and disconnected for the remaining 3 h of each cycle. The initial heating period of the luminaire is part of the first test cycle.*

The circuit condition shall be as in normal operation for the first six cycles, and as in abnormal operation (see Annex C) for the seventh cycle. For luminaires containing an electrical motor (e.g. a fan) the abnormal condition which most adversely affects the result of the test shall be selected.

For luminaires powered via information technology communication cable, the seventh cycle is carried out with the overvoltage condition as indicated in item d) considering the over voltage as an abnormal condition.

For luminaires for which there is no abnormal condition test according to 12.5.1, the total test duration shall be 240 h (i.e. 10 × 24 cycles at normal operation). For filament luminaires, the total test duration of 240 h shall apply in all cases.

- d) *During operating periods, the supply voltage for filament lamp luminaires, other than ELV, shall be $1,05 \pm 0,015$ times the voltage at which the rated wattage of the lamp is obtained.*

During operating periods, the supply voltage for other luminaires shall be $1,10 \pm 0,015$ times the rated voltage or the maximum of the rated voltage range.

For luminaires for constant voltage or constant current operation not equipped with controlgear the test shall be performed with 1,1 times the rated input constant voltage or rated input constant current as appropriate.

During operating periods, the supply voltage for class III luminaires, powered via information technology communication cable, shall be:

for cycles 1 to 6 (representing normal operation)

- 110 % of the rated input voltage of the luminaire at the relevant input port;*

for cycle 7 (representing abnormal operation)

- 130 % of the rated input voltage of the luminaire at the relevant input port for circuits greater than $5 V_{DC}$, with a minimum of $7,5 V_{DC}$ and*
- 150 % of the rated input voltage of the luminaire at the relevant input port for circuits equal to/less than $5 V_{DC}$.*

- e) *If the luminaire ceases to operate because of a failure, the following shall apply.*

- In the case of chance failure of a part of the luminaire (including the lamp), the instructions of item g) of 12.4.1 shall apply.*

- If a thermal protective device operates during the first six cycles, the test shall be modified as follows.*

- 1) For luminaires with cyclic protective devices, the luminaire shall be allowed to cool until the device resets. For luminaires with one-shot thermal protective devices (thermal links), the device shall be replaced.*

- 2) For all kinds of luminaires, the test shall then be continued up to 240 h in total with the circuit and the temperature adjusted in such a way that the protective device just fails to operate. The luminaire is deemed to have failed the test if adjustment below the luminaire's rated characteristics is necessary to prevent the protective device operating.*

- If a thermal protective device operates during the seventh (abnormal conditions) cycle, it shall either be allowed to cool, or, in the case of a one-shot device, it shall be replaced, and the test continued with the circuit and temperature adjusted in such a way that the protective device just fails to operate.*

- f) *In the case of luminaires incorporating a constant light output function, the luminaire shall be operated with the output of the controlgear set to deliver the maximum output to the light source for which the luminaire has been designed.*

NOTE It is possible that the manufacturer will need to provide a specially prepared test sample.

It is considered that if a cut-out device operates during the seventh (abnormal condition) cycle, then the functioning of the intended protection has been proven.

Arrangements should be made to signal a break in operation. The effective test duration shall not be reduced as a consequence of such a break.

12.3.2 Compliance

After the test of 12.3.1, the luminaire and, for track-mounted luminaires, also the track and component parts of the track system, shall be visually inspected. No part of the luminaire shall have become unserviceable (other than as a chance failure as described in item e) of 12.3.1) and plastic ES lampholders shall not be deformed. The luminaire shall not have become unsafe and shall not have caused damage to the track system. The marking of the luminaire shall be legible.

NOTE Symptoms of possible unsafe conditions include cracks, scorches and deformation.

12.4 Thermal test (normal operation)

Under conditions representing normal service, no part of the luminaire (including the lamp), the supply wiring within the luminaire, or the mounting surface shall attain a temperature which would impair safety.

In addition, parts intended to be touched, handled, adjusted or gripped by hand while the luminaire is at operating temperature shall not be too hot for the purpose.

Luminaires shall not cause excessive heating of lighted objects.

Track-mounted luminaires shall not cause excessive heating of tracks on which they are mounted.

Compliance is checked by carrying out the test described in 12.4.1. The test conditions for measuring the track temperature shall be as given in 12.1 of IEC 60570:2003.

For luminaires containing an electrical motor, this motor shall operate as intended during the test.

12.4.1 Test

The temperature shall be measured as indicated in 12.4.2 in accordance with the following conditions.

- a) *The luminaire shall be tested in a draught-proof enclosure designed to avoid excessive changes in ambient temperature. A luminaire suitable for surface mounting shall be mounted on a surface as described in Annex D. An example of a draught-proof enclosure is given in Annex D, but other types of enclosure may be used if the results obtained are compatible with those that would be obtained by the use of the enclosure described in Annex D. (For ballasts separate from the luminaire, see item h) of the present subclause.)*

The luminaire shall be connected to the power supply with the wiring and any materials (for example insulating sleeves) supplied with the luminaire for the purpose.

In general, connection shall be in accordance with the instructions provided with the luminaire or marked on it. Otherwise, wiring required to connect the luminaire under test to the supply and not supplied with it should be of a type representative of common practice. Such wiring not supplied with the luminaire is hereafter referred to as the test piece.

Temperature measurements shall be made in accordance with Annex E and Annex K.

- b) *The operating position shall be the thermally most onerous operating position which may reasonably be adopted in service. For fixed non-adjustable luminaires, a position shall not be selected if it is stated to be not permissible in instructions supplied with, or marked on, the luminaire. For settable and adjustable luminaires, the required distance from lighted objects shall be respected if marked on the luminaire, except for luminaires without provision for mechanical locking in any position, when the front rim of the reflector if any, otherwise the lamp, shall be positioned 100 mm from the mounting surface.*

- c) *The ambient temperature within the draught-proof enclosure shall be within the range of 10 °C to 30 °C and should preferably be 25 °C. It shall not vary by more than ± 1 °C during measurements and during a preceding period long enough to affect the results.*

If, however, a lamp has temperature-sensitive electrical characteristics (e.g. a fluorescent lamp), or if the t_a rating of the luminaire exceeds 30 °C, the ambient temperature within the draught-proof enclosure shall be within 5 °C of the t_a rating and should preferably be the same as the t_a rating.

An alternative test method is given in Clause D.3. In case of doubt the test method of 12.4.1 c) shall be taken as a reference test method.

- d) *The test voltage for the luminaire shall be as follows.*

- *Filament lamp luminaires other than ELV: that voltage which produces 1,05 times the rated wattage of the test lamp (see Annex B) except that heat test source (HTS) lamps are always operated at the voltage marked on the lamp.*
- *For other luminaires: 1,06 times the rated voltage or the maximum of the rated voltage range.*
- *For motors contained in luminaires: 1,06 times the rated voltage (or the maximum of the rated voltage range of the luminaire).*

Exception

For determination of the average temperature of the winding of a component with t_w marking and for the determination of the case temperature of a component with t_c marking, except capacitors, the test voltage shall be 1,00 times the rated voltage. This exception applies only to the measurement of the winding or case temperature and does not apply, for example, to the measurement of a terminal block on the same component.

Capacitors whether carrying t_c or not are tested at 1,06 times the rated voltage when operated within fluorescent and other discharge luminaires.

NOTE 1 If a luminaire contains both a filament lamp and a tubular fluorescent or other discharge lamp or a motor, it can be necessary to provide it temporarily with two separate supplies.

For luminaires for constant voltage or constant current operation not equipped with controlgear the test shall be performed with 1,1 times the rated input constant voltage or rated input constant current as appropriate.

During operating periods, the supply voltage for class III luminaires, powered via information technology communication cable, shall be:

- *106 % of the rated input voltage of the luminaire at the relevant input port.*

- e) *During and immediately before a measurement, the supply voltage shall be held within ± 1 % and preferably within $\pm 0,5$ % of the test voltage. The supply voltage shall be held within ± 1 % of the test voltage during such preceding period as may affect the measurement; this period shall be not less than 10 min.*
- f) *Measurements shall not be taken until the luminaire has stabilized thermally, i.e. temperatures are changing at a rate less than 1 °C per hour.*
- g) *If the luminaire ceases to operate because of a defective part of the luminaire (including the lamp), the part should be replaced and the test continued. Measurements already made need not be repeated, but the luminaire shall be stabilized before further measurements are made. If, however, a hazardous condition has arisen, or if any part becomes unserviceable as a type defect, then the luminaire is deemed to have failed the test. If a protective device in the luminaire operates, the luminaire is deemed to have failed.*
- h) *If remote controlgear/components are supplied as part of a luminaire, they shall be mounted and operated in accordance with the manufacturer's instructions. Temperatures of all parts shall comply with the limits specified by Section 12.*

If remote controlgear is not supplied as part of the luminaire, the manufacturer will provide controlgear typical of normal use. The controlgear shall be operated in free air and in an ambient temperature of 25 °C \pm 5 °C. The temperature of the controlgear shall not be measured.

- i) *In case of doubt in the test for filament lamp luminaires, the test shall be repeated with heat test source (HTS) lamps, if available. For temperatures which are mainly governed by the cap temperature of the lamp, the values obtained by HTS lamps are decisive. For those temperatures which are mainly governed by radiation, the values obtained by normal production lamps with clear bulbs are decisive.*
- j) *The light beam from the luminaire, for luminaires covered by 3.2.13, is directed towards a matt black painted wooden surface mounted perpendicular to the main direction of the light and similar to that described in Annex D. In case of more than one lamp is in use, the centre lamp shall be directed as specified above. All other lamps shall be directed in order to achieve a common focus. Luminaires are mounted at the distance from the surface which is marked on the luminaire.*

During the tests, measurements shall be made of the temperature of certain insulating parts, as required for the tests of Section 13.

- k) *For the measurement of lampholder temperatures for double-capped fluorescent lamps, the hot junction of the thermocouple shall be located flush with that surface of the holder adjacent to the lamp cap. If this is not possible, it should be placed as close as possible to this point but without touching the lamp cap.*

NOTE 2 The luminaire manufacturer can provide the type test sample with a thermocouple already attached to the lampholder. Usually, only one lampholder is prepared in such a way.

- l) *During the test for compliance, the through wiring and the looping-in wiring shall be loaded to the maximum value allowed by the size of the wire, or at a value specified by the manufacturer in the installation instructions.*

NOTE 3 In the following countries, during thermal testing, both the through wiring and the looping-in wiring are required to be loaded to the maximum value allowed by the size of the wire: Canada, USA.

- m) *In the case of luminaires incorporating a constant light output function the luminaire shall be operated with the output of the controlgear set to deliver the maximum output to the light source for which the luminaire has been designed.*

NOTE 4 It is possible that the manufacturer will need to provide a specially prepared test sample.

12.4.2 Compliance

In the test of 12.4.1, none of the temperatures shall exceed the appropriate values given in Tables 12.1 and 12.2 (subject only to the concession of item a) of this subclause) when the luminaire is operated at its rated ambient temperature t_a .

In those cases where the temperature in the test enclosure differs from t_a , this difference shall be taken into account when applying the limits in the tables (see also item c) of 12.4.1).

- a) *The temperature shall not exceed the values specified in Tables 12.1 and 12.2 by more than 5 °C.*

NOTE The allowance of 5 °C is made to take into account the inevitable variability of temperature measurements in luminaires.

- b) *The temperature of any part of the luminaire liable to thermal degradation in service shall not exceed a value which corresponds to a reasonable service period for the particular type of luminaire. Generally agreed values for principal parts of luminaires are given in Table 12.1 and values for common materials, when used in luminaires, are listed in Table 12.2. These values are specified here to obtain uniform assessment; slightly different values may be quoted elsewhere on the basis of other forms of materials testing or for other applications.*

If materials are used which are claimed to withstand higher temperatures than those specified in Table 12.2, or if other materials are used, they shall not be exposed to temperatures in excess of those which have been proved permissible for these materials.

- c) The temperature of the test piece (see item a) of 12.4.1), if PVC-insulated, shall not exceed 90 °C (or 75 °C where it is stressed, for example clamped), or such higher temperatures as may be indicated on the luminaire or in the manufacturer's instructions supplied with the luminaire in accordance with the requirements of Section 3. The limit shall be 120 °C for any PVC-insulated wire (internal or external wiring) even when additionally protected by a heat-resisting sleeve supplied with the luminaire. The sleeve shall comply with the requirements of 4.9.2.

Table 12.1 – Maximum temperatures under the test conditions of 12.4.2, for principal parts (1 of 2)

Part	Maximum temperature °C
Lamp caps	As specified in the appropriate IEC lamp standard ^a
Windings in ballasts or transformers with t_w marking	t_w
Case (of capacitor, starting device, electronic ballast or convertor, etc.)	
If t_c is marked	t_c^b
For capacitor if t_c is not marked	50
Windings in transformers, motors, etc., if the winding insulation system according to IEC 60085 is:	
– of class A material ^c	100
– of class E material ^c	115
– of class B material ^c	120
– of class F material ^c	140
– of class H material ^c	165
Insulation of wiring:	See Table 12.2 and items b) and c) of 12.4.2
Contacts of ceramic lampholders and insulating material of lampholders and starterholders:	
T1 or T2 marked (B15 and B22) ^d (IEC 61184)	165 for T1 and 210 for T2
Other types with T marking (IEC 60238, IEC 60400, IEC 60838 ^e and IEC 61184)	T marking
Other types without T marking (E14, B15) (IEC 60238 and IEC 61184)	135
(E27, B22) (IEC 60238 and IEC 61184) (E26)	165
(E40) (IEC 60238) (E 39)	225
Fluorescent lampholder/starterholders and miscellaneous lampholders without T marking (IEC 60400 and IEC 60838 (all parts) ^e)	80
Switches marked with individual ratings:	
With T marking	T marking
Without T marking	55
Other parts of the luminaire (according to material and use):	See Table 12.2 and item b) of 12.4.2

Table 12.1 (2 of 2)

Part	Maximum temperature °C
Mounting surface:	
Normally flammable surface	90
Non-combustible surface	Not measured
Means of adjustment and its surrounding space ^f	
Metal parts	60
Non-metal parts	75
Objects lighted by spotlights (see 12.4.1 j)):	90 (of test surface)
Track (for track-mounted luminaires)	As stated by the track manufacturer ^g
Plug-in independent controlgear, mains socket-outlet mounted luminaires:	
– case parts intended to be gripped by hand	75
– plug/socket interface	70
– all other parts	85
Replaceable glow-starting devices	80 ^h
Surface of recessed luminaires above suspended ceiling, covered with thermal insulating material	90
<p>^a For luminaires marked with information concerning the use of special lamps, or if it is obvious that special lamps are to be used, a higher value, as specified by the lamp manufacturer, is allowed. IEC 60357 and IEC 60682 provide information for the measurement of pinch temperature for tungsten halogen lamps. These measurements are required for performance criteria of lamps and not safety criteria of the luminaire. (Single-capped fluorescent lamps are excluded from being measured under normal operation test conditions, see Table 12.3).</p> <p>This does not apply to lamps covered by the scope of IEC 60432-2. The relevant information in this document for luminaire design shall be observed.</p> <p>^b Measured at the given reference point marked by the device manufacturer.</p> <p>^c The material classification is in accordance with IEC 60085 and IEC 60216 series.</p> <p>^d Temperature measured on the rim of a corresponding cap.</p> <p>^e For bi-pin lampholders, in case of doubt, the average of the contact temperature measurements should be used.</p> <p>^f For adjustable luminaires where the mounting instructions provide clear guidance to mount out of reach, and for settable luminaires, the temperature limits for the means of adjustment are not applicable</p> <p>^g For measuring conditions for the track temperature, see 12.1 of IEC 60570:2003.</p> <p>^h This temperature limit is a performance and not a not safety recommendation.</p>	

Table 12.2 – Maximum temperatures under the test conditions of 12.4.2, for common materials used in luminaires

Part	Maximum temperature °C
Insulation of wiring (internal and external), supplied with luminaire ^b :	
Glassfibre silicone-varnish impregnated	200 ^a
Polytetrafluoroethylene (PTFE)	250
Silicone rubber (not stressed)	200
Silicone rubber (compressive stress only)	170
Rubber or ordinary polyvinyl chloride (PVC)	90 ^a
Heat-resisting polyvinyl chloride (PVC)	105 ^a
Ethylene vinyl acetate (EVA)	140 ^a
Insulation of fixed wiring (as a fixed part of the installation not supplied with the luminaire) ^a :	
Unsleeved	90 ^c
Appropriate sleeving supplied with the luminaire	120
Thermoplastics:	
Acrylonitrile-butadiene-styrene (ABS)	95
Cellulose acetate butyrate (CAB)	95
Polymethyl methacrylate (acrylic)	90
Polystyrene	75
Polypropylene	100
Polycarbonate	130
Polyvinyl chloride (PVC) (where NOT used for electrical insulation)	100
Polyamide (nylon)	120
Thermosetting plastics:	
Mineral-filled phenol-formaldehyde (PF)	165
Cellulose-filled phenol-formaldehyde (PF)	140
Urea-formaldehyde (UF)	90
Melamine	100
Glassfibre-reinforced polyester (GRP)	130
Other materials:	
Resin-bonded paper/fabric	125
Silicone rubber (where NOT used for electrical insulation)	230
Rubber (where NOT used for electrical insulation)	90
Wood, paper, textiles and the like	90
^a Reduced by 15 °C where insulation is stressed, e.g. clamped or flexed. ^b Cable specifications usually quote different maximum temperatures but these are based on continuous operating temperatures rather than the test conditions given in this specification. ^c This temperature is the maximum permitted under the artificial test conditions given in this table, for example draught-proof enclosure and test supply voltage above the rated value for the luminaire. It is important to note that, in some countries, the European installation standards and the European cable standards specify a temperature of 70 °C to be the maximum that PVC fixed wiring can sustain in normal continuous operation.	

12.5 Thermal test (abnormal operation)

Under conditions representing abnormal service conditions (where applicable, but not representing a defect in the luminaire or misuse), parts of the luminaire and the mounting surface shall not attain excessive temperatures and the wiring within the luminaire shall not become unsafe.

NOTE Symptoms of possible unsafe conditions include cracks, scorches and deformation.

Track-mounted luminaires shall not cause excessive heating of tracks on which they are mounted.

Compliance is checked by carrying out the test described in 12.5.1.

12.5.1 Test

Temperatures of parts listed in Table 12.3 shall be measured in accordance with the following conditions.

- a) *The test shall be made if, during service, the luminaire could be in an abnormal condition as in cases 1), 2), 3) or 4) below, and if this condition would cause any part to be at a higher temperature than during normal operation (in which case a preliminary trial may be needed).*

If more than one abnormal condition is possible, that condition which most adversely affects the results of the tests shall be selected.

The test is not applicable to fixed non-adjustable filament lamp luminaires, except in case 3) below.

- 1) A possibly unsafe operating position, arising other than from misuse, e.g. if by accident an adjustable luminaire is bent in the direction of the mounting surface by using a force of 30 N minimum during a short period of time and on the most unfavourable point on the luminaire.*
- 2) A possibly unsafe circuit condition arising other than from defective manufacture or misuse; for example a circuit condition occurring at the end of the service period of a lamp or of a starter (see Annex C).*
- 3) A possibly unsafe operation condition arising from the use of a GLS lamp in a filament lamp luminaire intended for a special lamp; e.g. if, temporarily, a special lamp is replaced by a GLS lamp of the same wattage.*
- 4) A possible unsafe circuit condition arising from a short circuit in the secondary circuit (including the transformer itself) of a luminaire with transformer fitted for lamp voltage supply.*
- 5) A possible unsafe condition arising from overvoltage for a luminaire powered via information technology communication cable.*

Test 2) is applicable only to tubular fluorescent and other discharge lamp luminaires.

Test 4) shall be made with a short-circuit in the lampholder. During test 4), the temperature rise due to heat emanating from the lamp to the mounting surface shall be checked by the test according to item 1), while the temperature rise due to heat emanating from the transformer shall be measured with the contacts of the lampholder being short-circuited.

Luminaires containing an electrical motor are operated with the rotor locked against rotation.

In the case of the presence of one or more motors, the test should be made in accordance with the most critical condition (see Annex C).

The luminaire shall be tested under the conditions specified in items a), c), e), f), h) and l) of 12.4.1. In addition, the following shall apply.

- b) *The test voltage shall be as follows.*

Filament lamp luminaires: as specified in item d) of 12.4.1.

Tubular fluorescent and other discharge lamp luminaires: 1,1 times the rated voltage or the maximum of the rated voltage range.

For motors contained in luminaires: 1,1 times the rated voltage (or the maximum of the rated voltage range of the luminaire).

Luminaires containing transformer/convertors during short-circuit according to test 4): between 0,9 and 1,1 times the rated supply voltage, whichever is the most unfavourable.

During operating periods, the supply voltage for class III luminaires, powered via information technology communication cable, shall be:

- 130 % of the rated input voltage of the luminaire at the relevant input port for circuits greater than 5 V_{DC}, with a minimum of 7,5 V_{DC} and
- 150 % of the rated input voltage of the luminaire at the relevant input port for circuits equal to/less than 5 V_{DC}.

NOTE 1 If a luminaire contains both a filament lamp and a tubular fluorescent or other discharge lamp, or a motor, it may be necessary to provide it temporarily with two separate supplies.

For luminaires for constant voltage or constant current operation not equipped with controlgear the test shall be performed with 1,1 times the rated input constant voltage or rated input constant current as appropriate.

- c) *If the luminaire ceases to operate because of a defective part of the luminaire (including the lamp), the part should be replaced and the test continued. Measurements already made need not be repeated, but the luminaire shall be stabilized before further measurements are made. If, however, a hazardous condition has arisen, or if any part becomes unserviceable as a type defect, then the luminaire is deemed to have failed the test.*

If a protective device in the luminaire (for example a thermal or current cut-out of the one-shot or cycling type) operates during the test, the highest temperatures reached should be taken as the final temperatures.

- d) *If the luminaire incorporates a capacitor (other than a capacitor connected directly across the supply), this capacitor shall be short-circuited, notwithstanding the requirements of Annex C, if the voltage across it under test conditions would exceed 1,25 times its rated voltage for self-healing capacitors or 1,3 times its rated voltage for non-self-healing capacitors.*
- e) *Luminaires for some metal halide lamps and some high pressure sodium vapour lamps which according to the lamp specification can lead to ballast, transformer or starting device or transformer overheating are tested in accordance with item b)2) of Annex C.*
- f) *In the case of luminaires incorporating a constant light output function the luminaire shall be operated with the output of the controlgear set to deliver the maximum output to the light source for which the luminaire has been designed.*

NOTE 2 It is possible that the manufacturer will need to provide a specially prepared test sample.

12.5.2 Compliance

In the test of 12.5.1, none of the temperatures shall exceed the appropriate value given in Tables 12.3, 12.4 and 12.5 by more than 5 °C when the luminaire is operated at its rated ambient temperature t_a . In cases where the temperature of the test enclosure differs from t_a , the difference shall be taken into account when applying the limits given in the table.

Table 12.3 – Maximum temperatures under the test conditions of 12.5.1

Part	Maximum temperature °C
Caps of single-capped fluorescent lamps	As specified in the appropriate IEC lamp standard ^c
Windings in ballasts or transformers with t_w marking ^a Windings in transformers, motors etc., if the winding insulation system according to IEC 60085 is: – of class A material ^b – of class E material ^b – of class B material ^b – of class F material ^b – of class H material ^b	See Tables 12.4 and 12.5 150 165 175 190 210
Capacitor case: – if t_c is not marked – if t_c is marked.	60 $t_c + 10$
Ignitor case	$(t_c + X)$ as marked on the ignitor
Mounting surface: – surface illuminated by the lamp (settable and adjustable luminaires according to 12.5.1 a) 1) – surface heated by the lamp (portable luminaires according to 4.12 of IEC 60598-2-4:2017) – normally flammable surface – non-combustible surface (luminaires with symbol or warning notice)	175 175 130 Not measured
Track (for track-mounted luminaires)	As stated by the track manufacturer
Mains socket-outlet-mounted-luminaires and plug-ballast/transformer case parts intended to be gripped by hand	75
Surface of recessed luminaires above suspended ceiling, covered with thermal insulating material	130
^a Unless otherwise marked on the ballast, the maximum temperatures specified in the column S4.5 of Table 12.4 or Table 12.5 apply. ^b The material classification is in accordance with IEC 60085 and IEC 60216 (all parts). ^c Information regarding point(s) of measurement and temperature limits is given in IEC 61199:2011, IEC 61199:2011/AMD1:2012 and IEC 61199:2011/AMD2:2014, Annex C.	

Table 12.4 – Maximum temperature of windings under abnormal operating conditions and at 110 % of rated voltage for lamp controlgear

		Maximum temperature					
		°C					
Constant S		S4.5	S5	S6	S8	S11	S16
For $t_w =$	90	171	161	147	131	119	110
	95	178	168	154	138	125	115
	100	186	176	161	144	131	121
	105	194	183	168	150	137	126
	110	201	190	175	156	143	132
	115	209	198	181	163	149	137
	120	217	205	188	169	154	143
	125	224	212	195	175	160	149
	130	232	220	202	182	166	154
	135	240	227	209	188	172	160
	140	248	235	216	195	178	166
	145	256	242	223	201	184	171
	150	264	250	230	207	190	177

Table 12.5 – Maximum temperature of windings under abnormal operating conditions and at 110 % of rated voltage for lamp controlgear marked "D6"

		Maximum temperature °C					
Constant S		S4.5	S5	S6	S8	S11	S16
For $t_w =$	90	158	150	139	125	115	107
	95	166	157	145	131	121	112
	100	172	164	152	137	127	118
	105	179	171	158	144	132	123
	110	187	178	165	150	138	129
	115	194	185	171	156	144	134
	120	201	192	178	162	150	140
	125	208	199	184	168	155	145
	130	216	206	191	174	161	151
	135	223	213	198	180	167	156
	140	231	220	204	186	173	162
	145	238	227	211	193	179	168
	150	246	234	218	199	184	173

For lamp controlgear subjected to an endurance test duration other than 30 days or 60 days, Equation (2) as specified in Clause 13 of IEC 61347-1:2015 should be used to calculate the maximum temperature which should correspond to the number of days equal to two-thirds of the theoretical endurance test.

(An explanation of the constant S and its use is given in the relevant IEC auxiliary standard.)

12.6 Thermal test (failed windings in lamp controlgear)

These tests apply only to luminaires classified for mounting on normally flammable surfaces and incorporating controlgear that either does not meet the spacing requirements of 4.16.1 or does not provide thermal protection in accordance with 4.16.2. Electronic lamp controlgear and small wound devices that may be incorporated into these components are exempt from the requirements of this clause.

12.6.1 Test for luminaires without thermal cut-outs

The luminaire shall be tested under the conditions specified in items a), c), e), f), h) and l) of 12.4.1. In addition, the following also applies.

20 % of the lamp circuits in the luminaire, and not less than one lamp circuit, shall be subjected to abnormal conditions (see item a) of 12.5.1).

The circuits which have the most thermal influence on the mounting surface shall be chosen, and other lamp circuits shall be operated at rated voltage, or at the maximum of the rated voltage range under normal conditions.

The circuits subjected to the above conditions shall then be operated at 0,9, 1,0 and 1,1 times the rated voltage (or the maximum of the rated voltage range). When conditions are stable at each of these three test voltages, the highest winding temperature and the highest temperature of any part of the mounting surface shall be measured.


For fluorescent lamp luminaires with an AC supplied electronic lamp controlgear incorporating a filter coil, the voltage required to give nominal operating current shall be determined. The filter coil shall be operated at 0,9, 1,0 and 1,1 times this voltage. When conditions are stable at each of these three test voltages, the highest winding temperature and the highest temperature of any part of the mounting surface shall be measured. All other parts of the lamp controlgear and lamp shall be inoperative for this test.

Compliance is checked as follows.

- a) *The temperature of the mounting surface shall not exceed 130 °C when the lamp circuit(s), subjected to abnormal conditions, is (are) operated at 1,1 times the rated voltage.*
- b) *The values of temperature measured at 0,9, 1,0 and 1,1 times the rated voltage (or the maximum of the voltage range) are used for the linear regression formula in calculating the temperature of the mounting surface in relation to a ballast/transformer winding temperature of 350 °C. If the difference between winding temperature measurements at 0,9 and 1,1 co-ordinates is less than 30 K, a fourth point is added, whose co-ordinates are winding t_a , mounting surface t_a . The best straight line is drawn through the points on the graph. The estimated temperature of the mounting surface corresponding to a ballast winding temperature of 350 °C shall not exceed 180 °C.*

NOTE t_a is the rated t_a of the luminaire.

- c) *For track-mounted luminaires, no part of the track shall show symptoms of unsafe deterioration, for example cracks, scorches or deformation.*

12.6.2 Test for luminaires with temperature sensing controls external to the ballast or transformer and luminaires with temperature declared thermally protected ballasts
symbol  with a marked value above 130 °C.

The luminaire shall be set up for this test as described in 12.6.1.

The circuits subjected to the above conditions shall be operated with a slowly and steadily increasing current through the windings until the thermal cut-out operates. Time intervals and increments in current shall be such that thermal equilibrium between winding temperatures and mounting surface temperatures is achieved as far as is practicable.

During the test, the highest temperature of any part of the surface on which the luminaire is mounted shall be continuously measured. This completes the test for luminaires fitted with thermal links.

For luminaires fitted with manual-reset thermal cut-outs, the test shall be repeated three times, allowing a 30 min interval between tests. At the end of each 30 min interval, the cut-out shall be reset.

For luminaires fitted with auto-reset thermal cut-outs, the test shall be continued until a stable mounting surface temperature is achieved. The auto-reset thermal cut-out shall operate three times by switching the ballast off and on, under the given conditions.

Associated transformers not tested with their own enclosure shall be subjected to the test since these characteristics are not verified by the component standard.

Compliance is checked as follows.

During the test, the temperature of any part of the mounting surface shall not exceed 135 °C and shall be not more than 110 °C when the protector recloses the circuit (with a resetting type protector) except that:

during any cycle of operation of the protector during the test, the surface temperature may be more than 135 °C, provided that the length of time between the instant when the surface temperature first exceeds the limit and the instant of attainment of the maximum temperature indicated in Table 12.6 does not exceed the time correspondingly indicated in that table.

Table 12.6 – Temperature overshoot time limitation

Maximum temperature of the mounting surface °C	Maximum time for attainment of the maximum temperature from 135 °C Min
over 180	0
between 175 and 180	15
between 170 and 175	20
between 165 and 170	25
between 160 and 165	30
between 155 and 160	40
between 150 and 155	50
between 145 and 150	60
between 140 and 145	90
between 135 and 140	120

After the test, the following applies.

The highest temperature of any part of the mounting surface shall not exceed 180 °C at any time during tests for thermal links and manual-reset thermal cut-outs, or 130 °C during tests for auto-reset thermal cut-outs.

For track-mounted luminaires, after the test no part of the track shall show symptoms of unsafe deterioration, for example cracks, scorches or deformation.

12.7 Thermal test in regard to fault conditions in lamp controlgear or electronic devices incorporated in thermoplastic luminaires

The test applies only to luminaires with a thermoplastic housing not fitted with a mechanical temperature-independent support as per 4.15.2.

This test shall not be applied to independent transformers provided with their own enclosure, complying with IEC 61558 (all parts) and to independent controlgear with their own enclosure complying with IEC 61347 (all parts).

12.7.1 Test for luminaires without temperature sensing controls

12.7.1.1 Test for luminaires incorporating ballast(s) of fluorescent lamps with a lamp load ≤ 70 W

Three luminaires shall be tested under the conditions specified in items a), b), c), e), and h) of 12.4.1. In addition, the following applies.

The ballast under test (which has the most thermal influence on the fixing points, mounting surface and exposed parts, fitted inside the luminaire according to luminaire design) shall be supplied directly at 1,1 times the rated voltage for 4 h (conditioning period), in accordance with Figure 32.

If more than one ballast is used inside the luminaire, only one of them shall be checked in fault condition; the other(s) shall be supplied at 1,1 times the rated supply voltage, in normal operation with the relevant lamp (s) in the circuit (up to the end of the test).

Following the first initial conditioning period, the supply voltage to the ballast under test shall be increased by 20 % of the rated supply voltage and left for a period of 15 min. If no failure of the ballast occurs during this period, the supply voltage to the ballast under test shall be increased repeatedly in steps of 10 % of the rated supply voltage at 15 min intervals until ballast failure occurs.

For the circuit not subjected to the test, an increase of the supply voltage during the fault condition shall be avoided (to check this, it is necessary to keep measuring the ballast current). After the ballast failure, the luminaire shall be allowed to cool to ambient temperature.

Electronic controlgear and small wound devices incorporated in them are exempted from these requirements.

Annex W provides an alternative method to the tests specified in this section. The reference method is that given in 12.7.1.1.

In order to perform this fault test, a protection should be used for the supply circuit, but it shall not influence the test result.

Because of the high current that may be present during this test, appropriate protection of the test circuit shall be provided. To ensure that any protection device does not affect the outcome of the test and the ballast breakdown has occurred at the conclusion of the test; it shall be checked that this ballast failure is due to winding rupture. See Figure 32.

A 20 A fuse (with electrical characteristics specified in IEC 60269) may be used.

Following the test, the luminaire shall be inspected to ensure that the components have been retained in place.

Parts of the luminaire enclosure providing protection against electric shock shall continue to protect live parts against access with the standard test finger as specified in Section 8.

12.7.1.2 Test for luminaires incorporating discharge lamps, fluorescent lamps (> 70 W), transformer of power > 10 VA

The luminaire shall be tested under the conditions specified in items a), c), e), f) and h) of 12.4.1. In addition, the following applies:

20 % of the lamp circuits in the luminaire, and not less than one lamp circuit, shall be subjected to abnormal conditions (see item a) of 12.5.1).

The circuit(s) which have the most thermal influence on the fixing point and exposed parts shall be chosen and other lamp circuits shall be operated at rated voltage under normal conditions.

The circuit(s) subjected to abnormal conditions, shall be operated at 0,9, 1,0 and 1,1 times the rated voltage (or the maximum of the rated voltage range). When conditions are stable, the highest winding temperature, the highest temperature of fixing points and the most thermally influenced exposed parts shall be measured. It is not necessary to measure the temperature of small wound devices that are incorporated within electronic circuits.

The values of ambient temperature and the temperature measured at 0,9, 1,0 and 1,1 times the rated voltage (or the maximum of the voltage range) are used for the linear regression formula in calculating the temperature of fixing points and other exposed parts in relation to a ballast/transformer winding temperature of 350 °C. If the difference between winding temperature measurements at 0,9 and 1,1 co-ordinates is less than 30 K, a fourth point is added, whose co-ordinates are winding t_a , fixing or exposed part t_a . The thermoplastic material is then subjected to the ball pressure test as described in 13.2.1 at the estimated temperature determined by linear regression, but not less than 75 °C. The diameter of the impression shall be measured and shall not exceed 2 mm.

This is a fault condition test and the application of the additional 25 °C to the test temperature of 13.2.1 does not apply.

NOTE t_a is the rated t_a of the luminaire.

12.7.1.3 Test for luminaires with inherently short-circuit proof transformer of power ≤ 10 VA

The fault test shall be carried out, according to the test method in 12.7.1.2, to small transformers with power up to 10 VA; at the end of the first period of 4 h, with the secondary winding short circuited, in case of no failure the voltage shall be incremented by the same steps in 12.7.1.1 up to the failure.

The short circuit current shall be allowed to continue until transformer failure occurs; transformers that are mounted in their own enclosure (e.g. emergency inverter) and have shown to comply with their own relevant safety standard are deemed to comply with this subclause without the need for test.

Following the test, the luminaire shall be inspected to ensure that the components have been retained in place.

Parts of the luminaire enclosure providing protection against electric shock shall continue to protect live parts against access with the standard test finger, as specified in Section 8.

Because of the high current that may be present during this test, appropriate protection of the test circuit shall be provided (see 12.7.1.1). It shall be checked that any protection device does not affect the outcome of the test and the transformer breakdown has occurred at the conclusion of the test.

12.7.2 Test for luminaires with temperature sensing controls internal/external to the ballast or transformer

The luminaires shall be set up for this test as described in the first three paragraphs of 12.7.1.2.

The circuits subjected to abnormal conditions shall be operated with a slowly and steadily increasing current through the windings, until the temperature sensing control operates.

Time intervals and increments in current shall be such that thermal equilibrium between winding temperatures and temperature of fixing points and most thermally influenced exposed parts is achieved as far as practicable. During the test, the highest temperature of the spots tested shall be continuously measured.

For luminaires fitted out with manual-reset thermal cut-outs, the test shall be repeated six times, allowing 30 min intervals between tests. At the end of each 30 min interval, the cut-out shall be reset.

For luminaires fitted with auto-reset thermal cut-outs, the tests shall be continued until a stable temperature is achieved.

In order to perform the test on transformers, see also 15.3.5 of IEC 61558-1:2005. The temperature sensing controls external to the transformer shall be checked according to 20.4, 20.5 and 20.6 of IEC 61558-1:2005.

The highest temperature of the fixing points and most thermally influenced exposed parts shall be recorded. The thermoplastic material is then subjected to the ball pressure test as described in 13.2.1 at the maximum recorded temperature, but not less than 75 °C. The diameter of the impression shall be measured and shall not exceed 2 mm.

This is a fault condition test and the application of the additional 25 °C to the test temperature of 13.2.1 does not apply.

NOTE 1 "Fixing points" (in 12.7) means both the fixing points of components and the fixing points of a luminaire to the mounting surface.

NOTE 2 "Exposed part" (in 12.7) means the outer surface of the luminaire enclosure.

NOTE 3 According to the requirements of 12.7, measurement of exposed parts is restricted to those parts providing the luminaire/component fixing or parts providing a protective barrier against accidental contact with live parts, as required by Section 8.

NOTE 4 The hottest part of the thermoplastic material section requiring testing is measured. This may often be on the internal surface of a luminaire enclosure, not the outer surface.

NOTE 5 The material temperature limits defined are with respect to materials under both mechanical load and no mechanical load.

SECTION 13: RESISTANCE TO HEAT, FIRE AND TRACKING

13.1 General

This section specifies requirements and tests relating to the resistance to heat, fire and tracking of certain parts of insulating material of luminaires.

For printed wiring boards, reference shall be made to the requirements of IEC 61249 (all parts).

13.2 Resistance to heat

External parts of insulating material providing protection against electric shock, and parts of insulating material retaining current-carrying parts or SELV or PELV parts in position shall be sufficiently resistant to heat.

The ball pressure test does not have to be applied to plastic parts of a luminaire which provide supplementary insulation.

13.2.1 Compliance is checked by the following test.

The test is not made on parts of ceramic material or on insulation of wiring.

The test shall be made in a heating cabinet having a temperature $25\text{ °C} \pm 5\text{ °C}$ in excess of the operating temperature of the relevant part determined during the temperature test (normal operation) of Section 12, with a minimum temperature of 125 °C when parts retaining current-carrying parts or SELV or PELV parts in position are tested, and 75 °C for other parts.

The surface of the part to be tested shall be placed in the horizontal position and a steel ball of 5 mm diameter pressed against this surface with a force of 20 N. A suitable apparatus for this test is shown in Figure 10. If the surface under test bends, the part where the ball presses should be supported.

The specimen shall be at least 2,5 mm thick, but if such a thickness is not available on the specimen then two or more pieces are placed (stacked) together.

After 1 h, the ball shall be removed from the sample, and the sample shall be cooled by immersion in cold water for 10 s. The diameter of the impression shall be measured and shall not exceed 2 mm.

13.3 Resistance to flame and ignition

Parts of insulating material retaining current-carrying parts in position, and external parts of insulating material providing protection against electric shock shall be resistant to flame and ignition.

For materials other than ceramic, compliance is checked by the test of 13.3.1 or 13.3.2, as appropriate.

13.3.1 *Parts of insulating material retaining current-carrying parts in position shall withstand the following tests. The parts to be tested are subjected to the needle-flame test of IEC 60695-11-5, the test flame being applied to the sample for 10 s at the point where the highest temperatures are likely to occur, measured if necessary during the thermal tests of Section 12.*

The duration of burning shall not exceed 30 s after removal of the test flame, and any burning drop from the sample shall not ignite the underlying parts as required by IEC 60695-11-5.

The requirements of this subclause do not apply in those cases where the luminaire provides an effective barrier to burning drops.

13.3.2 *Parts of insulating material which do not retain live parts in position, but which provide protection against electric shock shall withstand the following test.*

Parts are subjected to a test using a nickel-chromium glow-wire heated to 650 °C. The test apparatus and test procedure shall be those described in IEC 60695-2-11.

Any flame or glowing of the sample shall extinguish within 30 s of withdrawing the glow-wire, and any burning or molten drop shall not ignite the underlying parts specified in IEC 60695-2-11.

The requirements of this subclause do not apply in those cases where the luminaires provide an effective barrier to burning drops or where the insulation material is ceramic.

13.4 Resistance to tracking

Insulating parts of luminaires, which are other than ordinary luminaires, which retain current-carrying parts or SELV or PELV parts in position or are in contact with such parts, shall be of material resistant to tracking unless they are protected against dust and moisture.

13.4.1 *Compliance is checked by the following test, which is made at three places on the test sample.*

For materials other than ceramic, compliance is checked by the proof tracking test in accordance with IEC 60112 subject to the following details.

- *If the specimen has no flat surface of at least 15 mm × 15 mm, the test may be carried out on a flat surface with reduced dimensions provided drops of liquid do not flow off the specimen during the test. No artificial means should, however, be used to retain the liquid on the surface. In case of doubt, the test may be made on a separate strip of the same material, having the required dimensions and manufactured by the same process.*
- *If the thickness of the specimen is less than 3 mm, two, or if necessary more, specimens should be stacked to obtain a thickness of at least 3 mm.*
- *The test shall be made at three places of the specimen or on three specimens.*
- *The electrodes (see Figure 11) shall be of platinum and test solution A, described in 7.3 of IEC 60112:2003, shall be used.*

13.4.2 *The specimen shall withstand 50 drops without failure at a test voltage of PTI 175.*

A failure has occurred if a current of 0,5 A or more flows for at least 2 s by a conducting path between the electrodes on the surface of the specimen, thus operating the overcurrent relay, or if the specimen burns without releasing the overcurrent relay.

Clause 9 of IEC 60112:2003 regarding determination of erosion does not apply.

The Note 3 of Clause 5 of IEC 60112:2003 regarding surface treatment does not apply.

SECTION 14: SCREW TERMINALS

14.1 General

This section specifies requirements for all types of terminals which employ screws incorporated in luminaires.

Examples of screw terminals are shown in Figure 12 to Figure 16.

14.2 Terms and definitions

14.2.1

pillar terminal

terminal in which the conductor is inserted in a hole or cavity, where it is clamped under the shank of the screw or screws

Note 1 to entry: The clamping pressure may be applied directly by the shank of the screw or through an intermediate clamping member to which pressure is applied by the shank of the screw.

Note 2 to entry: Examples of pillar terminals are shown in Figure 12.

14.2.2

screw terminal

terminal in which the conductor is clamped under the head of the screw

Note 1 to entry: The clamping pressure may be applied directly by the head of the screw or through an intermediate part, such as a washer, clamping plate or anti-spread device.

Note 2 to entry: Examples of screw terminals are shown in Figure 13.

14.2.3

stud terminal

terminal in which the conductor is clamped under a nut

Note 1 to entry: The clamping pressure may be applied directly by a suitably shaped nut or through an intermediate part, such as a washer, clamping plate or anti-spread device.

Note 2 to entry: Examples of stud terminals are shown in Figure 13.

14.2.4

saddle terminal

terminal in which the conductor is clamped under a saddle by means of two or more screws or nuts

Note 1 to entry: Examples of saddle terminals are shown in Figure 14.

14.2.5

lug terminal

screw terminal or stud terminal, designed for clamping a cable lug or bar by means of a screw or nut

Note 1 to entry: Examples of lug terminals are shown in Figure 15.

14.2.6

mantle terminal

terminal in which the conductor is clamped against the base of a slot by a suitably shaped washer under the nut, by a central peg if the nut is a cap nut, or by equally effective means for transmitting the pressure from the nut to the conductor within the slot

Note 1 to entry: Examples of mantle terminals are shown in Figure 16.

14.3 General requirements and basic principles

14.3.1 These requirements apply to terminals with screw clamping carrying a current not exceeding 63 A, intended for the connection, by clamping only, of copper conductors of cables and flexible cords.

These requirements do not exclude terminals of types other than those shown in Figure 12 to Figure 16.

14.3.2 Terminals are of varied design and have different shapes: they include, among others, terminals in which the conductor is clamped directly or indirectly under the shank of the screw, terminals in which the conductor is clamped directly or indirectly under the head of the screw, terminals in which the conductor is clamped directly or indirectly under a nut, and terminals intended solely for use with cable lugs or bars.

The basic principles governing these requirements are specified in 14.3.2.1 to 14.3.2.3.

14.3.2.1 Terminals are primarily for the connection of only one conductor, although, owing to the wide range of conductors that each terminal is required to clamp, they may in some cases be suitable for clamping two conductors having the same nominal cross-sectional area, which is smaller than the maximum value for which the terminal is designed.

Certain types of terminals, in particular pillar terminals and mantle terminals, may be used for looping-in, when two or more conductors of the same or different nominal cross-sectional area or composition have to be connected. In such cases, the terminal sizes specified in this document may not be applicable.

14.3.2.2 In general, terminals will be suitable for the connection of cables and flexible cords without special preparation of the conductor, but provision is made in certain cases for connection by means of cable lugs or for connection to bars.

14.3.2.3 A numerical classification for terminals is adopted, based on the nominal cross-sectional areas of the conductors that the terminal can accept. According to this classification, each terminal can accept any one of three successive sizes of conductors in the range of nominal cross-sectional areas specified in IEC 60227 (all parts) or IEC 60245 (all parts).

With one exception, the sizes of the conductors within each range advance by one step for each increase in the size of the terminal.

The nominal cross-sectional areas of the conductors assigned to each terminal are given in Table 14.1, which also gives the diameter of the largest conductor that each terminal can accept.

Terminals may be used with conductors smaller than the nominal given range, provided the conductor is clamped with sufficient pressure to ensure adequate electrical and mechanical connection.

Table 14.1 – Nominal cross-sectional areas of conductors according to terminal sizes

Terminal size	Flexible conductors				Rigid conductors, solid or stranded			
	Nominal cross-sectional areas			Diameter of largest conductor	Nominal cross-sectional areas			Diameter of largest conductor
	mm ²				mm ²			
0 ^a	0,5	0,75	1	1,45	—	—	—	—
1 ^b	0,75	1	1,5	1,73	0,75	1	1,5	1,45
2	1	1,5	2,5	2,21	1	1,5	2,5	2,13
3	1,5	2,5	4	2,84	1,5	2,5	4	2,72
4 ^c	2,5	4	6	3,87	2,5	4	6	3,34
5	2,5	4	6	4,19	4	6	10	4,32
6	4	6	10	5,31	6	10	16	5,46
7	6	10	16	6,81	10	16	25	6,83

^a Not suitable for rigid conductors. Suitable for flexible conductors of 0,4 mm² cross-sectional area (see 5.3.1).

^b Also suitable for flexible conductors having a nominal cross-sectional area of 0,5 mm² if the end of the conductor is folded back on itself.

^c Not suitable for 6 mm² flexible conductors of some special constructions.

14.3.3 Terminals shall allow the proper connection of copper conductors having nominal cross-sectional areas as given in Table 14.2 and the conductor space shall be at least that given in Figure 12, Figure 13, Figure 14 or Figure 16, as appropriate.

These requirements do not apply to lug terminals.

Table 14.2 – Nominal cross-sectional areas of conductors according to maximum current

Maximum current carried by the terminal A	Flexible conductors			Rigid conductors solid or stranded				
	Nominal cross-sectional areas ^a			Terminal size	Nominal cross-sectional areas ^a			Terminal size
	mm ²				mm ²			
2	0,4			0	—			—
6	0,5	to	1	0	0,75	to	1,5	1
10	0,75	to	1,5	1	1	to	2,5	2
16	1	to	2,5	2	1,5	to	4	3
20	1,5	to	4	3	1,5	to	4	3
25	1,5	to	4	3	2,5	to	6	4
32	2,5	to	6	4 or 5 ^b	4	to	10	5
40	4	to	10	6	6	to	16	6
63	6	to	16	7	10	to	25	7

^a These requirements do not apply to terminals used for the interconnections of different components of luminaires by means of cables or flexible cords not complying with IEC 60227 (all parts) or IEC 60245 (all parts), if the other requirements of this document are met.

^b Terminal size 4 is not suitable for 6 mm² of flexible conductors of some special constructions, in which case terminal size 5 should be used.

Compliance is checked by inspection, by measurement and by fitting conductors of the smallest and largest cross-sectional areas specified.

14.3.4 Terminals shall provide adequate connection of the conductors.

Compliance is checked by carrying out all tests of 14.4.

14.4 Mechanical tests

14.4.1 For pillar terminals, the distance between the clamping screw and the end of the conductor, when fully inserted, shall be at least that given in Figure 12.

The minimum distance between the clamping screw and the end of the conductor applies only to pillar terminals through which the conductor cannot pass.

For mantle terminals, the distance between the fixed part and the end of the conductor, when fully inserted, shall be at least that given in Figure 16.

Compliance is checked by measurement, after a solid conductor of the largest cross-sectional area given in Table 14.2 has been fully inserted and fully clamped.

14.4.2 Terminals shall be so designed or placed that neither a solid conductor nor a strand of a stranded conductor can slip out while the clamping screws or nuts are being tightened.

This requirement does not apply to lug terminals.

For fixed luminaires intended solely for permanent connection to fixed (external) wiring, this requirement applies only to the use of solid or rigid stranded conductors. The test is made with rigid stranded conductors.

Compliance is checked by the following test.

Terminals are fitted with a conductor having the composition given in Table 14.3.

Table 14.3 – Composition of conductors

Terminal size	Number of strands and nominal diameter of strands ($n \times \text{mm}$)	
	Flexible conductors	Rigid stranded conductors
0	$32 \times 0,20$	–
1	$30 \times 0,25$	$7 \times 0,50$
2	$50 \times 0,25$	$7 \times 0,67$
3	$56 \times 0,30$	$7 \times 0,85$
4	$84 \times 0,30$	$7 \times 1,04$
5	$84 \times 0,30$	$7 \times 1,35$
6	$80 \times 0,40$	$7 \times 1,70$
7	$126 \times 0,40$	$7 \times 2,14$

Before insertion in the terminal, strands of rigid conductors are straightened and flexible conductors are twisted in one direction so that there is a uniform twist of one complete turn in a length of approximately 20 mm.

The conductor is inserted in the terminal for the minimum distance specified or, where no distance is specified, until it just projects from the far side of the terminal and in the position most likely to allow the strand to slip out. The clamping screw is then tightened with a torque equal to two-thirds of that given in the appropriate column of Table 14.4.

For flexible conductors, the test is repeated with a new conductor which is twisted as before, but in the opposite direction.

After the test, no strand of the conductor shall have slipped out through the gap between the clamping means and the retaining device.

14.4.3 Terminal sizes up to and including size 5 shall allow the conductor to be connected without special preparation.

Compliance is checked by inspection.

NOTE The term "special preparation" covers the application of additional solder to the strands of the conductor, use of cable lugs, formation of eyelets, etc., but not the reshaping of the conductor for its introduction into the terminal or the twisting of a stranded conductor to consolidate the end.

The bonding together by heating of the tinned strands of a flexible conductor without the addition of solder is not considered special preparation.

14.4.4 Terminals shall have adequate mechanical strength.

Screws and nuts for clamping the conductors shall have a metric ISO thread. Terminals for external wiring shall not serve to fix any other component, except that they may also clamp internal conductors if these are so arranged that they are unlikely to be displaced when fitting external conductors.

Screws shall not be of a metal which is soft or liable to creep, such as zinc or aluminium.

Compliance is checked by inspection and by the tests of 14.3.3, 14.4.6, 14.4.7 and 14.4.8.

14.4.5 Terminals shall be resistant to corrosion.

Compliance is checked by the corrosion test specified in Section 4.

14.4.6 Terminals shall be fixed to the luminaire or to a terminal block or otherwise fixed in position. When the clamping screws or nuts are tightened or loosened, the terminals shall not work loose, internal wiring shall not be subjected to stress, and creepage distances and clearances shall not be reduced below the values specified in Section 11.

These requirements do not imply that the terminals should be so designed that their rotation or displacement is prevented, but any movement shall be sufficiently limited so as to ensure compliance with this document.

Covering with sealing compound or resin is sufficient to prevent a terminal from working loose, provided that the sealing compound or resin is not subject to stress during normal use and the effectiveness of the sealing compound or resin is not impaired by temperatures attained by the terminal under the most unfavourable conditions specified in Section 12.

Compliance is checked by inspection, by measurements and by the following test.

A rigid copper conductor of the largest cross-sectional area given in Table 14.2 is placed in the terminal. Screws and nuts are tightened and loosened five times by means of a suitable test screwdriver or wrench, the torque applied when tightened being equal to that given in the appropriate column of Table 14.4 or in the appropriate table of Figure 12, Figure 13, Figure 14, Figure 15 or Figure 16, whichever is the higher.

Table 14.4 – Torque to be applied to screws and nuts

Nominal diameter of thread mm	Torque Nm				
	I	II	III	IV	V
Up to and including 2,8	0,2	–	0,4	0,4	–
Over 2,8 up to and including 3,0	0,25	–	0,5	0,5	–
Over 3,0 up to and including 3,2	0,3	–	0,6	0,6	–
Over 3,2 up to and including 3,6	0,4	–	0,8	0,8	–
Over 3,6 up to and including 4,1	0,7	1,2	1,2	1,2	1,2
Over 4,1 up to and including 4,7	0,8	1,2	1,8	1,8	1,8
Over 4,7 up to and including 5,3	0,8	1,4	2,0	2,0	2,0
Over 5,3 up to and including 6,0	–	1,8	2,5	3,0	3,0
Over 6,0 up to and including 8,0	–	2,5	3,5	6,0	4,0
Over 8,0 up to and including 10,0	–	3,5	4,0	10,0	6,0
Over 10,0 up to and including 12,0	–	4,0	–	–	8,0
Over 12,0 up to and including 15,0	–	5,0	–	–	10,0

The conductor is moved each time the screw or nut is loosened.

Column I applies to screws without heads if the screw, when tightened, does not protrude from the hole, and to other screws which cannot be tightened by means of a screwdriver with a blade wider than the diameter of the screw.

Column II applies to nuts of mantle terminals with cap nuts which are tightened by means of a screwdriver.

Column III applies to other screws which are tightened by means of a screwdriver.

Column IV applies to screws and nuts, other than nuts of mantle terminals, which are tightened by means other than a screwdriver.

Column V applies to nuts of mantle terminals in which the nut is tightened by means other than a screwdriver.

Where a screw has a hexagonal head with means for tightening with a screwdriver and the values in columns III and IV are different, the test is made twice, first applying to the hexagonal head the torque given in column IV, and then on another set of samples, applying the torque given in column III by means of a screwdriver. If the values in columns III and IV are the same, only the test with the screwdriver is made.

During the test, terminals shall not work loose and there shall be no damage, such as breakage of screws or damage to the head slots, threads, washers or stirrups that will impair the further use of the terminals.

For mantle terminals, the specific nominal diameter is that of the slotted stud. The shape of the blade of the test screwdriver shall suit the head of the screw to be tested. The screws and nuts shall not be tightened in jerks.

14.4.7 Terminals shall clamp the conductor reliably between metal surfaces.

For lug terminals, a spring washer, or equally effective locking means, shall be provided and the surface within the clamping area shall be smooth.

For mantle terminals, the bottom of the conductor space shall be slightly rounded in order to obtain a reliable connection.

Compliance is checked by inspection and by the following test.

The terminals are fitted with rigid conductors of the smallest and largest cross-sectional areas given in Table 14.2, the terminal screws being tightened with a torque equal to two-thirds of that given in the appropriate column of Table 14.4.

If the screw has a hexagonal head with a slot, the torque applied is equal to two-thirds of that given in column III of Table 14.4.

Each conductor is then subjected to a pull of the value, in newtons, given in Table 14.5; the pull is applied without jerks, for 1 min, in the direction of the axis of the conductor space.

Table 14.5 – Pull to be applied to conductor

Terminal size	0	1	2	3	4	5	6	7
Pull (N)	30	40	50	50	60	80	90	100

During the test, the conductor shall not move noticeably in the terminal.

14.4.8 Terminals shall clamp the conductor without undue damage to the conductor.

Compliance is checked by inspection of the conductors, after conductors of the smallest and largest cross-sectional areas given in Table 14.2 have been clamped once and loosened, the torque applied to clamp the conductor being equal to two-thirds of that given in Table 14.4.

If the screw has a hexagonal head with a slot, the torque applied is equal to two-thirds of that given in column IV of Table 14.4.

NOTE Conductors are unduly damaged if they show deep or sharp indentations.

SECTION 15: SCREWLESS TERMINALS AND ELECTRICAL CONNECTIONS

15.1 General

This section specifies requirements for all types of terminals and electrical connections, that do not employ screws, for solid or stranded copper conductors up to 2,5 mm² for internal wiring of luminaires and for connections to external wiring of luminaires.

Some examples of screwless terminals and electrical connections are shown in Figure 17, Figure 18 and Figure 19. IEC 61210 provides further examples of screwless terminals and electrical connections.

15.2 Terms and definitions

15.2.1

screwless terminals

parts required to make connections in electrical circuits by mechanical means without screws

15.2.2

permanent connections

connections designed to be made only once with the same conductor

EXAMPLE Wire wrapping or crimping.

15.2.3

non-permanent connections

connections which allow lead assemblies or conductors to be connected and disconnected several times

EXAMPLE Pin or tab and receptacle, or some spring-type terminals

15.2.4

lead assemblies

conductors fitted with auxiliary parts, usually by permanent connection

15.2.5

non-prepared conductors

conductors without special preparation or auxiliary parts

Note 1 to entry: Insulation may, however, be stripped to expose the conductor.

Note 2 to entry: The term "special preparation" covers the application of additional solder to the strands of the conductor, use of cable lugs, tabs and receptacles, formation of eyelets, etc., but not the reshaping of the conductor for its introduction into the terminal or the twisting of a stranded conductor to consolidate the end.

The bonding together by heating of the tinned strands of a flexible conductor without the addition of solder is not considered to be special preparation.

15.2.6

test current

current assigned to a terminal or connection by the manufacturer

Note 1 to entry: When terminals are part of a component, the test current shall be the rated current of the component.

15.3 General requirements

15.3.1 Parts of terminals or connections for carrying current shall be made of one of the following materials:

- copper;

- an alloy containing at least 58 % copper for parts that are worked cold or at least 50 % copper for other parts;
- another metal no less resistant to corrosion than copper and having mechanical properties no less suitable.

15.3.2 Terminals and connections shall clamp the conductor with sufficient pressure and without undue damage to the conductor.

The conductor shall be clamped between metal surfaces. However, terminals for circuits having a rated current not exceeding 2 A may have one non-metallic surface if the requirements of 15.3.5 are met.

Insulation piercing terminals are only acceptable for the creation of a branch connection in SELV or PELV circuits of luminaires or other luminaires as non-rewireable, permanent connections.

NOTE Conductors are unduly damaged if they show deep or sharp indentations.

15.3.3 Terminals shall be so designed that, when the conductor has been adequately inserted into the terminal, further insertion of its end is prevented by a stop.

15.3.4 Terminals other than those for lead assemblies shall accept "non-prepared conductors" (see 15.2.5).

Compliance with the requirements of 15.3.2, 15.3.3 and 15.3.4 is checked by inspection of the terminals or connections, after fitting with appropriate conductors, and after the heating test of 15.5.2.2 or 15.6.3.2.

15.3.5 Electrical connections shall be so designed that the pressure essential for good electrical conductivity is not transmitted through insulating material other than ceramic, pure mica, or other material with characteristics no less suitable, unless there is sufficient resilience in the metallic parts to compensate for any possible shrinking of the insulating material (see Figure 17 and Figure 18).

15.3.6 It shall be clear how the connection of the conductor to, and the disconnection from, spring-type non-permanent screwless terminals is effected.

The disconnection of a conductor shall require an operation other than a pull of the conductor and shall be such that it can be made by hand or with the aid of a simple, generally available device.

15.3.7 Terminals for connection to several conductors under spring clamps shall clamp each conductor independently.

For terminals designed for non-permanent connections, it shall be possible to withdraw the conductors together or separately.

15.3.8 Terminals shall be suitably fixed to the equipment or to a terminal block or otherwise fixed in position. They shall not work loose when conductors are inserted or withdrawn.

Compliance is checked by inspection and, if there is a doubt, by applying the mechanical test given in 15.5.1 or 15.6.2. During the test, the terminals shall not work loose and there shall be no damage that will impair their further use.

The above conditions apply not only to terminals which are fixed to equipment but also to terminals which are delivered separately. Covering with sealing compound without other means of locking is not sufficient. Self-hardening resins may however be used to lock terminals which are not subject to torsion in normal use.

15.3.9 Terminals and connections shall withstand the mechanical, electrical and thermal stresses occurring in normal use.

Compliance is checked by the tests of Clauses 15.5 or 15.6, as appropriate.

15.3.10 Manufacturers shall state the conductor size or sizes for which the component is designed and the type of conductor, for example, solid or stranded.

15.4 General instructions on tests

15.4.1 Preparation of samples

The tests for ingress of dust and moisture of Section 9, if appropriate, shall be carried out before testing terminals or connections contained within the luminaires.

15.4.2 Test conductors

Tests shall be carried out with copper conductors of the types and dimensions recommended by the manufacturer. If a range of conductors is specified, the smallest and largest shall be selected for testing.

15.4.3 Multi-conductor terminals

Screwless terminals having provision for the simultaneous connection of several conductors shall be tested with the number of conductors indicated in the data provided by the manufacturer.

15.4.4 Multi-way terminals

Each terminal in a group or strip of terminals, for example, a terminal block on a ballast, may be used as a separate sample.

15.4.5 Test quantities

The tests described in Clauses 15.5 to 15.6 are carried out on four terminals (or connections). At least three terminals shall meet the requirements. If one terminal fails, four further terminals are tested and these shall meet the requirements.

The tests described in 15.6.3.2 are carried out on ten terminals.

15.5 Terminal and connections for internal wiring

15.5.1 Mechanical tests

Terminals and connections shall have adequate mechanical strength.

Compliance is checked by the tests of 15.5.1.1 and 15.5.1.2.

15.5.1.1 Non-permanent connections

The mechanical strength of the terminals (or connections) is checked on a set of four terminals. If all the terminals contained within the luminaire are not of the same design, one set of four terminals of each design is subjected to the test.

This test shall only be applied to devices on which the user may work to complete assembly of the luminaire before it is put into service.

15.5.1.1.1 *In the case of spring-type terminals (see Figure 18), the test is made with solid copper conductors of the size or sizes specified by the manufacturer. If a range of conductors is specified, the smallest and largest are selected for testing.*

Of the four terminals, two are tested with conductors having the smallest cross-sectional area and the two remaining samples with conductors having the largest cross-sectional area. These conductors are connected to, and disconnected from, each terminal five times.

For the first four connections, new conductors are used each time. For the fifth connection, the same conductor is used as for the fourth connection and it is clamped at the same place. For each connection, the conductors are pushed into the terminals as far as the stop.

If the terminal is suitable for stranded conductors, an additional test is then made with one rigid stranded copper conductor. If, however, a range of conductors is specified, those with the smallest and largest cross-sectional areas are selected for testing. Each conductor is subjected to only one connection and disconnection with the corresponding terminal used for the testing with solid conductors.

After the final connection, each conductor is subjected to a test pull of 4 N.

15.5.1.1.2 *Pin or tab and receptacle type connections are also subjected to a test pull of 4 N.*

The pull is applied without jerks, for 1 min, in the direction opposite to that used for the application or insertion of the conductor or lead assembly.

During the test, the conductor or lead assembly shall not move from the terminal and neither the terminal nor the conductor or lead assembly shall undergo any alteration impairing its future use.

The maximum force for the application or insertion of the conductor or lead assembly shall not exceed 50 N and, in the case of pin or tab and receptacle type connections, the force for disconnection shall not exceed this value.

15.5.1.2 Permanent connections

The connection shall remain fully effective when a pull-off force of 20 N is applied, for 1 min, in a direction opposite to that used for the application or insertion of the conductors.

In some cases, a special tool may be used to apply the force correctly (e.g. in the case of wire-wrapped terminals).

Multi-conductor terminals are tested with the above force applied to each conductor in turn.

15.5.2 Electrical tests

Terminals and connections shall have adequate electrical performance.

Compliance is checked by the tests of 15.5.2.1 and 15.5.2.2.

15.5.2.1 Contact resistance test

The electrical performance of terminals (or connections) is checked on a set of four terminals. If all the terminals contained within the luminaire are not of the same design, one set of four terminals of each design is subjected to the test.

15.5.2.1.1 For spring-type terminals, the test according to 15.5.2.1.3 is made with four solid copper non-insulated conductors.

If a range of conductors is specified, two of the terminals are tested with conductors having the smallest cross-sectional area and the two remaining terminals with conductors having the largest cross-sectional area.

15.5.2.1.2 In the case of pin or tab and receptacle type terminals, the test of 15.5.2.1.3 is made with lead assemblies.

15.5.2.1.3 Each terminal with its conductor is loaded with the test current (AC or DC) and after 1 h, the voltage drop across the terminal, still at the test current, is measured. The measuring points are located as close as possible to the contact point across which the voltage drop is being measured. The measured voltage drop shall not exceed 15 mV.

The voltage drop for each joint or contact is considered separately; for example, the junction of the conductor to receptacle is considered separately from the junction of receptacle to pin.

The total voltage drop of two inseparable joints, when measured together, shall not exceed twice the value given in this subclause.

15.5.2.2 Heating tests

15.5.2.2.1 Terminals (or connections) with a rated current up to and including 6 A are then subjected to an ageing test, without current, of 25 cycles duration, each cycle comprising 30 min at a temperature of $T \pm 5^\circ\text{C}$ or $100^\circ\text{C} \pm 5^\circ\text{C}$, whichever is the higher, followed by a cooling down period to a temperature between 15°C and 30°C . Terminals (or connections) with a rated current exceeding 6 A are subjected to an ageing test of 100 such cycles.

NOTE The temperature T is the marked maximum rated temperature for T-marked components such as lampholders.

15.5.2.2.2 The voltage drop is again measured on each terminal:

- a) after the 10th and 25th cycles for terminals with a rated current up to and including 6 A;
- b) after the 50th and 100th cycles for terminals with a rated current greater than 6 A.

If, for all terminals, the voltage drop, in both cases, does not exceed by more than 50 % the voltage drop measurements on the same terminal tested under 15.6.1, or if the increase in voltage drop is less than 2 mV, the terminals comply with the requirement.

If the voltage drop of any of the terminals exceeds 22,5 mV, the terminals are rejected.

If, for one of the terminals, the voltage drop measured under a) or b) exceeds by more than 50 %, with a minimum of 2 mV, the voltage drop measured on the same terminal under 15.6.1 but does not exceed 22,5 mV, the four terminals are subjected to a new ageing test, according to current rating, of 25 cycles or 100 cycles duration without current.

After the 10th and 25th or 50th and 100th cycles (according to current rating), the voltage drops are again measured. For any terminal, the voltage drop shall not exceed 22,5 mV.

The total voltage drop of two inseparable joints, when measured together, shall not exceed twice the values given in this subclause.

15.5.2.2.3 If a terminal is so designed that the conductor is tightened against a surface of insulating material, this surface shall not be deformed during these heating tests.

Compliance is checked by inspection.

15.6 Terminals and connections for external wiring

15.6.1 Conductors

Spring-type terminals shall be suitable for the connection of rigid conductors, solid or stranded, with the nominal cross-sectional areas given in Table 15.1.

Table 15.1 – Conductor rating

Maximum rated current of terminals	Nominal cross-sectional areas of conductors
A	mm ²
6	0,5 to 1
10	> 1 to 1,5
16	> 1,5 to 2,5

NOTE Terminals are usually referred to by a designation. Size 0, for example, is generally a 6 A rating. If the component rating is less than the technical capacity, the component rating is used.

Compliance is checked by inspection, by measurement and by fitting conductors of the smallest and largest cross-sectional areas specified.

15.6.2 Mechanical tests

Terminals and connections shall have adequate mechanical strength.

Compliance is checked by the tests of 15.6.2.1 and 15.6.2.2, which are made on one terminal of each of four samples.

15.6.2.1 *In the case of spring-type terminals, the test is made alternately with solid copper conductors having the largest and then the smallest cross-sectional areas specified in 15.6. These conductors are connected to, and disconnected from, each terminal five times. If all the terminals contained within the luminaire are not of the same design, one terminal of each design is subjected to the test.*

For the first four connections, new conductors are used each time. For the fifth connection, the same conductor is used as for the fourth connection and it is clamped at the same place. For each connection, the conductors are pushed into the terminals as far as the stop.

If the terminal is stated by the manufacturer to be suitable for stranded conductors (see 15.3.10), an additional test is then made with two rigid stranded copper conductors, the first having the largest cross-sectional area specified in 15.6, and the second having the smallest cross-sectional area. These conductors are subjected to only one connection and disconnection.

After the final connection, each conductor is subjected to a pull test according to Table 15.2.

15.6.2.2 *Pin or tab and receptacle type connections are also subjected to a pull test according to Table 15.2.*

Table 15.2 – Conductor pull force

Maximum rated current of terminals A	Pull N	
	Spring type and welded connections	Pin or tab and receptacle type
6	20	8
10	30	15
16	30	15

NOTE If the component rating is less than the terminal capacity, the component rating is used.

The pull is applied without jerks, for 1 min, in the direction opposite to that used for the application or insertion of the conductor or lead assembly.

During the test, the conductor or lead assembly shall not move out from the terminal and neither the terminal nor the conductor or lead assembly shall undergo any alteration impairing its future use.

15.6.3 Electrical tests

Terminals and connections shall have adequate electrical performance.

Compliance is checked by the tests of 15.6.3.1 and 15.6.3.2.

15.6.3.1 Contact resistance test

The electrical performance of terminals (or connections) is checked on a set of ten terminals. If all the terminals contained within the luminaire are not of the same design, one set of ten terminals of each design is subjected to the test.

15.6.3.1.1 *For spring-type terminals, the test according to 15.6.3.1.3 is made with ten solid copper non-insulated conductors.*

Five conductors having the largest cross-sectional areas specified in 15.6 are connected as in normal use, each to one terminal.

Five conductors having the smallest cross-sectional areas specified in 15.6 are connected as in normal use, each to one of the five remaining terminals.

15.6.3.1.2 *In the case of pin or tab and receptacle type terminals, the test according to 15.6.3.1.3 is made with lead assemblies.*

15.6.3.1.3 *Each terminal with its conductor is loaded with the test current (AC or DC) and, after 1 h, the voltage drop across the terminal, still at the test current is measured. The measuring points are located as close as possible to the contact point across which the voltage drop is being measured.*

The measured voltage drop shall not exceed 15 mV.

The total voltage drop of two inseparable joints, when measured together, shall not exceed twice the value given in this subclause.

15.6.3.2 Heating tests

The thermal performance of terminals (or connections) is checked on the terminals which have been subjected to the test of 15.6.3.1.

15.6.3.2.1 *After having cooled down to the ambient temperature, each conductor is replaced by a new solid copper non-insulated conductor having the largest cross-sectional area specified in 15.6 and each lead assembly is replaced by a new appropriate lead assembly which is then connected to, and withdrawn from, the terminal or the relevant part of the connection five times.*

The conductors are then replaced by new non-insulated conductors.

15.6.3.2.2 *Each terminal with its conductor is loaded with the test current (AC or DC) for a time just sufficient for the voltage drop to be measured. For these measurements and the measurements of 15.6.3.2.4, the requirements of 15.6.3.1 apply.*

15.6.3.2.3 *Terminals (or connections) with a rated current up to and including 6 A are then subjected to an ageing test, without current, of 25 cycles duration, each cycle comprising 30 min at a temperature of $T \pm 5^\circ\text{C}$ or $100^\circ\text{C} \pm 5^\circ\text{C}$, whichever is the higher, followed by a cooling down period to a temperature between 15°C and 30°C . Terminals (or connections) with a rated current exceeding 6 A are subjected to an ageing test of 100 such cycles.*

NOTE The temperature T is the marked maximum rated temperature for T-marked components, such as lampholders.

15.6.3.2.4 *The voltage drop is again measured on each terminal:*

- a) after the 10th and 25th cycles for terminals with a rated current up to and including 6 A;*
- b) after the 50th and 100th cycles for terminals with a rated current greater than 6 A.*

If, for all terminals, the voltage drop, in both cases, does not exceed by more than 50 % the voltage drop measurements on the same terminal tested under 15.6.3.2.2, or if the increase in voltage drop is less than 2 mV, the terminals comply with the requirement.

If the voltage drop of any of the terminals exceeds 22,5 mV, the terminals are rejected.

If, for one of the terminals, the voltage drop measured under a) or b) exceeds by more than 50 %, with a minimum of 2 mV, the voltage drop measured on the same terminal under 15.6.3.2.2 but does not exceed 22,5 mV, the ten terminals are subjected to a new ageing test, according to current rating, of 25 cycles or 100 cycles duration without current.

After the 10th and 25th or 50th and 100th cycles (according to current rating), the voltage drops are again measured. For any terminal, the voltage drop shall not exceed 22,5 mV.

The total voltage drop of two inseparable joints, when measured together, shall not exceed twice the value given in this subclause.

15.6.3.2.5 *If a terminal is so designed that the conductor is tightened against a surface of insulating material, this surface shall not become deformed during these heating tests.*

Compliance is checked by inspection.











Amperes	A
Frequency (hertz)	Hz
Volts	V
Watts	W
AC supply	 (IEC 60417-5032:2002-10)
DC supply	 (IEC 60417-5031:2002-10)
DC and AC supply	 (IEC 60417-5033:2002-10)
Class II	 (IEC 60417-5172:2003-02)
Class III	 (IEC 60417-5180:2003-02)
Rated maximum ambient temperature	$t_{a...} \text{ }^{\circ}\text{C}$
Warning against the use of cool-beam lamps	
Minimum distance from lighted objects (metres)	
Luminaires not suitable for direct mounting on normally flammable surfaces (suitable only for mounting on non-combustible surfaces)	<div style="display: flex; justify-content: space-around; align-items: center;"> <div style="text-align: center;">  Surface mounted </div> <div style="text-align: center;">  Recessed </div> </div>
Luminaires not suitable for covering with thermally insulating material	

Figure 1 – Symbols (1 of 3)













Ordinary	IP20
Drip-proof	IPX1
Rain-proof	IPX3
Splash-proof	IPX4
Jet-proof	IPX5
Powerful water jet-proof	IPX6
Watertight (immersible)	IPX7
Pressure-watertight (submersible)	IPX8 m (followed by an indication of the maximum depth of submersion in metres)
High pressure and temperature water jet-proof	IPX9 (80 °C)
High pressure and cold water jet-proof	IPX9 (15 °C)
Protected against solid objects greater than 2,5 mm	IP3X
Protected against solid objects greater than 1 mm	IP4X
Dust-proof	IP5X
Dust-tight	IP6X
Use of heat resistant supply cables, interconnecting cables or external wiring	 <div>(The number of cores shown is optional)</div>
Luminaires designed for use with bowl mirror lamps	
Rough service luminaires	
Luminaires for use with high pressure sodium lamps that require an external ignitor (to the lamp)	
Luminaires for use with high pressure sodium lamps having an internal starting device	

Figure 1 (2 of 3)

Replace any cracked protective shield	 (Rectangular)
	or
	 (Round)
Luminaire designed to be used only with self-shielded tungsten halogen lamps or self-shielded metal halide lamps	
Luminaires with internal fuses	
Do not stare at the operating light source	
Functional earthing (IEC 60417-5018)	
Protective earthing (IEC 60417-5019)	

All symbols shall comply with the proportional requirements given in IEC 80416-1.

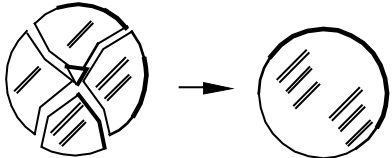
NOTE The marking of the symbols corresponding to IP numbers is optional.

Caution, risk of electric shock



(Source IEC 60417-6042:2010-11)


Figure 1 (3 of 3)

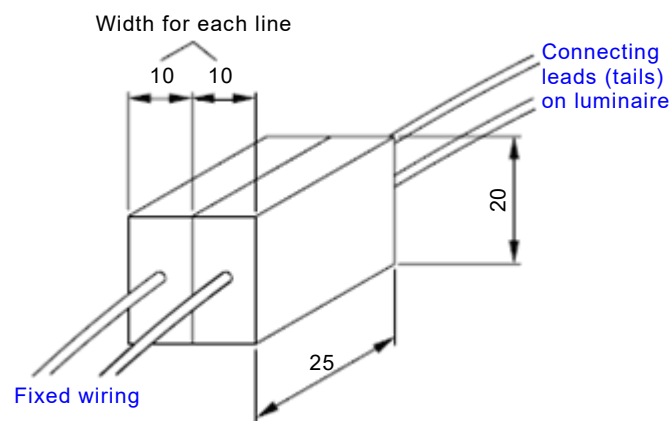

IEC

Figure 2 – Terminal block arrangement for installation test for luminaires with connecting leads (tails)

Figure 3 – Void

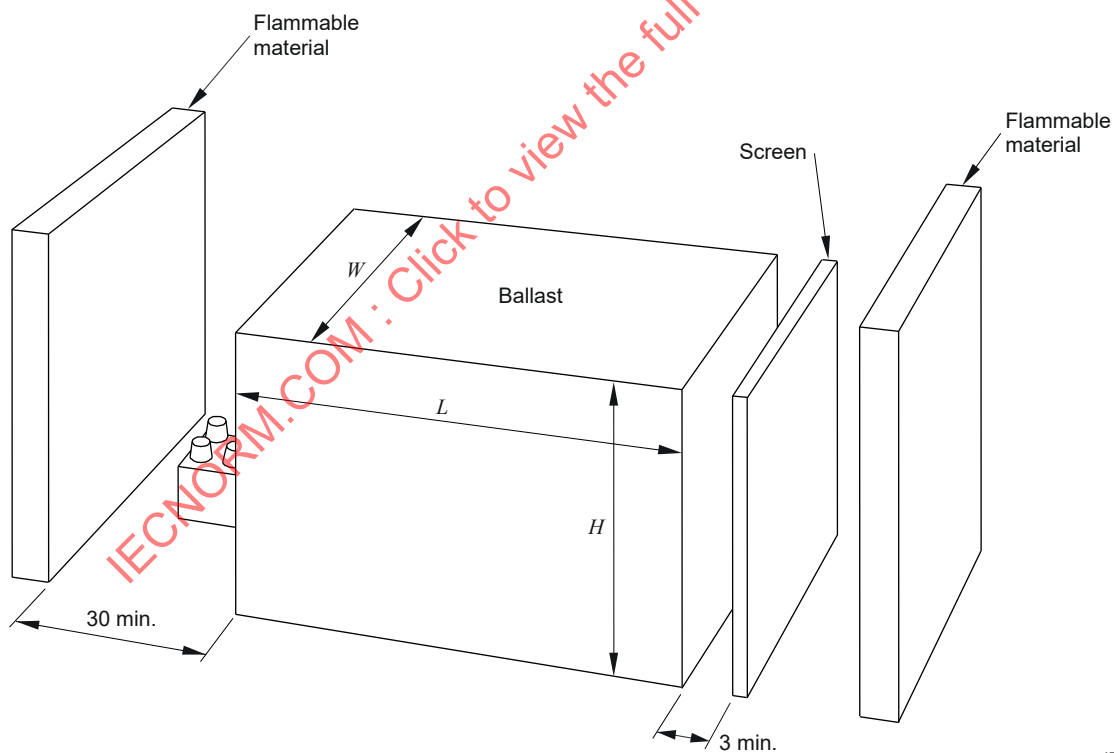

IEC 489/08

Dimensions in millimetres

Figure 4 – Illustration of the requirements of 4.15

Figure 5 – Void


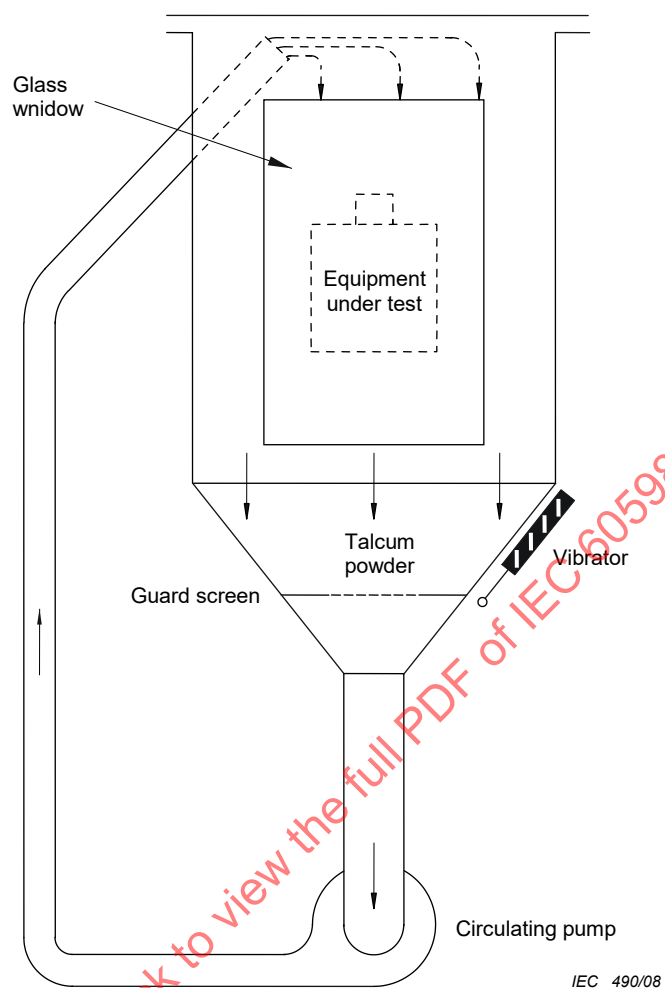



Figure 6 – Apparatus for proving protection against dust

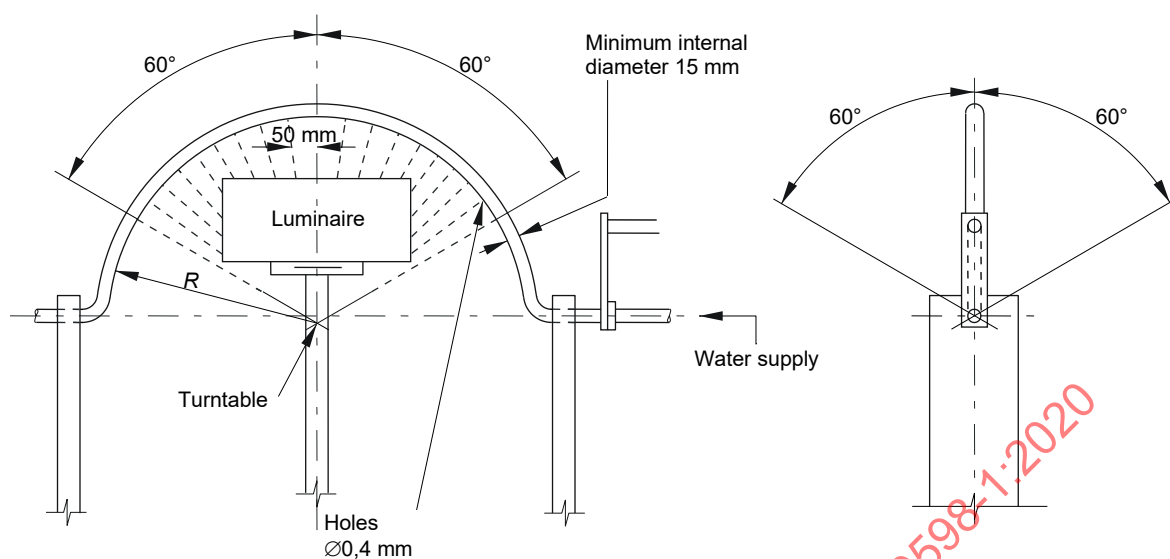

IEC 491/08


	Luminaire protection	
	rainproof	splash-proof
Oscillation half-angle	$\pm 60^\circ$	$\pm 180^\circ$
Holes within half-angle	$\pm 60^\circ$	$\pm 90^\circ$

Figure 7 – Apparatus for testing protection against rain and splashing

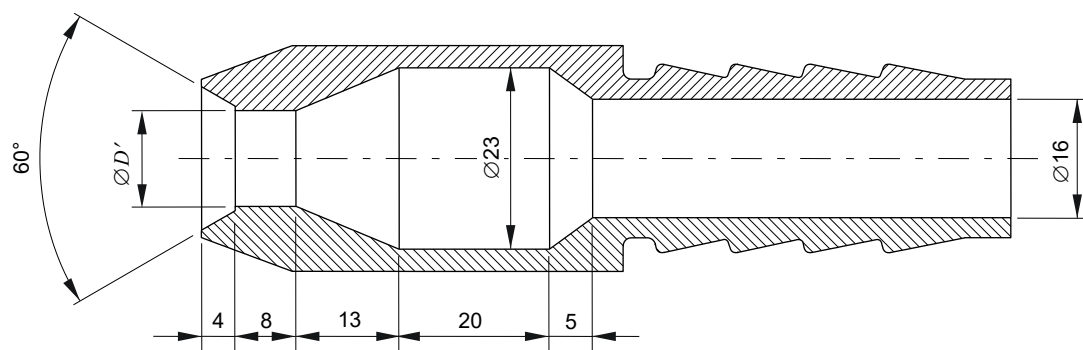

$D' = 6,3$ mm for the test of 9.2.6 (second characteristic numeral 5)


$D' = 12,5$ mm for the test of 9.2.7 (second characteristic numeral 6)

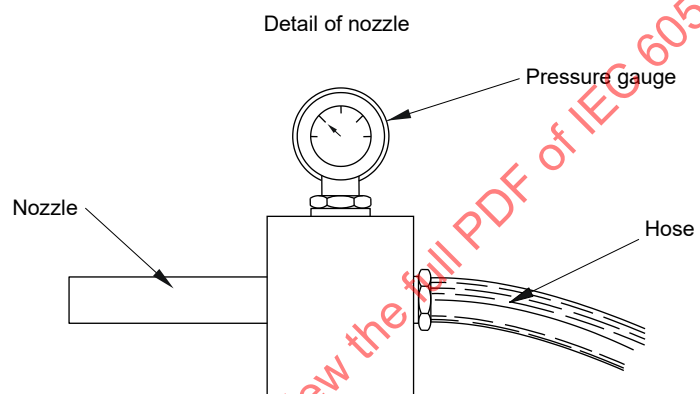

IEC 492/08

Dimensions in millimetres

Figure 8 – Nozzle for spray test

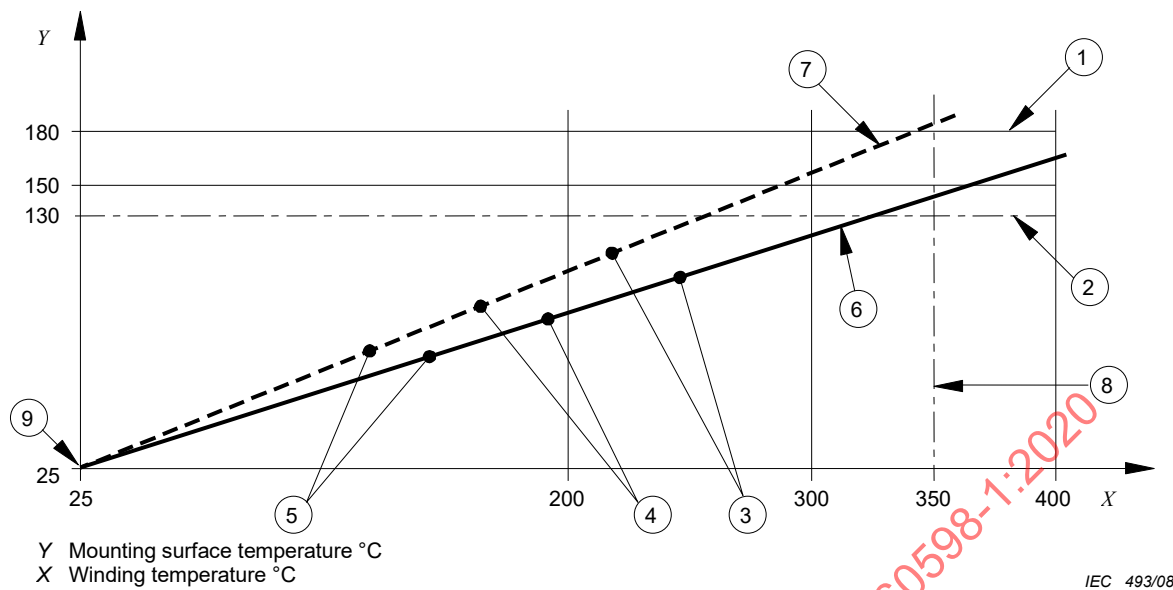


Key

Y = Mounting surface temperature °C

X = Winding temperature °C


- 1 Limiting value of mounting surface in case of failed winding
- 2 Limiting value of mounting surface temperature during abnormal operation at 1,1 times the rated voltage (see 12.6.1 a))
- 3 Measuring point at 1,1 times the rated voltage (see 12.6.1 b))
- 4 Measuring point at 1,0 times the rated voltage
- 5 Measuring point at 0,9 times the rated voltage
- 6 Straight line drawn through plotted points and indicating a satisfactory luminaire, as the extrapolation of the line to a winding temperature of 350°C is below a mounting surface temperature of 180 °C
- 7 Straight dashed line drawn through plotted points and indicating a luminaire which fails the test because the extrapolation of the line exceeds a mounting surface temperature of 180 °C before reaching a winding temperature of 350 °C
- 8 Assumed maximum value of the winding temperature of a failed winding
- 9 t_a / t_a co-ordinate plotted only if difference between winding temperatures at 0,9 and 1,1 times the rated voltage is less than 30 K. The example shown is for a luminaire having a t_a rating of 25 °C

Figure 9 – Relation between winding temperature and mounting surface temperature

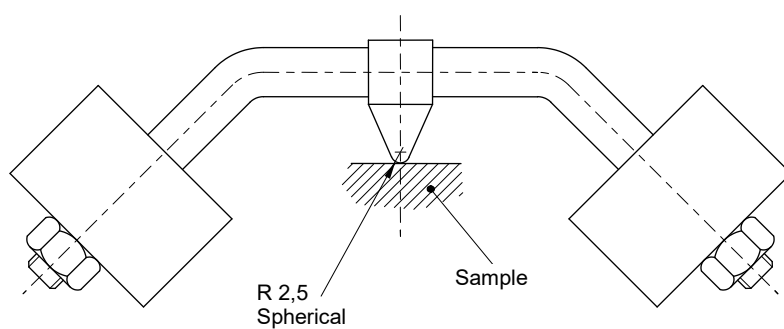

IEC 494/08


Dimensions in millimetres

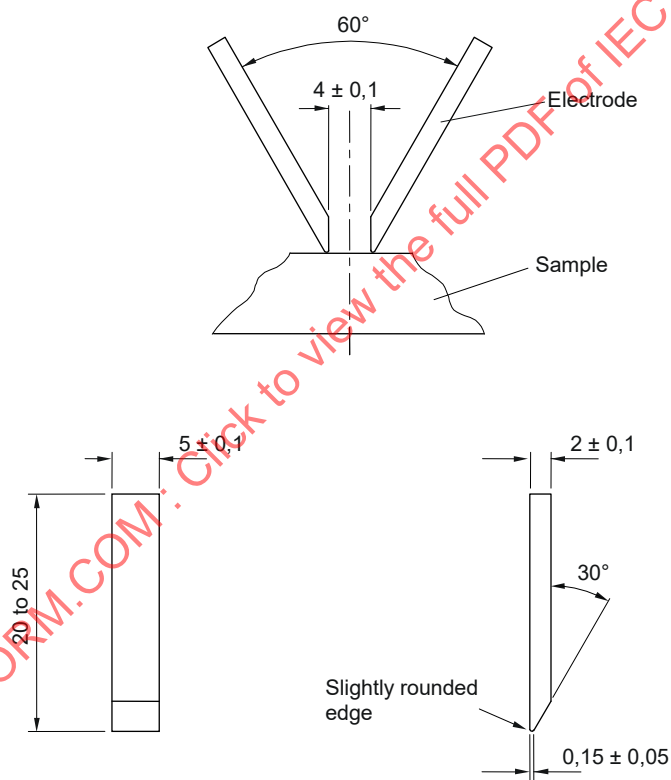Figure 10 – Ball-pressure apparatus

IEC 495/08

Dimensions in millimetres

Figure 11 – Arrangement and dimensions of the electrodes for the tracking test

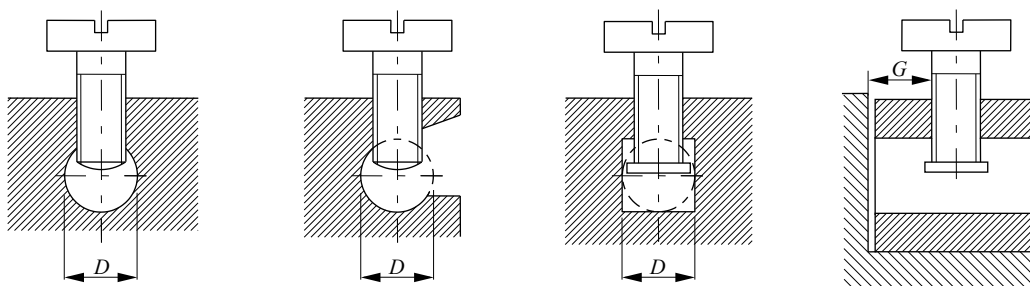

IEC 496/08

Terminals without pressure plate	Terminals with pressure plate
D = conductor space	G = distance between clamping screw and end of conductor when fully inserted

The shape of the conductor space may differ from those shown, provided a circle with a diameter equal to the minimum value specified for D can be inscribed.


NOTE The part of the terminal containing the threaded hole and the part of the terminal against which the conductor is clamped by the screw can be two separate parts, as in the case of terminals provided with a stirrup.

Terminal size	Minimum diameter D of conductor space mm	Minimum distance G between clamping screw and end of conductor when fully inserted		Torque Nm					
				I ^a		III ^a		IV ^a	
		One screw	Two screws	One screw	Two screws	One screw	Two screws	One screw	Two screws
1	2,5	1,5	1,5	0,2	0,2	0,4	0,4	0,4	0,4
2	3,0	1,5	1,5	0,25	0,2	0,5	0,4	0,5	0,4
3	3,6	1,8	1,5	0,4	0,2	0,8	0,4	0,8	0,4
4	4,0	1,8	1,5	0,4	0,25	0,8	0,5	0,8	0,5
5	4,5	2,0	1,5	0,7	0,25	1,2	0,5	1,2	0,5
6	5,5	2,5	2,0	0,8	0,7	2,0	1,2	2,0	1,2
7	7,0	3,0	2,0	1,2	0,7	2,5	1,2	3,0	1,2




^a The values specified apply to the screws covered by the corresponding columns in Table 14.4.

Figure 12 – Pillar terminals



Screw not requiring washer
or clamping plate

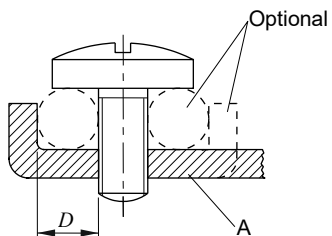

Screw requiring washer
or clamping plate

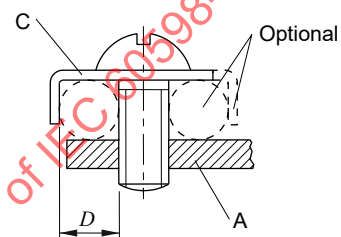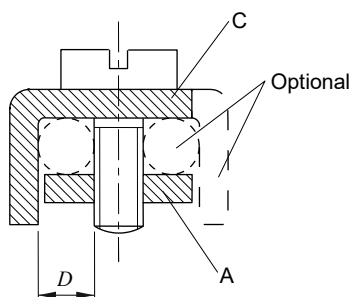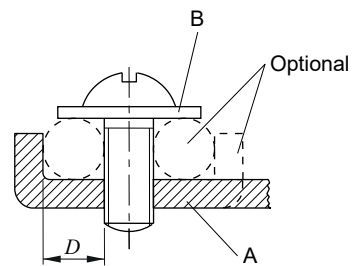

Screw terminals

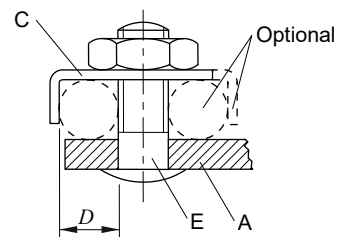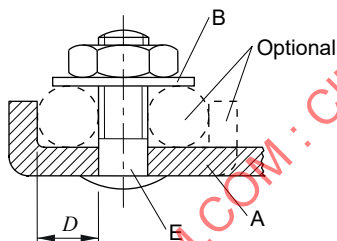

Stud terminals

IEC 497/08

Key

- A fixed part
- B washer or clamping plate
- C anti-spread device
- D conductor space
- E stud


NOTE The part which retains the conductor in position can be of insulating material provided the pressure necessary to clamp the conductor is not transmitted through the insulating material.

Figure 13 – Screw terminals and stud terminals (1 of 2)

Terminal size	Minimum diameter <i>D</i> of conductor space mm	Torque Nm			
		III ^a		IV ^a	
		One screw	Two screws	One screw or stud	Two screws or studs
0	1,4	0,4	–	0,4	–
1	1,7	0,5	–	0,5	–
2	2,0	0,8	–	0,8	–
3	2,7	1,2	0,5	1,2	0,5
4	3,6	2,0	1,2	2,0	1,2
5	4,3	2,0	1,2	2,0	1,2
6	5,5	2,0	1,2	2,0	1,2
7	7,0	2,5	2,0	3,0	2,0

^a The values specified apply to the screws or studs covered by the corresponding columns in Table 14.4.

Figure 13 (2 of 2)

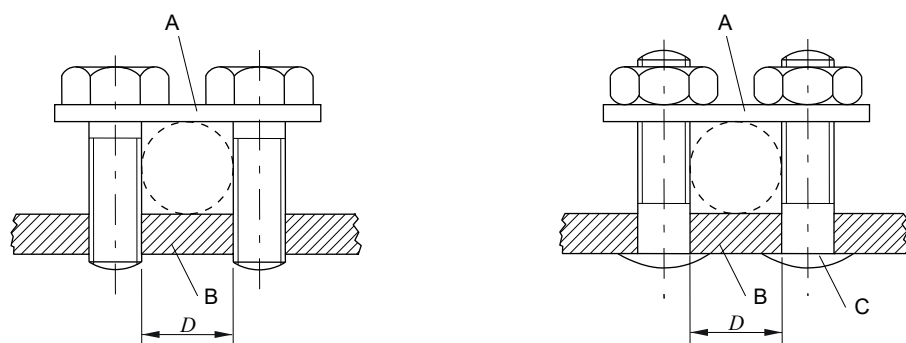

IEC 498/08

Key

A saddle

B fixed part

C stud

D conductor space


NOTE The shape of the section of the conductor space can differ from those shown in the figures, provided a circle with a diameter equal to the minimum value specified for D can be inscribed.

The shape of the upper and lower faces of the saddle can be different, to accommodate conductors of either small or large cross-sectional area, by reversing the saddle.

The terminals can have more than two clamping screws or studs.

Terminal size	Minimum diameter D of conductor space mm	Torque Nm
3	3,0	0,5
4	4,0	0,8
5	4,5	1,2
6	5,5	1,2
7	7,0	2,0

Figure 14 – Saddle terminals

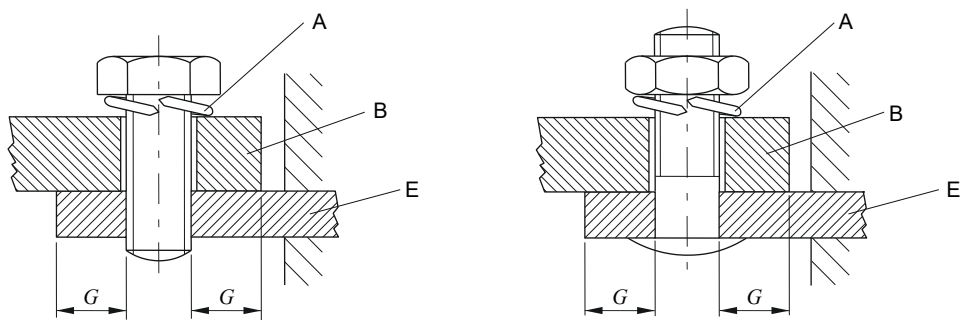

IEC 499/08

Key

- A locking means
- B cable lug or bar
- E fixed part
- F stud
- G distance between edge of hole and side of clamping area

For certain types of equipment, the use of terminals of a size smaller than those specified is allowed.

Terminal size	Minimum distance <i>G</i> between edge of hole and side of clamping area mm	Torque Nm	
		III ^a	VI ^a
6	7,5	2,0	2,0
7	9,0	2,5	3,0

^a The values specified apply to the studs covered by the corresponding columns in Table 14.4.

Figure 15 – Lug terminals



IEC 500/08

Key

A fixed part

D conductor space

Terminal size	Minimum diameter D of conductor space ^a	Minimum distance between fixed part and end of conductor when fully inserted
	mm	mm
0	1,4	1,5
1	1,7	1,5
2	2,0	1,5
3	2,7	1,8
4	3,6	1,8
5	4,3	2,0
6	5,5	2,5
7	7,0	3,0

^a The torque value to be applied is that specified in column II or V of Table 14.4 as appropriate.

Figure 16 – Mantle terminals

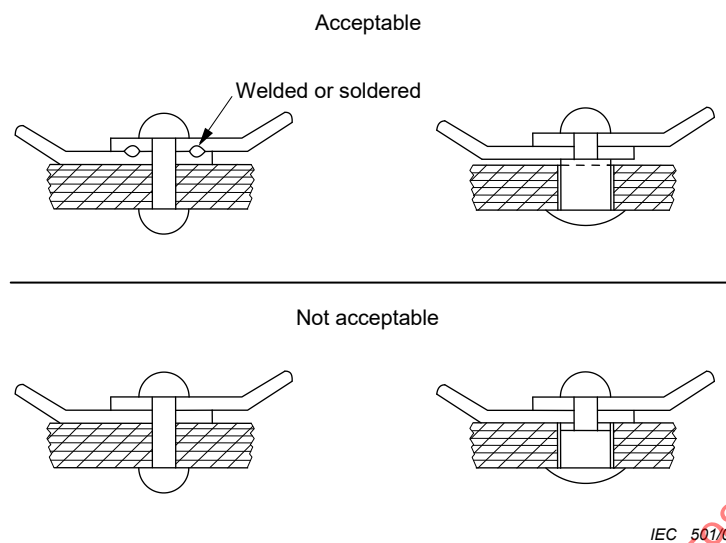


Figure 17 – Construction of electrical connections



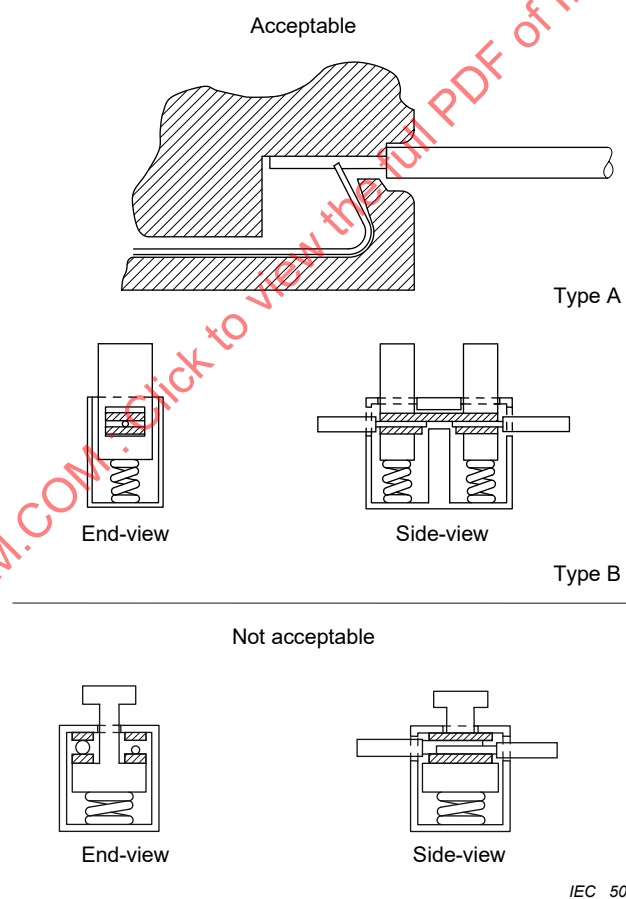


Figure 18 – Examples of spring-type screwless terminals

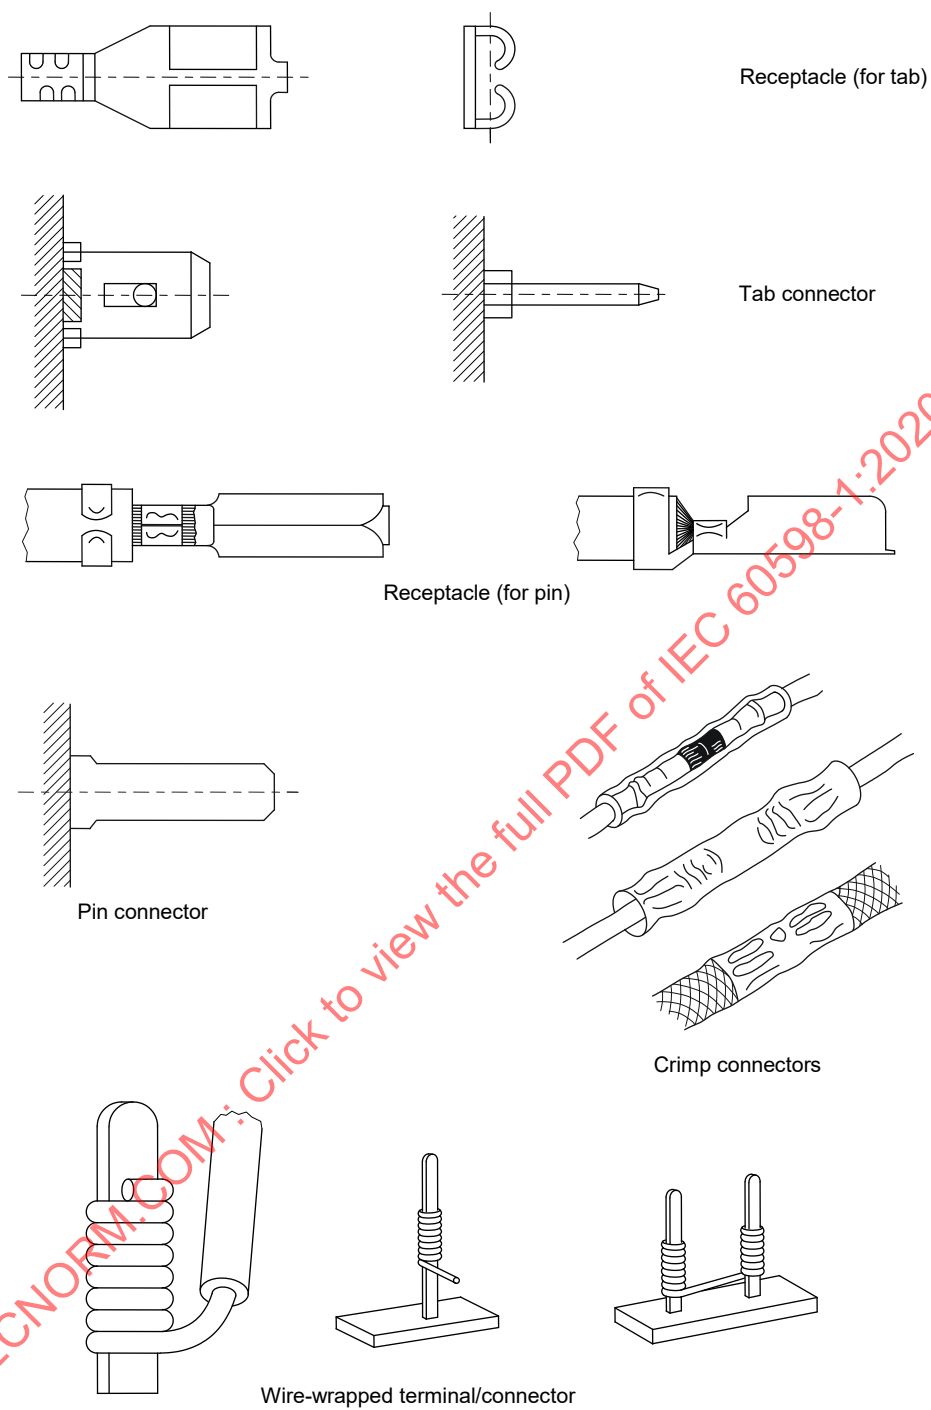


IEC 503/08


Figure 19 – Further examples of screwless terminals

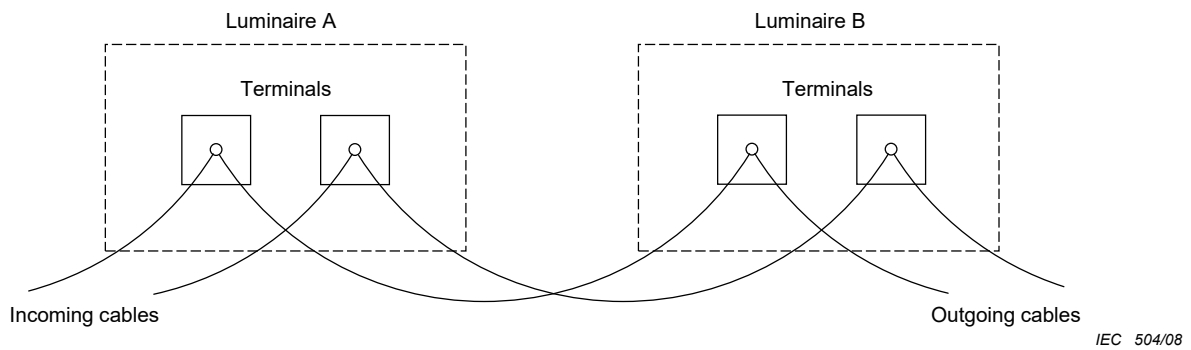

a) Illustration of the term "looping-in" (feed through)

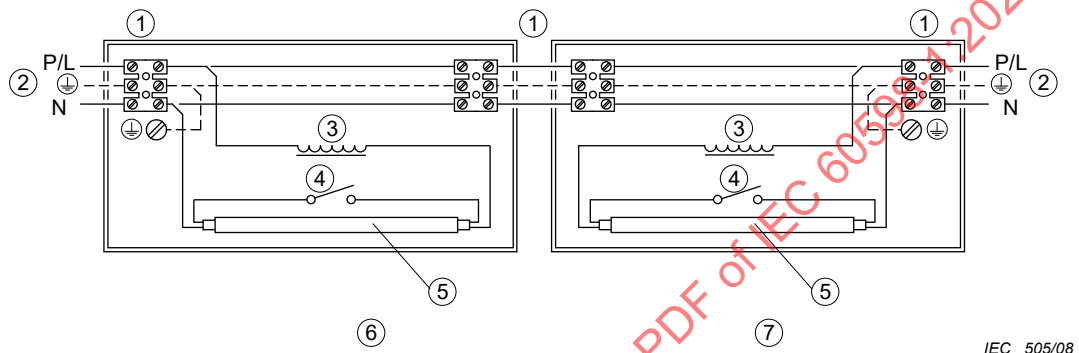

b) Illustration of the term "through wiring" terminating in the luminaire
(can be used for three-phase through wiring where the luminaire is connected
between L1, L2 and L3 and the neutral in turn)

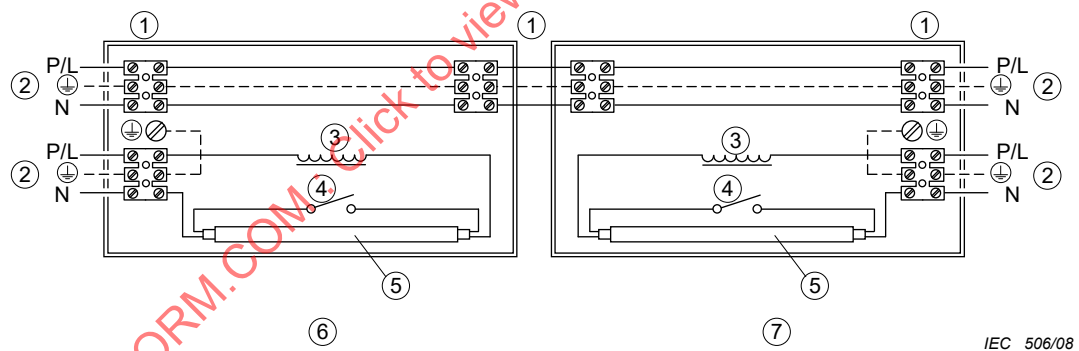


c) Illustration of the term "through wiring" not terminating in the luminaire

Key

- | | |
|-------------|---------------|
| 1 terminals | 5 lamp |
| 2 supply | 6 luminaire A |
| 3 ballast | 7 luminaire B |
| 4 starter | |

Figure 20 – Illustration of the terms "looping-in" and "through wiring"

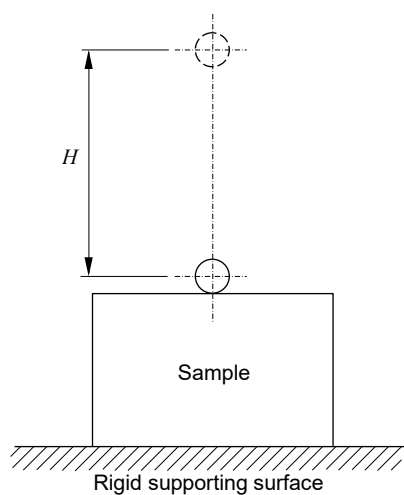

IEC 507/08

The rigid supporting surface should be arranged vertically for a side impact test.


Figure 21 – Apparatus for ball impact tests



Self-tapping screw: pointed or flat



Thread-cutting screw




Thread-forming screw (thread formed by deformation)

IEC 508/08

Figure 22 – Examples of self-tapping, thread-cutting and thread-forming screws (from ISO 1891)

Figure 23 – Void

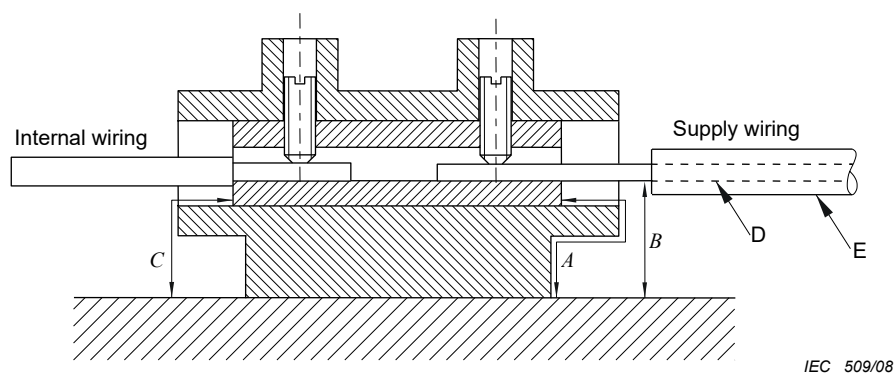


Key

- A* creepage distance
- B* clearance (supply wiring)
- C* clearance (internal wiring)
- D* conductor
- E* insulation

Figure 24 – Illustration of creepage and clearance measurements at a supply terminal


Figure 25 – Void

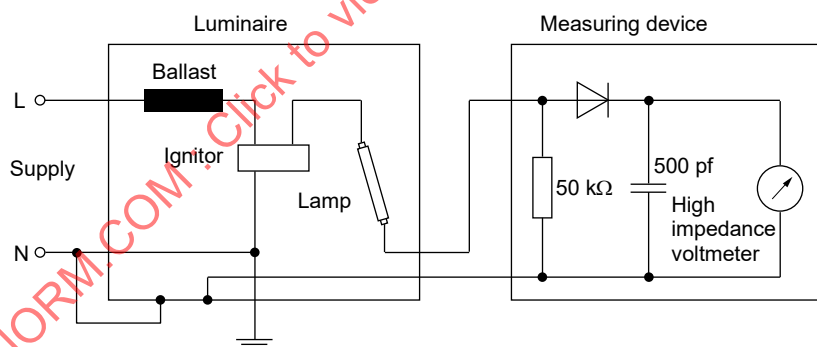

IEC 511/08


NOTE The polarity of the diode to be reversed if necessary.

Figure 26 – Test circuit for safety during insertion

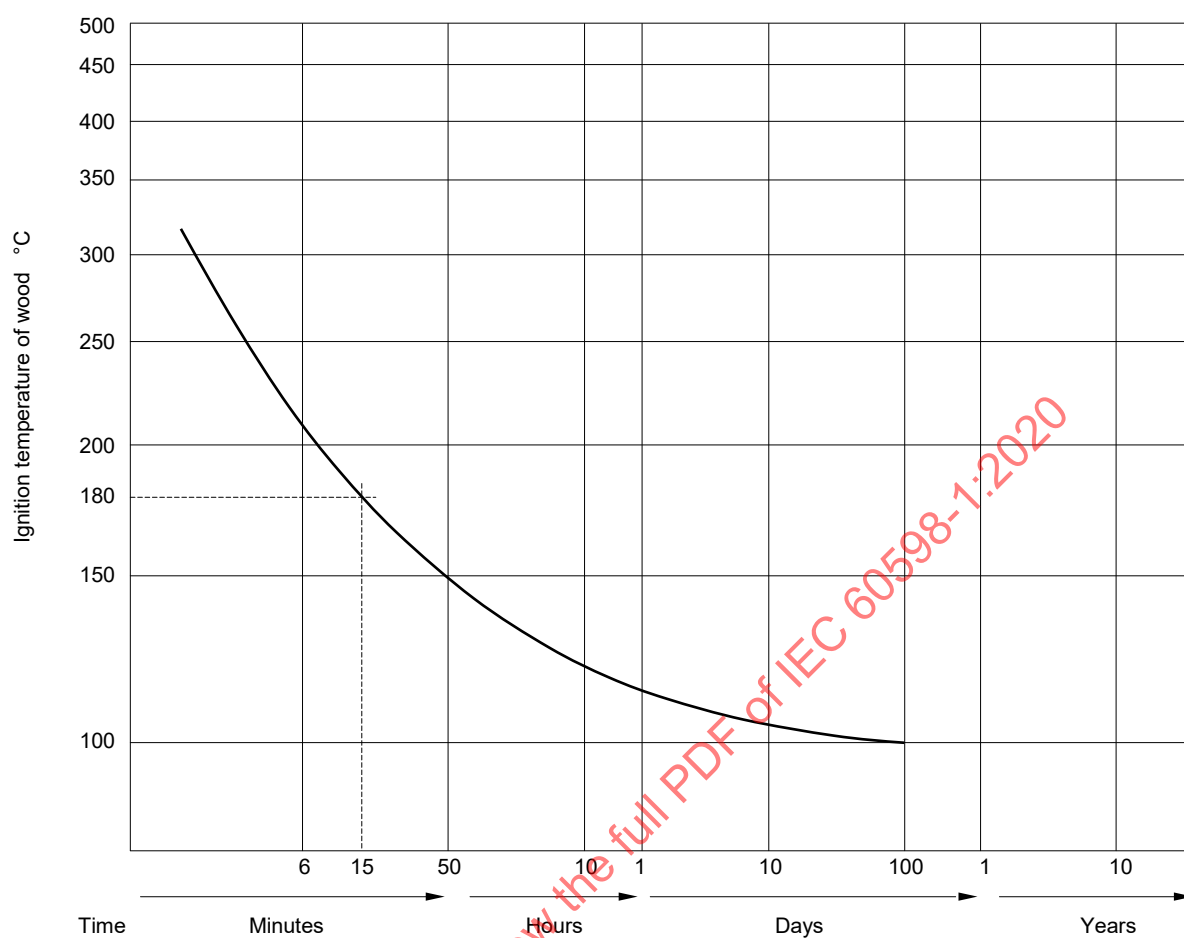


IEC 512/08

Figure 27 – Ignition temperatures of wood as a function of time

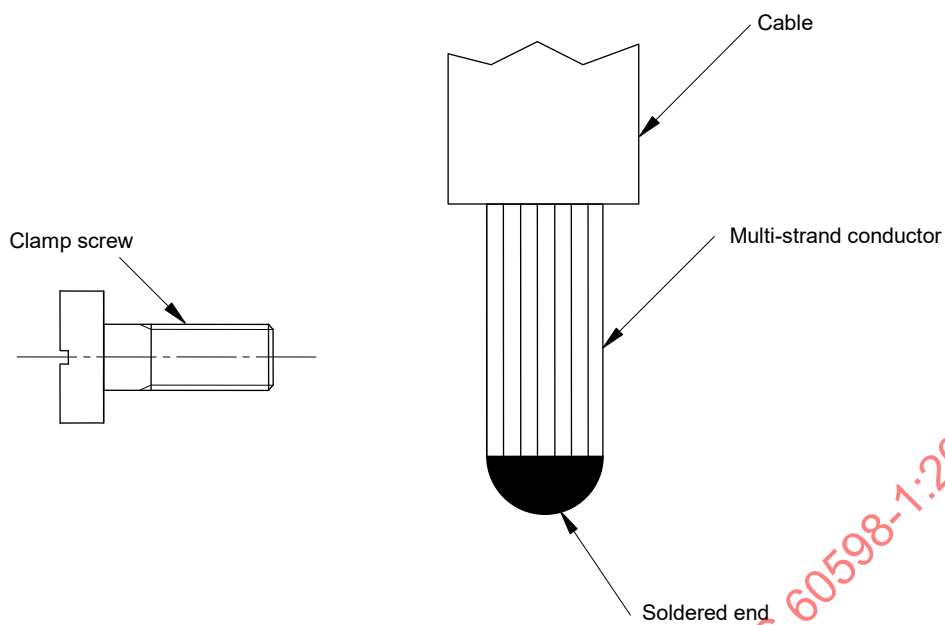

IEC 513/08


Figure 28 – Example of permitted degree of soldering

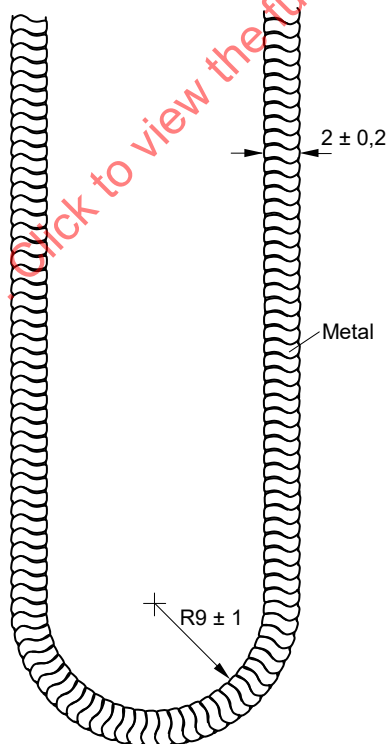

IEC 514/08

Dimensions en millimètres

Figure 29 – Test chain

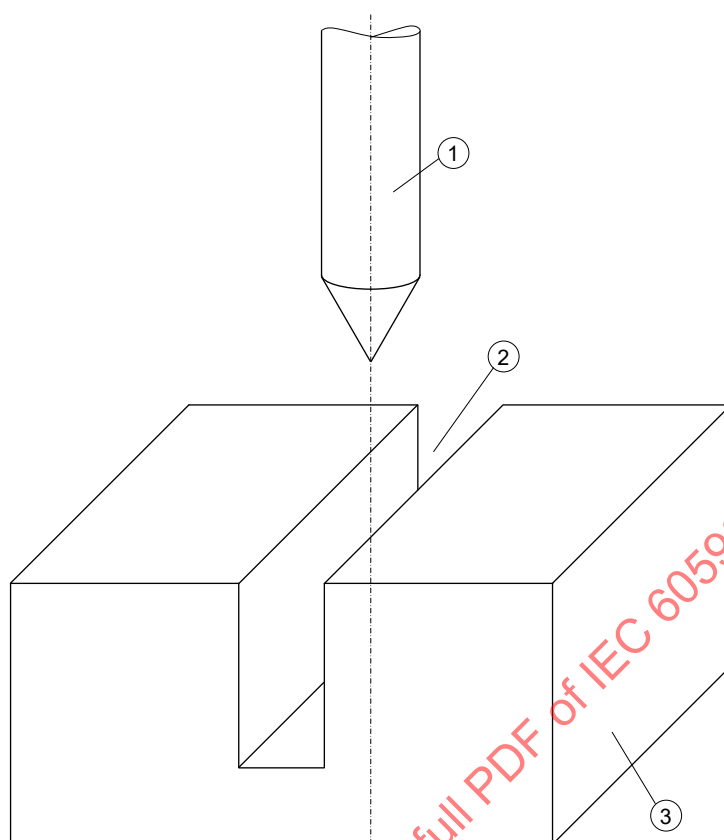

IEC 515/08

Key

- 1 thread forming screw
- 2 groove
- 3 metallic material

Figure 30 – Example of a thread forming screw used in a groove of a metallic material

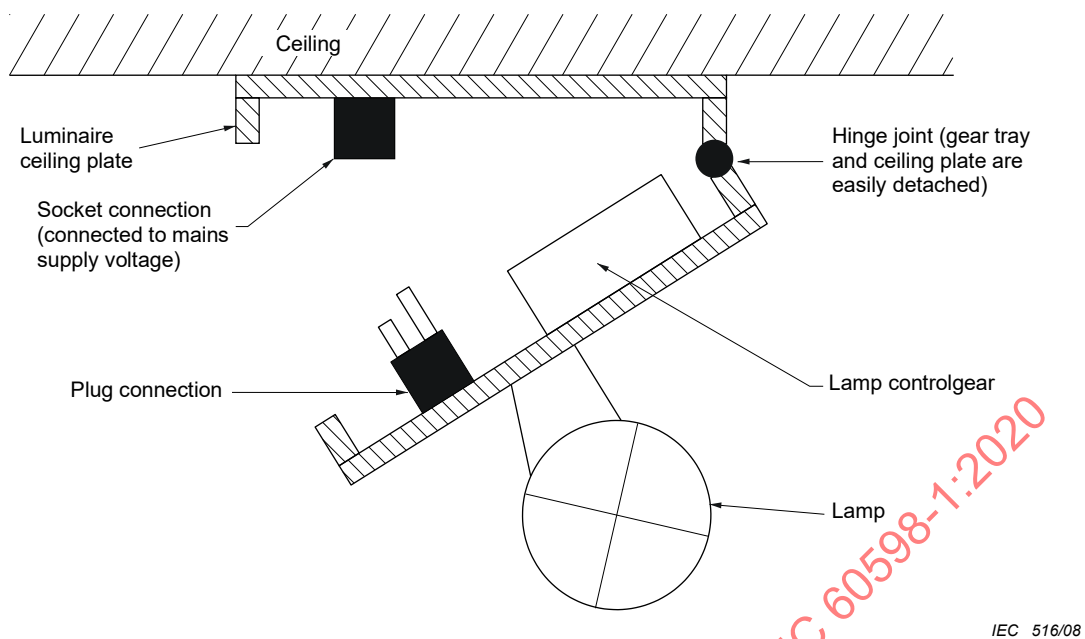


Figure 31 – Electro-mechanical contact system with plug/socket connection

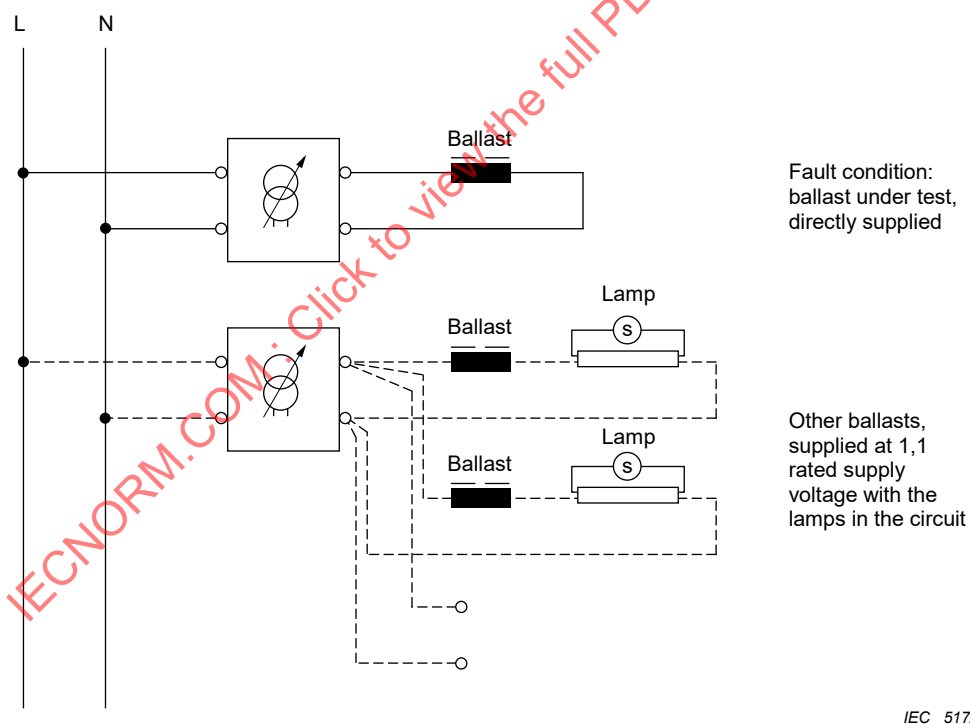


Figure 32 – Test circuit for luminaires incorporating fluorescent lamp ≤ 70 W

Annex A

(normative)

Test to establish whether a conductive part can cause an electric shock

In order to determine whether a conductive part is a live part which can cause an electric shock, the luminaire is operated at rated supply voltage and nominal frequency and the following tests are conducted:

A.1 In order to determine whether a conductive part is a live part which can cause an electric shock, the device under test (DUT) is operated at rated voltage and nominal supply frequency. A conductive part is not a live part if the requirements of Clauses A.2 or A.3 are met.

NOTE The purpose of this annex is to establish if a conductive part can cause an electric shock, if touched. It does not indicate the kind and level of insulation used.

For the tests according to Clauses A.2 and A.3:

- one pole of the supply of the DUT shall be at earth potential;
- if no explicit designation of the supply voltage polarity is marked on the DUT, the test is done with both supply voltage polarities;
- the measurements are made:
 - between the part concerned and any accessible conductive part;
 - between the part concerned and earth.

A.2 The voltage is measured by using a measuring circuit consisting of a non-inductive resistance of 50 k Ω .

- The voltage shall not exceed 35 V AC peak or 60 V ripple free DC or 25 V peak interrupted DC voltage between 10 Hz and 200 Hz.

A.3 Where the voltage measured according to Clause A.2 exceeds the limit value, the touch-current shall not exceed:

- for AC: 0,7 mA (peak);
- for DC: 2,0 mA.

Compliance is checked by using the measuring network from Figure G.2.

Annex B (normative)

Test lamps

B.1 General

For the tests of Section 12, it is convenient to keep a stock of lamp types commonly required. These are selected from normal production lamps for characteristics as close as possible to the objective characteristics listed in the appropriate standards. The selected lamps are aged (at least 24 h for filament lamps and at least 100 h for tubular fluorescent and other discharge lamps, with occasional off periods), and a further check is made that their characteristics are still satisfactory and stable. Lamps shall not be retained as test lamps for longer than about three-quarters of their typical operating period in normal service. Lamps are inspected before each test for any damage or signs of approaching unserviceability. Discharge lamps shall be checked regularly to ensure that there has been no appreciable shift in electrical characteristics which would influence the temperatures in luminaires. If a lamp can be inserted in a circuit in more than one position (e. g. a fluorescent lamp) marks shall be made to assist consistent insertion. Great care shall be taken in handling test lamps; in particular, sodium vapour, mercury vapour and metal halide discharge lamps and amalgam fluorescent lamps shall not be moved while still hot. A lamp selected for a particular test shall be of a rating and type for which the luminaire is claimed to be suitable. If a choice of lamp shape, construction or finish is indicated by the manufacturer, the thermally most onerous shall be taken. Otherwise, the most common type shall be used.

The requirements according to Clauses B.2 to B.5 refer to the selection of lamps as test lamps, and to lamp selection for a particular test of a luminaire.

B.2 Filament lamps within the scope of IEC 60432-1 and IEC 60432-2

B.2.1 Principal modes of heat transfer and lamps used for testing

B.2.1.1 In seeking to test the luminaire with lamps which develop the most onerous conditions within it, consideration needs to be given to two principal modes of heat transfer, radiation and conduction.

B.2.1.2 Radiation. The materials of the luminaire are heated by radiation from the lamp filament, supplemented, for the area immediately around and especially above the lamp, by convected heat from the bulb surface. In general, for testing such conditions, clear lamps are used. The filament shapes used in most HV lamps provide a slightly irregular radiation pattern but are unlikely to have highly directional properties. There is more variation in lamps designed for LV (100 V to 130 V), as lamps with transverse or axial filaments may produce different heating patterns which could be important in certain designs. Where reflector lamps are involved, note is taken of clear areas in the neck region. If it is intended to use lamps with heat transmitting reflectors, such lamps are used for tests. Light centre length also plays a role.

B.2.1.3 Conduction. The lampholder and associated wiring receive heat by conduction from the lamp cap and if the luminaire can operate with the lamp in the cap-up position, by convection transfer from the outer surface of the lamp.

B.2.2 Filament test lamps

B.2.2.1 General

Testing of the conditions according to B.2.1.3 and endurance testing require heat test source lamps (HTS lamps) prepared and used as specified in B.2.2.2 and B.2.2.3.

B.2.2.2 Preparation

Readily available lamps are used. Each lamp is uniquely identified and its cap temperature rise (Δt_S) shall be determined by the IEC 60360 method.

These values shall be compared to the values in Table 2 of IEC 60432-1:1999 and IEC 60432-1:1999/AMD1:2005 and Table 1 of IEC 60432-2:1999 and IEC 60432-2:1999/AMD1:2005 respectively and the difference is noted ($\Delta(\Delta t_S)$).

Where IEC 60432-1 and IEC 60432-2 do not specify a temperature, then the manufacturer's data should be used, or manufacturers should be requested to supply test lamps.

B.2.2.3 Use

A known test lamp is used in the normal way for thermal testing, and its cap temperature noted. This figure is corrected by $\Delta(\Delta t_S)$ to obtain the final test figure. This is compared with standard limits in Table 12.1.

The following guidelines will help in the selection of suitable lamps.

Compared with clear or frosted lamps, higher cap temperatures are principally to be found on lamps which have:

- a white coated or dark coloured bulb;
- a smaller bulb;
- a shorter light centre length.

Small differences from the specified Δt_S of Table 2 of IEC 60432-1:1999 and IEC 60432-1:1999/AMD1:2005 shall be corrected for the adjustment of the HTS lamps by the test voltage, but such adjustment shall not cause the wattage to exceed 105 % of the rated wattage (corresponding to 103,2 % voltage).

Additionally, for the thermal test by conduction only, the outer surface of a lamp may be hand printed with suitable high temperature paint, commencing in the area of the cap and, if necessary, extending over all the bulb surface.

For reflector and bowl mirror lamps, only the test voltage shall be used for adjustment of the temperature.

For endurance testing, HTS lamps which have been modified to give increased cap temperature are not used.

If the luminaire is provided with a marking for special lamps, or if it is obvious that special lamps are to be used in the luminaire, the tests are made with such special lamps.

Lamps are chosen in accordance with the maximum wattage for which the luminaire is marked. In case of doubt for luminaires marked with a maximum 60 W, E27 or B22 cap, tests shall also be made with a 40 W round bulb lamp.

The voltage rating of the test lamps shall be typical of the voltage rating in the market for which the luminaire is intended. If the luminaire is intended for two or more different groups of voltage supply, for example for 200 V to 250 V and for 100 V to 130 V, then the testing shall at least be carried out with lamps in the low voltage range (i. e. with the higher current), but taking into account the comments above.

When choosing the range of lamps for testing, the requirement of 3.2.8 should be taken into account.

If a lamp is operated by a transformer or similar device within or external to the luminaire, the rating of the test lamp shall correspond to the marking on the luminaire, transformer or similar instructions.

B.3 Halogen lamps within the scope of IEC 60432-3

Test with the lamps provided by the luminaire manufacturer.

Attention should be given to special features of these lamps (e.g. beam angle, cool-beam versions).

B.4 Tubular fluorescent and other discharge lamps

When a lamp is operated under reference conditions (according to the relevant IEC lamp standard), the lamp voltage, current and power shall be as close as possible to the lamp rated values, and shall be within 2,5 % of these values.

If a reference ballast is not available, lamps are selected using a production ballast which, at the calibration current, has an impedance within ± 1 % of that of the reference ballast.

Self-ballasted lamps are considered as fluorescent or other discharge lamps for the purpose of Section 12. If the luminaire is for use with filament lamps and self-ballasted lamps or other discharge lamps incorporating series filaments, it should be tested with the most onerous lamp (which in general will be with filament lamps).

If the luminaire is for use with a combination of lamp types (e.g. filament lamp plus a discharge lamp), it should be tested with the thermally most onerous type.

If the luminaire is for use with either filament or discharge lamps, it should be tested with the more onerous (or, if not known, with each in turn).

It is usually found that translucent materials attain a higher temperature with a discharge lamp or a discharge lamp incorporating a series filament than with a filament lamp, for a given lamp power.

If the luminaire is designed for a lamp type for which specifications have not yet been established, a test lamp should be selected after consultation with the lamp manufacturer.

B.5 LED modules within the scope of IEC 62031

Test with the LED modules provided by the luminaire manufacturer.

Annex C (normative)

Abnormal circuit conditions

The following is a list of abnormal circuit conditions which are applicable to a tubular fluorescent or other discharge lamp luminaire and from which the thermally most onerous condition shall be taken (see 12.5.1). If the luminaire contains more than one lamp, the abnormal conditions shall be applied only to the one lamp, which leads to the most adverse results. The abnormal condition shall be set up before the test is started. Conditions d) and e) refer only to lamps with two preheated electrodes (e.g. fluorescent lamps). The descriptions include instructions on test arrangements. Conveniently, the abnormal circuit condition is produced or simulated by remote switching so that it is not necessary to disturb a luminaire which has just completed the test of normal operation.

a) Short-circuit of starter contacts

This condition applies to starters with moving contacts, including starters incorporated in lamps.

b) Lamp rectification

1) Luminaires for fluorescent lamps (Figure C.1 and Figure C.2)

This is a fault condition which may occur after extended use in luminaires employing starterless ballasts with capacitive reactance control. When testing luminaires for the rectifying effect, the circuit shown in Figure C.1 shall be used. The lamp is connected to the midpoint of the appropriate equivalent resistors. The rectifier polarity is chosen so as to give the most unfavourable operating conditions. If necessary, the lamp is started using a suitable starting device.

The rectifier characteristics shall be:

- peak inverse voltage $\geq 800 \text{ V}$
- reverse leakage current $\leq 10 \mu\text{A}$
- forward current > 3 times nominal lamp running current
- transition time $\leq 50 \mu\text{s}$

Luminaires for tubular fluorescent lamps having Fa6 caps however, shall be tested as follows.

Initially, the lamp is operated under normal conditions with a short-circuited rectifier in series with the lamp. Then the bridging of the rectifier is opened. The rectifier shall be inserted in both polarities. The test is finished if the lamp extinguishes. If not, the following test is carried out.

The lamp is operated as shown in Figure C.2. The rectifier polarity shall be chosen so as to give the most unfavourable operating conditions. If necessary, the lamp is started using a suitable starting device.

2) Luminaires for some metal halide lamps and some high pressure sodium vapour lamps which, according to the lamp safety standard IEC 62035, can lead to ballast, transformer or starting device overloading (Figure C.3).

The lamp in the luminaire is replaced by the test circuit as shown in Figure C.3. The test is commenced with the test circuit, luminaire and controlgear stabilized at the ambient temperature of the draught-proof enclosure. By varying the resistor R , the lamp current is adjusted to a value equal to twice the normal lamp current. No further adjustment of R is made.

If steady conditions are reached before the temperature limits of 12.5.2 are exceeded, and for thermally protected controlgear the protection device has not operated, then R shall be adjusted to increase the current in suitable steps, for example 10 % increments. Care is taken to achieve steady conditions as far as possible at each step. In all cases, the current shall not be adjusted above a value equal to three times the normal lamp current.

NOTE For circuits protected by a self-resetting protection device a number of on/off cycles may need to occur before maximum temperatures have been reached.

Luminaires incorporating the following specific categories of metal halide and high pressure sodium lamps are exempt from the above rectification test requirements:

- *high pressure sodium lamps with rated wattage of 1 000 W and above;*
- *high pressure sodium lamps designed as direct replacements for mercury lamps;*
- *high pressure sodium and metal halide lamps identified by IEC 62035 as not being liable to end of life rectification;*
- *other high pressure sodium and metal halide lamps for which no end of life rectification risk has been identified by the lamp manufacturer. (This may limit suitability of the luminaire to specific lamp makers only).*

c) Lamps removed and not replaced.


d) One electrode of lamp open-circuited.

The conditions may be produced by switching. (Alternatively, a test lamp may be suitably modified.)

The electrode selected shall be that which more adversely affects the results.


e) Lamp will not start, but both electrodes are intact. For this condition, a non-serviceable or modified test lamp may be used.

f) Blockage of the motor(s) contained in the luminaire.

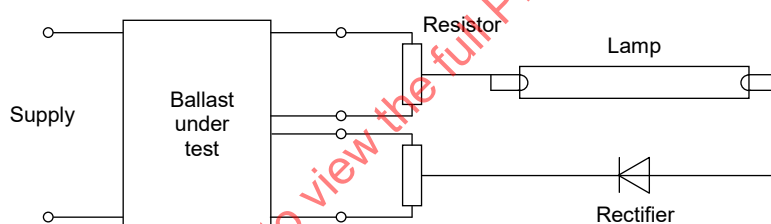


IEC 518/08

**Figure C.1 – Circuit for testing rectifying effect
(some capacitive starterless ballasts only)**

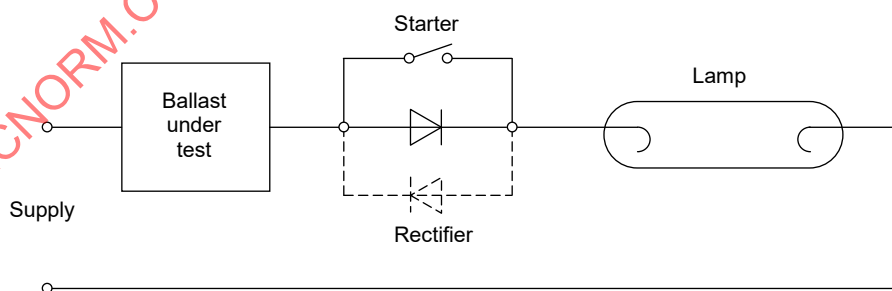

IEC 519/08

**Figure C.2 – Circuit for testing rectifying effect
(ballasts for single pin lamps)**

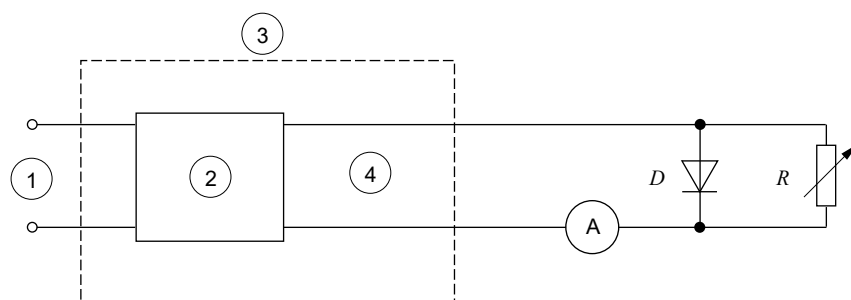

IEC 520/08

Key

- 1 supply
- 2 ballast, transformer, starting device
- 3 luminaire
- 4 lamp connections
- D* 100 A, 600 V
- R* 0 Ω to 200 Ω (wattage rating of the resistor to be at least half the lamp wattage)

Figure C.3 – Circuit for testing rectifying effect of some high pressure sodium and some metal halide lamps

Annex D (normative)

Thermal testing

D.1 Draught-proof enclosure

The following recommendations refer to the construction and use of a suitable draught-proof enclosure for luminaires, as required for the tests of normal and abnormal operation. Alternative constructions for draught-proof enclosures are suitable if it is established that similar results are obtained.

The draught-proof enclosure is rectangular, with a double skin on top and on at least three sides, and with a solid base. The double skins are of perforated metal, spaced approximately 150 mm apart, with regular perforations of 1 mm to 2 mm diameter, occupying about 40 % of the whole area of each skin.

The internal surfaces are painted with a matt paint. The three principal internal dimensions are each at least 900 mm. There shall be a clearance of at least 200 mm between the internal surfaces and any part of the largest luminaire for which the enclosure is designed.

If it is required to test two or more luminaires in a large enclosure, care should be taken that radiation from one luminaire cannot affect any other.

There is a clearance of at least 300 mm above the top of the enclosure and around the perforated sides. The enclosure is at a location protected as far as possible from draughts and sudden changes in air temperature; it is also protected from sources of radiant heat.

A luminaire under test is positioned as far away as possible from the six internal surfaces of the enclosure. The luminaire is mounted (subject to the requirements of 12.4.1 and 12.5.1) as under service conditions.

D.2 Mounting surface and test recess

A luminaire for direct fixing to a ceiling or wall should be fixed to a mounting surface comprising a wood or wood-fibre board. A non-combustible insulating material is used if the luminaire is not suitable for mounting on a combustible surface. The board is 15 mm to 20 mm thick, and extends not less than 100 mm (but preferably not more than 200 mm) beyond the normal projection of the smoothed outline of the luminaire. There is a clearance of at least 100 mm between the board and the internal surfaces of the enclosure. The board is painted black with a matt non-metallic paint.

A luminaire for corner-fixing is fixed in a corner comprising two boards, each complying with the preceding requirements.

A third board is required if the luminaire is to be fixed in a vertical corner immediately below a simulated ceiling.

Luminaires shall not cause the recess to attain temperatures likely to cause a hazard or fire risk and compliance is checked by the following test.

Recessed luminaires suitable for covering with thermal insulating are mounted in a test recess consisting of a suspended ceiling and thermal insulation material positioned in direct contact to the luminaire.


Recessed luminaires not suitable for covering with thermal insulating are mounted in a test recess, consisting of a suspended ceiling, on top of which is a rectangular box with vertical sides and horizontal top.

The suspended ceiling is made of a 12 mm thick general use particle board, in which a suitable opening has been made for the luminaire. The general use particle board shall extend at least 100 mm outside the projection of the luminaire on this board.

NOTE An example of general used particle board is boards manufactured according to ISO 16893-1.

- a) Luminaires for recessing into ceilings with thermal insulating material covering the luminaire

Thermal insulating material is tightly fitted to the outside of the luminaire. The thermal insulation shall be equivalent to two 10 cm thick layers of mineral wool with a coefficient of thermal resistivity of $0,04 \text{ W/m} \times \text{K}$. Thinner layers can be used when having a higher thermal resistivity. If a luminaire is provided with separate parts intended for recessed mounting, (for example, with separate light source enclosure and controlgear enclosure), the test recess shall be constructed observing the manufacturer's recommendations for minimum spacing between parts (see Figure D.1). The space shall be filled with insulating material.

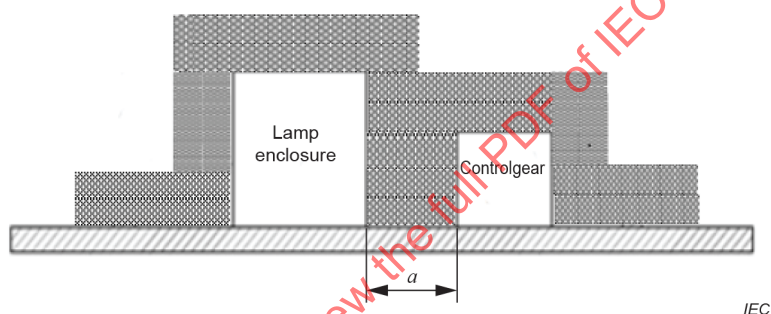

Key

a minimum separation as specified by the manufacturer

Other distances are in accordance with Annex D


Figure D.1 – Example of test recess where a luminaire comprises separate parts, in accordance with Clause D.2 a)

- b) Luminaires for recessing into ceilings but not suitable for covering with thermal insulating material

For recessed luminaires of this kind, the test recess consisting of a suspended ceiling, on top of which is a rectangular box with vertical sides and horizontal top shall be fixed above the luminaire. The vertical sides of the box are made of 19 mm thick laminated wood and the top of 12 mm thick general use particle board tightly sealed to the sides.

The sides and top of the box shall be spaced from the luminaire in accordance with the manufacturer's instructions supplied with the luminaire. If no spacing is specified, the sealed box shall touch the luminaire all around.

If a luminaire is provided with separate parts intended for recessed mounting, (for example, with separate light source enclosure and controlgear enclosure), the test recess shall be constructed as a single box observing the manufacturer's recommendations for minimum spacing between parts and the inside of the recess (see Figure D.2). Where spacing between parts is not specified (item '*a*' of Figure D.2), separate test recesses shall be used for each part.

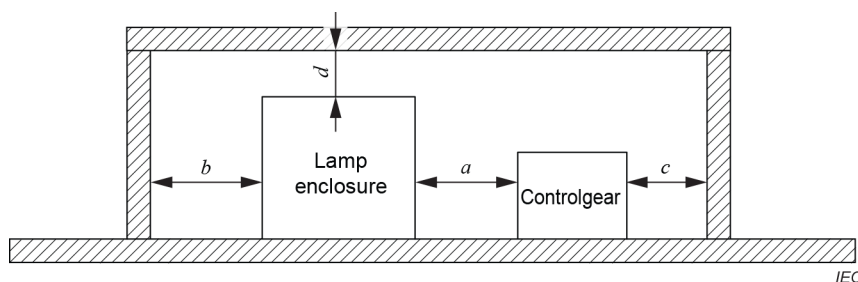

Key

a, b, c, d minimum separation as specified by the manufacturer

Other distances are in accordance with Annex D.

Figure D.2 – Example of test recess where a luminaire comprises separate parts, in accordance with Clause D.2 b)

If there are projecting spacers on the top or sides of the luminaire, then these spacers shall be placed in direct contact with the inside surfaces of the test box or insulating material.

The suspended ceiling and the interior of the box are painted black with a matt non-metallic paint, and there shall be a gap of not less than 100 mm between this assembly and the inside walls, ceiling and floor of the test enclosure.

NOTE 1 In Australia and New Zealand recessed luminaires are classified and tested for installations with thermal insulation in accordance with IEC 60598-2-2, Particular requirements – Recessed Luminaires.

NOTE 2 It is acceptable in Japan to apply the present Annex D or JIL 5002 for thermal test on recessed luminaires.

When a luminaire is intended to be recessed into a wall, the test is made using a test recess similar to that described above, but with the board placed vertically.

For luminaires classified for mounting in direct contact with a normally flammable surface and suitable for covering with thermal insulating material, no part of the insulation material and the luminaire surface above the suspended ceiling shall exceed 90 °C (as given in Table 12.1) during the normal operation thermal test and 130 °C (as given in Table 12.3) during the abnormal operation thermal test.


For luminaires classified for mounting in direct contact with a normally flammable surface not suitable for covering with thermal insulating material, no part of the test recess shall exceed 90 °C (as given in Table 12.1) during the normal operation thermal test and 130 °C (as given in Table 12.3) during the abnormal operation thermal test.

For luminaires classified as not suitable for direct mounting on normally flammable surfaces, no temperatures are measured for the mounting surface or test recess.

A track-mounted luminaire is connected to a track system appropriate to the luminaire. The track is mounted as in normal use, according to the manufacturer's installation instructions. The luminaire is connected to the track in the most onerous thermal position of normal use permitted by the mounting instructions or marking. The luminaire is operated under the conditions specified in 12.4.1 and 12.5.1.

All spacings shall be measured from the extremes of the positions of movement where luminaires are settable and adjustable in overall dimension or position in either axis when fully installed and during normal operation (see Figure D.3).

Figure D.3 illustrates the correct test box size for a luminaire that is adjustable in both axes and thus needs space within a ceiling for the setting or the adjustment.

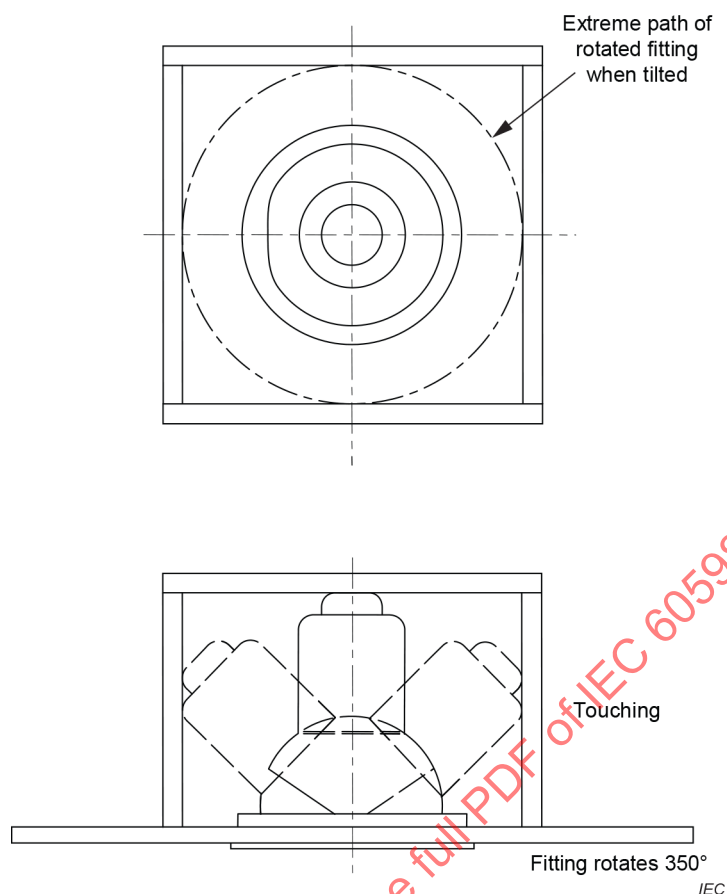

**Figure D.3 – Correct test box size (insulating ceilings)
for settable and adjustable luminaires**

D.3 Alternative test procedure for adjustment of measured temperatures for luminaire t_a rating(s)

D.3.1 General

The following test method can be used as an alternative to the reference test of 12.4.1 c) for luminaires:

- without temperature sensing controls, and
- where the rated ambient temperature t_a as marked on the luminaire is higher than the temperature in the draught proof enclosure, and
- where the light source has temperature-sensitive electrical (power) characteristics with a negative temperature coefficient (e.g. LED Light source with constant current type – controlgear assembly).

D.3.2 Thermal test of normal operation for luminaires without temperature sensing controls and where the rated ambient temperature t_a as marked on the luminaire is higher than the ambient temperature in the draught-proof enclosure

The luminaire shall be tested under the conditions specified in 12.4.1 a) to l) and according to the following:

The ambient temperature within the draught-proof enclosure shall be within the range of 10 °C to 30 °C and should preferably be 25 °C. It shall not vary by more than ± 1 °C during measurements and during a preceding period long enough to affect the results. The difference between the temperature in the draught-proof enclosure and the rated t_a temperature shall be calculated. The calculated difference temperature shall be added to each measured temperature value.

IECNORM.COM : Click to view the full PDF of IEC 60598-1:2020

Annex E (normative)

Determination of winding temperature rises by the increase-in-resistance method

NOTE Reference to ballasts also applies to similar components such as transformers.

Before commencing the test, arrangements are made whereby the ballast may be quickly connected by appropriate means of negligible resistance to a Wheatstone bridge, or other suitable measuring instrument, after the luminaire has been disconnected from the supply.

A chronometer with an easily-read second hand is essential.

The test procedure is as follows.

The luminaire remains unenergized for a period long enough to ensure that the complete luminaire, including the ballast windings, is thermally stable in a substantially constant ambient temperature (t_1), which shall not change by more than 3 °C during this period.

The resistance (R_1) of the cold ballast winding is measured and t_1 noted. The luminaire is operated until thermal stability has been achieved as indicated by a suitable temperature measuring device attached to the body of the ballast. The ambient air temperature (t_3) in the draught-proof enclosure is noted.

The luminaire is then disconnected from the supply, the time noted and the ballast connected immediately to the Wheatstone bridge. The resistance is measured as quickly as possible and the corresponding time noted.

Further resistance measurements, if necessary, are made at suitable intervals whilst the ballast is cooling, the times at which the measurements are made being recorded. These measurements enable a time/resistance curve to be plotted which is extrapolated back to the point corresponding to the instant of disconnection of the supply and the resistance R_2 of the hot winding is read.

Since the resistance of copper varies in direct proportion to the temperatures as measured from a reference point of –234,5 °C, the hot temperature t_2 may be calculated from the ratio of the hot resistance R_2 to the cold resistance R_1 by means of the equation:

$$\frac{R_2}{R_1} = \frac{t_2 + 234,5}{t_1 + 234,5}$$

The constant 234,5 relates to copper windings; for aluminium, this constant is 229. Hence, for windings of copper wire:

$$t_2 = \frac{R_2}{R_1} (t_1 + 234,5) - 234,5$$

The temperature rise is the difference between the calculated temperature t_2 and the ambient air temperature t_3 at the conclusion of the test, that is:

$$\text{temperature rise} = (t_2 - t_3) \text{ K}$$