

INTERNATIONAL STANDARD

NORME INTERNATIONALE



Industrial networks – Profiles –

**Part 2-6: Additional real-time fieldbus profiles based on ISO/IEC/IEEE 8802-3 –
CPF 6**

Réseaux industriels – Profils –

**Partie 2-6: Profils de bus de terrain supplémentaires pour les réseaux en temps
réel fondés sur l'ISO/IEC/IEEE 8802-3 – CPF 6**



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2023 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Secretariat
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

IEC Products & Services Portal - products.iec.ch

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 300 terminological entries in English and French, with equivalent terms in 19 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Recherche de publications IEC -

webstore.iec.ch/advsearchform

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études, ...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

IEC Just Published - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et une fois par mois par email.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: sales@iec.ch.

IEC Products & Services Portal - products.iec.ch

Découvrez notre puissant moteur de recherche et consultez gratuitement tous les aperçus des publications. Avec un abonnement, vous aurez toujours accès à un contenu à jour adapté à vos besoins.

Electropedia - www.electropedia.org

Le premier dictionnaire d'électrotechnologie en ligne au monde, avec plus de 22 300 articles terminologiques en anglais et en français, ainsi que les termes équivalents dans 19 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

INTERNATIONAL STANDARD

NORME INTERNATIONALE



Industrial networks – Profiles –

**Part 2-6: Additional real-time fieldbus profiles based on ISO/IEC/IEEE 8802-3 –
CPF 6**

Réseaux industriels – Profils –

**Partie 2-6: Profils de bus de terrain supplémentaires pour les réseaux en temps
réel fondés sur l'ISO/IEC/IEEE 8802-3 – CPF 6**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

ICS 35.100.20; 35.240.50

ISBN 978-2-8322-6694-6

Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.

CONTENTS

FOREWORD.....	3
INTRODUCTION.....	5
1 Scope.....	6
2 Normative references	6
3 Terms, definitions, abbreviated terms, acronyms, and conventions	7
3.1 Terms and definitions.....	7
3.2 Abbreviated terms and acronyms	8
3.3 Symbols.....	8
3.4 Conventions.....	8
4 CPF 6 (INTERBUS®) – RTE communication profiles	9
4.1 General overview	9
4.2 CP 6/4	10
4.2.1 Mapping	10
4.2.2 Type 10 service and protocol selection	11
4.2.3 Type 8 service and protocol selection	12
4.2.4 Performance indicator selection.....	12
4.3 CP 6/5	13
4.3.1 Mapping	13
4.3.2 Type 10 service and protocol selection.....	13
4.3.3 Type 8 service and protocol selection.....	14
4.3.4 Performance indicator selection.....	14
4.4 CP 6/6	14
4.4.1 Mapping	14
4.4.2 Type 10 service and protocol selection	14
4.4.3 Type 8 service and protocol selection	15
4.4.4 Performance indicator selection.....	15
Bibliography.....	16
Figure 1 – Linking-device communication profiles RTE-network context.....	9
Figure 2 – Linking-device mapping principle.....	10
Figure 3 – Data Mapping.....	11
Table 1 – CPF 6 symbols	8
Table 2 – CPF 6: device CP identifier assignment.....	10
Table 3 – Linking-device Type 10 network PI overview	12

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**INDUSTRIAL NETWORKS –
PROFILES –****Part 2-6: Additional real-time fieldbus profiles
based on ISO/IEC/IEEE 8802-3 –
CPF 6****FOREWORD**

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

Attention is drawn to the fact that the use of some of the associated protocol types is restricted by their intellectual-property-right holders. In all cases, the commitment to limited release of intellectual-property-rights made by the holders of those rights permits a layer protocol type to be used with other layer protocols of the same type, or in other type combinations explicitly authorized by their respective intellectual property right holders.

NOTE Combinations of protocol types are specified in the IEC 61784-1 series and the IEC 61784-2 series.

IEC 61784-2-6 has been prepared by subcommittee 65C: Industrial networks, of IEC technical committee 65: Industrial-process measurement, control and automation. It is an International Standard.

This first edition, together with the other parts of the same series, cancels and replaces the fourth edition of IEC 61784-2 published in 2019. This first edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to IEC 61784-2:2019:

- a) split of the original IEC 61784-2 into several subparts, one subpart for the material of a generic nature, and one subpart for each Communication Profile Family specified in the original document.

The text of this International Standard is based on the following documents:

Draft	Report on voting
65C/1209/FDIS	65C/1237/RVD

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this International Standard is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/publications.

A list of all parts of the IEC 61784-2 series, published under the general title *Industrial networks – Profiles – Part 2: Additional real-time fieldbus profiles based on ISO/IEC/IEEE 8802-3*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The "colour inside" logo on the cover page of this document indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INTRODUCTION

The IEC 61784-2 series provides additional Communication Profiles (CP) to the existing Communication Profile Families (CPF) of the IEC 61784-1 series and additional CPFs with one or more CPs. These profiles meet the industrial automation market objective of identifying Real-Time Ethernet (RTE) communication networks coexisting with ISO/IEC/IEEE 8802-3 – commonly known as Ethernet. These RTE communication networks use provisions of ISO/IEC/IEEE 8802-3 for the lower communication stack layers and additionally provide more predictable and reliable real-time data transfer and means for support of precise synchronization of automation equipment.

More specifically, these profiles help to correctly state the compliance of RTE communication networks with ISO/IEC/IEEE 8802-3, and to avoid the spreading of divergent implementations.

Adoption of Ethernet technology for industrial communication between controllers and even for communication with field devices promotes the use of Internet technologies in the field area. This availability would be unacceptable if it causes the loss of features required in the field area for industrial communication automation networks, such as:

- real-time,
- synchronized actions between field devices like drives,
- efficient, frequent exchange of very small data records.

These new RTE profiles can take advantage of the improvements of Ethernet networks in terms of transmission bandwidth and network span.

Another implicit but essential requirement is that the typical Ethernet communication capabilities, as used in the office world, are fully retained, so that the software involved remains applicable.

The market is in need of several network solutions, each with different performance characteristics and functional capabilities, matching the diverse application requirements. RTE performance indicators, whose values will be provided with RTE devices based on communication profiles specified in the IEC 61784-2 series, enable the user to match network devices with application-dependent performance requirements of an RTE network.

INDUSTRIAL NETWORKS – PROFILES –

Part 2-6: Additional real-time fieldbus profiles based on ISO/IEC/IEEE 8802-3 – CPF 6

1 Scope

This part of IEC 61784-2 defines extensions of Communication Profile Family 6 (CPF 6) for Real-Time Ethernet (RTE). CPF 6 specifies a set of Real-Time Ethernet (RTE) communication profiles (CPs) and related network components based on the IEC 61158 series (Type 8 and Type 10), ISO/IEC/IEEE 8802-3 and other standards.

For each RTE communication profile, this document also specifies the relevant RTE performance indicators and the dependencies between these RTE performance indicators.

NOTE 1 All CPs are based on standards or draft standards or International Standards published by the IEC or on standards or International Standards established by other standards bodies or open standards processes.

NOTE 2 The RTE communication profiles use ISO/IEC/IEEE 8802-3 communication networks and its related network components and in some cases amend those standards to obtain RTE features.

NOTE 3 Some CPs of CPF 6 are specified in IEC 61784-1-6.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

NOTE All parts of the IEC 61158 series, as well as the IEC 61784-1 series and the IEC 61784-2 series, are maintained simultaneously. Cross-references to these documents within the text therefore refer to the editions as dated in this list of normative references.

IEC 61158 (all parts), *Industrial communication networks – Fieldbus specifications*

IEC 61158-2:2023, *Industrial communication networks – Fieldbus specifications – Part 2: Physical layer specification and service definition*

IEC 61784-1-6:2023, *Industrial networks – Profiles – Part 1-6: Fieldbus profiles – Communication Profile Family 6*

IEC 61784-2-0:2023, *Industrial networks – Profiles – Part 2-0: Additional real-time fieldbus profiles based on ISO/IEC/IEEE 8802-3 – General concepts and terminology*

IEC 61784-2-3:2023, *Industrial networks – Profiles – Part 2-3: Additional real-time fieldbus profiles based on ISO/IEC/IEEE 8802-3 – CPF 3*

IEC 61784-5-3, *Industrial communication networks – Profiles – Part 5-3: Installation of fieldbuses – Installation profiles for CPF 3*

IEC 61784-5-6, *Industrial communication networks – Profiles – Part 5-6: Installation of fieldbuses – Installation profiles for CPF 6*

ISO/IEC/IEEE 8802-3, *Telecommunications and exchange between information technology systems – Requirements for local and metropolitan area networks – Part 3: Standard for Ethernet*

IEEE Std 802-2014, *IEEE Standard for Local and Metropolitan Area Networks: Overview and Architecture*

IEEE Std 802.1AB-2016, *IEEE Standard for Local and metropolitan area networks – Station and Media Access Control Connectivity Discovery*

IEEE Std 802.1AS-2020, *IEEE Standard for Local and Metropolitan Area Networks – Timing and Synchronization for Time-Sensitive Applications*

IEEE Std 802.1Q-2018, *IEEE Standard for Local and Metropolitan Area Networks – Bridges and Bridged Networks*

IETF RFC 768, J. Postel, *User Datagram Protocol*, August 1980, available at <https://www.rfc-editor.org/info/rfc768> [viewed 2022-02-18]

IETF RFC 791, J. Postel, *Internet Protocol*, September 1981, available at <https://www.rfc-editor.org/info/rfc791> [viewed 2022-02-18]

IETF RFC 792, J. Postel, *Internet Control Message Protocol*, September 1981, available at <https://www.rfc-editor.org/info/rfc792> [viewed 2022-02-18]

IETF RFC 793, J. Postel, *Transmission Control Protocol*, September 1981, available at <https://www.rfc-editor.org/info/rfc793> [viewed 2022-02-18]

IETF RFC 1157, J.D. Case, M. Fedor, M.L. Schoffstall, J. Davin, *Simple Network Management Protocol (SNMP)*, May 1990, available at <https://www.rfc-editor.org/info/rfc1157> [viewed 2022-02-18]

IETF RFC 1213, K. McCloghrie, M. Rose, *Management Information Base for Network Management of TCP/IP-based internets: MIB-II*, March 1991, available at <https://www.rfc-editor.org/info/rfc1213> [viewed 2022-02-18]

3 Terms, definitions, abbreviated terms, acronyms, and conventions

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 61784-2-0, ISO/IEC/IEEE 8802-3, IEEE Std 802-2014, IEEE Std 802.1AB-2016, IEEE Std 802.1AS-2020 and IEEE Std 802.1Q-2018 apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <https://www.electropedia.org/>
- ISO Online browsing platform: available at <https://www.iso.org/obp>

3.2 Abbreviated terms and acronyms

For the purposes of this document, abbreviated terms and acronyms defined in IEC 61784-2-0 and the following apply.

CP	Communication Profile [according to IEC 61784-1-0]
CPF	Communication Profile Family [according to IEC 61784-1-0]
ICMP	Internet Control Message Protocol (see IETF RFC 792)
IETF	Internet Engineering Task Force
IP	Internet Protocol (see IETF RFC 791)
LLDP	Link Layer Discovery Protocol (see IEEE Std 802.1AB-2016)
MIB	Management Information base
PI	Performance indicator
RSTP	Rapid Spanning Tree Algorithm and Protocol (see IEEE Std 802.1Q-2018)
SNMP	Simple Network Management Protocol (see IETF RFC 1157)
TCP	Transmission Control Protocol (see IETF RFC 793)
UDP	User Datagram Protocol (see IETF RFC 768)

3.3 Symbols

For the purposes of this document, symbols defined in IEC 61784-2-0 and Table 1 apply.

NOTE Definitions of symbols in this Subclause 3.3 do not always use the italic font, as they are already identified as symbols.

Table 1 – CPF 6 symbols

Symbol	Definition	Unit
<i>DTLD</i>	Total delivery time between a Type 8 slave and a Type 10 entity	µs
<i>DT10</i>	Delivery time of the Type 10 network	µs
<i>Cta_M</i>	Application cycle time of the mapping application in the linking-device	
<i>M</i>	Type 8 Master implementation factor	–
<i>n</i>	Number of data octets (user data; payload)	octets
<i>s/8</i>	Number of Type 8 slaves connected to the linking-device	–
<i>T_{bit}</i>	Nominal bit duration (see IEC 61158-2, 27.2)	µs
<i>t_s</i>	Software processing time of the Type 8 master (application specific)	µs

3.4 Conventions

For the purposes of this document, the conventions defined in IEC 61784-2-0 apply.

4 CPF 6 (INTERBUS®¹) – RTE communication profiles

4.1 General overview

Communication Profile Family 6 (CPF 6) defines communication profiles based on IEC 61158 series Type 8 and Type 10 specifications, which correspond to parts of the communication systems commonly known as INTERBUS and PROFINET.

In this document, the following communication profiles are specified for CPF 6:

– Profile 6/4

This profile defines service and protocol selections together with a mapping for a linking-device connecting Type 8 and Type 10 communication systems. It comprises CP 6/1 master and CP 3/4 device together with a mapping.


– Profile 6/5

This profile defines service and protocol selections together with a mapping for a linking-device connecting Type 8 and Type 10 communication systems. It comprises CP 6/1 master and CP 3/5 device together with a mapping.

– Profile 6/6

This profile defines service and protocol selections together with a mapping for a linking-device connecting Type 8 and Type 10 communication systems. It comprises CP 6/1 master and CP 3/6 device together with a mapping.

Figure 1 shows the linking-device CPs and the relation to other Type 8 and Type 10 CPs.

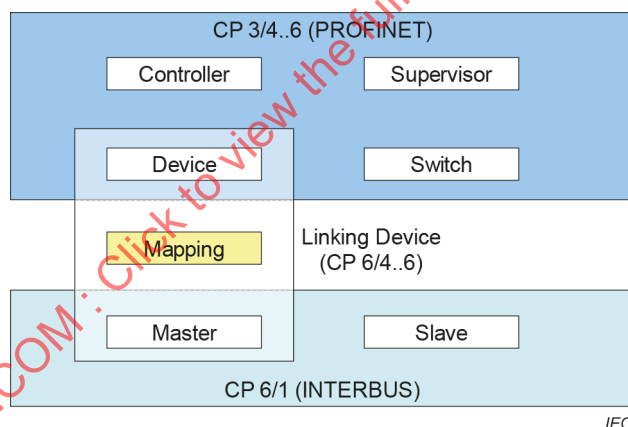

IEC

Figure 1 – Linking-device communication profiles RTE-network context

Linking-devices which comply with a communication profile can be further classified by a CP identifier. The CP identifier assignment is shown in Table 2.

¹ INTERBUS is the trade name of Phoenix Contact GmbH & Co. KG. This information is given for the convenience of users of this document and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance with this profile does not require use of the trade name INTERBUS. Use of the trade name INTERBUS requires permission of the trade name holder.

Table 2 – CPF 6: device CP identifier assignment

Profile	Linking device
Profile 6/4	649
Profile 6/5	659
Profile 6/6	669

Each communication profile provides a well-defined set of provisions. For a distinct device, further selections of services, parameters and parameter values shall be made. These selections should be described according to ISO 15745-3 as INTERBUS device profiles in the form of an INTERBUS device profile exchange description. An INTERBUS device profile based on a CP shall specify the CP identifier in the following format:

<communicationEntity ... communicationProfile="[CP identifier]" ...>

4.2 CP 6/4

4.2.1 Mapping

Type 8 devices shall be assigned to Type 10 slots or Type 10 subslots.

NOTE 1 The mapping concept itself is not part of the communication profile. The mapping concept used could be described in the device description of the linking-device according to ISO 15745-1.

Type 10 slots or subslots could have 1 or more Type 8 devices assigned to it.

Figure 2 depicts the mapping principle. The data mapping is shown in Figure 3.

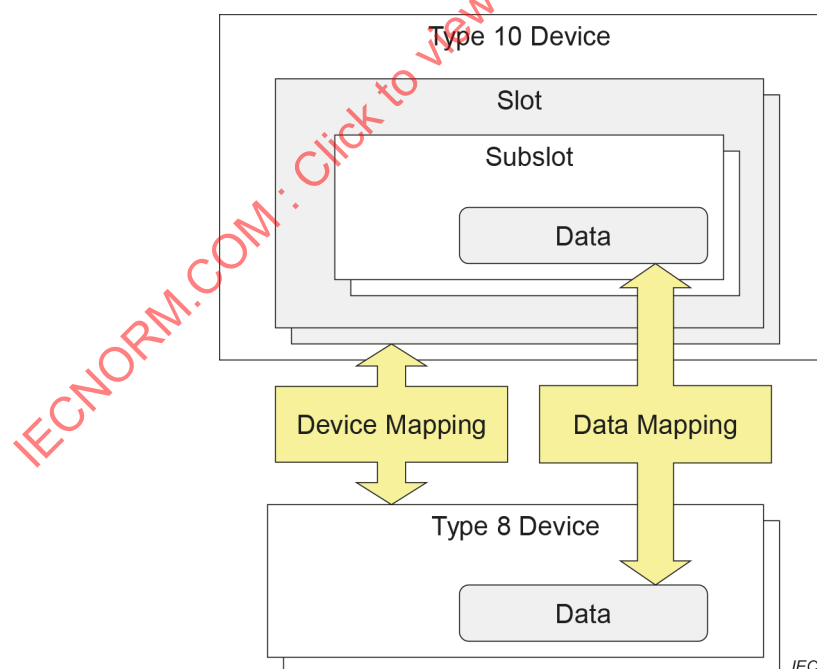


Figure 2 – Linking-device mapping principle

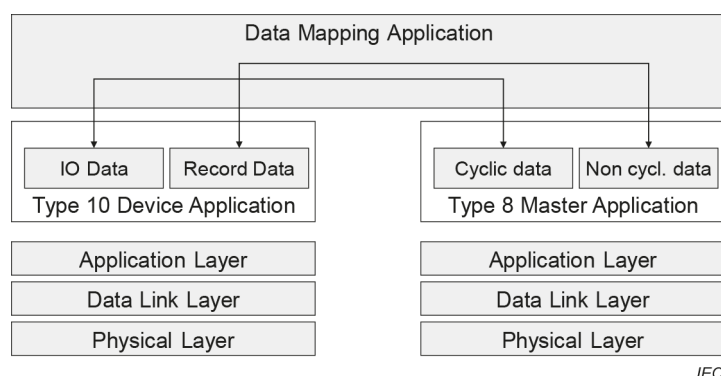


Figure 3 – Data Mapping

The specific applications realize the services of types 8 and 10 according to the defined communication profiles. The data objects of the network applications are interconnected with a mapping application which shall implement the following behavior:

- the Input/Output data of the subslot shall be mapped to the cyclic data of the corresponding Type 8 slaves;
- the process data status information (IOPS/IOCS) of the subslot shall be locally generated because there is no corresponding process data status in Type 8 Systems;
- the record data objects of the subslot shall be mapped to the non cyclic data of the corresponding Type 8 slaves.

NOTE 2 It is possible to describe the Input/Output data and the record data of a subslot in the device description of the linking-device according to ISO 15745-1.

4.2.2 Type 10 service and protocol selection

4.2.2.1 Physical layer

The Type 10 physical layer of this profile shall be according to ISO/IEC/IEEE 8802-3. Linking-devices shall use a data rate of at least 100 Mbit/s and full-duplex mode at least for one port. The auto negotiation and crossover function specified in ISO/IEC/IEEE 8802-3 shall be used.

Recommended connectors, cables and installation guidelines are specified in IEC 61784-5-3.

4.2.2.2 Data-link layer

The Type 10 data-link layer of a linking-device shall be according to ISO/IEC/IEEE 8802-3, IEEE Std 802.1AB-2016 and IEEE Std 802.1Q-2018.

From the various optional Management Information Bases (MIB) at least the LLDP MIB (see IEEE Std 802.1AB-2016) and SNMP MIB-II (see IETF RFC 1213) are required.

4.2.2.3 Application layer

4.2.2.3.1 AL service selection

The linking-device shall provide the CP 3/4 AL service selection as specified in IEC 61784-2-3 for an IO device.

4.2.2.3.2 AL protocol selection

The linking-device shall provide the CP 3/4 AL protocol selection as specified in IEC 61784-2-3 for an IO device.

4.2.3 Type 8 service and protocol selection

4.2.3.1 Physical layer

The linking-device shall provide the CP 6/1 master PhL service and protocol selection as specified for CP identifier 619 in IEC 61784-1-6, Clause 4.

Recommended connectors, cables and installation guidelines are specified in IEC 61784-5-6.

4.2.3.2 Data-link layer

The linking-device shall provide the CP 6/1 master DLL service and protocol selection as specified for CP identifier 619 in IEC 61784-1-6, Clause 4.

4.2.3.3 Application layer

The linking-device shall provide the CP 6/1 master AL service and protocol selection as specified for CP identifier 619 in IEC 61784-1-6, Clause 4.

4.2.4 Performance indicator selection

4.2.4.1 Performance indicator overview

Table 3 specifies the relevant performance indicators for the Type 10 network node of a linking-device.

Table 3 – Linking-device Type 10 network PI overview

Performance indicator	Applicable	Constraints
Delivery time	YES	See 4.2.4.2.2 for the delivery time of data from the Type 8 network
Number of end-stations	YES	–
Basic network topology	YES	–
Number of switches between end-stations	YES	–
Throughput RTE	YES	–
Non-RTE bandwidth	YES	–
Time synchronization accuracy	YES	–
Non-time-based synchronization accuracy	–	–
Redundancy recovery time	YES	For the Type 10 network only

4.2.4.2 Performance indicator dependencies

4.2.4.2.1 Performance indicator dependency matrix

The dependencies of the performance indicators of the Type 10 network of a linking device are as specified in IEC 61784-2-3 for CP 3/4.

4.2.4.2.2 Delivery time for Type 8 slave data

The performance indicator delivery time for the Type 10 network (DT10) is defined as in IEC 61784-2-3 for CP 3/4.

The delivery time for data from a Type 8 slave can be calculated by Formula (1).

$$DTLD = DT10 + cta_M + [M \times 13 \times (8 + s/8) + 3 \times a] \times T_{\text{bit}} + t_s \quad (1)$$

where

<i>DTLD</i>	is the total delivery time between a Type 8 slave and a Type 10 entity;
<i>DT10</i>	is the delivery time of the Type 10 network;
<i>cta_M</i>	is the application cycle time of the mapping application in the linking-device;
<i>M</i>	is the Type 8 Master implementation factor;
<i>n</i>	is the number of data octets (user data; payload);
<i>s/8</i>	is the number of Type 8 slaves connected to the linking-device;
<i>T_{bit}</i>	is the nominal bit duration (see IEC 61158-2, 27.2);
<i>t_s</i>	is the software processing time of the Type 8 master (application specific).

4.2.4.3 Consistent set of performance indicators

The consistent set of performance indicators for the Type 10 network is described in IEC 61784-2-3 for CP 3/4.

4.3 CP 6/5

4.3.1 Mapping

The mapping is specified in 4.2.1.

4.3.2 Type 10 service and protocol selection

4.3.2.1 Physical layer

The Type 10 physical layer of this profile shall be according to ISO/IEC/IEEE 8802-3. Linking-devices shall use a data rate of at least 100 Mbit/s and full-duplex mode at least for one port. The auto negotiation and crossover function specified in ISO/IEC/IEEE 8802-3 shall be used.

Recommended connectors, cables and installation guidelines are specified in IEC 61784-5-3.

4.3.2.2 Data-link layer

The Type 10 data-link layer of a linking-device shall be according to ISO/IEC/IEEE 8802-3, IEEE Std 802.1AB-2016, and IEEE Std 802.1Q-2018.

From the various optional Management Information Bases (MIB) at least the LLDP MIB (see IEEE Std 802.1AB-2016) and SNMP MIB-II (see IETF RFC 1213) are required.

4.3.2.3 Application layer

4.3.2.4 AL service selection

The linking-device shall provide the CP 3/5 AL service selection as specified in IEC 61784-2-3 for an IO device.

4.3.2.5 AL protocol selection

The linking-device shall provide the CP 3/5 AL protocol selection as specified in IEC 61784-2-3 for an IO device.

4.3.3 Type 8 service and protocol selection

4.3.3.1 Physical layer

The linking-device shall provide the CP 6/1 master PhL service and protocol selection as specified for CP identifier 619 in IEC 61784-1-6, Clause 4.

Recommended connectors, cables and installation guidelines are specified in IEC 61784-5-6.

4.3.3.2 Data-link layer

The linking-device shall provide the CP 6/1 master DLL service and protocol selection as specified for CP identifier 619 in IEC 61784-1-6, Clause 4.

4.3.3.3 Application layer

The linking-device shall provide the CP 6/1 master AL service and protocol selection as specified for CP identifier 619 in IEC 61784-1-6, Clause 4.

4.3.4 Performance indicator selection

4.3.4.1 Performance indicator overview

See 4.2.4.1.

4.3.4.2 Performance indicator dependencies

See 4.2.4.2.

4.3.4.3 Consistent set of performance indicators

The consistent set of performance indicators for the Type 10 network is described in IEC 61784-2-3 for CP 3/5.

4.4 CP 6/6

4.4.1 Mapping

The mapping is specified in 4.2.1.

4.4.2 Type 10 service and protocol selection

4.4.2.1 Physical Layer

The Type 10 physical layer of this profile shall be according to ISO/IEC/IEEE 8802-3. Linking-devices shall use a data rate of at least 100 Mbit/s and full-duplex mode at least for one port. The auto negotiation and crossover function specified in ISO/IEC/IEEE 8802-3 shall be used.

Recommended connectors, cables and installation guidelines are specified in IEC 61784-5-3.

4.4.2.2 Data-link layer

The Type 10 DLL of a linking-device shall be according to ISO/IEC/IEEE 8802-3, IEEE Std 802.1AB-2016 and IEEE Std 802.1Q-2018.

From the various optional Management Information Bases (MIB) at least the LLDP MIB (see IEEE Std 802.1AB-2016) and SNMP MIB-II (see IETF RFC 1213) are required.

4.4.2.3 Application layer

4.4.2.3.1 AL service selection

The linking-device shall provide the CP 3/6 AL service selection as specified in IEC 61784-2-3 for an IO device.

4.4.2.3.2 AL protocol selection

The linking-device shall provide the CP 3/6 AL service selection as specified in IEC 61784-2-3 for an IO device.

4.4.3 Type 8 service and protocol selection

The Type 8 service and protocol selection is specified in 4.3.3.

4.4.4 Performance indicator selection

4.4.4.1 Performance indicator overview

See 4.2.4.1.

4.4.4.2 Performance indicator dependencies

See 4.2.4.2.

4.4.4.3 Consistent set of performance indicators

The consistent set of performance indicators for the Type 10 network is described in IEC 61784-2-3 for CP 3/6.

IECNORM.COM : Click to view the full PDF of IEC 61784-2-6:2023

Bibliography

IEC 61158-1, *Industrial communication networks – Fieldbus specifications – Part 1: Overview and guidance for the IEC 61158 and IEC 61784 series*

IEC 61158-3-8, *Industrial communication networks – Fieldbus specifications – Part 3-8: Data-link layer service definition – Type 8 elements*

IEC 61158-4-8, *Industrial communication networks – Fieldbus specifications – Part 4-8: Data-link layer protocol specification – Type 8 elements*

IEC 61158-5-8, *Industrial communication networks – Fieldbus specifications – Part 5-8: Application layer service definition – Type 8 elements*

IEC 61158-5-10, *Industrial communication networks – Fieldbus specifications – Part 5-10: Application layer service definition – Type 10 elements*

IEC 61158-6-8, *Industrial communication networks – Fieldbus specifications – Part 6-8: Application layer protocol specification – Type 8 elements*

IEC 61158-6-10, *Industrial communication networks – Fieldbus specifications – Part 6-10: Application layer protocol specification – Type 10 elements*

IEC 61784-1 (all parts), *Industrial networks – Profiles – Part 1: Fieldbus profiles*

IEC 61784-1-0, *Industrial networks – Profiles – Part 1-0: Fieldbus profiles – General concepts and terminology*

IEC 61784-2 (all parts), *Industrial networks – Profiles – Part 2: Additional real-time fieldbus profiles based on ISO/IEC/IEEE 8802-3*

IEC 61918, *Industrial communication networks – Installation of communication networks in industrial premises*

ISO/IEC 7498-1, *Information technology – Open Systems Interconnection – Basic Reference Model. The Basic Model*

ISO/IEC 9646 (all parts), *Information technology – Open Systems Interconnection – Conformance testing methodology and framework*

ISO/IEC TR 10000-1:1998, *Information technology – Framework and taxonomy of International Standardized Profiles – Part 1: General principles and documentation framework*

ISO/IEC 11801-1:2017, *Information technology – Generic cabling for customer premises – Part 1: General requirements*

ISO 15745-1, *Industrial automation systems and integration – Open systems application integration framework – Part 1: Generic reference description*

ISO 15745-3, *Industrial automation systems and integration – Open systems application integration framework – Part 3: Reference description for IEC 61158-based control systems*

IECNORM.COM : Click to view the full PDF of IEC 61784-2-6:2023

SOMMAIRE

AVANT-PROPOS	19
INTRODUCTION.....	21
1 Domaine d'application	22
2 Références normatives	22
3 Termes, définitions, abréviations, acronymes et conventions	23
3.1 Termes et définitions	23
3.2 Abréviations et acronymes	24
3.3 Symboles	24
3.4 Conventions.....	24
4 CPF 6 (INTERBUS®) – Profils de communication RTE	25
4.1 Présentation générale	25
4.2 CP 6/4	26
4.2.1 Mapping	26
4.2.2 Sélection des services de type 10 et du protocole	27
4.2.3 Sélection des services de type 8 et du protocole	28
4.2.4 Sélection des indicateurs de performance.....	28
4.3 CP 6/5	29
4.3.1 Mapping	29
4.3.2 Sélection des services de type 10 et du protocole	29
4.3.3 Sélection des services de type 8 et du protocole	30
4.3.4 Sélection des indicateurs de performance.....	30
4.4 CP 6/6	31
4.4.1 Mapping	31
4.4.2 Sélection des services de type 10 et du protocole	31
4.4.3 Sélection des services de type 8 et du protocole	31
4.4.4 Sélection des indicateurs de performance.....	31
Bibliographie.....	32
Figure 1 – Contexte de réseau RTE des profils de communication d'appareils de liaison	25
Figure 2 – Principe de mapping de l'appareil de liaison.....	26
Figure 3 – Mapping des données	27
Tableau 1 – Symboles applicables à la CPF 6	24
Tableau 2 – CPF 6: attribution d'identifiants CP d'appareils	26
Tableau 3 – Vue d'ensemble des indicateurs de performance de réseau de type 10 de l'appareil de liaison	28

COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

RÉSEAUX INDUSTRIELS –
PROFILS –Partie 2-6: Profils de bus de terrain supplémentaires pour les réseaux
en temps réel fondés sur l'ISO/IEC/IEEE 8802-3 –
CPF 6

AVANT-PROPOS

- 1) La Commission Électrotechnique Internationale (IEC) est une organisation mondiale de normalisation composée de l'ensemble des comités électrotechniques nationaux (Comités nationaux de l'IEC). L'IEC a pour objet de favoriser la coopération internationale pour toutes les questions de normalisation dans les domaines de l'électricité et de l'électronique. A cet effet, l'IEC – entre autres activités – publie des Normes internationales, des Spécifications techniques, des Rapports techniques, des Spécifications accessibles au public (PAS) et des Guides (ci-après dénommés "Publication(s) de l'IEC"). Leur élaboration est confiée à des comités d'études, aux travaux desquels tout Comité national intéressé par le sujet traité peut participer. Les organisations internationales, gouvernementales et non gouvernementales, en liaison avec l'IEC, participent également aux travaux. L'IEC collabore étroitement avec l'Organisation Internationale de Normalisation (ISO), selon des conditions fixées par accord entre les deux organisations.
- 2) Les décisions ou accords officiels de l'IEC concernant les questions techniques représentent, dans la mesure du possible, un accord international sur les sujets étudiés, étant donné que les Comités nationaux de l'IEC intéressés sont représentés dans chaque comité d'études.
- 3) Les Publications de l'IEC se présentent sous la forme de recommandations internationales et sont agréées comme telles par les Comités nationaux de l'IEC. Tous les efforts raisonnables sont entrepris afin que l'IEC s'assure de l'exactitude du contenu technique de ses Publications; l'IEC ne peut pas être tenue responsable de l'éventuelle mauvaise utilisation ou interprétation qui en est faite par un quelconque utilisateur final.
- 4) Dans le but d'encourager l'uniformité internationale, les Comités nationaux de l'IEC s'engagent, dans toute la mesure possible, à appliquer de façon transparente les Publications de l'IEC dans leurs publications nationales et régionales. Toutes divergences entre toutes Publications de l'IEC et toutes publications nationales ou régionales correspondantes doivent être indiquées en termes clairs dans ces dernières.
- 5) L'IEC elle-même ne fournit aucune attestation de conformité. Des organismes de certification indépendants fournissent des services d'évaluation de conformité et, dans certains secteurs, accèdent aux marques de conformité de l'IEC. L'IEC n'est responsable d'aucun des services effectués par les organismes de certification indépendants.
- 6) Tous les utilisateurs doivent s'assurer qu'ils sont en possession de la dernière édition de cette publication.
- 7) Aucune responsabilité ne doit être imputée à l'IEC, à ses administrateurs, employés, auxiliaires ou mandataires, y compris ses experts particuliers et les membres de ses comités d'études et des Comités nationaux de l'IEC, pour tout préjudice causé en cas de dommages corporels et matériels, ou de tout autre dommage de quelque nature que ce soit, directe ou indirecte, ou pour supporter les coûts (y compris les frais de justice) et les dépenses découlant de la publication ou de l'utilisation de cette Publication de l'IEC ou de toute autre Publication de l'IEC, ou au crédit qui lui est accordé.
- 8) L'attention est attirée sur les références normatives citées dans cette publication. L'utilisation de publications référencées est obligatoire pour une application correcte de la présente publication.
- 9) L'attention est attirée sur le fait que certains des éléments de la présente Publication de l'IEC peuvent faire l'objet de droits de brevet. L'IEC ne saurait être tenue pour responsable de ne pas avoir identifié de tels droits de propriété et averti de leur existence.

L'attention est attirée sur le fait que l'utilisation de certains des types de protocoles associés est restreinte par les détenteurs des droits de propriété intellectuelle. En tout état de cause, l'engagement de renonciation partielle aux droits de propriété intellectuelle pris par les détenteurs de ces droits autorise l'utilisation d'un type de protocole de couche avec les autres protocoles de couche du même type, ou dans des combinaisons avec d'autres types autorisés explicitement par les détenteurs respectifs des droits de propriété intellectuelle pour ces types.

NOTE Les combinaisons de types de protocoles sont spécifiées dans la série IEC 61784-1 et la série IEC 61784-2.

L'IEC 61784-2-6 a été établie par le sous-comité 65C: Réseaux industriels, du comité d'études 65 de l'IEC: Mesure, commande et automation dans les processus industriels. Il s'agit d'une Norme internationale.

Cette première édition, conjointement avec les autres parties de la même série, annule et remplace la quatrième édition de l'IEC 61784-2 parue en 2019. Cette première édition constitue une révision technique.

Cette édition inclut les modifications techniques majeures suivantes par rapport à l'IEC 61784-2:2019:

- a) scission de l'IEC 61784-2 d'origine en plusieurs sous-parties, une sous-partie pour le matériel de nature générique et une sous-partie pour chaque famille de profils de communication spécifiée dans le document d'origine.

Le texte de cette Norme internationale est issu des documents suivants:

Projet	Rapport de vote
65C/1209/FDIS	65C/1237/RVD

Le rapport de vote indiqué dans le tableau ci-dessus donne toute information sur le vote ayant abouti à son approbation.

La version française de cette norme n'a pas été soumise au vote.

La langue employée pour l'élaboration de cette Norme internationale est l'anglais.

Le présent document a été rédigé selon les Directives ISO/IEC, Partie 2, il a été développé selon les Directives ISO/IEC, Partie 1 et les Directives ISO/IEC, Supplément IEC, disponibles sous www.iec.ch/members_experts/refdocs. Les principaux types de documents développés par l'IEC sont décrits plus en détail sous www.iec.ch/standardsdev/publications.

Une liste de toutes les parties de la série IEC 61784-2, publiées sous le titre général *Réseaux industriels – Profils – Partie 2: Profils de bus de terrain supplémentaires pour les réseaux en temps réel fondés sur l'ISO/IEC/IEEE 8802-3*, se trouve sur le site web de l'IEC.

Le comité a décidé que le contenu de ce document ne sera pas modifié avant la date de stabilité indiquée sur le site web de l'IEC sous webstore.iec.ch dans les données relatives au document recherché. A cette date, le document sera

- reconduit,
- supprimé,
- remplacé par une édition révisée, ou
- amendé.

IMPORTANT – Le logo "colour inside" qui se trouve sur la page de couverture de ce document indique qu'elle contient des couleurs qui sont considérées comme utiles à une bonne compréhension de son contenu. Les utilisateurs devraient, par conséquent, imprimer cette publication en utilisant une imprimante couleur.

INTRODUCTION

La série IEC 61784-2 fournit des profils de communication (CP) supplémentaires aux familles de profils de communication (CPF) existantes de la série IEC 61784-1 et des CPF supplémentaires à un ou plusieurs CP. Ces profils répondent aux objectifs du marché d'automatisation industrielle visant à identifier les réseaux de communication Ethernet en temps réel (RTE) coexistant avec l'ISO/IEC/IEEE 8802-3 – communément appelée la norme pour Ethernet. Ces réseaux de communication RTE s'appuient sur les dispositions de l'ISO/IEC/IEEE 8802-3 relatives aux couches inférieures de la pile de communication et assurent en outre un transfert de données en temps réel plus prévisible et fiable, et une prise en charge d'une synchronisation précise de l'équipement d'automatisation.

De manière plus spécifique, ces profils permettent d'assurer la conformité des réseaux de communication RTE à l'ISO/IEC/IEEE 8802-3 et d'éviter la propagation de mises en œuvre divergentes.

L'adoption de la technologie Ethernet pour la communication industrielle entre les contrôleurs, et même pour la communication avec les appareils de terrain, favorise l'utilisation des technologies Internet dans la zone de terrain. Cette disponibilité pourrait s'avérer inacceptable si elle était à l'origine de la perte de certaines fonctionnalités exigées dans la zone de terrain des réseaux d'automatisation des communications industrielles, telles que:

- le fonctionnement en temps réel;
- les actions synchronisées entre les appareils de terrain, tels que les unités d'entraînement;
- l'échange efficace et fréquent d'enregistrements de données de très faible volume.

Ces nouveaux profils RTE peuvent présenter l'avantage d'améliorer les réseaux Ethernet en matière de largeur de bande de transmission et de portée de réseau.

Une autre exigence implicite, mais néanmoins essentielle, porte sur le fait que la totalité des capacités de communication Ethernet classiques (telles qu'elles sont utilisées dans le monde professionnel) est conservée, ce qui permet de continuer à utiliser le logiciel concerné.

Le marché a besoin de plusieurs solutions réseau, présentant chacune des caractéristiques de performance et des capacités fonctionnelles différentes qui correspondent aux différentes exigences d'application. Les indicateurs de performance RTE, dont les valeurs sont fournies avec les appareils RTE en fonction des profils de communication spécifiés dans la série IEC 61784-2, permettent à l'utilisateur de mettre en correspondance les appareils du réseau avec les exigences de performance dépendantes de l'application d'un réseau RTE.

RÉSEAUX INDUSTRIELS – PROFILS –

Partie 2-6: Profils de bus de terrain supplémentaires pour les réseaux en temps réel fondés sur l'ISO/IEC/IEEE 8802-3 – CPF 6

1 Domaine d'application

La présente partie de l'IEC 61784-2 définit les extensions de la famille de profils de communication 6 (CPF 6) pour l'Ethernet en temps réel (RTE). La CPF 6 spécifie un ensemble de profils de communication (CP) Ethernet en temps réel (RTE, Real-Time Ethernet) et de composants de réseau associés basés sur la série IEC 61158 (type 8 et type 10), l'ISO/IEC/IEEE 8802-3 et d'autres normes.

Pour chaque profil de communication RTE, le présent document spécifie également les indicateurs de performance RTE correspondants et les dépendances entre ces indicateurs de performance RTE.

NOTE 1 Tous les CP sont fondés sur des normes ou projets de normes, ou des Normes internationales, publiés par l'IEC, ou bien sur des normes ou des Normes internationales établies par d'autres organismes de normalisation ou des processus de normalisation ouverts.

NOTE 2 Les profils de communication RTE utilisent les réseaux de communication ISO/IEC/IEEE 8802-3 et leurs composants de réseau connexes et amendent dans certains cas ces normes, pour obtenir les fonctions RTE.

NOTE 3 Certains CP de la CPF 6 sont spécifiés dans l'IEC 61784-1-6.

2 Références normatives

Les documents suivants sont cités dans le texte de sorte qu'ils constituent, pour tout ou partie de leur contenu, des exigences du présent document. Pour les références datées, seule l'édition citée s'applique. Pour les références non datées, la dernière édition du document de référence s'applique (y compris les éventuels amendements).

NOTE Toutes les parties de la série IEC 61158, ainsi que la série IEC 61784-1 et la série IEC 61784-2, font l'objet d'une maintenance simultanée. Les références croisées à ces documents dans le texte se rapportent par conséquent aux éditions datées dans la présente liste de références normatives.

IEC 61158 (toutes les parties), *Réseaux de communication industriels - Spécifications des bus de terrain*

IEC 61158-2:2023, *Réseaux de communication industriels – Spécifications des bus de terrain – Partie 2: Spécification et définition des services de la couche physique*

IEC 61784-1-6:2023, *Réseaux industriels – Profils – Partie 1-6: Profils de bus de terrain - Famille de profils de communication 6*

IEC 61784-2-0:2023, *Réseaux industriels – Profils – Partie 2-0: Profils de bus de terrain supplémentaires pour les réseaux en temps réel fondés sur l'ISO/IEC/IEEE 8802-3 – Concepts généraux et terminologie*

IEC 61784-2-3:2023, *Réseaux industriels – Profils – Partie 2-3: Profils de bus de terrain supplémentaires pour les réseaux en temps réel fondés sur l'ISO/IEC/IEEE 8802-3 – CPF 3*

IEC 61784-5-3, *Réseaux de communication industriels – Profils – Partie 5-3: Installation des bus de terrain – Profils d'installation pour CPF 3*

IEC 61784-5-6, *Réseaux de communication industriels – Profils – Partie 5-6: Installation des bus de terrain – Profils d'installation pour CPF 6*

ISO/IEC/IEEE 8802-3, *Télécommunications et échange entre systèmes informatiques – Exigences pour les réseaux locaux et métropolitains – Partie 3: Norme pour Ethernet*

IEEE Std 802-2014, *IEEE Standard for Local and Metropolitan Area Networks: Overview and Architecture* (disponible en anglais seulement)

IEEE Std 802.1AB-2016, *IEEE Standard for Local and metropolitan area networks – Station and Media Access Control Connectivity Discovery* (disponible en anglais seulement)

IEEE Std 802.1AS-2020, *IEEE Standard for Local and Metropolitan Area Networks – Timing and Synchronization for Time-Sensitive Applications* (disponible en anglais seulement)

IEEE Std 802.1Q-2018, *IEEE Standard for Local and Metropolitan Area Networks – Bridges and Bridged Networks* (disponible en anglais seulement)

IETF RFC 768, J. Postel, *User Datagram Protocol*, août 1980, disponible à l'adresse <https://www.rfc-editor.org/info/rfc768> [consulté le 18/02/2022]

IETF RFC 791, J. Postel, *Internet Protocol*, septembre 1981, disponible à l'adresse <https://www.rfc-editor.org/info/rfc791> [consulté le 18/02/2022]

IETF RFC 792, J. Postel, *Internet Control Message Protocol*, septembre 1981, disponible à l'adresse <https://www.rfc-editor.org/info/rfc792> [consulté le 18/02/2022]

IETF RFC 793, J. Postel, *Transmission Control Protocol*, septembre 1981, disponible à l'adresse <https://www.rfc-editor.org/info/rfc793> [consulté le 18/02/2022]

IETF RFC 1157, J.D. Case, M. Fedor, M.L. Schoffstall, J. Davin, *Simple Network Management Protocol (SNMP)*, mai 1990, disponible à l'adresse <https://www.rfc-editor.org/info/rfc1157> [consulté le 18/02/2022]

IETF RFC 1213, K. McCloghrie, M. Rose, *Management Information Base for Network Management of TCP/IP-based internets: MIB-II*, mars 1991, disponible à l'adresse <https://www.rfc-editor.org/info/rfc1213> [consulté le 18/02/2022]

3 Termes, définitions, abréviations, acronymes et conventions

3.1 Termes et définitions

Pour les besoins du présent document, les termes et définitions de l'IEC 61784-2-0, l'ISO/IEC/IEEE 8802-3, l'IEEE Std 802-2014, l'IEEE Std 802.1AB-2016, l'IEEE Std 802.1AS-2020 et l'IEEE Std 802.1Q-2018 s'appliquent.

L'ISO et l'IEC tiennent à jour des bases de données terminologiques destinées à être utilisées en normalisation, consultables aux adresses suivantes:

- IEC Electropedia: disponible à l'adresse <https://www.electropedia.org/>
- ISO Online browsing platform: disponible à l'adresse <https://www.iso.org/obp>

3.2 Abréviations et acronymes

Pour les besoins du présent document, les abréviations et les acronymes de l'IEC 61784-2-0 ainsi que les suivants s'appliquent.

CP	Communication Profile (profil de communication) [conformément à l'IEC 61784-1-0]
CPF	Communication Profile Family (famille de profils de communication) [conformément à l'IEC 61784-1-0]
ICMP	Internet Control Message Protocol (protocole de message de contrôle Internet) (voir l'IETF RFC 792)
IETF	Internet Engineering Task Force (groupe spécial d'ingénierie d'Internet)
IP	Internet Protocol (protocole Internet) (voir l'IETF RFC 791)
LLDP	Link Layer Discovery Protocol (protocole de reconnaissance de couche de liaison) (voir l'IEEE Std 802.1AB-2016)
MIB	Management Information Base (base d'informations de gestion)
PI	Performance Indicator (indicateur de performance)
RSTP	Rapid Spanning Tree algorithm and Protocol (algorithme et protocole d'arbre de recouvrement rapide) (voir l'IEEE Std 802.1Q-2018)
SNMP	Simple Network Management Protocol (protocole de gestion de réseau simple) (voir l'IETF RFC 1157)
TCP	Transmission Control Protocol (protocole de commande de transmission) (voir l'IETF RFC 793)
UDP	User Datagram Protocol (protocole de datagramme utilisateur) (voir l'IETF RFC 768)

3.3 Symboles

Pour les besoins du présent document, les symboles de l'IEC 61784-2-0 ainsi que ceux du Tableau 1 s'appliquent.

NOTE Les définitions des symboles dans le présent paragraphe 3.3 ne sont pas systématiquement en italique, dans la mesure où les symboles sont déjà identifiés comme tels.

Tableau 1 – Symboles applicables à la CPF 6

Symbole	Définition	Unité
<i>DTLD</i>	Temps de remise total entre un appareil subordonné de type 8 et une entité de type 10	µs
DT10	Temps de remise du réseau de type 10	µs
<i>Cta_M</i>	Durée du cycle d'application de l'application de mapping dans l'appareil de liaison	
<i>M</i>	Facteur de mise en œuvre de l'appareil principal de type 8	–
<i>n</i>	Nombre d'octets des données (données utilisateur; données utiles)	octets
<i>s/8</i>	Nombre d'appareils subordonnés de type 8 connectés à l'appareil de liaison	–
<i>T_{bit}</i>	Durée nominale en bits (voir IEC 61158-2, 27.2)	µs
<i>t_s</i>	Temps de traitement logiciel de l'appareil principal de type 8 (spécifique à l'application)	µs

3.4 Conventions

Pour les besoins du présent document, les conventions définies dans l'IEC 61784-2-0 s'appliquent.

4 CPF 6 (INTERBUS®¹) – Profils de communication RTE

4.1 Présentation générale

La famille de profils de communication 6 (CPF 6) définit les profils de communication reposant sur les spécifications type 8 et type 10 de la série IEC 61158, ce qui correspond aux parties des systèmes de communication communément appelées INTERBUS et PROFINET.

Dans le présent document, les profils de communication suivants sont spécifiés pour la CPF 6:

– profil 6/4

Ce profil définit les sélections de services et de protocole avec mapping d'un appareil de liaison permettant de connecter les systèmes de communication de type 8 et de type 10. Il est composé d'un appareil principal CP 6/1 et d'un appareil CP 3/4 avec mapping;


– profil 6/5

Ce profil définit les sélections de services et de protocole avec mapping d'un appareil de liaison permettant de connecter les systèmes de communication de type 8 et de type 10. Il est composé d'un appareil principal CP 6/1 et d'un appareil CP 3/5 avec mapping;

– profil 6/6

Ce profil définit les sélections de services et de protocole avec mapping d'un appareil de liaison permettant de connecter les systèmes de communication de type 8 et de type 10. Il est composé d'un appareil principal CP 6/1 et d'un appareil CP 3/6 avec mapping.

La Figure 1 représente les profils de communication d'appareil de liaison et la relation avec d'autres profils de communication de type 8 et de type 10.

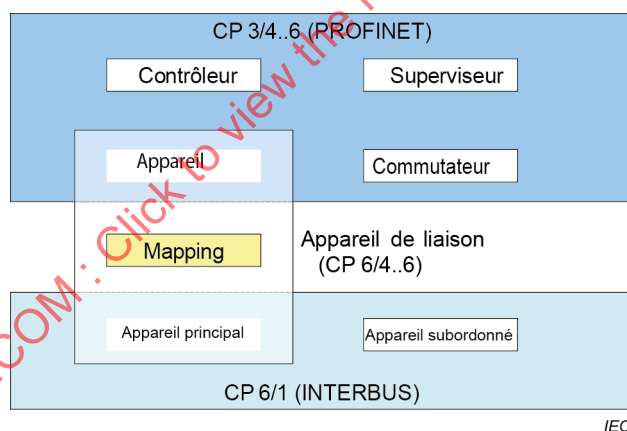

IEC

Figure 1 – Contexte de réseau RTE des profils de communication d'appareils de liaison

Les appareils de liaison conformes à un profil de communication peuvent être classés selon un identifiant CP. L'attribution d'un identifiant CP est présentée dans le Tableau 2.

¹ INTERBUS est l'appellation commerciale de Phoenix Contact GmbH & Co. KG. Cette information est donnée à l'intention des utilisateurs du présent document et ne signifie nullement que l'IEC approuve le détenteur de la marque ou de l'un quelconque de ses produits. La conformité à ce profil n'exige pas l'utilisation de l'appellation commerciale INTERBUS. L'utilisation de l'appellation commerciale INTERBUS exige l'autorisation du détenteur de l'appellation commerciale.

Tableau 2 – CPF 6: attribution d'identifiants CP d'appareils

Profil	Appareil de liaison
Profil 6/4	649
Profil 6/5	659
Profil 6/6	669

Chaque profil de communication donne un ensemble bien défini de dispositions. Pour un appareil distinct, d'autres sélections de services, de paramètres et de leurs valeurs doivent être réalisées. Il convient de décrire ces sélections conformément à l'ISO 15745-3 étant donné que les profils d'appareil INTERBUS sous la forme d'un profil d'appareil INTERBUS échangent la description. Un profil d'appareil INTERBUS reposant sur un profil de communication doit spécifier l'identifiant CP au format suivant:

<communicationEntity ... communicationProfile="[CP identifier]" ...>

4.2 CP 6/4

4.2.1 Mapping

Les appareils de type 8 doivent être attribués à des ensembles ou sous-ensembles de type 10.

NOTE 1 Le concept de mapping lui-même ne fait pas partie du profil de communication. Le concept de mapping utilisé peut être présenté dans la description de l'appareil de liaison conformément à l'ISO 15745-1.

Un ou plusieurs appareils de type 8 peuvent être attribués à des ensembles ou sous-ensembles de type 10.

La Figure 2 donne une représentation du principe de mapping. Le mapping des données est représenté à la Figure 3.

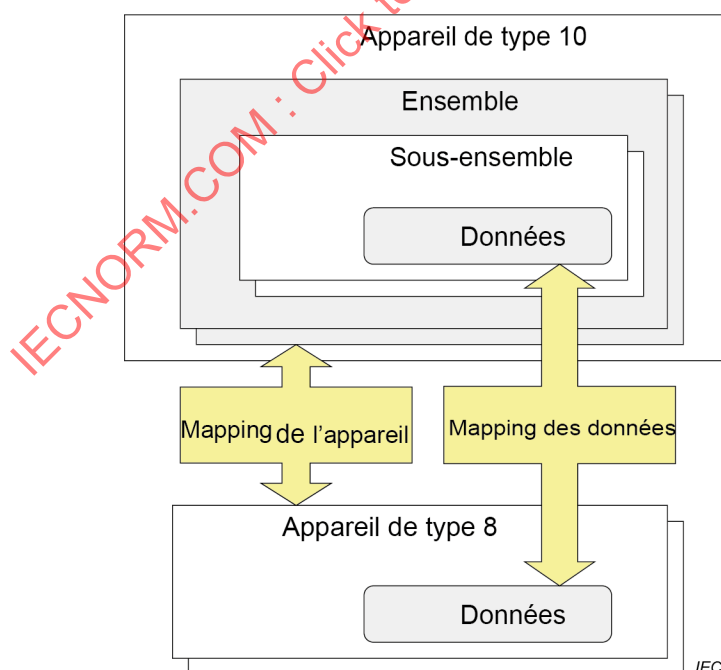


Figure 2 – Principe de mapping de l'appareil de liaison