



IEC 62453-303-2

Edition 1.0 2009-06

# INTERNATIONAL STANDARD

## NORME INTERNATIONALE



**Field device tool (FDT) interface specification –  
Part 303-2: Communication profile integration – IEC 61784 CP 3/4, CP 3/5  
and CP 3/6**

**Spécification des interfaces des outils des dispositifs de terrain (FDT) –  
Partie 303-2: Intégration des profils de communication – CP 3/4, CP 3/5 et  
CP 3/6 de la CEI 61784**

IECNORM.COM : Click to view the full PDF of IEC 62453-303-2:2009



## THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2009 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de la CEI ou du Comité national de la CEI du pays du demandeur.

Si vous avez des questions sur le copyright de la CEI ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de la CEI de votre pays de résidence.

IEC Central Office  
3, rue de Varembé  
CH-1211 Geneva 20  
Switzerland

Tel.: +41 22 919 02 11  
Fax: +41 22 919 03 00  
[info@iec.ch](mailto:info@iec.ch)  
[www.iec.ch](http://www.iec.ch)

### About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

### About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

#### Useful links:

IEC publications search - [www.iec.ch/searchpub](http://www.iec.ch/searchpub)

The advanced search enables you to find IEC publications by a variety of criteria (reference number, text, technical committee,...).

It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)

Stay up to date on all new IEC publications. Just Published details all new publications released. Available on-line and also once a month by email.

Electropedia - [www.electropedia.org](http://www.electropedia.org)

The world's leading online dictionary of electronic and electrical terms containing more than 30 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary (IEV) on-line.

Customer Service Centre - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: [csc@iec.ch](mailto:csc@iec.ch).

### A propos de la CEI

La Commission Electrotechnique Internationale (CEI) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

### A propos des publications CEI

Le contenu technique des publications de la CEI est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

#### Liens utiles:

Recherche de publications CEI - [www.iec.ch/searchpub](http://www.iec.ch/searchpub)

La recherche avancée vous permet de trouver des publications CEI en utilisant différents critères (numéro de référence, texte, comité d'études,...).

Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

Just Published CEI - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)

Restez informé sur les nouvelles publications de la CEI. Just Published détaille les nouvelles publications parues. Disponible en ligne et aussi une fois par mois par email.

Electropedia - [www.electropedia.org](http://www.electropedia.org)

Le premier dictionnaire en ligne au monde de termes électriques et électroniques. Il contient plus de 30 000 termes et définitions en anglais et en français, ainsi que les termes équivalents dans les langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (VEI) en ligne.

Service Clients - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: [csc@iec.ch](mailto:csc@iec.ch).



IEC 62453-303-2

Edition 1.0 2009-06

# INTERNATIONAL STANDARD

## NORME INTERNATIONALE



**Field device tool (FDT) interface specification –  
Part 303-2: Communication profile integration – IEC 61784 CP 3/4, CP 3/5  
and CP 3/6**

**Spécification des interfaces des outils des dispositifs de terrain (FDT) –  
Partie 303-2: Intégration des profils de communication – CP 3/4, CP 3/5 et  
CP 3/6 de la CEI 61784**

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

COMMISSION  
ELECTROTECHNIQUE  
INTERNATIONALE

PRICE CODE  
CODE PRIX

V

ICS 25.040.40; 35.100.05; 35.110

ISBN 978-2-8322-0995-0

**Warning! Make sure that you obtained this publication from an authorized distributor.**

**Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

## CONTENTS

FOREWORD .....	4
INTRODUCTION .....	6
1 Scope .....	7
2 Normative references .....	7
3 Terms, definitions, symbols, abbreviated terms and conventions .....	7
3.1 Terms and definitions .....	7
3.2 Abbreviated terms .....	8
3.3 Conventions .....	8
3.3.1 Data type names and references to data types .....	8
3.3.2 Vocabulary for requirements .....	8
3.3.3 Use of UML .....	8
4 Bus category .....	8
5 Access instance and device data .....	9
5.1 Process Channel objects provided by DTM .....	9
5.2 DTM services to access instance and device data .....	9
6 Protocol specific behavior .....	9
7 Protocol specific usage of general data types .....	9
8 Protocol specific common data types .....	11
9 Network management data types .....	11
9.1 General .....	11
9.2 Parameter access data types .....	11
10 Communication data types .....	17
11 Channel parameter data types .....	20
12 Device identification .....	23
12.1 Protocol specific handling of data type STRING .....	23
12.2 Device type identification data types .....	23
12.3 Topology scan data types .....	26
12.4 Scan identification data types .....	27
12.5 Device type identification data types .....	29
Bibliography .....	32
 Figure 1 – Part 303-2 of the IEC 62453 series .....	6
 Table 1 – Protocol identifier .....	8
Table 2 – Physical layer identifier .....	8
Table 3 – Protocol specific usage of general data types .....	9
Table 4 – Simple parameter access data types .....	11
Table 5 – Structured parameter access data types .....	14
Table 6 – Simple communication data types .....	17
Table 7 – Structured communication data types .....	18
Table 8 – Simple channel parameter data types .....	21
Table 9 – Structured channel parameter data types .....	22
Table 10 – Identification data types for PROFINET with pure DCP .....	24

Table 11 – Identification data types for PROFINET with I&M.....	25
Table 12 – Simple identification data types with protocol independent semantics.....	26
Table 13 – Structured identification data types with protocol independent semantics .....	26
Table 14 – Simple device type identification data types .....	26
Table 15 – Structured device type identification data type.....	27
Table 16 – Simple scan identification data types.....	27
Table 17 – Structured scan identification data types .....	28
Table 18 – Structured device type identification data types .....	29

IECNORM.COM : Click to view the full PDF of IEC 62453-303-2:2009

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

### FIELD DEVICE TOOL (FDT) INTERFACE SPECIFICATION –

#### Part 303-2: Communication profile integration – IEC 61784 CP 3/4, CP 3/5 and CP 3/6

#### FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 62453-303-2 has been prepared by subcommittee 65E: Devices and integration in enterprise systems, of IEC technical committee 65: Industrial-process measurement, control and automation.

This part, in conjunction with the other parts of the first edition of the IEC 62453 series cancels and replaces IEC/PAS 62453-1, IEC/PAS 62453-2, IEC/PAS 62453-3, IEC/PAS 62453-4 and IEC/PAS 62453-5 published in 2006, and constitutes a technical revision.

Each part of the IEC 62453-3xy series is intended to be read in conjunction with IEC 62453-2.

This bilingual version (2013-07) corresponds to the monolingual English version, published in 2009-06.

The text of this standard is based on the following documents:

FDIS	Report on voting
65E/128/FDIS	65E/141/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

The French version of this standard has not been voted upon.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 62453 series, under the general title *Field Device Tool (FDT) interface specification*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

**IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**


## INTRODUCTION

This part of IEC 62453 is an interface specification for developers of FDT (Field Device Tool) components for function control and data access within a client/server architecture. The specification is a result of an analysis and design process to develop standard interfaces to facilitate the development of servers and clients by multiple vendors that need to interoperate seamlessly.

With the integration of fieldbuses into control systems, there are a few other tasks which need to be performed. In addition to fieldbus- and device-specific tools, there is a need to integrate these tools into higher-level system-wide planning- or engineering tools. In particular, for use in extensive and heterogeneous control systems, typically in the area of the process industry, the unambiguous definition of engineering interfaces that are easy to use for all those involved is of great importance.

A device-specific software component, called DTM (Device Type Manager), is supplied by the field device manufacturer with its device. The DTM is integrated into engineering tools via the FDT interfaces defined in this specification. The approach to integration is in general open for all kinds of fieldbuses and thus meets the requirements for integrating different kinds of devices into heterogeneous control systems.

Figure 1 shows how IEC 62453-303-2 is aligned in the structure of the IEC 62453 series.

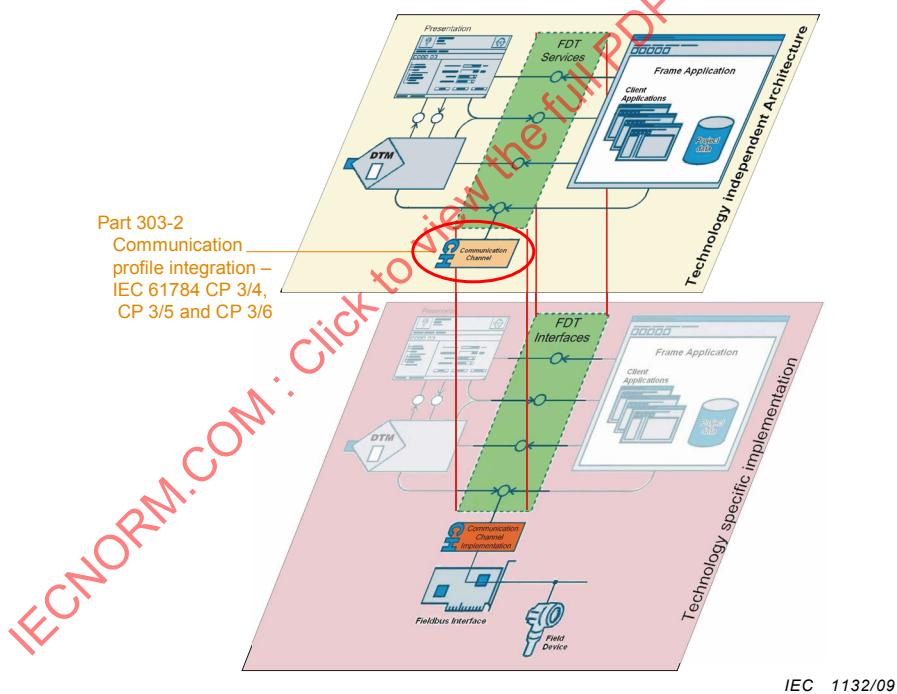

**Figure 1 – Part 303-2 of the IEC 62453 series**

## FIELD DEVICE TOOL (FDT) INTERFACE SPECIFICATION –

### Part 303-2: Communication profile integration – IEC 61784 CP 3/4, CP 3/5 and CP 3/6

## 1 Scope

Communication Profile 3/4, Communication Profile 3/5 and Communication Profile 3/6 (commonly known as PROFINET®<sup>1</sup> IO) define communication profiles based on IEC 61158-5-10 and IEC 61158-6-10. The basic profiles CP 3/4, CP 3/5, and CP 3/6 are defined in IEC 61784-2.

This part of IEC 62453 provides information for integrating the PROFINET® technology into the FDT interface (IEC 62453-2).

This part of the IEC 62453 specifies communication and other services.

This specification neither contains the FDT specification nor modifies it.

## 2 Normative references

The following referenced documents are indispensable for the application of this specification. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies

IEC 61158-5-10, *Industrial communication networks – Fieldbus specifications – Part 5-10: Application layer service definition – Type 10 elements*

IEC 61158-6-10, *Industrial communication networks – Fieldbus specifications – Part 6-10: Application layer protocol specification – Type 10 elements*

IEC 61784-2 *Industrial communication networks - Profiles - Part 2: Additional fieldbus profiles for real-time networks based on ISO/IEC 8802-3*

IEC 62453-1:2009, *Field Device Tool (FDT) interface specification – Part 1: Overview and guidance*

IEC 62453-2:2009, *Field Device Tool (FDT) interface specification – Part 2: Concepts and detailed description*

## 3 Terms, definitions, symbols, abbreviated terms and conventions

### 3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 62453-1 and IEC 62453-2 apply.

<sup>1</sup> PROFINET ® is the trademark of PROFIBUS Nutzerorganisation e.V. (PNO). PNO is a non-profit trade organization to support the fieldbus PROFIBUS. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this profile does not require use of the registered trademark. Use of the trademark PROFIBUS and PROFINET requires permission of the trade name holder.

### 3.2 Abbreviated terms

For the purposes of this document, the abbreviations given in IEC 62453-1 and IEC 62453-2 and the following apply.

AR	Application Relation
DCP	Discovery and basic Configuration Protocol
GSDML	Generic Station Description Markup Language
IOCS	IO Consumer Status
IOPS	IO Provider Status
UML	Unified Modeling Language

### 3.3 Conventions

#### 3.3.1 Data type names and references to data types

The conventions for naming and referencing of data types are explained in IEC 62453-2, Clause A.1

#### 3.3.2 Vocabulary for requirements

The following expressions are used when specifying requirements.

Usage of "shall" or "mandatory"	No exceptions allowed.
Usage of "should" or "recommended"	Strong recommendation. It may make sense in special exceptional cases to differ from the described behaviour.
Usage of "can" or "optional"	Function or behaviour may be provided, depending on defined conditions.

#### 3.3.3 Use of UML

Figures in this document are using UML notation as defined in Annex A of IEC 62453-1.

## 4 Bus category

IEC 61784 CP 3/4, CP 3/5 and CP 3/6 protocols are identified in the protocolId element of the structured data type 'fdt:BusCategory' by the following unique identifier as defined in Table 1:

**Table 1 – Protocol identifier**

Identifier value	ProtocolId name	Description
DFC98364-DAB8-493B-BB92-23B3F92FEBCD	'Profinet IO'	Support of IEC 61784 CP 3/4, CP 3/5 and CP 3/6 protocols

IEC 61784 CP 3/4, CP 3/5 and CP 3/6 use the following unique identifier for its physical layers.

**Table 2 – Physical layer identifier**

PhysicalLayer element	Description
99C36176-E59A-11DA-9023-0002B3ECDCBE	10BASET
99C36177-E59A-11DA-9023-0002B3ECDCBE	10BASETXHD
99C36178-E59A-11DA-9023-0002B3ECDCBE	10BASETDXFD
99C36179-E59A-11DA-9023-0002B3ECDCBE	100BASETXHD
99C3617A-E59A-11DA-9023-0002B3ECDCBE	100BASETDXFD

PhysicalLayer element	Description
99C3617B-E59A-11DA-9023-0002B3ECDCBE	10BASEFXHD
99C3617C-E59A-11DA-9023-0002B3ECDCBE	10BASEFXFD
99C3617D-E59A-11DA-9023-0002B3ECDCBE	1000BASEXHD
99C3617E-E59A-11DA-9023-0002B3ECDCBE	1000BASEXFDFD
99C3617F-E59A-11DA-9023-0002B3ECDCBE	1000BASELXHD
99C36180-E59A-11DA-9023-0002B3ECDCBE	1000BASELXFD
99C36181-E59A-11DA-9023-0002B3ECDCBE	1000BASESXHD
99C36182-E59A-11DA-9023-0002B3ECDCBE	1000BASESXFD
99C36183-E59A-11DA-9023-0002B3ECDCBE	1000BASETHD
99C36184-E59A-11DA-9023-0002B3ECDCBE	1000BASETFD
99C36185-E59A-11DA-9023-0002B3ECDCBE	10GigBASEFX

## 5 Access instance and device data

### 5.1 Process Channel objects provided by DTM

The minimum set of provided data should be:

- process values modeled as channel objects including the ranges and scaling.

### 5.2 DTM services to access instance and device data

The services InstanceItemList and DeviceItemList shall provide access to at least all mandatory parameters of CP 3/4, CP 3/5 and CP 3/6 devices.

## 6 Protocol specific behavior

Not applicable.

## 7 Protocol specific usage of general data types

The following table (Table 3) shows how general data types, defined in IEC 62453-2 within the namespace ‘fdt’, are used with CP 3/4, CP 3/5 and CP 3/6 devices.

**Table 3 – Protocol specific usage of general data types**

Attribute	Description for use in IEC 61784 CP 3/4, CP 3/5 and CP 3/6
fdt:address	For CP 3/4, CP 3/5 and CP 3/6 the address attribute is mandatory for the exposed parameters in the DTMs. The address string shall be constructed according to the rules of the FDT semanticId. That means the attribute ‘semanticId’ is always the same as the attribute ‘address’
fdt:protocolId	See Clause 4
fdt:physicalLayer	See Clause 4
fdt:deviceTypeId	The attribute “fdt:DtmDeviceType/@deviceTypeId” must contain the DeviceID according to the CP 3/4, CP 3/5 and CP 3/6 specification. The DeviceID shall be entered in decimal format, however, the value should be displayed as hex to the user. GSDML XPath Expression: “/ISO15745Profile/ProfileBody/DeviceIdentity/@DeviceID”
fdt:subDeviceType	Enter manufacturer specific value here

<b>Attribute</b>	<b>Description for use in IEC 61784 CP 3/4, CP 3/5 and CP 3/6</b>
fdt:vendor	<p>The attribute fdt:DtmDeviceType/VersionInformation/@vendor shall contain the VendorName according to CP 3/4, CP 3/5 and CP 3/6 specification.</p> <p>GSDML XPath Expression:</p> <p>“/ISO15745Profile/ProfileBody/DeviceIdentity/@VendorName”</p>
fdt:manufacturerId	<p>The attribute fdt:DtmDeviceType/VersionInformation/@vendor shall contain the VendorName according to the CP 3/4, CP 3/5 and CP 3/6 specification.</p> <p>GSDML XPath Expression:</p> <p>“/ISO15745Profile/ProfileBody/DeviceIdentity/@VendorName”</p>
fdt:deviceTypeInformation	<p>Path to the GSDML file. The attribute contains the full path including the file name.</p> <p>For IEC 61784 CP 3/4, CP 3/5 and CP 3/6 devices, it is mandatory to provide this attribute.</p> <p>Only a parent developed according to IEC 61784 CP 3/4, CP 3/5 and CP 3/6 Annex can handle GSDML information. Thus, it is not necessary to fill this attribute with the GSDML itself, if the parent is FDT 1.2 conformant.</p> <p>The deviceTypeInformation attribute is of type string and shall be used with format shown in the example:</p> <p>Example: file:///c:/myDtm/myGsdFile.xml</p>
fdt:deviceTypeInformationPath	<p>Shall not be used.</p> <p>The GSDML path information is already mandatory in the deviceTypeInformation attribute</p>
fdt:semanticId fdt:applicationDomain	<p>The SemanticIDs follow the different device models that are defined for IEC 61784 CP 3/4, CP 3/5 and CP 3/6 devices. FDT currently supports following models:</p> <ul style="list-style-type: none"> <li>• Profinet IO</li> <li>• PROFIdrive</li> </ul> <p><b>PROFINET IO</b></p> <p>The applicationDomain is: FDT_PROFINET_IO</p> <p>The semanticId follows the access information of a communication request:</p> <p>The semanticId is: Api.Slot.Subslot.Index.ByteOffset.BitOffset.BitLength</p> <p>Api – Api number</p> <p>Slot – Slot number</p> <p>Subslot – Subslot number</p> <p>Index – Index number</p> <p>ByteOffset – Start byte within the Index</p> <p>BitOffset – Start bit within the Index (range 0-7)</p> <p>BitLength – Length of values in bit</p> <p>These values are numbers based on decimal format without leading ‘0’.</p> <p><b>PROFIdrive</b></p> <p>The applicationDomain is: FDT_PROFINET_PROFIDRIVE</p> <p>According to the PROFIdrive profile, a device (drive unit) may be composed by a number (1-many) of drive objects (DOs). The DOs may have different types. Each DO is uniquely identifiable and manages its own parameters. Each parameter can be uniquely identified by its number (PNU). Each DO has its own number space.</p> <p>A parameter may contain simple data or composed data (e.g. arrays).</p> <p>The data of the device are accessible via a parameter channel (normally Api 0x3A00, Subslot 1, Index 0xB02E and a slot number which is the DO number).</p> <p>The semanticId is: DOdo-id.PNUpnu</p> <p>do-id Drive Object ID</p> <p>pnu ParameterNumber</p>

Attribute	Description for use in IEC 61784 CP 3/4, CP 3/5 and CP 3/6
	do-id, pnu are based on decimal format without leading '0'

## 8 Protocol specific common data types

Not applicable.

## 9 Network management data types

### 9.1 General

The data types specified in this subclause are used in the following services:

- NetworkManagementInfoRead service;
- NetworkManagementInfoWrite service.

### 9.2 Parameter access data types

The data types describe the parameter information of an IEC 61784 CP 3/4, CP 3/5 and CP 3/6 device (see Table 4 and Table 5)

**Table 4 – Simple parameter access data types**

Data type	Definition	Description
arType	UINT	ARType according to the PROFINET specification Shall only be set by Parent
arProperties	UDINT	ARProperties according to the PROFINET specification Shall only be set by Parent
arUUID	UUID	ARUUID according to the PROFINET specification Shall only be set by Parent
alarmCRTType	UINT	AlarmCRTType according to the PROFINET specification Shall only be set by Parent
alarmCRProperties	UDINT	AlarmCRProperties according to the PROFINET specification Shall only be set by Parent
rtaTimeoutFactor	UINT	RTATimeoutFactor according to the PROFINET specification Shall only be set by Parent
rtaRetries	UINT	RTARetries according to the PROFINET specification Shall only be set by Parent
localAlarmReference	UINT	LocalAlarmReference according to the PROFINET specification Shall only be set by Parent
maxAlarmDataLength	UINT	MaxAlarmDataLength according to the PROFINET specification Shall only be set by Parent
infoText	STRING	Additional textual information Shall only be set by DTM
localIndex	UINT	The attribute used within Device/Identification to address the device instance. Shall only be set by DTM

Data type	Definition	Description
nameOfStation	STRING	The station name is the primary address. The default value is the DNS_CompName of the GSDML. The Parent shall configure the station name according to the rules defined by the DNS_CompName.  Shall only be set by Parent apart of the default value, which shall be set by DTM (during InitNew)
dynIpAddress	BOOL	The attribute indicates whether the IP address is dynamically assigned to the device.  Shall only be set by Parent
extAddrSupported	BOOL	Extended address assignment (e.g. by DHCP, BootP) is supported by the Profinet IO Device.  Shall only be set by DTM
ipAddress	STRING	The attribute contains the IP address that is assigned to the device. The IP address is a secondary address. The default value is "0.0.0.0".  Shall only be set by Parent
ipSubnetMask	STRING	The attribute contains the subnet mask. The default value is "255.255.255.255".  Shall only be set by Parent
ipDefaultGateway	STRING	The attribute contains the default gateway address. The default value is an empty string.  Shall only be set by Parent
macAddress	STRING	The attribute contains the MAC address of the device. The MAC address is a secondary address.  The macAddress attribute is of type string and shall be used with format shown in the example: Example: 00:A0:45:01:02:03  Shall only be set by Parent
slotNumber	UINT	The slot address that is used by the module  Shall be set by DTM during configuration. Can be set by Parent during topology scan
moduleIdentNumber	UDINT	The ModuleIdentNumber according to the PROFINET specification  Shall be set by DTM during configuration. Can be set by Parent during topology scan
moduleProperties	UINT	This attribute is reserved for future use according to the PROFINET specification
subSlotNumber	UINT	The subslot address that is used by the submodule.  Shall be set by DTM during configuration. Can be set by Parent during topology scan
subModuleIdentNumber	UDINT	The SubmoduleIdentNumber according to the PROFINET specification.  Shall be set by DTM during configuration. Can be set by Parent during topology scan
ioType	enumeration (Input   Output   InputAndOutput )	Allowed values are: Input, Output, InputAndOutput.  Values and meaning according to the PROFINET specification - SubmoduleProperties.Type.  Shall be set by DTM during configuration. Can be set by Parent during topology scan
sharedInput	enumeration (IOController   IOControllerShare )	Allowed values are: IOController, IOControllerShare.  Values and meaning according to the PROFINET specification - SubmoduleProperties.SharedInput.  Shall be set by DTM during configuration. Can be set by Parent during topology scan

<b>Data type</b>	<b>Definition</b>	<b>Description</b>
reduceInputSubmoduleDataLength	enumeration (Expected   Zero )	Allowed values are: Expected, Zero. Values and meaning according to the PROFINET specification - SubmoduleProperties.ReduceInputSubmoduleDataLength. Shall be set by DTM during configuration. Can be set by Parent during topology scan
reduceOutputSubmoduleDataLength	enumeration (Expected   Zero )	Allowed values are: Expected, Zero. Values and meaning according PROFINET specification - SubmoduleProperties.ReduceOutputSubmoduleDataLength. Shall be set by DTM during configuration. Can be set by Parent during topology scan
discardIOXS	enumeration (Expected   Zero )	Allowed values are: Expected, Zero. Values and meaning according PROFINET specification - SubmoduleProperties.DiscardIOXS. Shall be set by DTM during configuration. Can be set by Parent during topology scan
api	UDINT	The API according to the PROFINET specification. Shall be set by DTM during configuration. Can be set by Parent during topology scan
index	UINT	The address of the desired record data object. Shall only be set by DTM.
recordData	ARRAY OF USINT	The binary data that will be written to the submodule during startup or connect. The record data implicitly contain the record data length. Shall only be set by DTM
consistency	enumeration (itemConsistency   allItemsConsistency )	The consistency of the input data. Shall only be set by DTM during configuration
sendClockFactor	UINT	SendClockFactor according to the PROFINET specification. Shall only be set by Parent, if the attribute belongs to the element SubModule. Shall only be set by DTM, if the attribute belongs to the element SendClockFactor
reductionRatio	UINT	ReductionRatio according to the PROFINET specification. Shall only be set by Parent, if the attribute belongs to the element SubModule. Shall only be set by DTM, if the attribute belongs to the element ReductionRatio
watchdogFactor	UINT	WatchdogFactor according to the PROFINET specification. Shall only be set by Parent
dataHoldFactor	UINT	DataHoldFactor according to the PROFINET specification. Shall only be set by Parent

**Table 5 – Structured parameter access data types**

Data type	Definition			Description
	Elementary data types	U s a g e	Multiplicity	
RecordParamData	STRUCT			Record data that will be written to the submodule during startup or connect
	index	M	[1..1]	
	recordData	M	[1..1]	
	fdt:name	O	[0..1]	
RecordParamDataList	STRUCT			List of records that will be written to the submodule during startup or connect
	collection of	M	[1..1]	
	RecordParamData		[1..*]	
OutputDataList	STRUCT			List of output data provided by a submodule. The list refers to the corresponding FDT-Channel objects
	consistency	O	[0..1]	
	fdt:ChannelReferences	M	[1..1]	
InputDataList	STRUCT			List of input data provided by a submodule. The list refers to the corresponding FDT-Channel objects
	consistency	O	[0..1]	
	fdt:ChannelReferences	M	[1..1]	
SubModule	STRUCT			The identification and configuration of a submodule
	subSlotNumber	M	[1..1]	
	fdt:name	M	[1..1]	
	fdt:descriptor	O	[0..1]	
	subModuleIdentNumber	M	[1..1]	
	api	M	[1..1]	
	sendClockFactor	M	[1..1]	
	reductionRatio	M	[1..1]	
	watchdogFactor	M	[1..1]	
	dataHoldFactor	M	[1..1]	
	InputDataList	O	[0..1]	
	OutputDataList	O	[0..1]	
	RecordParamDataList	O	[0..1]	
	SubModuleProperties	O	[0..1]	

IECNORM.COM - Click to view the full PDF of IEC 62453-303-2:2009

Data type	Definition			Description
	Elementary data types	U s a g e	Multiplicity	
SubModuleList	STRUCT			List of expected submodules within a module
	collection of	M	[1..1]	
	SubModule		[1..*]	
SubModuleProperties	STRUCT			The data type defines the type of submodule: NO_IO, INPUT, OUTPUT, IO according to the PROFINET specification. Shall be set by DTM during configuration. Can be set by Parent during topology scan
	ioType	M	[1..1]	
	sharedInput	M	[1..1]	
	reduceInput-SubmoduleDataLength	M	[1..1]	
	reduceOutput-SubmoduleDataLength	M	[1..1]	
	discardIOXS	M	[1..1]	
Module	STRUCT			The identification and configuration of a module
	slotNumber	M	[1..1]	
	moduleIdentNumber	M	[1..1]	
	moduleProperties	M	[1..1]	
	fdt:name	M	[1..1]	
	fdt:descriptor	M	[1..1]	
	SubModuleList	M	[1..1]	
ModuleList	STRUCT			List of expected modules within an application relationship
	collection of	M	[1..1]	
	Module		[1..*]	
AlarmCR	STRUCT			The Alarm CR is managed by the Communication DTM, but the information is stored at the Device DTM
	alarmCRTType	M	[1..1]	
	alarmCRProperties	M	[1..1]	
	rtaTimeoutFactor	M	[1..1]	
	rtaRetries	M	[1..1]	
	localAlarmReference	M	[1..1]	
	maxAlarmDataLength	M	[1..1]	
AR	STRUCT			The application relationship (AR) is managed by the Communication DTM, but the information is stored at the Device DTM
	arType	M	[1..1]	
	arProperties	M	[1..1]	
	arUUID	M	[1..1]	
	AlarmCR	M	[1..1]	
	ModuleList	O	[0..1]	

IECNORM.COM - Click to view the full PDF of IEC 62453-303-2009

Data type	Definition			Description
	Elementary data types	U s a g e	Multiplicity	
TimingProperties	STRUCT			<p>TimingProperties content matches the GSDML element TimingProperties. The data type provides device type related timing constraints to be considered by the IO Controller.</p> <p>TimingProperties and its data types shall be set by the DTM only. The Device DTM ignores element during execution of function IDtmParameter::SetParameters</p>
	collection of	M	[1..1]	
	SendClockFactor	M	[1..*]	
	collection of	M	[1..1]	
	ReductionRatio	M	[1..*]	
ReductionRatio	STRUCT			<p>ReductionRatio is required to map all device supported reduction ratio values described by GSDML attribute ReductionRatio. The GSDML attribute contains a value list to be mapped on several ReductionRatio elements of the schema described here.</p> <p>This data type represents device type data that shall be set by the DTM only. This information is used for communication schedule planning by the parent</p>
	reductionRatio	M	[1..1]	
SendClockFactor	STRUCT			<p>SendClockFactor is required to map all device supported send clock factor values described by GSDML attribute SendClockFactor. The GSDML attribute contains a value list to be mapped on several SendClockFactor elements of the schema described here.</p> <p>This data type represents device type data that shall be set by the DTM only. This information is used for communication schedule planning by the parent</p>
	sendClockFactor	M	[1..1]	
Identification	STRUCT			The identification of a device or device instance
	localIndex	M	[1..1]	
	fdt:deviceTypeId	M	[1..1]	
	fdt:manufacturerId	M	[1..1]	
	infoText	O	[0..1]	
	fdt:VersionInformation	O	[0..1]	
Device	STRUCT			The parameters of a device or device instance
	Identification	M	[1..1]	
	collection of	M	[1..1]	
	AR	M	[1..*]	
	TimingProperties	O	[0..1]	
Network	STRUCT			The address information of the PROFINET device

Data type	Definition			Description
	Elementary data types	U s a g e	Multiplicity	
	nameOfStation	M	[1..1]	
	dynIpAddress	M	[1..1]	
	ipAddress	M	[1..1]	
	ipSubnetMask	M	[1..1]	
	ipDefaultGateway	M	[1..1]	
	extAddrSupported	M	[1..1]	
	macAddress	O	[0..1]	
DeviceList	STRUCT			The list contains the parameters for one device. If the DTM is responsible for a device hosting multiple device instances, the list contains the parameters for each device instance
	Network	M	[1..1]	
	collection of	M	[1..1]	
	Device	M	[1..*]	

## 10 Communication data types

The data types described in this clause are used at following services:

- connect service;
- disconnect service;
- transaction service;
- abort service;
- SequenceBegin;
- SequenceEnd;
- SequenceStart.

The service arguments contain the address information and the communication data (explained in Table 6 and Table 7).

The data types described in this clause are defined for the following namespace. Namespace: fdtprofinet

**Table 6 – Simple communication data types**

Data type	Definition	Description
api	UDINT	Address information according to the PROFINET specification
nameOfStation	STRING	Address information according to the PROFINET specification
localIndex	UINT	Address information according to the PROFINET specification
errorDecode	USINT	Status information according to the PROFINET specification
errorCode1	UINT	Status information according to the PROFINET specification
errorCode2	USINT	Status information according to the PROFINET specification
index	UINT	Address information according to the PROFINET specification

Data type	Definition	Description	
communicationReference	UUID	Mandatory identifier for a communication link to a device. This identifier is allocated by the communication component during the Connect. The address information has to be used for all following communication calls	
slot	UINT	Address information according to the PROFINET specification	
subSlot	UINT	Address information according to the PROFINET specification	
addData1	UINT	Address information according to the PROFINET specification	
addData2	UINT	Address information according to the PROFINET specification	
length	UDINT	Maximum length of communication data in read request	
readOnly	BOOL	Only read support required on this connection. The CommunicationChannel can use this information for optimized connection management, e.g. use implicit AR	
sequenceTime	UDINT	Allowed duration in [ms] for the whole sequence. Can be set by the DTM at sequence begin	
delayTime	UDINT	Minimum delay time in [ms] between two communication calls	
systemTag	STRING	System Tag of a DTM	

Table 7 – Structured communication data types

Data type	Definition			Description
	Elementary data types	U s e s a g e	Multiplicity	
Abort	STRUCT			Describes the abort
	communicationReference	M	[1..1]	
CancelTransaction	STRUCT			Describes the specific transaction to cancel a pending transaction.  The function TransactionRequest is called with the same “invokeld” argument as the pending transaction request.  If the CancelTransaction request is accepted by the Communication Channel the function TransactionRequest returns TRUE.  If no transaction with the given invokeld was sent, then the function TransactionRequest returns FALSE.  No OnTransactionResponse can be expected for the previous pending request and for CancelTransaction request with specified invokeld.  If a regular OnTransactionResponse for the given invokeld was sent already, then the function TransactionRequest returns FALSE
	communicationReference	M	[1..1]	
ConnectRequest	STRUCT			Describes the communication request to establish a connection
	nameOfStation	M	[1..1]	
	fdt:manufacturerId	M	[1..1]	
	fdt:deviceTypeld	M	[1..1]	

Data type	Definition			Description
	Elementary data types	U s a g e	Multiplicity	
	localIndex	M	[1..1]	
	systemTag	M	[1..1]	
	readOnly	O	[0..1]	
ConnectResponse	STRUCT			Describes the communication response for a connect request
	communicationReference	M	[1..1]	
	addData1	O	[0..1]	
	addData2	O	[0..1]	
DisconnectRequest	STRUCT			Describes the communication request to release a connection
	communicationReference	M	[1..1]	
DisconnectResponse	STRUCT			Describes the communication response for a disconnect request
	communicationReference	M	[1..1]	
	addData1	O	[0..1]	
	addData2	O	[0..1]	
ReadRequest	STRUCT			Describes the communication request according to the PROFINET specification
	communicationReference	M	[1..1]	
	api	M	[1..1]	
	slot	M	[1..1]	
	subSlot	M	[1..1]	
	index	M	[1..1]	
	length	O	[0..1]	
ReadResponse	STRUCT			Describes the communication response for a read request according to the PROFINET specification
	communicationReference	M	[1..1]	
	addData1	O	[0..1]	
	addData2	O	[0..1]	
	ResponseError	O	[0..1]	
	fdt:CommunicationData	M	[1..1]	
ResponseError	STRUCT			Describes the PROFINET specific communication error
	errorDecode	M	[1..1]	
	errorCode1	M	[1..1]	
	errorCode2	M	[1..1]	
WriteRequest	STRUCT			Describes the communication request according to the PROFINET specification
	communicationReference	M	[1..1]	
	api	M	[1..1]	
	slot	M	[1..1]	

IECNORM.COM - Click to view the full PDF of IEC 62453-303-2:2009

Data type	Definition			Description
	Elementary data types	U s a g e	Multiplicity	
	subSlot	M	[1..1]	
	index	M	[1..1]	
	fdt:CommunicationData	M	[1..1]	
WriteResponse	STRUCT			Describes the communication response for a write request according to the PROFINET specification
	communicationReference	M	[1..1]	
	addData1	O	[0..1]	
	addData2	O	[0..1]	
	ResponseError	O	[0..1]	
SequenceBegin	STRUCT			Describes the sequence begin
	sequenceTime	O	[0..1]	
	delayTime	O	[0..1]	
	communicationReference	M	[1..1]	
SequenceEnd	STRUCT			Describes the sequence end
	communicationReference	M	[1..1]	
SequenceStart	STRUCT			Describes the sequence start
	communicationReference	M	[1..1]	

### Handling of errors during connect and disconnect

If an error occurs during a PROFINET connect or disconnect request, the Communication Channel shall return a fdt:CommunicationError. The error coding shall be done in the fdt:errorCode attribute. The fdt:errorCode shall contain the PROFINET error information "ErrorDecode", "ErrorCode1", "ErrorCode2" in exactly this sequence.

## 11 Channel parameter data types

It is up to a DTM whether it provides any channels. If a DTM allows a Frame Application, other DTMs, or a controller the direct access to its process values via PROFINET protocol, it should provide channel objects as described in this clause. Only the complete description of all channels belonging to an PROFINET process value allows proper access for external applications.

The description of channels, especially of the process values, allows the Frame Application to support the device in a more efficient way.

A DTM shall provide all channels including IOPS and IOCS channels. The channel collection exposed by the DTM describes the complete IO data structure. The channel schema supports cyclic and acyclic data exchange. The difference is made by using the data types IODataAddress or RecordDataAddress.

The data types are used at GetChannelParameters service and SetChannelParameters services.

The information returned by the GetChannelParameters service describes how to access an I/O value via PROFINET protocol (see Table 8 and Table 9).

The data types described in this clause are defined for the following namespace.  
Namespace: pniochannel

**Table 8 – Simple channel parameter data types**

Data type	Definition	Description
api	UDINT	This data type belongs to the channel address data types according to the PROFINET specification for channels accessible via PROFINET. The api value is set by the PROFINET controller during channel assignment
bitLength	UDINT	This data type specifies the number of bits used for a specific IO signal that might be a "bitArea"
bitOffset	UDINT	Address information allows accessing single IO signal values inside a "DataItem" inside cyclic communicated data. The data type can also specify the address of an acyclically exchanged parameter (ParameterRecord-DataItem/ Ref) according to the GSDML specification
byteOffset	UDINT	The data type specifies the address of an acyclically exchanged parameter (ParameterRecordDataItem/ Ref) according to the GSDML specification
frameApplicationTag	STRING	Frame Application specific tag used for identification and navigation. The DTM should display this tag at channel specific user interfaces
gatewayBusCategory	UUID	Unique identifier for a supported bus type like PROFINET according to the FDT specific CATID
index	UINT	Address information according to the PROFINET specification for parameter access via acyclic read / write communication service
number	UDINT	The data type represents the channel number according to PROFINET specification. The address information is used for IO data access and for diagnosis according to the Profinet specification for channels accessible via Profinet alarm message. The attribute is set by the DTM during device configuration
protectedByChannelAssignment	BOOL	TRUE if the channel is set to read only by the Frame Application. Usually set to TRUE if a channel assignment exists
statusChannelType	enumeration ( IOCS   IOPS )	Allowed values IOCS and IOPS
slotNumber	UINT	Address information according to the PROFINET specification for channels accessible via cyclic and acyclic communication service
subSlotNumber	UINT	Address information according to the PROFINET specification for channels accessible via cyclic and acyclic communication service

**Table 9 – Structured channel parameter data types**

Data type	Definition			Description
	Elementary data types	U s a g e	Multiplicity	
IODataAddress	STRUCT			The address for IO data access
	bitOffset	M	[1..1]	
RecordDataAddress	STRUCT			The address information that allows accessing parameter data
	index	M	[1..1]	
	bitOffset	M	[1..1]	
	byteOffset	M	[1..1]	
FDTChannel	STRUCT			Description of the channel
	fdt:tag	M	[1..1]	
	fdt:id	M	[1..1]	
	fdt:descriptor	O	[0..1]	
	protectedByChannelAssignment	M	[1..1]	
	number	M	[1..1]	
	api	M	[1..1]	
	slotNumber	M	[1..1]	
	subSlotNumber	M	[1..1]	
	fdt:dataType	M	[1..1]	
	bitLength	M	[1..1]	
	fdt:signalType	M	[1..1]	
	frameApplicationTag	O	[0..1]	
	appId:applicationId	O	[0..1]	
	fdt:SemanticInformation	O	[0..1]	
	fdt:BitEnumeratorEntries	O	[0..1]	
	fdt:EnumeratorEntries	O	[0..1]	
	fdt:Unit	O	[0..1]	
	IODataAddress	O	[0..1]	
	RecordDataAddress	O	[0..1]	
	fdt:Alarms	O	[0..1]	
	fdt:Ranges	O	[0..1]	
	fdt:SubstituteValue	O	[0..1]	
	fdt:Deadband	O	[0..1]	
FDTChannelType	STRUCT			Description of the channel component in case of channels with gateway functionality
	fdt:VersionInformation	M	[1..1]	
	gatewayBusCategory	O	[0..1]	
	statusChannelType	O	[0..1]	

IECNORM.COM - Click to view the full PDF of IEC 62453-303-2:2009

## 12 Device identification

There are different PROFINET specific identification elements.

An PROFINET scan may detect different device types: PROFINET devices supporting PROFINET I&M record data and devices supporting only pure DCP identification.

The following rule shall be applied for PROFINET Communication Channels:

- if I&M record data is available, create an I&M identification element;
- otherwise create a DCP identification element.

### 12.1 Protocol specific handling of data type STRING

PROFINET char array rules

- In all strings based on char ranges defined in the field bus protocol specification, the leading spaces are left trimmed. The char array is to be filled with 0x20h (blank).
- In VisibleStrings, invisible characters provided by a device have to be replaced by '?'. Characters within VisibleStrings, which are not defined in the 7 bit ASCII/ANSI character set, are considered to be invisible.

### 12.2 Device type identification data types

The PROFINET device type identification data types provide general data types with a protocol specific semantic (see Table 10 and Table 11) as well as data types without such a mapping (see Table 12).

The data types described in this clause are defined for the following namespace.  
Namespace: pniodent

IECNORM.COM : Click to view the full PDF of IEC 62453-303-2:2009

**Table 10 – Identification data types for PROFINET with pure DCP**

<b>PROFINET Attribute</b>	<b>Semantic element name</b>	<b>Data request in physical device</b>	<b>Protocol specific name</b>	<b>PROFINET Data Format</b>	<b>FDT data type (display Format)</b>	<b>Specification reference</b>
busProtocol	IdBusProtocol	For all DCP devices: “protocol_DCP”	Protocol	Enumeration ( protocol_DCP   protocol_IM )		
nameOfStation	IdAddress	DCP Get IP Option, Device Properties Option	NameOfStation, IP-parameter, Subnet Mask, Standard Gateway, MAC address	240 Octets Visible String	STRING [263]	
	ipAddress			4 Octets Visible String		
	ipSubnetMask			4 Octets Visible String		
	ipDefaultGateway			4 Octets Visible String		
	macAddress			6 Octets Visible String		
deviceTypeid	IdTypeid	DCP Get, Device Properties/Device-ID	DeviceIdent-Number	Unsigned16	UINT	
manufacturerId	IdManufacturer	DCP Get	DeviceVendor Value	Unsigned16	UINT	
deviceRole	IdDeviceRole	DCP Get, Device Properties/Device-role	DeviceRoleDetails	Unsigned8	enumeration ( ProfinetIO_Controller   ProfinetIO_Device   ProfinetIO_MultiDevice   ProfinetIO_Supervisor )	
manufacturerSpecificExtension	ManufacturerSpecificExtension	DCP Get, Device Properties/ Manufacturer specific	Manufacturer SpecificString	OctetString[ Size according to DCPBLength ]	STRING	

The semantic element “IdAddress” (string data type) consists after the XSL transformation of several PROFINET attributes. These attributes shall be separated by a semicolon “;” within the string and ordered in the following sequence:

Example:  
IdAddress="theName;ipAddress;ipSubnetMask;ipDefaultGateway;macAddress"  
"nameOfStation;ipAddress;ipSubnetMask;ipDefaultGateway;macAddress"

Example:  
IdAddress="theName;192.16.37;255.255.255.0;192.16.1.02;00:4C:4F:50".

**Table 11 – Identification data types for PROFINET with I&M**

<b>PROFINET Attribute</b>	<b>Semantic element name</b>	<b>Data request in physical device</b>	<b>Protocol specific name</b>	<b>PROFINET Data Format</b>	<b>FDT data type (display format)</b>	<b>Specification reference</b>
IdAddress, IdManufacturer, IdTypeID, IdDeviceRole, ManufacturerSpecificExtension as defined in Table 10						
busProtocol	IdBusProtocol	For all I&M devices: "protocol_IM"				enumeration ( protocol_DCP   protocol_IM )
orderId	I&M 0 Element 2		OrderID	20 Octets Visible String	STRING[20]	
serialNumber	IdSerialNumber	I&M 0 Element 3	IM_Serial_Number	16 Octets Visible String	STRING[16]	
softwareRevision	IdSoftwareRevision	I&M 0 Element 5	IM_Software_Revision	4 Octets - 1 Char + 3 Unsigned8 e.g. V1.3.0	STRING	
hardwareRevision	IdHardwareRevision	I&M 0 Element 4	IM_Hardware_Revision	Unsigned16	UINT	
profileID		I&M 0 Element 7	IM_ProfileID	Unsigned16	UINT	
profileSpecificType		I&M 0 Element 8	IM_Profile_Specific_Type	Unsigned16	UINT	

IEC62453-303-2 PDF  
Click To View

**Table 12 – Simple identification data types with protocol independent semantics**

Data type	Definition	Description
idDTMSupportLevel	enumeration ( genericSupport   profileSupport   blockspecificProfileSupport   specificSupport   identSupport )	enumeration genericSupport profileSupport blockspecificProfileSupport specificSupport
match	STRING	Used by Device DTM to define a regular expression which shall match to scanned physical define identification information
nomatch	STRING	Used by Device DTM to define a regular expression which shall not match to scanned physical define identification information. Used by Device DTM to indicate if identification information may not match

**Table 13 – Structured identification data types with protocol independent semantics**

Elements	Definition			Description
	Elementary data types	Usage	Multiplicity	
RegExpr	STRUCT			Includes regular expression string – either for match or for nomatch
	match	O	[0..1]	
	nomatch	O	[0..1]	

### 12.3 Topology scan data types

This data type is used at scan service response.

The data types describe one entry in the list of scanned devices (see Table 14 and Table 15).

The data types described in this subclause are defined for the following namespace.  
Namespace: fdtpnijdevice

**Table 14 – Simple device type identification data types**

Data type	Definition	Description
deviceRole	enumeration (IO_Controller   IO_Device   IO_MultiDevice   IO_Supervisor )	Indicates if the entry belongs to a PROFINET controller, a PROFINET device, PROFINET Multidevice or PROFINET Supervisor
ipAddress	STRING	The data type contains the IP address that is assigned to the device. The IP address is a secondary address. The default value is "0.0.0.0"
ipDefaultGateway	STRING	The data type contains the default gateway address. The default value is an empty string
ipSubNetmask	STRING	The data type contains the subnet mask. The default value is "255.255.255.255"
macAddress	STRING	The data type contains the MAC address of the device. The MAC address is a secondary address. The macAddress data type is of type string and shall be used with format shown in the example: Example: 00:A0:45:01:02:03

Data type	Definition	Description	
nameOfStation	STRING	The station name is the primary address. The default value is an empty string	

**Table 15 – Structured device type identification data type**

Data type	Definition			Description
	Elementary data types	Usage	Multiplicity	
ProfinetIODevice	STRUCT			Definiton of PROFINET device concerning the scan response
	nameOfStation	M	[1..1]	
	ipAddress	M	[1..1]	
	ipSubnetNask	M	[1..1]	
	ipDefaultGateway	M	[1..1]	
	macAddress	M	[1..1]	
	deviceRole	M	[1..1]	
	fdt:deviceTypeid	M	[1..1]	
	fdt:manufacturerId	M	[1..1]	
	fdt:VersionInformation	O	[0..1]	

The vendor and device name information of a DCP Identify Response shall be mapped in the fdt:VersionInformation data type as described below:

FDT Version Information	DCP Identify Response
vendor	Vendor name as text (is optional in DCP Identify response)
name	Device name as text (is optional in DCP Identify response)

#### 12.4 Scan identification data types

This clause defines data types that are used to provide protocol specific scanning (see Table 16 and Table 17).

The data types described in this clause are defined for the following namespace. Namespace: pnioscan

**Table 16 – Simple scan identification data types**

Data type	Definition	Description
resultState	enumeration (provisional   final   error )	Identifies if the result is one of the provisional results or the final result of the split scan results
configuredState	enumeration (configuredAndPhysicallyAvailable   configuredAndNotPhysicallyAvailable   availableButNotConfigured   notApplicable )	A communication master shall indicate in this attribute, if the scan response is related to a detected physical device which is configured or unconfigured

**Table 17 – Structured scan identification data types**

Tag	Definition			Description
	Elementary data types	Usage	Multiplicity	
IdAddress	STRUCT			All elements contain exactly one attribute each including the value of the scanned physical device. All elements with semantic meaning have a prefix "Id" for better identification
	pnioident:nameOfStation	M	[1..1]	
	pnioident:ipAddress	O	[0..1]	
	pnioident:macAddress	M	[1..1]	
	pnioident:ipSubnetMask	O	[0..1]	
	pnioident:ipDefaultGateway	O	[0..1]	
IdBusProtocol	STRUCT			IEC/NORMCom : Click to view the full PDF of IEC 62453-303-2:2009
	pnioident:busProtocol	M	[1..1]	
IdManufacturer	STRUCT			
	fdt:manufacturerId	M	[1..1]	
IdTypeID	STRUCT			
	fdt:deviceTypeid	M	[1..1]	
IdSoftwareRevision	STRUCT			
	pnioident:softwareRevision	M	[1..1]	
IdHardwareRevision	STRUCT			
	pnioident:hardwareRevision	M	[1..1]	
IdDeviceRole	STRUCT			These data types contain corresponding data types defined in FDTProfinetIOIdentS schema.xml. They are transformed to name value pairs without semantic meaning for Frame Application
	pnioident:deviceRole	M	[1..1]	
IdOrder	STRUCT			
	pnioident:orderId	M	[1..1]	
ProfileID	STRUCT			
	pnioident:profileID	M	[1..1]	
ProfileSpecificType	STRUCT			
	pnioident:profileSpecificType	M	[1..1]	
ManufacturerSpecific-Extension	STRUCT			These data types contain all elements for the appropriate protocol variant
	pnioident:manufacturerSpecificExtension	M	[1..1]	
ScanIdentification_DCP	STRUCT			
	configuredState	O	[0..1]	
	fdt:CommunicationError	O	[0..1]	
	IdBusProtocol	M	[1..1]	
	IdAddress	M	[1..1]	
	IdManufacturer	M	[1..1]	
	IdTypeID	M	[1..1]	
	IdDeviceRole	M	[1..1]	
	ManufacturerSpecificExtension	O	[0..1]	

Tag	Definition			Description
	Elementary data types	Usage	Multiplicity	
ScanIdentification_IM	STRUCT			Collection of ScanIdentification elements
	configuredState	O	[0..1]	
	fdt:CommunicationError	O	[0..1]	
	IdBusProtocol	M	[1..1]	
	IdAddress	M	[1..1]	
	IdManufacturer	M	[1..1]	
	IdTypeID	M	[1..1]	
	IdDeviceRole	M	[1..1]	
	ManufacturerSpecificExtension	O	[0..1]	
	IdOrder	M	[1..1]	
	IdSerialNumber	M	[1..1]	
	IdSoftwareRevision	M	[1..1]	
	IdHardwareRevision	M	[1..1]	
	ProfileID	M	[1..1]	
	ProfileSpecificType	M	[1..1]	
ScanIdentifications	STRUCT			Collection of ScanIdentification elements
	fdt:protocolId	M	[1..1]	
	resultState	M	[1..1]	
	choice of	M	[1..*]	
	ScanIdentification_DCP	S	[0..*]	
	ScanIdentification_IM	S	[0..*]	

## 12.5 Device type identification data types

The schema provides attributes and elements for providing protocol specific information for device types (see Table 18).

The data types described in this clause are defined for the following namespace.  
Namespace: pniodevtype

**Table 18 – Structured device type identification data types**

Tag	Definition			Description
	Elementary data types	Usage	Multiplicity	
IdBusProtocol	STRUCT			All data types contain exactly one data type each including the value of the scanned physical device. All data types with semantic meaning have a prefix "Id" for better identification
	pnioident:busProtocol	O	[0..1]	
	pnioident:RegExpr	O	[0..1]	
IdManufacturer	STRUCT			All data types contain exactly one data type each including the value of the scanned physical device. All data types with semantic meaning have a prefix "Id" for better identification
	fdt:manufacturerId	O	[0..1]	
	pnioident:RegExpr	O	[0..1]	
IdTypeID	STRUCT			All data types contain exactly one data type each including the value of the scanned physical device. All data types with semantic meaning have a prefix "Id" for better identification
	fdt:deviceTypeld	O	[0..1]	
	pnioident:RegExpr	O	[0..1]	
IdSoftwareRevision	STRUCT			

Tag	Definition			Description
	Elementary data types	Usage	Multiplicity	
	pnioident:softwareRevision	O	[0..1]	
	pnioident:RegExpr	O	[0..1]	
IdHardwareRevision	STRUCT			These data types contain corresponding data types defined in FDTProfinetIDent Schema.xml. They are transformed to name value pairs without semantic meaning for Frame Application
	pnioident:hardwareRevision	O	[0..1]	
	pnioident:RegExpr	O	[0..1]	
IdDeviceRole	STRUCT			
	pnioident:deviceRole	O	[0..1]	
	pnioident:RegExpr	O	[0..1]	
IdOrder	STRUCT			
	pnioident:orderId	M	[1..1]	
	pnioident:RegExpr	O	[0..1]	
ProfileID	STRUCT			
	pnioident:profileID	O	[0..1]	
	pnioident:RegExpr	O	[0..1]	
ProfileSpecificType	STRUCT			
	pnioident:profileSpecificType	O	[0..1]	
	pnioident:RegExpr	O	[0..1]	
ManufacturerSpecific-Extension	STRUCT			
	pnioident:manufacturerSpecificExtension	M	[1..1]	
Deviceldentification_DCP	STRUCT			These elements contain all elements for the appropriate protocol variant
	pnioident:idDTMSupportLeve	M	[1..1]	
	IdBusProtocol	M	[1..1]	
	IdManufacturer	M	[1..1]	
	IdTypeID	M	[1..1]	
	IdDeviceRole	M	[1..1]	
	ManufacturerSpecificExtension	O	[0..1]	
Deviceldentification_IM	STRUCT			
	pnioident:idDTMSupportLevel"	M	[1..1]	
	IdBusProtocol	M	[1..1]	
	IdManufacturer	M	[1..1]	
	IdTypeID	M	[1..1]	
	IdDeviceRole	M	[1..1]	
	ManufacturerSpecificExtension	O	[0..1]	
	IdOrder	M	[1..1]	
	IdSoftwareRevision	M	[1..1]	
	IdHardwareRevision	M	[1..1]	
	ProfileID	M	[1..1]	
	ProfileSpecificType	M	[1..1]	
Deviceldentifications	STRUCT			Collection of Deviceldentification elements
	fdt:protocolId	M	[1..1]	
	choice of	M	[1..*]	

IECNORM.COM - Click to view the full PDF of IEC 62453-303-2

Tag	Definition			Description
	Elementary data types	Usage	Multiplicity	
	DeviceIdentification_DCP	S	[0..*]	
	DeviceIdentification_IM	S	[0..*]	

IECNORM.COM : Click to view the full PDF of IEC 62453-303-2:2009

## Bibliography

IEC 61158 (all parts), *Industrial communication networks – Fieldbus specifications*

*Application Layer protocol for decentralized periphery and distributed automation.* Version 2.1  
June 2006, PNO Order No: 2.722

*Application Layer services for decentralized periphery and distributed automation.* Version 2.1  
June 2006, PNO Order No: 2.712

ISO/IEC 19501:2005, *Information technology – Open Distributed Processing – Unified Modeling Language (UML) Version 1.4.2*

IECNORM.COM : Click to view the full PDF of IEC 62453-303-2:2009

[IECNORM.COM](#) : Click to view the full PDF of IEC 62453-303-2:2009

## SOMMAIRE

AVANT-PROPOS .....	36
INTRODUCTION .....	38
1 Domaine d'application .....	40
2 Références normatives .....	40
3 Termes, définitions, symboles, abréviations et conventions .....	41
3.1 Termes et définitions .....	41
3.2 Abréviations .....	41
3.3 Conventions .....	41
3.3.1 Dénominations des types de données et références aux types de données .....	41
3.3.2 Vocabulaire relatif aux exigences .....	41
3.3.3 Utilisation de l'UML .....	41
4 Catégorie de bus .....	41
5 Accès aux données d'instances et de dispositifs .....	42
5.1 Objets de la voie de processus fournis par le DTM .....	42
5.2 Services du DTM pour l'accès aux données d'instances et de dispositifs .....	42
6 Comportement spécifique à un protocole .....	42
7 Utilisation spécifique à un protocole des types de données généraux .....	42
8 Types de données communs spécifiques à un protocole .....	44
9 Types de données relatifs à la gestion du réseau .....	44
9.1 Généralités .....	44
9.2 Types de données d'accès aux paramètres .....	44
10 Types de données de communication .....	51
11 Types de données relatifs aux paramètres des voies .....	54
12 Identification du dispositif .....	57
12.1 Prise en charge spécifique à un protocole du type de données STRING .....	57
12.2 Types de données pour l'identification du type de dispositif .....	57
12.3 Types de données pour le balayage topologique .....	61
12.4 Types de données pour l'identification lors du balayage .....	62
12.5 Types de données pour l'identification du type de dispositif .....	64
Bibliographie .....	67
Figure 1 – Partie 303-2 de la série CEI 62453 .....	39
Tableau 1 – Identificateur du protocole .....	41
Tableau 2 – Identificateur des couches physiques .....	42
Tableau 3 – Utilisation spécifique à un protocole des types de données généraux .....	43
Tableau 4 – Types de données simples d'accès aux paramètres .....	44
Tableau 5 – Types de données structurés d'accès aux paramètres .....	47
Tableau 6 – Types de données simples de communication .....	51
Tableau 7 – Types de données structurés de communication .....	52
Tableau 8 – Types de données simples pour les paramètres des voies .....	55
Tableau 9 – Types de données structurés pour les paramètres des voies .....	56

Tableau 10 – Types de données pour l'identification pour PROFINET avec DCP d'origine.....	58
Tableau 11 – Types de données pour l'identification pour PROFINET avec I&M .....	60
Tableau 12 – Types de données simples pour l'identification avec une sémantique indépendante du protocole.....	61
Tableau 13 – Types de données structurés pour l'identification avec une sémantique indépendante du protocole.....	61
Tableau 14 – Types de données simples pour l'identification du type de dispositif .....	61
Tableau 15 – Type de données structurés pour l'identification du type de dispositif .....	62
Tableau 16 – Types de données simples pour l'identification lors du balayage .....	63
Tableau 17 – Types de données structurés pour l'identification lors du balayage .....	63
Tableau 18 – Types de données structurés pour l'identification du type de dispositif .....	65

IECNORM.COM : Click to view the full PDF of IEC 62453-303-2:2009

## COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

### SPÉCIFICATION DES INTERFACES DES OUTILS DES DISPOSITIFS DE TERRAIN (FDT) –

#### Partie 303-2: Intégration des profils de communication – CP 3/4, CP 3/5 et CP 3/6 de la CEI 61784

#### AVANT-PROPOS

- 1) La Commission Électrotechnique Internationale (CEI) est une organisation mondiale de normalisation composée de l'ensemble des comités électrotechniques nationaux (Comités nationaux de la CEI). La CEI a pour objet de favoriser la coopération internationale pour toutes les questions de normalisation dans les domaines de l'électricité et de l'électronique. À cet effet, la CEI – entre autres activités – publie des Normes internationales, des Spécifications techniques, des Rapports techniques, des Spécifications accessibles au public (PAS) et des Guides (ci-après dénommés «Publication(s) de la CEI»). Leur élaboration est confiée à des comités d'études, aux travaux desquels tout Comité national intéressé par le sujet traité peut participer. Les organisations internationales, gouvernementales et non gouvernementales, en liaison avec la CEI, participent également aux travaux. La CEI collabore étroitement avec l'Organisation Internationale de Normalisation (ISO), selon des conditions fixées par accord entre les deux organisations.
- 2) Les décisions ou accords officiels de la CEI concernant les questions techniques représentent, dans la mesure du possible, un accord international sur les sujets étudiés, étant donné que les Comités nationaux de la CEI intéressés sont représentés dans chaque comité d'études.
- 3) Les Publications de la CEI se présentent sous la forme de recommandations internationales et sont agréées comme telles par les Comités nationaux de la CEI. Tous les efforts raisonnables sont entrepris afin que la CEI s'assure de l'exactitude du contenu technique de ses publications; la CEI ne peut pas être tenue responsable de l'éventuelle mauvaise utilisation ou interprétation qui en est faite par un quelconque utilisateur final.
- 4) Dans le but d'encourager l'uniformité internationale, les Comités nationaux de la CEI s'engagent, dans toute la mesure possible, à appliquer de façon transparente les Publications de la CEI dans leurs publications nationales et régionales. Toute divergence entre toute Publication de la CEI et toute publication nationale ou régionale correspondante doit être indiquée en termes clairs dans cette dernière.
- 5) La CEI n'a prévu aucune procédure de marquage valant indication d'approbation et n'engage pas sa responsabilité pour les équipements déclarés conformes à une de ses Publications.
- 6) Tous les utilisateurs doivent s'assurer qu'ils sont en possession de la dernière édition de cette publication.
- 7) Aucune responsabilité ne doit être imputée à la CEI, à ses administrateurs, employés, auxiliaires ou mandataires, y compris ses experts particuliers et les membres de ses comités d'études et des Comités nationaux de la CEI, pour tout préjudice causé en cas de dommages corporels et matériels, ou de tout autre dommage de quelque nature que ce soit, directe ou indirecte, ou pour supporter les coûts (y compris les frais de justice) et les dépenses découlant de la publication ou de l'utilisation de cette Publication de la CEI ou de toute autre Publication de la CEI, ou au crédit qui lui est accordé.
- 8) L'attention est attirée sur les références normatives citées dans cette publication. L'utilisation de publications référencées est obligatoire pour une application correcte de la présente publication.
- 9) L'attention est attirée sur le fait que certains des éléments de la présente publication CEI peuvent faire l'objet de droits de propriété intellectuelle ou de droits analogues. La CEI ne saurait être tenue pour responsable de ne pas avoir identifié de tels droits de propriété ou de ne pas avoir signalé leur existence.

La Norme internationale CEI 62453-303-2 a été établie par le sous-comité 65E: Les dispositifs et leur intégration dans les systèmes de l'entreprise, du comité technique 65: Mesure, commande et automation dans les processus industriels de la CEI.

Cette partie, conjointement aux autres parties de la première édition de la série CEI 62453 annule et remplace les CEI/PAS 62453-1, CEI/PAS 62453-2, CEI/PAS 62453-3, CEI/PAS 62453-4 et la CEI/PAS 62453-5 publiées en 2006, et constitue une révision technique.

Chaque partie de la série CEI 62453-3xy est destinée à être lue conjointement à la CEI 62453-2.

La présente version bilingue (2013-07) correspond à la version anglaise monolingue publiée en 2009-06.

Le texte anglais de cette norme est issu des documents 65E/128/FDIS et 65E/141/RVD.

Le rapport de vote 65E/141/RVD donne toute information sur le vote ayant abouti à l'approbation de cette norme.

La version française de cette norme n'a pas été soumise au vote.

Cette publication a été rédigée conformément aux Directives ISO/CEI, Partie 2.

Une liste de toutes les parties de la série CEI 62453, sous le titre général *Spécification de l'Interface de l'Outil des Dispositifs de Terrain (FDT)*, est disponible sur le site web de la CEI.

Le comité a décidé que le contenu de cette publication ne sera pas modifié avant la date de maintenance indiquée sur le site web de la CEI sous «<http://webstore.iec.ch>» dans les données relatives à la publication recherchée. À cette date, la publication sera

- reconduite,
- supprimée,
- remplacée par une édition révisée, ou
- amendée.

**IMPORTANT** – Le logo "colour inside" qui se trouve sur la page de couverture de cette publication indique qu'elle contient des couleurs qui sont considérées comme utiles à une bonne compréhension de son contenu. Les utilisateurs devraient, par conséquent, imprimer cette publication en utilisant une imprimante couleur.


## INTRODUCTION

Cette partie de la CEI 62453 désigne une spécification de l'interface pour les développeurs des composants de FDT (Field Device Tool) (Outil pour Dispositifs de Terrain) pour la commande des fonctions et l'accès aux données au sein d'une architecture client/serveur. La spécification résulte d'une analyse et d'un processus de conception destiné à développer des interfaces normalisées afin de faciliter le développement de serveurs et de clients par de multiples vendeurs ayant besoin d'interagir sans problème.

Des bus de terrain étant intégrés aux systèmes de commande, quelques tâches supplémentaires doivent être effectuées. En plus des outils relatifs aux dispositifs ainsi qu'aux bus de terrain, il est nécessaire d'intégrer ces outils à des outils de planification à l'échelle du système à un niveau plus élevé ou à des outils d'études. En particulier, pour des utilisations dans des systèmes de commande vastes et hétérogènes, généralement dans le secteur de l'industrie de transformation, il est très important de définir clairement les interfaces d'ingénierie faciles d'utilisation pour toutes celles concernées.

Un composant logiciel spécifique à un dispositif appelé DTM (Device Type Manager) (Gestionnaire du Type de Dispositif) est fourni par le fabricant du dispositif de terrain avec le dispositif auquel il est associé. Le DTM est intégré aux outils d'ingénierie via les interfaces du FDT définies dans la présente spécification. L'approche de l'intégration est généralement ouverte à tous les types de bus de terrain et par conséquent satisfait aux exigences relatives à l'intégration de différents types de dispositifs dans des systèmes de commande hétérogènes.

La Figure 1 présente la manière dont la CEI 62453-303-2 est alignée dans la structure de la série CEI 62453.

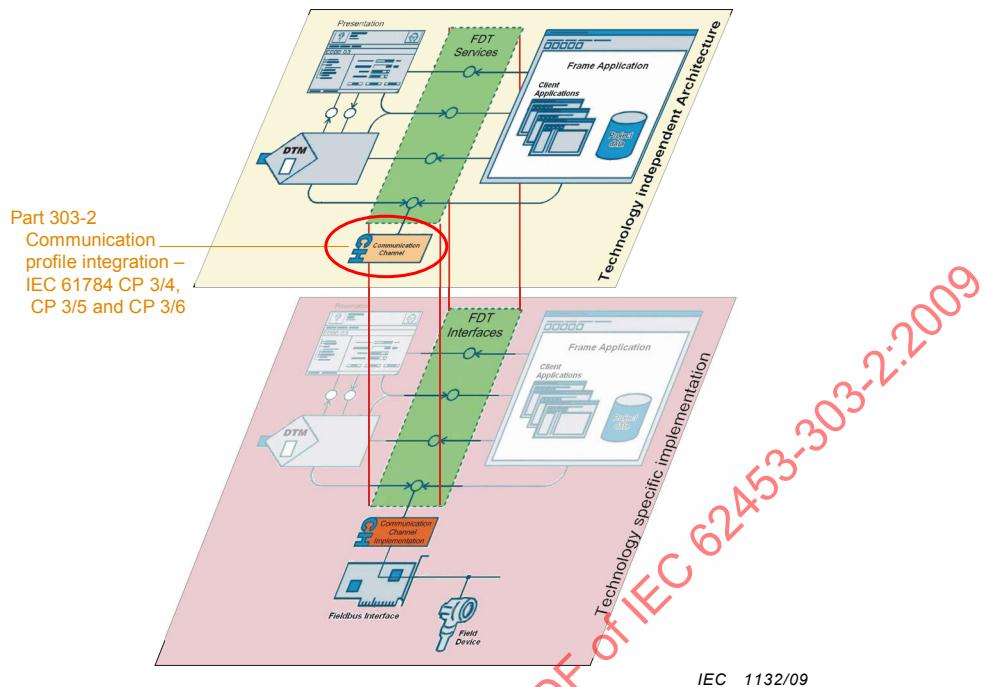**Légende**

Anglais	Français
Presentation	Présentation
FDT services	Services des FDT
Frame Application	Application cadre
Client applications	Applications client
Project data	Données du projet
Communication channel	Voie de communication
Technology independent architecture	Architecture indépendante vis-à-vis de toute technologie
Part 303-2 Communication profile integration IEC 61784 CP 3/4 CP 3/5 CP 3/6	Partie 303-2 Intégration des profils de communication CP 3/4 CP 3/5 CP 3/6 de la CEI 61784
Technology specific implementation	Mise en œuvre spécifique à une technologie
DTM	DTM
Fieldbus interface	Interface du bus de terrain
Field device	Dispositif de terrain
Communication channel implementation	Mise en œuvre de voie de communication

**Figure 1 – Partie 303-2 de la série CEI 62453**

## SPÉCIFICATION DES INTERFACES DES OUTILS DES DISPOSITIFS DE TERRAIN (FDT) –

### Partie 303-2: Intégration des profils de communication – CP 3/4, CP 3/5 et CP 3/6 de la CEI 61784

#### 1 Domaine d'application

Le Profil de Communication 3/4, le Profil de Communication 3/5 et le Profil de Communication 3/6 (généralement connus sous le nom de PROFINET®<sup>1</sup> IO) définissent les profils de communication basés sur la CEI 61158-5-10 et la CEI 61158-6-10. Les principaux profils CP 3/4, CP 3/5, et CP 3/6 sont définis dans la CEI 61784-2.

Cette partie de la CEI 62453 fournit des informations relatives à l'intégration de la technologie PROFINET® dans l'interface du FDT (CEI 62453-2).

Cette partie de la CEI 62453 spécifie les services de communication et autres services.

La présente spécification ne contient pas la spécification du FDT et ne la modifie pas.

#### 2 Références normatives

Les documents de référence suivants sont indispensables pour l'application du présent document. Pour les références datées, seule l'édition citée s'applique. Pour les références non datées, la dernière édition du document de référence s'applique (y compris les éventuels amendements).

CEI 61158-5-10, *Réseaux de communication industriels – Spécifications des bus de terrain – Partie 5-10: Définition des services des couches d'application – Éléments de type 10*

CEI 61158-6-10, *Réseaux de communication industriels – Spécifications des bus de terrain – Partie 6-10: Spécification des services des couches d'application – Éléments de type 10*

IEC 61784-2 *Industrial communication networks - Profiles - Part 2: Additional fieldbus profiles for real-time networks based on ISO/IEC 8802-3* (disponible en anglais uniquement)

IEC 62453-1:2009, *Field Device Tool (FDT) interface specification – Part 1: Overview and guidance* (disponible en anglais uniquement)

IEC 62453-2:2009, *Field Device Tool (FDT) interface specification – Part 2: Concepts and detailed description* (disponible en anglais uniquement)

<sup>1</sup> PROFINET ® est la marque commerciale de PROFIBUS Nutzerorganisation e.V. (PNO). PNO est une organisation de commerce à but non lucratif prenant en charge le bus de terrain PROFIBUS. Cette information est donnée à l'intention des utilisateurs de la présente Norme internationale et ne signifie nullement que la CEI approuve ou recommande l'emploi exclusif du produit ainsi désigné. La conformité avec ce profil ne nécessite pas l'utilisation de la marque commerciale déposée. L'utilisation des marques commerciales PROFIBUS et PROFINET requiert l'autorisation du propriétaire de la marque.

### 3 Termes, définitions, symboles, abréviations et conventions

#### 3.1 Termes et définitions

Pour les besoins du présent document, les termes et définitions donnés dans la CEI 62453-1 et dans la CEI 62453-2 s'appliquent.

#### 3.2 Abréviations

Pour les besoins du présent document, les abréviations données dans la CEI 62453-1, la CEI 62453-2 ainsi que les suivantes s'appliquent.

AR	Application RelationRelation d'applications
DCP	Discovery and basic Configuration Protocol (Protocole de Découverte et de Configuration de base)
GSDML	Generic Station Description Markup Language (Langage de Balisage pour la Description des Stations Génériques)
IOCS	IO Consumer Status (Statut du Consommateur E/S)
IOPS	IO Provider Status (Statut du Fournisseur E/S)
UML	Unified Modeling Language (Langage de Modélisation Unifié)

#### 3.3 Conventions

##### 3.3.1 Dénominations des types de données et références aux types de données

Les conventions pour la dénomination et le référencement des types de données sont décrites dans la CEI 62453-2, Article A.1.

##### 3.3.2 Vocabulaire relatif aux exigences

Les expressions suivantes sont utilisées lors de la spécification des exigences.

Utilisation de "doit" ou de "obligatoire"	Aucune exception tolérée.
Utilisation de "il convient de" ou de "recommandé"	Recommandation forte. Il peut être légitime, dans des cas particuliers exceptionnels, de s'écartier du comportement décrit.
Utilisation de "peut" ou de "facultatif"	La fonction ou le comportement peut être donné(e) selon des conditions définies.

##### 3.3.3 Utilisation de l'UML

Les figures du présent document utilisent la notation UML telle que définie dans l'Annexe A de la CEI 62453-1.

### 4 Catégorie de bus

Les protocoles CP 3/4, CP 3/5 et CP 3/6 de la CEI 61784 sont identifiés dans l'élément protocolId du type de données structuré 'fdt:BusCategory' par l'identificateur unique suivant, comme défini dans le Tableau 1:

**Tableau 1 – Identificateur du protocole**

Valeur d'identificateur	Nom de protocolId	Description
DFC98364-DAB8-493B-BB92-23B3F92FEBCD	'Profinet IO'	Prise en charge des protocoles CEI 61784 CP 3/4, CP 3/5 et CP 3/6

Les CP 3/4, CP 3/5 et CP 3/6 de la CEI 61784 utilisent l'identificateur unique suivant pour ses couches physiques.

**Tableau 2 – Identificateur des couches physiques**

Élément PhysicalLayer	Description
99C36176-E59A-11DA-9023-0002B3ECDCBE	10BASET
99C36177-E59A-11DA-9023-0002B3ECDCBE	10BASETXHD
99C36178-E59A-11DA-9023-0002B3ECDCBE	10BASETXFD
99C36179-E59A-11DA-9023-0002B3ECDCBE	100BASETXHD
99C3617A-E59A-11DA-9023-0002B3ECDCBE	100BASETXFD
99C3617B-E59A-11DA-9023-0002B3ECDCBE	10BASEFXHD
99C3617C-E59A-11DA-9023-0002B3ECDCBE	10BASEFXFD
99C3617D-E59A-11DA-9023-0002B3ECDCBE	1000BASEXHD
99C3617E-E59A-11DA-9023-0002B3ECDCBE	1000BASEXFD
99C3617F-E59A-11DA-9023-0002B3ECDCBE	1000BASELXHD
99C36180-E59A-11DA-9023-0002B3ECDCBE	1000BASELXFD
99C36181-E59A-11DA-9023-0002B3ECDCBE	1000BASESXHD
99C36182-E59A-11DA-9023-0002B3ECDCBE	1000BASESXFD
99C36183-E59A-11DA-9023-0002B3ECDCBE	1000BASETHD
99C36184-E59A-11DA-9023-0002B3ECDCBE	1000BASETFD
99C36185-E59A-11DA-9023-0002B3ECDCBE	10GigBASEFX

## 5 Accès aux données d'instances et de dispositifs

### 5.1 Objets de la voie de processus fournis par le DTM

Il convient que l'ensemble minimal de données fournies soit:

- les valeurs de processus modélisées comme des objets channel (voies), y compris les plages et les changements d'échelle.

### 5.2 Services du DTM pour l'accès aux données d'instances et de dispositifs

Les services InstanceItemList et DeviceItemList doivent fournir un accès au minimum à l'ensemble des paramètres obligatoires des dispositifs CP 3/4, CP 3/5 et CP 3/6.

## 6 Comportement spécifique à un protocole

Non applicable.

## 7 Utilisation spécifique à un protocole des types de données généraux

Le tableau suivant (Tableau 3) présente la manière dont les types de données généraux, définis dans la CEI 62453-2 sous l'espace de noms 'fdt', sont utilisés avec les dispositifs CP 3/4, CP 3/5 et CP 3/6.

**Tableau 3 – Utilisation spécifique à un protocole des types de données généraux**

<b>Attribut</b>	<b>Description pour une utilisation dans CP 3/4, CP 3/5 et CP 3/6 de la CEI 61784</b>
fdt:address	Pour CP 3/4, CP 3/5 et CP 3/6, l'attribut de l'adresse est obligatoire pour les paramètres concernés dans les DTM. La chaîne de l'adresse doit être construite conformément aux règles de semanticId du FDT. Cela signifie que l'attribut 'semanticId' est toujours identique à l'attribut 'address'
fdt:protocolId	Voir Article 4
fdt:physicalLayer	Voir Article 4
fdt:deviceTypeId	L'attribut "fdt:DtmDeviceType/@deviceTypeId" doit comporter le DeviceID (identifiant du dispositif) conformément à la spécification de CP 3/4, CP 3/5 et de CP 3/6. Le DeviceID doit être saisi au format décimal, cependant il convient que la valeur apparaisse en hexadécimal à l'utilisateur. Expression XPath GSDML: "/ISO15745Profile/ProfileBody/DeviceIdentity/@DeviceID"
fdt:subDeviceType	Saisir ici la valeur spécifique à un fabricant
fdt:vendor	L'attribut fdt:DtmDeviceType/VersionInformation/@vendor doit comporter le VendorName (Nom du vendeur) conformément à la spécification de CP 3/4, CP 3/5 et de CP 3/6. Expression XPath GSDML: "/ISO15745Profile/ProfileBody/DeviceIdentity/@VendorName"
fdt:manufacturerId	L'attribut fdt:DtmDeviceType/VersionInformation/@vendor doit comporter le VendorName conformément à la spécification de CP 3/4, CP 3/5 et de CP 3/6. Expression XPath GSDML: "/ISO15745Profile/ProfileBody/DeviceIdentity/@VendorName"
fdt:deviceTypeInformation	Chemin d'accès au fichier GSDML. L'attribut comporte le chemin d'accès complet, y compris le nom du fichier. Pour les dispositifs CP 3/4, CP 3/5 et CP 3/6 de la CEI 61784, il est obligatoire de fournir cet attribut. Seul un parent développé conformément à l'Annexe relative aux CP 3/4, CP 3/5 et au CP 3/6 de la CEI 61784 peut traiter des informations GSDML. Par conséquent, il n'est pas nécessaire de remplir cet attribut avec le GSDML lui-même, si le parent est conforme au FDT 1.2. L'attribut deviceTypeInformation se présente sous la forme d'une chaîne et doit être utilisé avec le format présenté dans l'exemple: Exemple: file:///c:/myDtm/myGsdFile.xml
fdt:deviceTypeInformationPath	Ne doit pas être utilisé. Les informations relatives au chemin GSDML sont déjà obligatoires dans l'attribut deviceTypeInformation.
fdt:semanticId fdt:applicationDomain	Les SemanticID suivent les différents modèles de dispositifs définis pour les dispositifs CP 3/4, CP 3/5 et CP 3/6 de la CEI 61784. Le FDT supporte actuellement les modèles suivants: <ul style="list-style-type: none"><li>• Profinet IO</li><li>• PROFIdrive</li></ul> <b>PROFINET IO</b> L'applicationDomain (domaine d'application) est: FDT_PROFINET_IO Le semanticId suit les informations d'accès d'une demande de communication: Le semanticId est: Api.Slot.Subslot.Index.ByteOffset.BitOffset.BitLength Api – Numéro Api Slot – Numéro de baie Subslot – Numéro de sous-baies Index – Numéro d'index

Attribut	Description pour une utilisation dans CP 3/4, CP 3/5 et CP 3/6 de la CEI 61784
	<p>ByteOffset – Octet de départ au sein de l'Index      BitOffset – Bit de départ au sein de l'Index (plage 0-7)      BitLength – Longueur des valeurs en bits      Ces valeurs sont des nombres basés sur le format décimal sans '0' de tête.</p> <p><b>PROFIdrive</b>      L'applicationDomain est: FDT_PROFINET_PROFIDRIVE      Selon le profil PROFIdrive, un dispositif (unité de commande) peut être composé d'un certain nombre (1 à plusieurs) d'objets de commande (DO). Les DO («Drive object») peuvent être de différents types. Chaque DO est proprement identifiable et gère ses propres paramètres. Chaque paramètre peut être proprement identifié par son numéro (PNU). Chaque DO possède un espace entre les nombres qui lui est propre.      Un paramètre peut comporter des données simples ou complexes (ex: matrices).      Les données relatives à un dispositif sont accessibles via une voie de paramètres (normalement Api 0x3A00, Sous-baie 1, Index 0xB02E et numéro d'emplacement correspondant au numéro de DO).      Le semanticId est: DOdo-id.PNUpnu      do-id Drive Object ID      pnu ParameterNumber      do-id, pnu sont basés sur le format décimal sans '0' de tête</p>

## 8 Types de données communs spécifiques à un protocole

Non applicable.

## 9 Types de données relatifs à la gestion du réseau

### 9.1 Généralités

Les types de données spécifiés dans ce paragraphe sont utilisés dans les services suivants:

- Service NetworkManagementInfoRead;
- Service NetworkManagementInfoWrite.

### 9.2 Types de données d'accès aux paramètres

Les types de données décrivent les informations relatives aux paramètres d'un dispositif CP 3/4, CP 3/5 et CP 3/6 de la CEI 61784 (voir Tableau 4 et Tableau 5)

**Tableau 4 – Types de données simples d'accès aux paramètres**

Type de données	Définition	Description
arType	UINT	ARType conformément à la spécification PROFINET Ne doit être fixé que par un Parent
arProperties	UDINT	ARProperties conformément à la spécification PROFINET Ne doit être fixé que par un Parent
arUUID	UUID	ARUUID conformément à la spécification PROFINET Ne doit être fixé que par un Parent
alarmCRTType	UINT	AlarmCRTType conformément à la spécification PROFINET Ne doit être fixé que par un Parent

Type de données	Définition	Description
alarmCRProperties	UDINT	AlarmCRProperties conformément à la spécification PROFINET Ne doit être fixé que par un Parent
rtaTimeoutFactor	UINT	RTATimeoutFactor conformément à la spécification PROFINET Ne doit être fixé que par un Parent
rtaRetries	UINT	RTARetries conformément à la spécification PROFINET Ne doit être fixé que par un Parent
localAlarmReference	UINT	LocalAlarmReference conformément à la spécification PROFINET Ne doit être fixé que par un Parent
maxAlarmDataLength	UINT	MaxAlarmDataLength conformément à la spécification PROFINET Ne doit être fixé que par un Parent
infoText	STRING	Informations textuelles supplémentaires Ne doit être fixé que par le DTM
localIndex	UINT	L'attribut utilisé au sein du Dispositif/Identification pour adresser l'instance du dispositif. Ne doit être fixé que par le DTM
nameOfStation	STRING	Le nom de la station est l'adresse principale. La valeur par défaut est le DNS_CompatibleName du GSDML. Le Parent doit configurer le nom de la station conformément aux règles définies par le DNS_CompatibleName. Ne doit être fixé que par un Parent sauf la valeur par défaut qui elle, doit être fixée par le DTM (durant InitNew)
dynIpAddress	BOOL	L'attribut indique si l'adresse IP est dynamiquement attribuée au dispositif. Ne doit être fixé que par un Parent
extAddrSupported	BOOL	L'attribution de l'adresse étendue (ex: par DHCP, BootP) est prise en charge par le Dispositif de Profinet IO. Ne doit être fixé que par le DTM
ipAddress	STRING	L'attribut comporte l'adresse IP attribuée au dispositif. L'adresse IP est une adresse secondaire. La valeur par défaut est "0.0.0.0". Ne doit être fixé que par un Parent
ipSubnetMask	STRING	L'attribut comporte le masque de sous-réseau. La valeur par défaut est "255.255.255.255". Ne doit être fixé que par un Parent
ipDefaultGateway	STRING	L'attribut comporte l'adresse de la passerelle par défaut. La valeur par défaut est une chaîne vide. Ne doit être fixé que par un Parent
macAddress	STRING	L'attribut contient l'adresse MAC du dispositif. L'adresse MAC est une adresse secondaire. L'attribut macAddress se présente sous forme d'une chaîne et doit être utilisé avec le format présenté dans l'exemple: Exemple: 00:A0:45:01:02:03 Ne doit être fixé que par un Parent
slotNumber	UINT	L'adresse des emplacements utilisée par le module Doit être fixé par le DTM durant la configuration. Peut être fixé par un Parent durant le balayage topologique
moduleIdentNumber	UDINT	Le ModuleIdentNumber conformément à la spécification PROFINET Doit être fixé par le DTM durant la configuration. Peut être fixé par un Parent durant le balayage topologique
moduleProperties	UINT	Cet attribut est réservé à une utilisation ultérieure conformément à la spécification PROFINET

Type de données	Définition	Description
subSlotNumber	UINT	L'adresse des sous-baies utilisée par le sous-module Doit être fixé par le DTM durant la configuration. Peut être fixé par un Parent durant le balayage topologique
subModuleIdentNumber	UDINT	Le SubmoduleIdentNumber conformément à la spécification PROFINET. Doit être fixé par le DTM durant la configuration. Peut être fixé par un Parent durant le balayage topologique
ioType	enumeration (Input   Output   InputAndOutput )	Les valeurs autorisées sont: Input, Output, InputAndOutput. Les Valeurs et leur signification conformément à la spécification PROFINET - SubmoduleProperties.Type. Doit être fixé par le DTM durant la configuration. Peut être fixé par un Parent durant le balayage topologique
sharedInput	enumeration (IOController   IOControllerShare )	Les valeurs autorisées sont: IOController, IOControllerShare. Les valeurs et leur signification conformément à la spécification PROFINET - SubmoduleProperties.SharedInput. Doit être fixé par le DTM durant la configuration. Peut être fixé par un Parent durant le balayage topologique
reduceInputSubmoduleDataLength	enumeration (Expected   Zero )	Les valeurs autorisées sont: Expected, Zero. Les valeurs et leur signification conformément à la spécification PROFINET - SubmoduleProperties.ReduceInputSubmoduleDataLength. Doit être fixé par le DTM durant la configuration. Peut être fixé par un Parent durant le balayage topologique
reduceOutputSubmoduleDataLength	enumeration (Expected   Zero )	Les valeurs autorisées sont: Expected, Zero. Les valeurs et leur signification conformément à la spécification PROFINET - SubmoduleProperties.ReduceOutputSubmoduleDataLength. Doit être fixé par le DTM durant la configuration. Peut être fixé par un Parent durant le balayage topologique
discardIOXS	enumeration (Expected   Zero )	Les valeurs autorisées sont: Expected, Zero. Les valeurs et leur signification conformément à la spécification PROFINET - SubmoduleProperties.DiscardIOXS. Doit être fixé par le DTM durant la configuration. Peut être fixé par un Parent durant le balayage topologique
api	UDINT	L'API conformément à la spécification PROFINET. Doit être fixé par le DTM durant la configuration. Peut être fixé par un Parent durant le balayage topologique
index	UINT	L'adresse de l'objet de données enregistrées souhaité. Ne doit être fixé que par le DTM
recordData	ARRAY OF USINT	Les données binaires qui seront envoyées au sous-module lors du démarrage ou de la connexion. Les données d'enregistrement comportent implicitement la longueur des données d'enregistrement. Ne doit être fixé que par le DTM
consistency	enumeration (itemConsistency   allItemsConsistency )	La cohérence des données d'entrée. Doit être fixé par le DTM durant la configuration
sendClockFactor	UINT	SendClockFactor conformément à la spécification PROFINET. Ne doit être fixé que par un Parent, si l'attribut appartient à l'élément SubModule. Ne doit être fixé que par le DTM, si l'attribut appartient à l'élément SendClockFactor

Type de données	Définition	Description
reductionRatio	UINT	ReductionRatio conformément à la spécification PROFINET. Ne doit être fixé que par un Parent, si l'attribut appartient à l'élément SubModule. Ne doit être fixé que par le DTM, si l'attribut appartient à l'élément ReductionRatio
watchdogFactor	UINT	WatchdogFactor conformément à la spécification PROFINET. Ne doit être fixé que par un Parent
dataHoldFactor	UINT	DataHoldFactor conformément à la spécification PROFINET. Ne doit être fixé que par un Parent

**Tableau 5 – Types de données structurés d'accès aux paramètres**

Type de données	Définition			Description
	Types de données élémentaires	U ti li sa ti o n	Multiplicité	
RecordParamData	STRUCT			Les données d'enregistrement qui seront envoyées au sous-module lors du démarrage ou de la connexion
	Index	M	[1..1]	
	RecordData	M	[1..1]	
	fdt:name	O	[0..1]	
RecordParamDataList	STRUCT			Liste des enregistrements qui sera envoyée au sous-module lors du démarrage ou de la connexion
	collection_of	M	[1..1]	
	RecordParamData		[1..*]	
OutputDataList	STRUCT			Liste des données de sortie fournies par un sous-module. La liste fait référence aux objets de la voie du FDT correspondants
	Consistency	O	[0..1]	
	fdt:ChannelReferences	M	[1..1]	
InputDataList	STRUCT			Liste des données d'entrée fournies par un sous-module. La liste fait référence aux objets de la voie du FDT correspondants
	Consistency	O	[0..1]	
	fdt:ChannelReferences	M	[1..1]	
SubModule	STRUCT			L'identification et la configuration d'un sous-module
	subSlotNumber	M	[1..1]	
	fdt:name	M	[1..1]	
	fdt:descriptor	O	[0..1]	
	subModuleIdentNumber	M	[1..1]	
	Api	M	[1..1]	
	sendClockFactor	M	[1..1]	
	reductionRatio	M	[1..1]	

Type de données	Définition			Description
	Type de données élémentaires	U ti li s a ti o n	Multiplicité	
	watchdogFactor	M	[1..1]	
	dataHoldFactor	M	[1..1]	
	InputDataList	O	[0..1]	
	OutputDataList	O	[0..1]	
	RecordParamDataList	O	[0..1]	
	SubModuleProperties	O	[0..1]	
SubModuleList	STRUCT			Liste des sous-modules attendus au sein d'un module
	collection of	M	[1..1]	
	SubModule		[1..*]	
SubModuleProperties	STRUCT			Le type de données définit le type de sous-module: NO_IO, INPUT, OUTPUT, IO conformément à la spécification PROFINET. Doit être fixé par le DTM durant la configuration. Peut être fixé par un Parent durant le balayage topologique
	IoType	M	[1..1]	
	sharedInput	M	[1..1]	
	reduceInput-SubmoduleDataLength	M	[1..1]	
	reduceOutput-SubmoduleDataLength	M	[1..1]	
	discardIOXS	M	[1..1]	
Module	STRUCT			L'identification et la configuration d'un module
	slotNumber	M	[1..1]	
	moduleIdentNumber	M	[1..1]	
	moduleProperties	M	[1..1]	
	fdt:name	M	[1..1]	
	fdt:descriptor	M	[1..1]	
	SubModuleList	M	[1..1]	
ModuleList	STRUCT			Liste des modules prévus au sein d'une relation d'applications
	collection of	M	[1..1]	
	Module		[1..*]	
AlarmCR	STRUCT			L'Alarme CR est gérée par le DTM de Communication, cependant les informations sont stockées au niveau du DTM du dispositif
	alarmCRTType	M	[1..1]	
	alarmCRProperties	M	[1..1]	
	rtaTimeoutFactor	M	[1..1]	
	rtaRetries	M	[1..1]	

IECNORM.COM - Click to view the full PDF online C 62453-303-2:2009

Type de données	Définition			Description
	Types de données élémentaires	U ti li sati on	Multiplicité	
	localAlarmReference	M	[1..1]	
	maxAlarmDataLength	M	[1..1]	
AR	STRUCT			La relation d'applications (AR) est gérée par le DTM de Communication, cependant les informations sont stockées au niveau du DTM du dispositif
	arType	M	[1..1]	
	arProperties	M	[1..1]	
	arUUID	M	[1..1]	
	AlarmCR	M	[1..1]	
	ModuleList	O	[0..1]	
TimingProperties	STRUCT			Le contenu de TimingProperties correspond à l'élément TimingProperties de GSDML. Le type de données fournit au type de dispositif des contraintes temporelles dont le Contrôleur E/S doit tenir compte.  TimingProperties et ses types de données doivent être fixés uniquement par le DTM. Le DTM du dispositif ne tient pas compte de l'élément durant l'exécution de la fonction IDtmParameter::SetParameters
	collection of	M	[1..1]	
	SendClockFactor	M	[1..*]	
	collection of	M	[1..1]	
	ReductionRatio	M	[1..*]	
ReductionRatio	STRUCT			ReductionRatio est requis afin de mettre en correspondance l'ensemble des valeurs de rapport de réduction prises en charge par le dispositif et décrites par l'attribut ReductionRatio de GSDML. L'attribut GSDML contient une liste de valeurs à mettre en correspondance avec plusieurs éléments ReductionRatio du schéma décrit ici.  Ce type de données représente les données relatives au type de dispositif qui doivent être fixées uniquement par le DTM. Ces informations sont utilisées par le parent pour la planification programmée de la communication
	reductionRatio	M	[1..1]	

Type de données	Définition			Description
	Types de données élémentaires	U ti li sa ti o n	Multiplicité	
SendClockFactor	STRUCT			<p>SendClockFactor est requis afin de mettre en correspondance l'ensemble des valeurs du facteur temps pour l'envoi. L'attribut GSDML contient une liste de valeurs à mettre en correspondance avec plusieurs éléments SendClockFactor du schéma décrit ici.</p> <p>Ce type de données représente les données relatives au type de dispositif qui doivent être fixées uniquement par le DTM. Ces informations sont utilisées par le parent pour la planification programmée de la communication</p>
	sendClockFactor	M	[1..1]	
Identification	STRUCT			L'identification d'un dispositif ou de l'instance d'un dispositif
	localIndex	M	[1..1]	
	fdt:deviceTypeId	M	[1..1]	
	fdt:manufacturerId	M	[1..1]	
	infoText	O	[0..1]	
	fdt:VersionInformation	O	[0..1]	
Device	STRUCT			Les paramètres d'un dispositif ou de l'instance d'un dispositif
	Identification	M	[1..1]	
	collection of	M	[1..1]	
	AR	M	[1..*]	
	TimingProperties	O	[0..1]	
Network	STRUCT			Les informations relatives à l'adresse du dispositif PROFINET
	nameOfStation	M	[1..1]	
	dynIpAddress	M	[1..1]	
	ipAddress	M	[1..1]	
	ipSubnetMask	M	[1..1]	
	ipDefaultGateway	M	[1..1]	
	extAddrSupported	M	[1..1]	
	macAddress	O	[0..1]	
DeviceList	STRUCT			La liste comporte les paramètres pour un seul dispositif. Si le DTM est responsable d'un dispositif hébergeant plusieurs instances de dispositif, la liste comportera les paramètres pour chacune des instances de dispositif
	Network	M	[1..1]	
	collection of	M	[1..1]	
	Device	M	[1..*]	

IECNORM.COM - Click to view the full PDF of IEC 62453-303-2:2009

## 10 Types de données de communication

Les types de données décrits dans cet article sont utilisés dans les services suivants:

- service connexion;
- service déconnexion;
- service transaction;
- service arrêt prématuré;
- SequenceBegin (début de séquence);
- SequenceEnd (fin de séquence);
- SequenceStart (démarrage de séquence).

Les arguments des services comportent les informations relatives à l'adresse ainsi que les données de communication (présentées dans le Tableau 6 et Tableau 7)

Les types de données décrits dans cet article sont définis pour l'espace de noms suivant.  
Espace de noms: fdtprofinet

**Tableau 6 – Types de données simples de communication**

Type de données	Définition	Description
api	UDINT	Informations relatives à l'adresse conformément à la spécification PROFINET
nameOfStation	STRING	Informations relatives à l'adresse conformément à la spécification PROFINET
localIndex	UINT	Informations relatives à l'adresse conformément à la spécification PROFINET
errorDecode	USINT	Informations relatives au statut conformément à la spécification PROFINET
errorCode1	UINT	Informations relatives au statut conformément à la spécification PROFINET
errorCode2	USINT	Informations relatives au statut conformément à la spécification PROFINET
index	UINT	Informations relatives à l'adresse conformément à la spécification PROFINET
communicationReference	UUID	Identificateur obligatoire pour une liaison de communication à un dispositif. Cet identificateur est affecté par le composant de communication lors de la connexion. Les informations relatives à l'adresse doivent être utilisées pour l'ensemble des appels de communication suivants
slot	UINT	Informations relatives à l'adresse conformément à la spécification PROFINET
subSlot	UINT	Informations relatives à l'adresse conformément à la spécification PROFINET
addData1	UINT	Informations relatives à l'adresse conformément à la spécification PROFINET
addData2	UINT	Informations relatives à l'adresse conformément à la spécification PROFINET
length	UDINT	Longueur maximale des données de communication pour la demande de lecture
readOnly	BOOL	Seule la prise en charge de la lecture est requise sur cette connexion.  Le CommunicationChannel (voie de communication) peut utiliser ces informations pour une gestion optimisée de la connexion. Ex: utilisation de AR implicites

Type de données	Définition	Description	
sequenceTime	UDINT	Durée autorisée en [ms] pour l'ensemble de la séquence. Peut être fixé par le DTM en début de séquence	
delayTime	UDINT	Délai minimal en [ms] entre deux appels de communication	
systemTag	STRING	Marqueur Système d'un DTM	

**Tableau 7 – Types de données structurés de communication**

Type de données	Définition			Description
	Types de données élémentaires	U t il i s a t i o n	Multiplicité	
Abort	STRUCT			Décrit l'arrêt prématuré
	communicationReference	M	[1..1]	
CancelTransaction	STRUCT			Décrit la transaction spécifique pour annuler une transaction en cours.  La fonction TransactionRequest est appelée avec le même argument "invokeld" que la demande de transaction en cours.  Si la demande de CancelTransaction (d'annulation de la transaction) est acceptée par la voie de Communication, la fonction TransactionRequest (demande de transaction) passe sur TRUE (VRAI).  Lorsque aucune transaction n'a été envoyée avec le invokeld donné, la fonction TransactionRequest passe alors sur FALSE (FAUX).  Aucune OnTransactionResponse (réponse positive pour la transaction) ne peut être attendue pour les demandes précédentes en cours et pour les demandes de CancelTransaction (annulation de la transaction) avec le invokeld spécifié.  Lorsqu'une OnTransactionResponse (réponse positive pour la transaction) conforme pour un invokeld donné a déjà été donnée, la fonction TransactionRequest passe alors sur FALSE (FAUX)
	communicationReference	M	[1..1]	
ConnectRequest	STRUCT			Décrit la demande de communication pour établir une connexion
	nameOfStation	M	[1..1]	
	fdt:manufacturerId	M	[1..1]	
	fdt:deviceTypeld	M	[1..1]	
	localIndex	M	[1..1]	
	systemTag	M	[1..1]	
	readOnly	O	[0..1]	

IECNORM.COM : Click to view the full PDF of IEC 62453-303-2:2009

Type de données	Définition			Description
	Types de données élémentaires	U t il i s a t i o n	Multiplicité	
ConnectResponse	STRUCT			Décrit la réponse de communication à une demande de connexion
	communicationReference	M	[1..1]	
	addData1	O	[0..1]	
	addData2	O	[0..1]	
DisconnectRequest	STRUCT			Décrit la demande de communication pour libérer une connexion
	communicationReference	M	[1..1]	
DisconnectResponse	STRUCT			Décrit la réponse de communication à une demande de déconnexion
	communicationReference	M	[1..1]	
	addData1	O	[0..1]	
	addData2	O	[0..1]	
ReadRequest	STRUCT			Décrit la demande de communication conformément à la spécification PROFINET
	communicationReference	M	[1..1]	
	Api	M	[1..1]	
	Slot	M	[1..1]	
	subSlot	M	[1..1]	
	index	M	[1..1]	
	length	O	[0..1]	
ReadResponse	STRUCT			Décrit la réponse de communication à une demande de lecture conformément à la spécification PROFINET
	communicationReference	M	[1..1]	
	addData1	O	[0..1]	
	addData2	O	[0..1]	
	ResponseError	O	[0..1]	
	fdt:CommunicationData	M	[1..1]	
ResponseError	STRUCT			Décrit l'erreur de communication spécifique à PROFINET
	errorDecode	M	[1..1]	
	errorCode1	M	[1..1]	
	errorCode2	M	[1..1]	
WriteRequest	STRUCT			Décrit la demande de communication conformément à la spécification PROFINET
	communicationReference	M	[1..1]	
	Api	M	[1..1]	
	Slot	M	[1..1]	

IECNORM.COM - Click to view the full PDF of IEC 62453-303-2:2009

Type de données	Définition			Description
	Types de données élémentaires	U t il i s a t i o n	Multiplicité	
	subSlot	M	[1..1]	
	index	M	[1..1]	
	fdt:CommunicationData	M	[1..1]	
WriteResponse	STRUCT			Décrit la réponse de communication à une demande d'écriture conformément à la spécification PROFINET
	communicationReference	M	[1..1]	
	addData1	O	[0..1]	
	addData2	O	[0..1]	
	ResponseError	O	[0..1]	
SequenceBegin	STRUCT			Décrit le début de la séquence
	sequenceTime	O	[0..1]	
	delayTime	O	[0..1]	
	communicationReference	M	[1..1]	
SequenceEnd	STRUCT			Décrit la fin de la séquence
	communicationReference	M	[1..1]	
SequenceStart	STRUCT			Décrit le démarrage de la séquence
	communicationReference	M	[1..1]	

### Gestion des erreurs durant la connexion et la déconnexion

Si une erreur survient durant une demande de connexion ou de déconnexion de PROFINET, la voie de Communication doit retourner un fdt:CommunicationError. Le codage de l'erreur doit être effectué dans l'attribut fdt:errorCode. Le fdt:errorCode doit comporter les informations relatives à l'erreur PROFINET “ErrorDecode”, “ErrorCode1”, “ErrorCode2” exactement dans cet ordre.

## 11 Types de données relatifs aux paramètres des voies

Un DTM choisit ou non de fournir des voies. Si un DTM autorise, à une Application cadre, à d'autres DTM, ou à un contrôleur, l'accès direct à ses valeurs de processus via le protocole PROFINET, il convient qu'il fournit des objets de voie comme décrit dans cet article. Seule une description complète de l'ensemble des voies appartenant à une valeur de processus PROFINET permet un accès aux applications externes.

La description des voies, spécialement des valeurs de processus, permet à l'Application cadre de prendre en charge le dispositif le mieux possible.

Un DTM doit fournir l'ensemble des voies y compris les voies IOPS et IOCS. L'ensemble des voies exposées par le DTM constitue la structure complète de données IO. Le schéma des voies convient aux échanges de données cycliques et acycliques. La différence repose sur l'utilisation de types de données IODataAddress ou RecordDataAddress.

Les types de données sont utilisés dans les services GetChannelParameters et SetChannelParameters.

Les informations retournées par le service GetChannelParameters exposent la manière d'accéder à une valeur E/S via le protocole PROFINET (voir Tableau 8 et Tableau 9).

Les types de données décrits dans cet article sont définis pour l'espace de noms suivant.  
Espace de noms: pniochannel

**Tableau 8 – Types de données simples pour les paramètres des voies**

Type de données	Définition	Description
Api	UDINT	Ce type de données appartient aux types de données de l'adresse de la voie conformément à la spécification PROFINET pour les voies accessibles via PROFINET. La valeur api est fixée par le contrôleur PROFINET lors de l'attribution de la voie
bitLength	UDINT	Ce type de données précise le nombre de bits utilisé pour un signal E/S spécifique pouvant être une "bitArea"
bitOffset	UDINT	Informations relatives à l'adresse permettant d'accéder aux valeurs de signal E/S simple dans un "DataItem" au sein de données communiquées de manière cyclique. Le type de données peut également spécifier l'adresse d'un paramètre échangé de manière acyclique (ParameterRecord-DataItem/ Ref) conformément à la spécification GSDML
byteOffset	UDINT	Le type de données spécifie l'adresse d'un paramètre échangé de manière acyclique (ParameterRecordDataItem/ Ref) conformément à la spécification GSDML
frameApplicationTag	STRING	Marqueur spécifique à l'Application cadre utilisé pour l'identification et la navigation. Il convient que le DTM affiche ce marqueur au niveau des interfaces de la voie spécifiques à chaque utilisateur
gatewayBusCategory	UUID	L'unique identificateur pour un type de bus pris en charge tel que PROFINET conformément au CATID spécifique au FDT
index	UINT	Informations relatives à l'adresse conformément à la spécification PROFINET pour accéder aux paramètres via le service communication lecture / écriture acyclique
number	UDINT	Le type de données représente le numéro de la voie conformément à la spécification PROFINET. Les informations relatives à l'adresse sont utilisées pour accéder aux données E/S et pour le diagnostic conformément à la spécification Profinet pour les voies accessibles via le message d'alarme Profinet. L'attribut est fixé par le DTM durant la configuration du dispositif
protectedByChannelAssignment	BOOL	TRUE (VRAI) si la voie est réglée afin de n'être lue que par l'Application cadre. Généralement réglée sur TRUE si l'attribution de la voie existe
statusChannelType	enumeration ( IOCS   IOPS )	Valeurs autorisées IOCS et IOPS
slotNumber	UINT	Informations relatives à l'adresse conformément à la spécification PROFINET pour les voies accessibles via le service communication cyclique et acyclique
subSlotNumber	UINT	Informations relatives à l'adresse conformément à la spécification PROFINET pour les voies accessibles via le service communication cyclique et acyclique