

NFPA®

257

Standard on
Fire Test for Window and
Glass Block Assemblies

2022



NFPA[®] 257

Standard on Fire Test for Window and Glass Block Assemblies

2022 Edition



NFPA, 1 Batterymarch Park, Quincy, MA 02169-7471
An International Codes and Standards Organization

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS




NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

REVISION SYMBOLS IDENTIFYING CHANGES FROM THE PREVIOUS EDITION

Text revisions are shaded. A  before a section number indicates that words within that section were deleted and a  to the left of a table or figure number indicates a revision to an existing table or figure. When a chapter was heavily revised, the entire chapter is marked throughout with the  symbol. Where one or more sections were deleted, a • is placed between the remaining sections. Chapters, annexes, sections, figures, and tables that are new are indicated with an **N**.

Note that these indicators are a guide. Rearrangement of sections may not be captured in the markup, but users can view complete revision details in the First and Second Draft Reports located in the archived revision information section of each code at www.nfpa.org/docinfo. Any subsequent changes from the NFPA Technical Meeting, Tentative Interim Amendments, and Errata are also located there.

REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

ADDITIONAL IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org.

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/docinfo.

Copyright © 2021 National Fire Protection Association®. All Rights Reserved.

NFPA® 257

Standard on

Fire Test for Window and Glass Block Assemblies

2022 Edition

This edition of NFPA 257, *Standard on Fire Test for Window and Glass Block Assemblies*, was prepared by the Technical Committee on Fire Tests. It was issued by the Standards Council on May 15, 2021, with an effective date of June 4, 2021, and supersedes all previous editions.

This edition of NFPA 257 was approved as an American National Standard on June 4, 2021.

Origin and Development of NFPA 257

NFPA 257 was tentatively adopted by NFPA in 1969 and officially adopted in 1970. Subsequent revisions were released in 1975, 1980, 1985, and 1990.

The 1996 edition of NFPA 257 was a complete rewrite that included editorial and technical revisions. Many of those revisions were made to parallel those of NFPA 252, *Standard Methods of Fire Tests of Door Assemblies*. The technical revisions included modifications to the furnace pressure. The neutral pressure was eliminated so that the test assembly could be tested to the pressure required by other code requirements (i.e., NFPA 101, *Life Safety Code*, and the model building codes). In addition, the duration of the test method was extended beyond the 45 minutes required in previous editions to allow for the testing of new glazing materials.

The 2000 edition was completely revised for the purposes of consistency and editorial reformatting. It was modified so that the test protocols and equipment used would be more consistent with the provisions in NFPA 251, *Standard Method of Tests of Fire Endurance of Building Construction and Materials*, and NFPA 252, *Standard Method of Fire Tests of Door Assemblies*. This edition recognized the positive pressure testing required by some of the model building codes and also provided greater clarification on how to conduct the hose stream test to achieve greater repeatability and reproducibility.

The 2007 edition was a complete revision for compliance with the *Manual of Style for NFPA Technical Committee Documents*. It also contained revisions to its scope and purpose provisions to clarify the committee's intent, and it contained a new reference to ASTM E2226, *Standard Practice for Application of Hose Stream*, for details on conducting the hose stream test.

The 2012 edition was revised to require that all tests be run under positive pressure.

The 2017 edition included a new time-temperature curve. The allowed time between the test and the hose stream test was reduced, and a new reference for the hose stream test procedure was added.

The 2022 edition is a reaffirmation of the previous edition with minor reference updates.

Technical Committee on Fire Tests

Barry L. Badders, Jr., Chair
Intertek Testing Services, TX [RT]

Benjamin H. Caldwell, Bjarke Ingels Group (BIG), NY [SE]
Karen C. Carpenter, Southwest Research Institute, TX [RT]
Soph R. Davenberry, National Energy Management Institute Committee (NEMIC), VA [L]
Rick D. Davis, National Institute of Standards & Technology (NIST), MD [RT]
Scott E. Dillon, Crane Engineering, MN [SE]
William E. Fitch, Phyrefish.com, FL [SE]
Richard G. Gann, Gaithersburg, MD [SE]
Marcelo M. Hirschler, GBH International, CA [SE]
Paul A. Hough, Armstrong World Industries, Inc., PA [M]
William E. Koffel, Koffel Associates, Inc., MD [SE]
Sergei V. Levchik, Israel Chemicals Ltd. (ICL-IP), NY [M]
 Rep. ACC-North American Flame Retardant Alliance
Michael E. Luna, ICC NTA, LLC., TX [RT]
James Andrew Lynch, The Fire Solutions Group, PA [SE]
John Martell, Professional Fire Fighters of Maine/IAFF, ME [L]
 Rep. International Association of Fire Fighters

Rodney A. McPhee, Canadian Wood Council, Canada [M]
Kathleen A. Newman, Firetect, CA [M]
Nicholas Ozog, Wiss, Janney, Elstner Associates, Inc., IL [SE]
Arthur J. Parker, JENSEN HUGHES, MD [SE]
Bill Perdue, American Home Furnishings Alliance -AHFA, NC [U]
Shamim Rashid-Sumar, National Ready Mixed Concrete Assn., NY [M]
Michael L. Savage, Sr., Marion County Building Safety, FL [E]
Michael Schmeida, Gypsum Association, OH [M]
David T. Sheppard, US Bureau of Alcohol, Tobacco, Firearms & Explosives, MD [RT]
Dwayne Sloan, UL LLC, NC [RT]
Kuma Sumathipala, American Wood Council, VA [M]
Robert J. Wills, American Iron and Steel Institute, AL [M]
Peter J. Willse, AXA XL/Global Asset Protection Services, LLC, CT [I]
Dong Zeng, FM Global, MA [I]
 Rep. FM Global

Alternates

Marc Alam, Canadian Wood Council, Canada [M]
 (Alt. to Rodney A. McPhee)
Richard J. Davis, FM Global, MA [I]
 (Alt. to Dong Zeng)
Timothy Earl, GBH International, MI [SE]
 (Alt. to Marcelo M. Hirschler)
Stephen Paul Fuss, US Bureau of Alcohol, Tobacco, Firearms & Explosives, MD [RT]
 (Alt. to David T. Sheppard)
Justin A. Geiman, Fire and Risk Alliance LLC, MD [SE]
 (Alt. to James Andrew Lynch)
Karl Dana Houser, Intertek, PA [RT]
 (Alt. to Barry L. Badders, Jr.)
Jonathan Humble, American Iron and Steel Institute, CT [M]
 (Alt. to Robert J. Wills)

Marc L. Janssens, Southwest Research Institute, TX [RT]
 (Alt. to Karen C. Carpenter)
Elizabeth C. Keller, Engineering Systems, Inc., NC [SE]
 (Alt. to Scott E. Dillon)
Cori Leffler, Firetect, CA [M]
 (Alt. to Kathleen A. Newman)
Daniel A. Martin, JENSEN HUGHES, MD [SE]
 (Alt. to Arthur J. Parker)
Jason V. Smart, American Wood Council (AWC), VA [M]
 (Alt. to Kuma Sumathipala)
Matthew T. Vinci, International Association of Fire Fighters, DC [L]
 (Alt. to John Martell)
Luke C. Woods, UL LLC, MA [RT]
 (Alt. to Dwayne Sloan)

Nonvoting

Robert H. Barker, American Fiber Manufacturers Association, VA [M]
Rohit “Rik” Khanna, US Consumer Product Safety Commission (CPSC), MD [C]
 Rep. US Consumer Product Safety Commission
Tracy L. Vecchiarelli, NFPA Staff Liaison

Andrew Lock, US Consumer Product Safety Commission, MD [C]
 Rep. US Consumer Product Safety Commission

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on fire testing procedures, for reviewing existing fire test standards and recommending appropriate action to NFPA, for recommending the application of and advising on the interpretation of acceptable test standards for fire problems of concern to NFPA technical committees and members, and for acting in a liaison capacity between NFPA and the committees of other organizations writing fire test standards. This Committee does not cover fire tests that are used to evaluate extinguishing agents, devices, or systems.

Contents

Chapter 1 Administration	257- 4	5.2 Mounting.	257- 7
1.1 Scope.	257- 4	5.3 Test Wall.	257- 7
1.2 Purpose.	257- 4		
1.3 Units.	257- 4	Chapter 6 Conduct of Tests	257- 7
Chapter 2 Referenced Publications	257- 4	6.1 Fire Test.	257- 7
2.1 General.	257- 4	6.2 Hose Stream Test.	257- 7
2.2 NFPA Publications. (Reserved)	257- 4		
2.3 Other Publications.	257- 4	Chapter 7 Performance Criteria	257- 8
2.4 References for Extracts in Mandatory Sections.	257- 5	7.1 Fire Test.	257- 8
		7.2 Hose Stream Test.	257- 8
Chapter 3 Definitions	257- 5	Chapter 8 Report	257- 8
3.1 General.	257- 5	8.1 Results.	257- 8
3.2 NFPA Official Definitions.	257- 5		
3.3 General Definitions.	257- 5	Annex A Explanatory Material	257- 9
Chapter 4 Control of Fire Test	257- 5	Annex B Background and Development	257- 9
4.1 Temperature–Time Curve.	257- 5	Annex C Radiant and Total Heat Flux	257- 12
4.2 Furnace Temperatures.	257- 5	Annex D Informational References	257- 13
4.3 Furnace Pressure.	257- 6	Index	257- 14
Chapter 5 Fire Window Assembly	257- 7		
5.1 Construction and Size.	257- 7		

NFPA 257

Standard on

Fire Test for Window and Glass Block Assemblies

2022 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading “Important Notices and Disclaimers Concerning NFPA Standards.” They can also be viewed at www.nfpa.org/disclaimers or obtained on request from NFPA.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with all TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by TIAs or Errata, please consult the National Fire Codes® Subscription Service or the “List of NFPA Codes & Standards” at www.nfpa.org/docinfo. In addition to TIAs and Errata, the document information pages also include the option to sign up for alerts for individual documents and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced and extracted publications can be found in Chapter 2 and Annex D.

Chapter 1 Administration

1.1 Scope.

1.1.1 This standard prescribes standardized fire and hose stream test procedures that apply to the evaluation of fire window assemblies, including windows, glass block, and other light-transmitting assemblies intended to retard the spread of fire through openings in fire resistance-rated walls.

1.1.2 This standard is not to be construed as determining the suitability of fire window assemblies for continued use after fire exposure.

1.1.3 This standard provides a standardized method for comparing the performance of fire window assemblies.

1.2* Purpose.

1.2.1 This standard prescribes specific standardized fire and hose stream test procedures for determining the fire protection rating of window assemblies, glass block, and other light-transmitting assemblies used in openings in fire resistance-rated walls.

1.2.2 This standard provides a means for evaluating the ability of a window, glass block, or other light-transmitting assemblies to remain in a wall opening during a prescribed fire test exposure, followed by the application of a hose stream.

1.2.3 Tests made in conformity with this standard register performance and develop data that enable regulatory bodies to determine the suitability of fire window assemblies for use in wall openings where fire protection ratings are required.

1.2.4* The tests described herein expose a specimen to a standard fire exposure that is controlled to achieve specified temperatures throughout a specified time period, which then is followed by the application of a specified standard hose stream.

1.2.5 Variations from or changes in the construction or conditions of the window assembly as tested can affect the performance characteristics of the fire window assembly.

1.2.6 The standard permits through-openings created by cracking, separation, or loss of glazing material, provided such openings do not exceed specified limits.

1.2.7 This standard does not provide the following:

- (1) Full information regarding the performance of a specific fire window assembly where installed in walls constructed of materials other than those tested
- (2) Evaluation of the degree to which the fire window assembly contributes to the fire hazard by generation of heat and other products of combustion
- (3) Measurement of the fire window assembly's ability to control or limit the passage of smoke through the assembly

1.3 Units. The International System of Units (SI) value for a measurement and the U.S. customary unit value given in parentheses are acceptable for use as the primary units for satisfying the requirements of this standard.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

2.2 NFPA Publications. (Reserved)

2.3 Other Publications.

2.3.1 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM E2226, *Standard Practice for Application of Hose Stream*, 2015b (2019).

2.3.2 Other Publications.

Merriam-Webster's Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections.

NFPA 80, *Standard for Fire Doors and Other Opening Protectives*, 2019 edition.

NFPA 101®, *Life Safety Code*®, 2021 edition.

NFPA 221, *Standard for High Challenge Fire Walls, Fire Walls, and Fire Barrier Walls*, 2021 edition.

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1 Shall. Indicates a mandatory requirement.

3.2.2 Should. Indicates a recommendation or that which is advised but not required.

3.2.3 Standard. An NFPA Standard, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA Manuals of Style. When used in a generic sense, such as in the phrase “standards development process” or “standards development activities,” the term “standards” includes all NFPA Standards, including Codes, Standards, Recommended Practices, and Guides.

3.3 General Definitions.

3.3.1 Assembly.

3.3.1.1* Fire Window Assembly. A window or glass block assembly having a fire protection rating. [80, 2019]

3.3.1.2 Glass Block Assembly. A light-transmitting assembly constructed of glass block held together with mortar or other suitable materials.

3.3.1.3* Window Assembly. An integral, fabricated unit that contains a glazed light(s) placed in an opening in a wall and that is intended primarily for the transmission of light or of light and air and not primarily for human entrance or exit.

N 3.3.2* Fire Protection Rating. The designation indicating the duration of the fire test exposure to which an opening protective assembly was exposed. [221, 2021]

N 3.3.3* Fire Resistance Rating. The time, in minutes or hours, that materials or assemblies have withstood a fire exposure as determined by the tests, or methods based on tests, prescribed by NFPA 101. [101, 2021]

3.3.4 Fire Window Assembly. See 3.3.1.1.

3.3.5 Glass Block Assembly. See 3.3.1.2.

3.3.6 Glazed Light. A pane of glazing material that is separated by muntins and mullions from adjacent panes of glazing material in a fire window assembly.

3.3.7* Glazing Material. A transparent or translucent material used in fire door assemblies and fire windows.

3.3.8 Opening. For the purpose of this standard, a through-hole in the fire window assembly that can be seen from the unexposed side while looking through the plane of the assembly from a perpendicular position.

3.3.9 Window Assembly. See 3.3.1.3.

Chapter 4 Control of Fire Test

4.1 Temperature–Time Curve.

4.1.1 The temperature inside the furnace to which the test assemblies are exposed during the fire test shall be controlled to conform to the standard temperature–time curve shown in Figure 4.1.1 for the duration of the fire test, with the points that determine the curve specified beneath the graph in Figure 4.1.1.

4.1.2 At the start of the fire test, the ambient laboratory air temperature shall be in the range between 10°C and 32°C (50°F and 90°F).

4.2 Furnace Temperatures.

4.2.1 The temperature of the furnace shall be determined by the average temperature obtained from the readings of not less than nine thermocouples symmetrically disposed and distributed within the furnace to measure the temperature near all parts of the fire window assembly.

4.2.1.1 The thermocouples shall be protected by sealed porcelain tubes with a 19 mm (¾ in.) outside diameter and a 3 mm (⅛ in.) wall thickness.

4.2.1.2 Base-metal thermocouples shall be protected by one of the following:

- (1) Sealed 13 mm (½ in.) nominal diameter wrought-steel or wrought-iron pipe of standard weight
- (2) Enclosure in protective tubes of materials and dimensions such that the time constant of the protected thermocouple assembly is 5 minutes to 7.2 minutes

4.2.1.3 The exposed length of the thermocouple protection tube in the furnace chamber shall be not less than 305 mm (12 in.).

4.2.1.4 The junction of the thermocouples shall be 152 mm (6 in.) from the exposed face of the fire window assembly or from the test wall in which the assembly is installed.

4.2.2 The furnace temperature shall be measured and recorded during the fire test at intervals not exceeding 1 minute.

4.2.3 The furnace temperature shall be controlled so that the area under the temperature–time curve, obtained by averaging the results from the temperature readings specified in 4.2.1, is as follows:

- (1) Within 10 percent of the corresponding area under the standard temperature–time curve shown in Figure 4.1.1 for fire tests of 1 hour or less
- (2) Within 7.5 percent of the corresponding area under the standard temperature–time curve for tests longer than 1 hour but not longer than 2 hours
- (3) Within 5 percent of the corresponding area under the standard temperature–time curve for tests longer than 2 hours

4.3 Furnace Pressure.

4.3.1 Vertical Pressure. The vertical pressure distribution within the furnace shall be measured and controlled in accordance with 4.3.1.1 through 4.3.1.6.

4.3.1.1 The vertical pressure distribution within the furnace shall be measured by at least two pressure-sensing probes separated by a minimum vertical distance of 1830 mm (6 ft) inside the furnace.

4.3.1.2 The pressure-sensing probes shall be as shown in either Figure 4.3.1.2(a) or Figure 4.3.1.2(b).

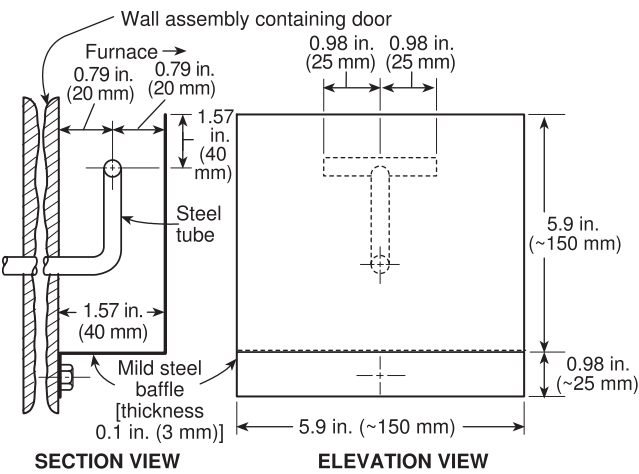


FIGURE 4.3.1.2(a) Static Pressure-Measuring Device Dimensions.

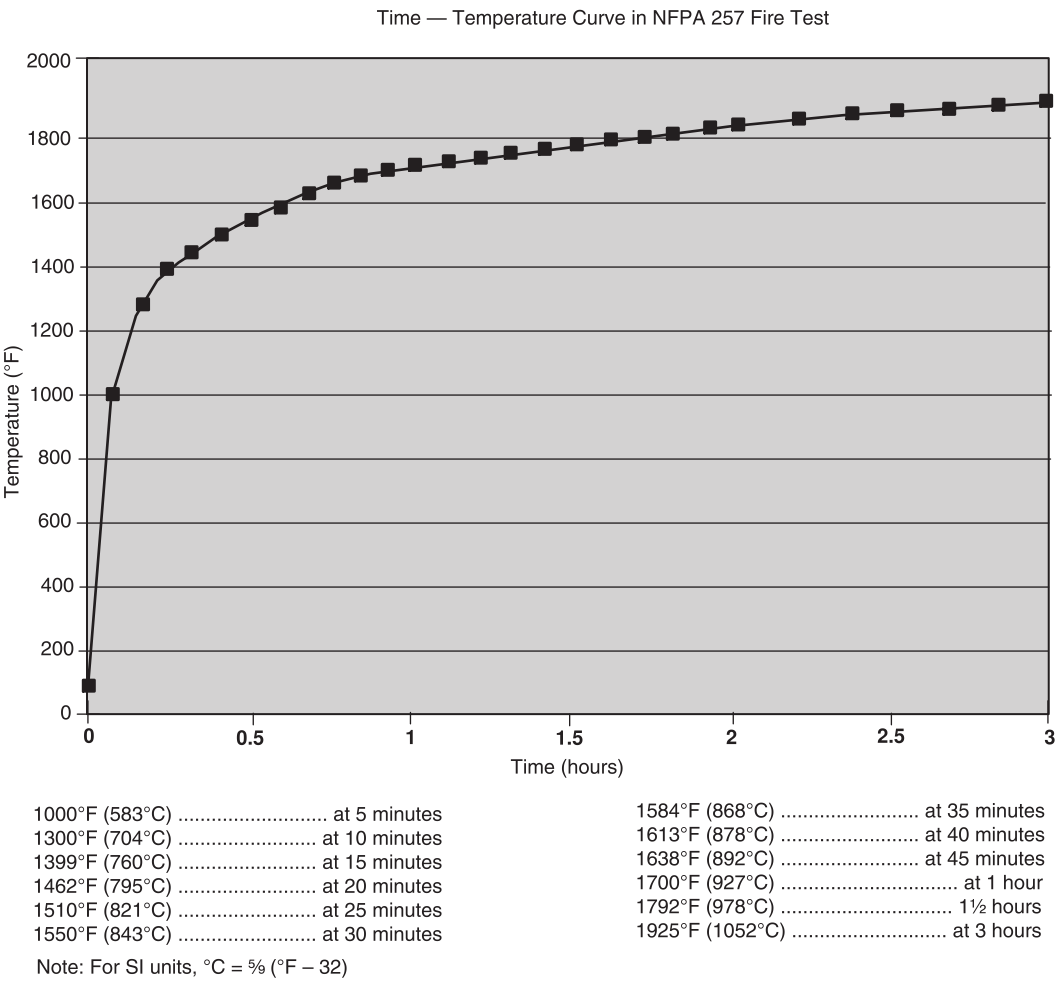


FIGURE 4.1.1 Temperature–Time Curve.

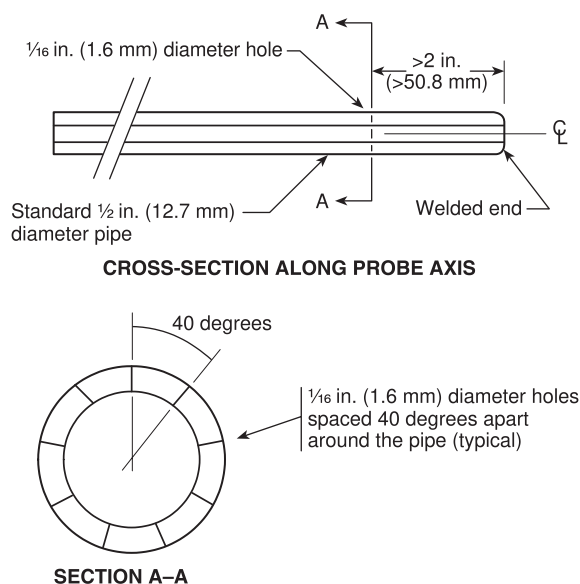


FIGURE 4.3.1.2(b) Pressure Probe.

4.3.1.3 The pressure-sensing probes shall be located within 152 mm (6 in.) of the vertical centerline of the furnace opening.

4.3.1.4 The pressure at each location shall be measured using a differential pressure instrument capable of reading in increments no larger than 2.5 Pa (0.01 in. wg) with a precision of not more than ± 1.25 Pa (± 0.005 in. wg).

4.3.1.5 The differential pressure measurement instrument shall be located so as to minimize stack effects caused by vertical runs of pressure tubing between the pressure-sensing probes and the differential pressure measurement instrument locations.

4.3.1.6 Based on the vertical separation and pressure differences between the two pressure-sensing probes, a calculation of the neutral plane [0 (zero) differential pressure] location shall be made.

4.3.2 Maintenance of Pressure. Control of the furnace pressure shall be established beginning no later than 5 minutes after the start of the test and shall be maintained throughout the remainder of the fire test period.

4.3.3 Positive Pressure. The fire test shall be conducted under positive pressure, and the neutral pressure plane in the furnace shall be established such that at least two-thirds of the height of the fire window assembly is located above the neutral pressure plane.

4.3.4 Measurement of Pressure. The furnace pressure shall be measured and recorded throughout the fire test period at intervals not exceeding 1 minute.

Chapter 5 Fire Window Assembly

5.1 Construction and Size.

5.1.1 The design, construction, material, workmanship, hardware, and size of the fire window assembly shall represent those for which a fire protection rating is desired.

5.1.2 A record of materials and construction details shall be kept for the purpose of identification.

5.1.3 The area of the fire window assembly shall be not less than 9.3 m² (100 ft²), with no dimension less than 2745 mm (9 ft).

5.1.4 When the conditions of use limit the construction to smaller dimensions, a proportionate reduction shall be permitted to be made in the dimensions of the tests used to qualify the fire window assemblies for such restricted use.

5.2 Mounting.

5.2.1 The fire window assembly shall be installed in the wall or partition construction in the manner in which it is to be used.

5.2.2 The fire window assembly shall be mounted so that the latches and fasteners, other than hinges, are on the unexposed side, and the mounting shall not prevent the free, unrestricted operation of all operable components such as ventilators and sashes.

5.3 Test Wall.

5.3.1 The test wall or partition in which the fire window assembly is mounted and tested shall have the strength and fire resistance to retain the assembly throughout the fire and hose stream tests.

5.3.2 The wall or partition shall be constructed of materials representative of the wall or partition construction in which the fire window assembly is intended to be installed.

Chapter 6 Conduct of Tests

6.1 Fire Test.

6.1.1 Duration. The test shall be conducted until the desired fire protection rating period is reached or until failure to meet any of the performance criteria specified in Chapter 7 occurs.

6.1.2 Furnace Heat Flux. Where required, procedures for measuring the total heat flux (convective and radiative) and the radiative heat flux within the furnace shall be provided. (See Annex C.)

6.1.3 Unexposed Surface Radiation. Where required, procedures for measuring the radiant heat flux from the unexposed face of the fire window assembly shall be provided. (See Annex C.)

6.2 Hose Stream Test.

6.2.1 Within 2 minutes of completion of the fire test, the fire-exposed side of the fire window assembly shall be subjected to a standard hose stream test as described in ASTM E2226, *Standard Practice for Application of Hose Stream*.

6.2.2 The minimum water pressure at the base of the play pipe during the hose stream test shall be as specified in Table 6.2.2.

6.2.3 The hose stream shall be applied over the exposed area of the fire window assembly in accordance with the criteria specified in Table 6.2.2.

6.2.4* The exposed area of the fire window assembly shall be calculated using the outside dimensions of the fire window assembly, including the frames.

Table 6.2.2 Water Pressure at Base of Play Pipe and Duration of Application for Hose Stream

Desired Rating	Water Pressure at Base of Play Pipe		Duration of Application for Exposed Area	
	psi	kPa	sec/ft ²	sec/m ²
≥3 hours	45	310	3	32
≥1½ hours and <3 hours	30	207	1.5	16
≥1 hour and <1½ hours	30	207	0.9	10
<1 hour	30	207	0.6	6

Chapter 7 Performance Criteria

7.1 Fire Test.

7.1.1 Window Assemblies. During the fire test, a window assembly shall meet the performance criteria specified in 7.1.1.1 through 7.1.1.6.

7.1.1.1 The window assembly shall remain in the wall in which it is installed for the duration of the fire test.

7.1.1.2 No flaming shall occur on the unexposed surface of the assembly.

7.1.1.3 There shall be no separation of the glazing material edges from the glazing frame that creates openings.

7.1.1.4 At the perimeter of operable components, movement from the initial closed position shall not exceed the thickness of the frame member at any point.

7.1.1.5 The window assembly shall not move away from the wall to the extent that an opening is created.

7.1.1.6 There shall be no openings in the window assembly.

7.1.2 Glass Block Assemblies. During the fire test, a glass block assembly shall meet the performance criteria specified in 7.1.2.1 through 7.1.2.4.

7.1.2.1 The glass block assembly shall remain in the frame in which it is installed for the duration of the fire test.

7.1.2.2 No flaming shall occur on the unexposed surface of the assembly.

7.1.2.3 There shall be no openings in any of the individual glass blocks.

7.1.2.4 No openings shall be produced during the test in the joints between individual glass blocks or between glass blocks and the frame in which the glass block assembly is installed.

7.2 Hose Stream Test.

7.2.1 Window Assemblies. During the hose stream test, a window assembly shall meet the performance criteria specified in 7.2.1.1 through 7.2.1.4.

7.2.1.1 The window assembly shall remain in the wall in which it is installed for the duration of the hose stream test.

7.2.1.2 At the perimeter of operable components, movement from the initial closed position shall not exceed the thickness of the frame member at any point.

7.2.1.3 Openings created by separation of the glazing material edges from the glazing frame due to movement away from the frame shall not exceed 30 percent of each individual glazed light perimeter.

7.2.1.4 Openings created by glazing material breakage in the central area of each individual glazed light shall not exceed 5 percent of the area of the glazed light.

7.2.2 Glass Block Assemblies. During the hose stream test, a glass block assembly shall meet the performance criteria specified in 7.2.2.1 and 7.2.2.2.

7.2.2.1 The glass block assembly shall remain in the frame in which it is installed for the duration of the fire test.

7.2.2.2 At least 70 percent of the glass blocks shall not develop openings.

Chapter 8 Report

8.1 Results.

8.1.1 General.

8.1.1.1 Results of the performance of a fire window assembly subjected to the fire exposure tests as prescribed in these test methods shall be reported.

8.1.1.2 The report shall include, but shall not be limited to, the information specified in 8.1.2 through 8.1.14.

8.1.2 The construction details and materials used to construct the test wall or partition in which the fire window assembly is mounted for testing shall be described.

8.1.3 The temperature measurements of the furnace shall be plotted on a comparative graph showing the standard temperature–time curve.

8.1.4 All observations of the reactions of the fire window assembly that have an influence on its performance during both the fire and hose stream tests shall be reported.

8.1.5 The fire window assembly, including the appearance of fasteners and attachments following both the fire and hose stream tests, shall be described.

8.1.6 The amount and nature of the movement of any operable components from the initial closed position shall be given.

8.1.7 For window assemblies, the condition of the individual glazed lights, including movement of the edges, and the percentage and location of glazing material fragments dislodged during the tests shall be reported.

8.1.8 For glass block assemblies, any loosening of the blocks in the frame and any through-openings, including their location, shall be described.

8.1.9 The following information shall be provided to ensure positive identification and duplication of the fire window assembly in all respects:

- (1) Materials and construction of the fire window assembly
- (2) Details of installation, including frames, latches, hinges, and fasteners used for mounting
- (3) Size of the glazed area

8.1.10 Pressure differential measurements made between the furnace and the unexposed side of the fire window assembly,

and the calculation that determines the position of the neutral plane with respect to the bottom of the fire window assembly during the fire test, shall be reported.

8.1.11 The actual duration of the fire test shall be given.

8.1.11.1 The fire protection rating of the fire window assembly that successfully meets the performance criteria specified in Chapter 7 also shall be reported.

8.1.11.2 One of the following fire protection ratings shall be assigned based on, but not more than, the duration of the fire test:

- (1) 20 minutes
- (2) 30 minutes
- (3) 45 minutes
- (4) 1 hour
- (5) 1½ hours
- (6) 2 hours
- (7) 3 hours
- (8) Hourly increments for ratings over 3 hours

8.1.12 Where the fire protection rating is 30 minutes or longer, a correction shall be applied as follows for variation of the furnace exposure time from that prescribed in 4.2.3 in cases when exposure time affects the fire protection rating:

- (1) The test duration shall be multiplied by two-thirds of the difference in area between the curve of the average furnace temperature and the standard temperature–time curve for the first three-quarters of the test duration.
- (2) The product then shall be divided by the difference in area between the standard temperature–time curve and a baseline of 20°C (68°F) for the same portion of the test, increasing the latter area by 30°C/hr (54°F/hr) [1800°C/min (3240°F/min)], to compensate for the thermal lag of the furnace thermocouples during the first part of the test.
- (3) For fire test exposures higher than the standard temperature–time curve, the indicated fire protection rating shall be increased by the amount of the correction and shall be decreased similarly for fire exposure below the standard temperature–time curve.
- (4) The correction shall be expressed by the following formula:

[8.1.12]

$$C = \frac{2I(A - A_s)}{3(A_s + L)}$$

where:

C = correction in the same units as I

I = indicated fire protection rating

A = area under the curve of the indicated average furnace temperature for the first three-quarters of the indicated rating period

A_s = area under the standard temperature–time curve for the same part of the indicated fire protection rating

L = lag correction in the same units as A and A_s
[30°C/hr (54°F/hr)] [1800°C/min (3240°F/min)]

8.1.13 The results of the hose stream test shall be reported.

8.1.14 The fire window assembly, including the appearance of fasteners, attachments, and other hardware, following both the fire and hose stream tests shall be described.

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.2 The degree of fire protection measured in units of time is not an absolute value, since all possible actual fire scenarios are not represented by the standard fire exposure described herein. This standard allows different fire window assemblies to be compared with each other to evaluate their relative performance as measured against a standard fire exposure.

A.1.2.4 The fire exposure is not necessarily representative of all fire conditions, due to varying changes in the amount, nature, and distribution of fire loading, ventilation, compartment size and configuration, and heat sink characteristics of the compartment. The fire exposure does, however, provide a relative measure of the fire performance of fire window assemblies under these specified fire exposure conditions. Similarly, the hose stream exposure is not necessarily representative of all applications of actual hose streams used by a fire department during fire suppression efforts. The degree of fire protection measured in units of time is not an absolute value, since all possible actual fire scenarios are not represented by the standard fire exposure described herein.

A.3.3.1.1 Fire Window Assembly. For further information, see NFPA 80.

A.3.3.1.3 Window Assembly. For further information, see NFPA 80.

A.3.3.2 Fire Protection Rating. The acceptance criteria for determining fire protection ratings for fire door assemblies are described in NFPA 252 and those for fire window assemblies are described in this standard. Fire protection ratings are different from fire resistance ratings. It is common for a fire window to have a fire protection rating lower than the wall fire resistance rating in which it is installed.

A.3.3.3 Fire Resistance Rating. Fire resistance ratings are typically determined by testing to ASTM E119, *Standard Test Methods for Fire Tests of Building Construction and Materials*.

A.3.3.7 Glazing Material. For further information, see NFPA 80.

A.6.2.4 The exposed area of the fire window assembly is required to be calculated using the outside dimensions of the test specimen, including the frame, but normally not including the wall or partition into which the specimen is mounted. Where multiple test specimens are mounted in the same wall or partition, the rectangular or square wall area encompassing all of the specimens is considered to be the exposed area because the hose stream has to traverse the exposed area during its application.

Annex B Background and Development

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

B.1 Introduction.

B.1.1 This annex provides the user of NFPA 257 with background information on the development of the standard and its application in the fire protection of buildings. It also

provides guidance in the planning and performance of fire tests and in the reporting of results. No attempt has been made to incorporate all the available information on fire testing in this annex.

B.1.2 The serious student of fire testing should review the documents referenced in Annex D for a better appreciation of the intricate problems associated with testing and with the interpretation of test results.

B.2 Major Revisions.

B.2.1 The 1996 edition of this standard incorporated significant revisions to update the standard and to provide additional performance information. That information is useful for fire protection engineering purposes and building code requirements pertaining to the use and application of fire window assemblies.

B.2.2 Based on international standards, it has been determined that additional useful information can be obtained readily during the fire test of fire window assemblies. This information can be incorporated in building codes for use in determining acceptable levels of performance and can be applied by fire protection engineers and other design professionals to achieve a more cost-effective level of fire and life safety in the use of fire window assemblies.

B.2.3 The current requirements for fire test duration are open, whereas previous editions limited the duration to 45 minutes. With the advent of new glazing materials that provide various levels of fire protection, the current requirements have responded to the needs of the industry and the fire protection community by establishing various fire protection ratings that are both longer and shorter than the previous 45-minute specification. The 45-minute limit was based on the ability of standard wired glass to perform satisfactorily in accordance with earlier editions of this standard.

B.2.4 To parallel the criteria in NFPA 252, the hose stream test duration and application pressure in this standard reflect the increased duration of the fire test. This standard also has been clarified with regard to the amount of glass or glass block permitted to be broken or otherwise dislodged during the fire test and the hose stream test.

B.2.5 Criteria also have been established for limiting flaming on the unexposed face of the fire window assembly. A test procedure for measuring the radiant heat flux from the unexposed face of the window assembly has been added to this annex. Its purpose is to provide a standardized protocol for making such measurements. The information obtained is then appropriate for fire protection engineering usage and for fire modeling in which it is desirable to control the radiant heat transfer through a fire window or glass block assembly.

B.3 Application.

B.3.1 Openings in the exterior walls of buildings have contributed to the spread of fire. Fire protection standards and building codes recognize the hazard associated with exterior wall openings that are created by inadequate spatial separation between buildings. Where the spatial separation is inadequate and the expected fire exposure is moderate or light, such codes and standards permit window openings protected by fire windows. Such protection can be provided by properly designed windows and glass block assemblies. Where sustained

severe exposures are possible, the openings should be protected with fire door assemblies.

B.3.2 To protect paths of egress from interior fires, fire window assemblies can be specified for openings abutting exterior stairs and fire escapes and for openings in corridors whose wall openings are used to provide natural lighting of the corridor from adjacent rooms.

B.4 Scope and Significance.

B.4.1 NFPA 257 provides a test method for evaluating the effectiveness of protection for light-transmitting openings.

B.4.2 The test exposes the fire window assembly to predetermined fire conditions for a desired fire protection rating period, then, at the option of the test sponsor, subjects the assembly to a standard hose stream impact test.

B.4.3 This standard also measures heat transmission and radiation through the assembly (*see Annex C*). NFPA 80A should be consulted for information on exterior fire exposure problems, and NFPA 80 should be referenced for information on radiant heat transfer.

B.4.4 Openings in walls, even where protected, provide a lower fire protection rating than that of the wall, and the designed protection cannot be expected if combustibles are located directly in front of or behind the protectives. Therefore, clear spaces should be provided on both sides of openings in fire-rated walls and partitions.

B.5 Furnace.

B.5.1 The test method referred to in Section B.4 provides details on the operating characteristics and temperature measurement requirements of the test furnace. The walls of the furnace typically should be of furnace refractory materials and should be sufficiently rugged to maintain the overall integrity of the furnace during the fire exposure period.

B.5.2 The thermocouples in the furnace are required to be located 152 mm (6 in.) from the face of the wall in which the fire window assembly is installed. Otherwise, no furnace depth is specified. A minimum depth of 457 mm (18 in.) is necessary to meet the requirement that the exposed length of the thermocouple protection tube be at least 305 mm (12 in.).

B.5.3 The documents referenced in Annex D should be consulted for a more comprehensive review of furnace design and performance.

B.6 Temperature–Time Curve.

B.6.1 A specified temperature–time relationship for the test fire is defined in this standard. The actual recorded temperature–time condition achieved in the furnace during the test as measured by the area under the temperature–time curve is required to be within the specified percentages of those of the standard curve. The number and type of temperature-measuring devices are outlined in this standard, as are specific standard practices for location and use of temperature-measuring devices.

B.6.2 The standard temperature–time curve represents a relatively severe building fire. The curve was adopted in 1918 as a result of several conferences held by 11 technical organizations, including testing laboratories, insurance underwriters, fire protection associations, and technical societies. It should be recognized that the temperature–time relationship of this

test method represents only one actual fire situation. However, it is used in other fire test methods such as those specified in NFPA 252 and ASTM E814, *Standard Test Method for Fire Tests of Penetration Firestop Systems*.

B.6.3 Although the temperature–time curve is specified for standard thermocouples located within the furnace, measurement of the temperature–time curve using standard thermocouples does not establish a standard incident heat flux on the tested specimen. Incident heat flux that occurs in an actual fire can vary significantly from that developed by tests conducted by this standard test method. Similarly, this standard provides for a standard temperature–time relationship to be followed by all furnaces using this standard method, although the internal heat flux developed in various test furnaces can vary.

B.7 Furnace Control.

B.7.1 This standard contains specific instructions for measuring temperatures in the furnace and for the selection of required thermocouples. Thermocouples of the design specified are sufficiently rugged to retain accuracy throughout anticipated test periods. However, their massive construction results in a significant time delay in response to temperature change, causing actual temperatures that exceed the indicated temperatures during the early stages of the test period, when the temperature rises rapidly.

B.7.2 The iron or porcelain tubes surrounding the junction and leads of the thermocouple provide a shield against degradation of the junction and increase thermal inertia. Depending on the type of thermocouple used and its method of protection, some laboratories replace furnace thermocouples after accruing 3 or 4 hours of use.

B.8 Test Assemblies. Fire window assemblies are tested in relatively large sizes compared to most side-hinged swinging fire doors [for example, 9.3 m² (100 ft²) for windows versus 1.9 m² to 3.7 m² (20 ft² to 40 ft²) for doors]. The size of individual panes of glazing material is determined by the designer. Fire window assemblies as large as 13.9 m² (150 ft²) have been tested. When the size of any assembly is less than 9.3 m² (100 ft²), it should be reported.

B.9 Conduct of the Tests. The test frame or wall in which a fire window assembly is installed should be rugged enough to endure the fire exposure during the test period without affecting the window assembly. Traditionally, this wall has been of masonry construction. Currently, fire windows are installed in walls of other than masonry construction and have been tested in such walls as well.

B.10 Furnace Pressures.

B.10.1 A fire in a building compartment creates both negative and positive pressures on window assemblies, depending on the following:

- (1) Atmospheric conditions
- (2) Height above ground
- (3) Wind conditions
- (4) Ventilation of the compartment at the beginning of the fire
- (5) Ventilation during the fire

B.10.2 A furnace pressure that is slightly higher than the ambient pressure outside of the furnace could have a significant impact on the performance of fire barrier assemblies. Operating a test furnace at a negative pressure differential has the effect of drawing any hot gases or flames back into the furnace chamber, so the ability to observe flaming around any openings on the unexposed surface is minimized. Furthermore, the draft induced by the negative pressure differential reduces any heating that might occur along the edges of any openings and, in fact, provides some degree of cooling of surfaces. Positive compartment pressures in actual fires have the opposite effect.

B.10.3 In previous editions, NFPA 257 specified that the pressure in the furnace should be maintained as nearly equal to atmospheric as possible. This method of test generally resulted in the test assembly's subjection to a negative pressure during the test because most laboratories set the neutral plane in the furnace at or above the top of the assembly. As revised, the standard now permits tests to be conducted under any pressure situation, depending on the needs or requirements of the manufacturer, the test laboratory, or the authority having jurisdiction. The pressure in the furnace is required to be measured and reported.

B.10.4 The differential pressure employed is the pressure that is necessary to evaluate the fire window assembly with respect to its field installation. The differential pressure should be determined by one of the following:

- (1) Code requirements
- (2) Design pressure that can occur in the type of installation for which the test is proposed
- (3) Test sponsor
- (4) Other criteria

B.11 Hose Stream Test.

B.11.1 Immediately following the fire test, the test assembly is removed from the furnace, and the fire window assembly is subjected to the impact, erosion, and cooling effects of a stream of water. The water discharges from a 63.5 mm (2½ in.) hose under the following conditions:

- (1) Through a standard play pipe, equipped with a (28.5 mm) (1⅛ in.) tip
- (2) Under a specified pressure for a specified duration based on the length of the fire test and the area of the fire window assembly

B.11.2 The application of water produces stresses in the assembly and provides a measure of its structural capabilities. Weights have been used in Europe to provide a measure of the assembly's ability to withstand impact. The hose stream is considered to be an improvement over the weights in both uniformity and accuracy.

B.11.3 Just as the standard fire exposure is not intended to be representative of any or all actual fire conditions, the standard hose stream exposure is not intended to be representative of any actual fire-fighting or fire suppression activity. The fire exposure test and the hose stream test provide a relative measure of the performance of constructions and assemblies under specified standard exposure conditions.