

NFPA 505
Powered
Industrial Trucks
Including Type
Designations,
Areas of Use,
Maintenance
and Operation
1987 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA Headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable Federal, State and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action which is not in compliance with applicable laws and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision — This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference — Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders or similar instruments. Any deletions, additions and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription — **A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof, and, (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rulemaking process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rulemaking powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rulemaking powers may apply for and may receive a special royalty when the public interest will be served thereby.

3. Scope of License Grant — The terms and conditions set forth above do not extend to the index to this document.


(For further explanation, see the Policy Concerning the Adoption, Printing and Publication of NFPA Documents which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accepts any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

Over 16,000 copies sold!

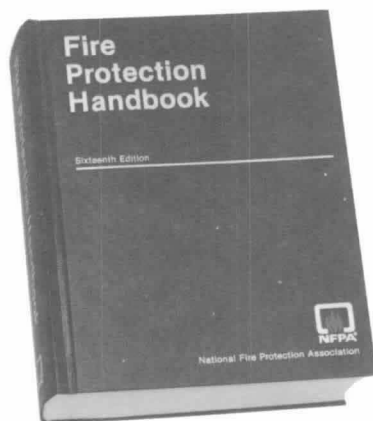

Put the experts on your side — with the Fire Protection Handbook!

Stay on top of developments in fire protection techniques, systems and equipment all from one comprehensive source. The **sixteenth edition of the Fire Protection Handbook** features current information on every aspect of firesafety... facts you'll use again and again.

Whether you're involved with building design and construction, sprinkler installations, firesafety education, fire service training, or any other aspect of fire protection and prevention, the *Fire Protection Handbook* addresses your specific information needs.

You'll find the latest on building design and construction... fire modeling... hazardous waste control... haz-mat emergency response... the fire hazards of robotics... aerosol charging... mining and industrial safety... EMS. It's all here—in one comprehensive volume that's more extensive and easy-to-use than ever before!

Approximately 1,760 pages, 20 sections on specific subjects and occupancies, 173 fact-packed chapters, and nearly 2,000 illustrations, photographs and diagrams!

For easy ordering, call toll-free 1-800-344-3555! Monday–Friday, 8:30 AM–8:00 PM, ET

YES! Send me _____ copies of the Fire Protection Handbook. Item No. V5-FPH1686 \$75.00 (NFPA Members \$67.50)

Plus \$2.85 handling. *NFPA pays all shipping charges.*

California residents add 6% sales tax _____

Total amount enclosed \$ _____

Name _____

Address _____

City, State, Zip _____

NFPA Member No. _____

☐ I enclose a check (payable to NFPA)

☐ Please bill me ☐ Charge my ☐ ☐

Card No. _____

Signature _____ Exp. _____



National Fire Protection Association
Batterymarch Park, Quincy, MA 02269

Join over 37,000 professionals like yourself who belong to NFPA!



You can have impact on issues that affect the firesafety industry...How?

When you belong to NFPA you'll receive special membership benefits that help you make informed decisions and make your voice a stronger one in the firesafety community. Your benefits include:

1. Voting privileges on proposed changes to existing codes and standards, and on new codes and standards.

2. Fire Journal Magazine, Fire News Newsletter, and Fire Protection Reference Directory & Buyers Guide — *exclusive members-only publications* — your source for fire statistics,

reports, investigations, manufacturers, and codes and standards references.

3. 10% discount on all products and services.

4. Special invitations to Annual and Fall, and Regional Meetings — where you can compare notes with your colleagues and take a position on issues that affect you. All these benefits — plus the pride and confidence that comes with membership in an internationally-acclaimed organization can be yours for annual dues of \$60.00. **Join NFPA today!**

For easy ordering, call toll-free 1-800-344-3555! Monday–Friday, 8:30 AM–8:00 PM, ET

YES! Send me an application to join my colleagues at NFPA today!

Name _____

Address _____

City, State, Zip _____

Date _____

Signature _____

☐ I enclose a check (payable to NFPA)

☐ Please bill me ☐ Charge my ☐ ☐

Card No. _____


Signature _____ Exp. _____



National Fire Protection Association
Batterymarch Park, Quincy, MA 02269

Code V5

Over 15,000 copies sold!

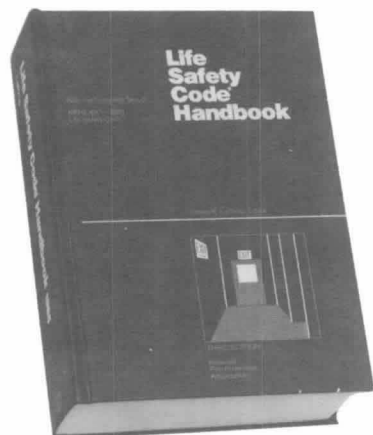

How to interpret and apply the Life Safety Code...

The **Life Safety Code Handbook** puts the facts and explanations you need at your fingertips! The Handbook includes:

- Complete text of 1985 Life Safety Code
- Helpful section-by-section explanations of the Code
- Hundreds of useful tables and illustrations
- Formal Interpretations — written by the Committee in direct response to field inquiries

Information is included on: board and care facilities; requirements for sprinklers in new high-rise health care facilities; provisions for revolving doors and smoke proof enclosures; requirements for stairwell floor re-entry; *plus* hundreds of significant changes from previous editions. Improve your ability to apply the Life Safety Code (NFPA 101) requirements in your fire and life safety profession — **order your copy today!**

For easy order, call toll-free 1-800-344-3555! Monday–Friday, 8:30 AM–8:00 PM, ET

YES! Send me _____ copies of the Life Safety Code Handbook (1985 ed.). Item No. U5-101HB85 \$39.50 (NFPA Members \$35.55)

Plus \$2.85 handling. *NFPA pays all shipping charges.*

California residents add 6% sales tax _____

Total amount enclosed \$ _____

Name _____

Address _____

City, State, Zip _____

NFPA Member No. _____

☐ I enclose a check (payable to NFPA)

☐ Please bill me ☐ Charge my ☐ ☐

Card No. _____

Signature _____ Exp. _____



National Fire Protection Association
Batterymarch Park, Quincy, MA 02269



NO POSTAGE
NECESSARY
IF MAILED
IN THE
UNITED STATES


BUSINESS REPLY MAIL

FIRST CLASS PERMIT NO. 3376 QUINCY, MA

POSTAGE WILL BE PAID BY ADDRESSEE

National Fire Protection Association

Batterymarch Park
Quincy, MA 02269-9904



NO POSTAGE
NECESSARY
IF MAILED
IN THE
UNITED STATES

BUSINESS REPLY MAIL

FIRST CLASS PERMIT NO. 3376 QUINCY, MA

POSTAGE WILL BE PAID BY ADDRESSEE

National Fire Protection Association

Batterymarch Park
Quincy, MA 02269-9904



NO POSTAGE
NECESSARY
IF MAILED
IN THE
UNITED STATES


BUSINESS REPLY MAIL

FIRST CLASS PERMIT NO. 3376 QUINCY, MA

POSTAGE WILL BE PAID BY ADDRESSEE

National Fire Protection Association

Batterymarch Park
Quincy, MA 02269-9904



© 1987 NFPA, All Rights Reserved

NFPA 505

Firesafety Standard for Powered Industrial Trucks

Including Type Designations, Areas of Use, Maintenance, and Operation

1987 Edition

This edition of NFPA 505, *Standard for Powered Industrial Trucks*, was prepared by the Technical Committee on Industrial Trucks, and acted on by the National Fire Protection Association, Inc. at its Annual Meeting held May 18-21, 1987 in Cincinnati, Ohio. It was issued by the Standards Council on June 10, 1987, with an effective date of June 30, 1987, and supersedes all previous editions.

The 1987 edition of this standard has been approved by the American National Standards Institute.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

Origin and Development of NFPA 505

Chapter 1 (formerly Part A) of this standard was originally designated as NFPA 505A and was first adopted by the Association in 1951. Chapters 3 and 4 (formerly Parts A and B), "Maintenance of Industrial Trucks" and "Operation of Industrial Trucks," were originally adopted in 1952 and published by the NFPA under the designation NFPA 505B and 505C, respectively. Revisions were made in 1955, 1957, 1963, 1965, 1966, 1967, 1968, 1969, 1971, 1972, 1973, 1975, 1978 and 1982. 1971 was the first edition to be approved by ANSI.

The principal changes to this edition include moving examples of gases, vapors, and flammable liquids to the appendix; the title of Chapter 5 was changed to include the operation of industrial trucks, and several ANSI/UL standards have been referenced.

Technical Committee on Industrial Trucks

Richard E. Munson, Chairman

E. I. Dupont de Nemours & Co

Charles L. Crocker, Burlington Industries Inc.

Dale A. Gray, Ford Motor Co.

Lee Gibbs, Underwriters Laboratories Inc.

Rep. Motor Vehicle Manufacturers Assn.

Dallas R. Knight, Factory Mutual Research Corp.

Alternates

William J. Montwieler, Industrial Truck Assn.

(Alternate to ITA Rep.)

Richard Bielen, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Contents

Chapter 1 Type Designations and Areas of Use	505- 4
1-1 Scope	505- 4
1-2 General	505- 4
1-3 Definitions	505- 4
1-4	505- 5
1-5	505- 5
1-6	505- 5
1-7 Specific Areas of Use	505- 5
Chapter 2 Dual-Fuel Trucks	505- 8
2-1 General	505- 8
2-2 Requirements	505- 8
2-3	505- 8
Chapter 3 Converted Trucks	505- 8
3-1	505- 8
3-2 Conversion Requirements	505- 9
Chapter 4 Maintenance of Industrial Trucks	505- 9
4-1 General	505- 9
4-2 Precautions	505- 9
4-3	505- 9
4-4	505- 9
4-5	505- 9
4-6	505- 9
4-7	505- 9
4-8	505- 9
Chapter 5 Fuel Recharging, Marking, and Operation of Industrial Trucks	505- 9
5-1 Fuel Handling and Storage	505- 9
5-2 Dual Fuel	505-10
5-3 Changing and Charging Storage Batteries	505-11
5-4 Use of Trucks in Classified Areas	505-11
5-5 Safe Operating Rules	505-11
Chapter 6 Referenced Publications	505-13
Appendix A	505-13
Index	505-15

NFPA 505

Firesafety Standard for Powered Industrial Trucks

Including Type Designations, Areas of Use,

Maintenance, and Operation

1987 Edition

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates explanatory material on that paragraph in Appendix A.

Information on referenced publications can be found in Chapter 6.

Chapter 1 Type Designations and Areas of Use

1-1 Scope. This standard applies to fork trucks, tractors, platform lift trucks, motorized hand trucks, and other specialized industrial trucks powered by electric motors or internal combustion engines. This standard does not apply to compressed air or nonflammable compressed gas-operated industrial trucks, farm vehicles, or automotive vehicles for highway use.

1-2 General.

1-2.1 Design and installation of the LP-Gas fuel systems on LP-Gas and dual-fuel powered industrial trucks shall be in accordance with the applicable provisions of NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*.

1-2.2 Approved powered industrial trucks as used in this standard are those trucks listed for the use intended, by a testing laboratory. Trucks shall be tested and labeled in accordance with ANSI/UL 558, *Safety Standard for Internal-Combustion-Engine Powered Industrial Trucks*, or ANSI/UL 583, *Safety Standard for Electric-Battery-Powered Industrial Trucks*.

1-3* Definitions.

Approved. Acceptable to the "authority having jurisdiction."

NOTE: The National Fire Protection Association does not approve, inspect or certify any installations, procedures, equipment, or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations or procedures, equipment or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations which is in a position to determine compliance with appropriate standards for the current production of listed items.

Authority Having Jurisdiction. The "authority having jurisdiction" is the organization, office or individual responsible for "approving" equipment, an installation or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner since jurisdictions and "approval" agencies vary as do their responsibilities. Where public safety is primary, the "authority having jurisdiction" may be a federal, state, local or other regional department or individual such as a fire chief, fire marshal, chief of a fire prevention bureau, labor department, health department, building official, electrical inspector, or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the "authority having jurisdiction." In many circumstances the property owner or his designated agent assumes the role of the "authority having jurisdiction"; at government installations, the commanding officer or departmental official may be the "authority having jurisdiction."

Labeled. Equipment or materials to which has been attached a label, symbol or other identifying mark of an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

Listed. Equipment or materials included in a list published by an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

NOTE: The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The "authority having jurisdiction" should utilize the system employed by the listing organization to identify a listed product.

Type Designation. A system for identifying types of powered industrial trucks for operation in nonclassified and classified areas [see following paragraphs (a) through (m)].

(a) The *type D* units are diesel-powered units having minimal acceptable safeguards against inherent fire hazards.

(b) The *type DS* units are diesel-powered units that, in addition to all the requirements for the type D units, are provided with additional safeguards to the exhaust, fuel, and electrical systems.

(c) The *type DY* units are diesel-powered units that have all the safeguards of the type DS units and, in addition, do not have any electrical equipment, including ignition. They are equipped with temperature limitation features.

(d) The *type E* units are electrically powered units having minimum acceptable safeguards against inherent fire and electrical shock hazards.

(e) The *type ES* units are electrically powered units that, in addition to all of the requirements for the type E units, are provided with additional safeguards to the electrical system to prevent emission of hazardous sparks and to limit surface temperatures.

(f) The *type EE* units are electrically powered units that have, in addition to all of the requirements for the types E and ES units, the electric motors and all other

electrical equipment completely enclosed.

(g) The *type EX* units are electrically powered units that differ from the types E, ES, or EE units in that the electrical fittings and equipment are so designed, constructed, and assembled that the units may be used in atmospheres containing specifically named flammable vapors, dusts, and, under certain conditions, fibers. Type EX units are specifically tested and classified for use in Class I, Group D or for Class II, Group G locations as defined in NFPA 70, *National Electrical Code*®.

(h) The *type G* units are gasoline-powered units having minimum acceptable safeguards against inherent fire hazards.

(i) The *type GS* units are gasoline-powered units that, in addition to all the requirements for the type G units, are provided with additional safeguards to the exhaust, fuel, and electrical systems.

(j) The *type LP* units are liquefied-petroleum-gas-powered units having minimum acceptable safeguards against inherent fire hazards.

(k) The *type LPS* units are liquefied-petroleum-gas-powered units that, in addition to the requirements for the type LP units, are provided with additional safeguards to the exhaust, fuel, and electrical systems.

(l) The *type G/LP* units operate on either gasoline or liquefied petroleum gas having minimum acceptable safeguards against inherent fire hazards.

(m) The *type GS/LPS* units operate on either gasoline or liquefied petroleum gas and, in addition to all requirements for the type G/LP units, are provided with

additional safeguards to the exhaust, fuel, and electrical systems.

1-4 The authority having jurisdiction shall determine the hazard classification of any particular location. The location shall have been classified prior to the consideration of industrial trucks being used therein and the type of industrial truck required shall be as provided in Section 1-7 of this standard for such location.

1-5 Several areas of any one plant or building may have different hazard classifications. The authority having jurisdiction shall limit the use of industrial trucks in classified areas in a plant or building in accordance with the hazard classification of such areas. The responsibility for enforcement of restricted use in such areas shall rest on management.

1-6 The industrial trucks specified in Section 1-7 are the minimum types required. Industrial trucks having greater safeguards may be used if desired.

1-7 Specific Areas of Use.

NOTE: Table 1-7 provides a summary of industrial truck types for specific areas of use and was developed from information contained in this section.

References in parentheses in the following subsection headings in this section are to the corresponding classification as used in NFPA 70, *National Electrical Code*, for the convenience of people familiar with those classifications.

Table 1-7 — Summary Table on Use of Powered Industrial Trucks as Described in Chapter 1 of this Standard

Locations	Diesel-Powered			Electric-Powered				Gasoline-Powered		LP-Gas-Powered		Dual-Fuel		Text Par. Reference
	D	DS	DY	E	ES	EE	EX	G	GS	LP	LPS	G/LP	GS/LPS	
Class I														
Division 1														
Group A														1-7.1
Group B														1-7.1
Group C														1-7.1
Group D							A							1-7.2
Class I														
Division 2														
Group A		X	X		X	X	X		X		X		X	1-7.9
Group B		X	X		X	X	X		X		X		X	1-7.9
Group C		X	X		X	X	X		X		X		X	1-7.9
Group D		*	A		*	A	A		*		*		*	1-7.3
Class II														
Division 1														
Group E							*							1-7.4
Group G							A							1-7.5
Class II														
Division 2														
Group E		X	X		X	X	X		X		X		X	1-7.9
Group G		*	A		*	A	A		*		*		*	1-7.6
Class III														
Division 1		*	A		*	A	A		*		*		*	1-7.7
Class III														
Division 2		A	A	*	A	A	A		A		A		A	1-7.8

Key To Table Symbols

A = Type truck authorized in location described.

* = Type truck authorized in location described with approval of the authority having jurisdiction.

X = Type truck authorized to be determined by the authority having jurisdiction.

Blank spaces = Type truck not authorized in location described.

1-7.1* Areas Containing Certain Flammable Gases or Vapors Where Power-Operated Industrial Trucks Shall Not Be Used (Class I, Groups A, B and C, Division 1). Power-operated industrial trucks shall not be used in these locations.

NOTE: For examples of chemicals of which mixtures of their vapors in air are classified as Class I, Group A, B, and C, see Article 500-2 of NFPA 70, *National Electrical Code*, and A-1-7.1 of this standard.

1-7.2 Areas Where Vapors of Flammable Liquids and Some Gases Exist Under Normal Operating Conditions (Class I, Group D, Division 1).

1-7.2.1* Approved power-operated industrial trucks designated as type EX and classified for Class I, Group D chemicals shall be used in these locations containing gases or vapors.

NOTE: For examples of chemicals of which mixtures of their vapors in air are classified as Class I, Group D, see Article 500-2 of NFPA 70, *National Electrical Code*, and A-1-7.2.1 of this standard.

1-7.2.2 Class I, Group D, Division 1 includes locations where volatile flammable liquids or liquefied flammable gases are transferred from one container to another; interiors of spray booths and areas in the vicinity of spraying and painting operations where volatile flammable solvents are used; locations containing open tanks or vats of volatile flammable liquids; drying rooms or compartments for the evaporation of flammable solvents; locations containing fat and oil extraction apparatus using volatile flammable solvents; portions of cleaning and dyeing plants where hazardous liquids are used; gas generator rooms and other portions of gas manufacturing plants where flammable gas may escape; inadequately ventilated pump rooms for flammable gas or for volatile flammable liquids; the interiors of refrigerators and freezers in which volatile flammable materials are stored in open, lightly stoppered, or easily ruptured containers; and all other locations where hazardous concentrations of flammable vapors or gases are likely to occur in the course of normal operations.

1-7.3 Areas Where Volatile Flammable Liquids and Their Vapors or Flammable Gases Are Normally Confined (Class I, Group D, Division 2).

1-7.3.1 Approved power-operated industrial trucks designated as types DY, EE, or EX (classified for Class I, Group D locations) shall be used in locations where volatile flammable liquids or flammable gases are handled, processed, or used, but in which these liquids, vapors, or gases will normally be confined within closed containers or closed systems from which they can escape only in case of accidental rupture or breakdown of such containers or systems, or in case of abnormal operation of equipment; also in locations in which ignitable concentrations of gases or vapors are normally prevented by positive mechanical ventilation but which might become hazardous through failure or abnormal operation of the ventilating equipment; or in locations adjacent to Class I, Division 1 locations, and to which ignitable concentrations of gases or vapors might occasionally be com-

municated unless such communication is prevented by adequate positive-pressure ventilation from a source of clean air, and effective safeguards against ventilation failure are provided.

1-7.3.2 In locations used for the storage of flammable liquids in sealed containers or liquefied or compressed flammable gases in containers, approved power-operated industrial trucks designated as types DS, ES, GS, LPS, or GS/LPS may be used if permitted for such locations by the authority having jurisdiction.

1-7.3.3 The classification Class I, Group D, Division 2 includes locations where volatile flammable liquids or flammable gases or vapors are used, but which, in the judgment of the authority having jurisdiction, would become hazardous only in case of an accident or of some unusual operating condition. The quantity of flammable material that might escape in case of accident, the adequacy of ventilating equipment, the total area involved, and the record of the industry or business with respect to explosions or fires are all factors that should receive consideration in determining whether or not the DS, DY, ES, EE, GS, LPS, or GS/LPS-type truck possesses sufficient safeguards for the location.

1-7.4 Areas Containing Combustible Metal Dusts and Other Combustible Dusts Having Resistivity of less than 10^5 ohm-cm (Class II, Group E, Division 1).

1-7.4.1 Power-operated industrial trucks shall not be used in locations containing hazardous concentrations of metal dust, including aluminum, magnesium, and their commercial alloys, and other dusts of similarly hazardous characteristics having resistivity of less than 10^5 ohm-cm.

Exception: Approved power-operated industrial trucks designated as type EX may be used in such locations, subject to special investigation of both the truck and specific area of use by the authority having jurisdiction.

1-7.4.2 In atmospheres where dust of magnesium, aluminum, or aluminum bronze might be present, fuses, switches, motor controllers, and circuit breakers of trucks shall have enclosures specifically approved for such locations.

1-7.5 Areas Containing Combustible Dusts in Suspension Having Resistivity of 10^5 ohm-cm or Greater (Class II, Group G, Division 1).

1-7.5.1 Approved power-operated industrial trucks designated as EX (classified for Class II, Group G locations) shall be used in locations in which combustible dust having resistivity of 10^5 ohm-cm or greater is or may be in suspension under normal operating conditions in quantities sufficient to produce explosive or ignitable mixtures, or where mechanical failure or abnormal operation of machinery or equipment might cause such mixtures to be produced.

1-7.5.2 The classification Class II, Group G, Division 1 includes the working areas of grain handling and storage plants, rooms containing grinders or pulverizers,

cleaners, graders, scalpers, open conveyors or spouts, open bins or hoppers, mixers or blenders, automatic or hopper scales, packing machinery, elevator heads and boots, stock distributors, dust and stock collectors (except all-metal collectors vented to the outside), and all similar dust-producing machinery and equipment in grain processing plants, starch plants, sugar pulverizing plants, malting plants, wood flour plants, hay grinding plants, and other occupancies of similar nature where combustible dust having resistivity of 10^5 ohm-cm or greater might, under normal operating conditions, be present in the air in quantities sufficient to produce explosive or ignitable mixtures.

1-7.6 Areas Where Combustible Dusts Having Resistivity of 10^5 ohm-cm or Greater Are Present but not Normally in Suspension in the Atmosphere (Class II, Group G, Division 2).

1-7.6.1 Approved power-operated industrial trucks designated as type DY, EE, or EX (classified for Class II, Group G locations) shall be used in locations in which combustible dust having resistivity of 10^5 ohm-cm or greater is not normally in suspension in the air or is not likely to be thrown into suspension by the normal operation of equipment or apparatus in quantities sufficient to produce explosive or ignitable mixtures but where deposits or accumulations of such dust might be ignited by arcs or sparks originating in the truck.

1-7.6.2 In locations where dangerous concentrations of suspended dust having resistivity of 10^5 ohm-cm or greater would not be likely, approved power-operated industrial trucks designated as type DS, ES, GS, LPS, or GS/LPS may be used if permitted for such location by the authority having jurisdiction. These locations would include rooms and areas containing only closed spouting and conveyors, closed bins or hoppers, or machines and equipment from which appreciable quantities of dust would escape only under abnormal operating conditions; rooms or areas into which explosive or ignitable concentrations of suspended dust might be communicated only under abnormal operating conditions; rooms or areas where the formation of explosive or ignitable concentrations of suspended dust is prevented by the operation of effective dust-control equipment; warehouses and shipping rooms where dust-producing materials are stored or handled only in bags or containers and other similar locations.

1-7.7 Areas Where Easily Ignitable Fibers or Materials Producing Combustible Flyings Are Handled, Manufactured, or Used (Class III, Division 1).

1-7.7.1 Approved power-operated industrial trucks designated as type DY, EE, or EX shall be used in locations that are classified because of the presence of easily ignitable fibers or materials producing combustible flyings but in which such fibers or flyings are not likely to be in suspension in the air in quantities sufficient to produce ignitable mixtures.

NOTE: Where these materials are either in enclosed systems or flyings in air are minimized through use of ventilation controls, then the use of DS, ES, GS, LPS, or GS/LPS trucks may be considered.

1-7.7.2 Locations where easily ignitable fibers or flyings are found usually include some parts of rayon, cotton, and other textile mills; combustible fiber manufacturing and processing plants; cotton gins and cotton-seed mills; flax processing plants; clothing manufacturing plants; wood working plants (except wood flour plants); and establishments and industries involving similar processes or conditions.

Wood flour plants shall be considered as being in the type of locations defined in 1-7.5.2.

Easily ignitable fibers and flyings include rayon, cotton (including cotton linters and cotton waste), sisal or henequen, istle, jute, hemp, tow, cocoa fiber, oakum, baled waste kapok, Spanish moss, excelsior, sawdust, wood chips, and other materials of similar nature.

1-7.8 Areas Where Easily Ignitable Fibers Are Stored or Handled (Class III, Division 2).

Exception: In process of manufacture.

1-7.8.1 Approved power-operated industrial trucks designated as type DS, DY, ES, EE, EX, GS, LPS, or GS/LPS shall be used in locations where easily ignitable fibers are stored or handled, including outside storage, but are not being processed or manufactured. Industrial trucks designated as type E, which have been previously used in these locations, may be continued in use with the approval of the authority having jurisdiction.

1-7.9 Hazardous Areas Not Otherwise Classified. The authority having jurisdiction shall determine what types of approved power-operated industrial trucks, if any, shall be used on an engineering survey of the property and an evaluation of the fire and explosion hazards.

1-7.10 Piers and Wharves.

1-7.10.1 When it is determined that the location on piers and wharves for handling general cargo is not hazardous, any approved power-operated industrial truck designated as type D, E, G, LP, or G/LP may be used, or trucks which conform to the requirements for these types may be used.

1-7.10.2 Where an area of a pier or wharf is determined to be hazardous, only approved power-operated industrial trucks specified for such locations in the preceding subsections shall be used.

1-7.11 General Inside and Outside Storage.

1-7.11.1 When it is determined that the location for general storage in warehouses or general outside storage is not hazardous, any approved power-operated industrial truck designated as type D, E, G, LP, or G/LP may be used or trucks that conform to the requirements for these types may be used.

1-7.11.2 Where the location for general storage in warehouses or general outside storage is determined to be hazardous, only approved power-operated industrial trucks specified for such locations in the preceding subsections shall be used.

1-7.12 General Industrial or Commercial Properties.

1-7.12.1 When it is determined that the locations on general industrial or commercial properties for handling or processing materials (storage being incidental to handling and processing), or both, is not hazardous, any approved power-operated industrial truck designated as type D, E, G, LP, or G/LP may be used, or trucks that conform to the requirements for these types may be used.

1-7.12.2 Where the location on general industrial or commercial properties for handling or processing materials, or both, is determined to be hazardous, only approved power-operated industrial trucks specified for such locations in the preceding subsections shall be used.

1-7.13 Converted Industrial Trucks.

1-7.13.1 Power-operated industrial trucks that have been originally approved or that conform to the requirements for type G for the use of gasoline for fuel, when converted to the use of liquefied petroleum gas fuel in accordance with Chapter 3, may be used in those locations where G- or LP-type trucks have been specified in the preceding subsections.

1-7.13.2 Power-operated industrial trucks that have been originally approved, or that conform to the requirement for type G for the use of gasoline for fuel, when converted to the use of dual fuels in accordance with Chapter 3, may be used in those locations where G- or LP-type trucks have been specified in the preceding subsections.

1-7.13.3 Power-operated industrial trucks that have been originally approved, or that conform to the requirements for type LP for the use of liquefied petroleum gas for fuel, when converted to the use of dual fuels in accordance with Chapter 3, may be used in those locations where G- or LP-type trucks have been specified in the preceding subsections.

1-7.13.4 Power-operated industrial trucks that have been originally approved, or that conform to the requirements for type LP for the use of liquefied petroleum gas for fuel, when converted to the use of gasoline for fuel in accordance with Chapter 3, may be used in those locations where G-type trucks have been specified in the preceding subsections.

1-7.13.5 Power-operated industrial trucks that have been originally approved, or that conform to the requirements for type G/LP for the use of dual fuels, when converted to the use solely of gasoline for fuel in accordance with Chapter 3, may be used in those locations where G-type trucks have been specified in the preceding subsections.

1-7.13.6 Power-operated industrial trucks that have been originally approved, or that conform to the requirements for type G/LP for the use of dual fuels, when converted to the use solely of liquefied petroleum gas for fuel in accordance with Chapter 3, may be used in those locations where LP-type trucks have been specified in the preceding subsections.

1-7.13.7 Power-operated industrial trucks originally

designated GS, LPS, or GS/LPS shall not be converted to the use of other fuels.

1-7.13.8 Power-operated industrial trucks originally approved or that conform to the requirements for type G, LP, or G/LP shall not be converted to type GS, LPS, or GS/LPS.

Chapter 2 Dual-Fuel Trucks

2-1 General. A dual-fuel truck is defined as a truck equipped to be operated on either gasoline or LPG without further modification.

2-2 Requirements.

2-2.1 Those parts of the fuel system that come into contact with gasoline shall meet the requirements for liquid fuel — ANSI/UL 558, *Standard for Internal-Combustion-Engine-Powered Industrial Trucks*. (See *Appendix A*.)

2-2.2 Those parts of the fuel system that come into contact with LPG fuel shall meet the requirements for LPG fuel — ANSI/UL 558, *Standard for Internal-Combustion-Engine-Powered Industrial Trucks*, or NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*. (See *Appendix A*.)

2-2.3 Those parts of the fuel system that come into contact with both gasoline and LPG fuel shall be compatible with both types of fuel.

2-2.4 Fuel Changeover. When switching from LPG to liquid fuel, care shall be taken to ascertain there is no spillage of liquid fuel.¹

2-3 The truck designations (*see Section 1-3*) as shown on the nameplate and the type markers (*see Figure 5-4.2.2*) shall not be painted over so as to obscure their content.

Chapter 3 Converted Trucks

3-1* Industrial trucks originally approved and classified by type designation (*see 1-7.13*):

(a) For the use of gasoline for fuel may be converted to liquefied petroleum gas as a fuel:

(b) For the use of gasoline or liquefied petroleum gas for fuel may be converted to dual fuels:

(c) For the use of liquefied petroleum gas for fuel or dual fuels may be converted to gasoline only as a fuel:

(d) For the use of dual fuels may be converted to liquefied petroleum gas only as a fuel:

Provided that in each of the above conversions the complete conversion results in a truck that embodies the features specified for the particular fuel to be used.

¹The purpose of this requirement is to ensure the carburetor float system is functioning properly after a period of disuse.

3-2 Conversion Requirements.

3-2.1 A truck designated G, LP, or G/LP, when converted to another of these designations, shall conform to the requirements for the designation selected in accordance with ANSI/UL 558, *Standard for Internal-Combustion-Engine-Powered Industrial Trucks*.

3-2.2 Conversion kits for use on trucks having type designation G, LP, or G/LP shall conform to the requirements for the type designation selected in accordance with ANSI/UL 558, *Standard for Internal-Combustion-Engine-Powered Industrial Trucks*, and may be approved by a testing laboratory.

(a) The content of the kit shall be as set forth in 3-2.3.

(b) The installation of the kit shall conform to the features set forth in 3-2.3.

When a conversion kit approved by a testing laboratory is used, a copy of the report shall be supplied to the authority having jurisdiction, upon request.

3-2.3 Kits for conversion of G, LP, and G/LP trucks shall include:

(a) Step-by-step installation instructions with pictorial illustration (if necessary) for clarity.

(b) All parts required to complete the installation, including:

1. Functional components,
2. Mounting brackets and hardware,
3. Connecting wires, hoses, and fittings,
4. Sealants, if required.

(c) A durable, corrosion-resistant plate indicating the type designation of the converted truck, for permanent mounting on the truck.

(d) A metal nameplate attached to the LP-tank mounting identifying the fuel container assembly to be used.

(e) If the conversion is from LP to gasoline or dual fuels and the truck was not equipped with a gasoline fuel tank, a tank should be included in the kit along with the necessary mounting and connection hardware and installation instructions.

(f) If the conversion is from gasoline to LP, instructions for removal or deactivation of the present components including gasoline tank(s).

(g) Instructions covering checks and tests to be performed after the conversion and prior to putting the truck into service.

3-2.3.1 When a conversion kit is installed, all original identification of approval and type designation shall be removed or obliterated and the plate specified in 3-2.3(c) shall be installed in lieu thereof.

Chapter 4 Maintenance of Industrial Trucks

4-1 General. It is essential that the firesafety built into power-operated industrial trucks be maintained; any

power-operated industrial truck not in safe operating condition shall be removed from service.

4-2 Precautions.

4-2.1 Repairs shall not be made in Class I, II, and III locations.

4-2.2 Repairs to the fuel and ignition systems of industrial trucks that involve fire hazards shall be conducted only in locations designated for such repairs.

4-2.3 Repairs to the electrical system of battery-powered industrial trucks shall be performed only after the battery has been disconnected.

4-3 All parts of any industrial truck, and particularly trucks approved for use in classified hazardous locations, requiring replacement shall be replaced only with parts providing the same degree of firesafety as those used in the original design.

4-4 Water mufflers shall be filled daily or as frequently as is necessary to prevent depletion of the supply of water below 75 percent of the filled capacity. Vehicles with mufflers having screens or other parts that may become clogged shall not be operated while such screens or parts are clogged. Any vehicle that emits hazardous sparks or flames from the exhaust system shall immediately be removed from service, and not returned to service until the cause for the emission of such sparks and flames has been eliminated.

4-5 When the temperature of any part of any truck is found to be in excess of its normal operating temperature and creates a hazardous condition, the vehicle shall be removed from service and not returned to service until the cause for such overheating has been eliminated.

4-6 Industrial trucks shall be kept in a clean condition, reasonably free of lint, excess oil, and grease. Noncombustible agents are preferred for cleaning trucks. Flammable liquids — i.e., having a flash point below 100°F (37.8°C) — shall not be used. Combustible liquids — i.e., having a flash point at or above 100°F (37.8°C) — may be used. Precautions regarding toxicity, ventilation, and fire hazard shall be consonant with the agent or solvent used.

4-7 When antifreeze is required in the engine cooling system, only glycol-base material shall be used.

4-8 The truck designations (*see Section 1-3*) as shown on the nameplate and the type markers (*see 5-4.2*) shall not be painted over so as to obscure their content.

Chapter 5 Fuel Recharging, Marking, and Operation of Industrial Trucks

5-1 Fuel Handling and Storage.

5-1.1 Liquid Fuels (such as Gasoline and Diesel Fuel).

5-1.1.1 The storage and handling of liquid fuels shall

be in accordance with NFPA 30, *Flammable and Combustible Liquids Code*.

5-1.1.2 Trucks using liquid fuels shall be refueled only at locations designated for that purpose and from approved dispensing pumps. Safe outdoor locations are preferable to those indoors. NFPA 30, *Flammable and Combustible Liquids Code*, includes requirements for arranging indoor fueling facilities.

5-1.1.3 Engines shall be stopped and operator off the truck during refueling.

5-1.1.4 Emergency refueling shall be from approved safety cans. Safety cans shall be inspected regularly for damage to closures and for leaks; faulty cans shall be replaced.

5-1.1.5 Spillage of fuel or overfilling the vehicle fuel tank shall be avoided.

5-1.1.6 Smoking shall be prohibited in the refueling area.

5-1.2 Liquefied Petroleum Gas Fuel.

5-1.2.1 The storage and handling of liquefied petroleum gas (LP-Gas) shall be in accordance with NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*.

5-1.2.2 Filling of fuel containers that are permanently mounted on trucks and the filling of removable DOT-type LP-Gas containers shall be done at locations designated for that purpose and in accordance with NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*.

5-1.2.3 LP-Gas containers shall not be dropped, thrown, rolled, or dragged.

5-1.2.4 LP-Gas containers shall not be overfilled.

5-1.2.5 The engine shall be stopped and operator off the truck during refueling.

5-1.2.6 Trained and designated personnel shall refill or exchange LP-Gas containers.

5-1.2.7 A soap solution shall be used to check for leaks. A match or open flame shall not be used.

5-1.2.8 Removable LP-Gas containers shall not be exchanged and LP-Gas-powered vehicles shall not be parked near sources of heat, open flames, or similar sources of ignition, or near open pits, underground entrances, elevator shafts, or other similar areas unless such areas are adequately ventilated to prevent accumulations of LP-Gas.

5-1.2.9 Trucks equipped with permanently mounted LP-Gas containers shall be refueled outdoors.

5-1.2.10 The exchange of removable LP-Gas containers is preferably done outdoors, but may be done indoors. Means shall be provided in the fuel system to minimize

the escape of fuel when the containers are exchanged. This shall be accomplished by:

(a) Closing the valve on the LP-Gas container, and

(b) Using an approved automatic quick-closing coupling (a type that closes in both directions, when uncoupled) in the fuel line. Where such an automatic quick-closing coupling is not used, the fuel line shall be emptied by allowing the engine to run until the fuel in the line is consumed.

5-1.2.11 Removable LP-Gas containers shall be securely mounted to prevent jarring loose, slipping, or rotating, and shall be so positioned that the safety pressure relief valve opening is always in contact with the vapor space (top) of the container. This is accomplished by an indexing pin and container clamp(s) that, when the container is properly installed, position the container.

5-1.2.12 All reserve LP-Gas containers shall be stored and transported with the service valve closed. Safety relief valves shall have direct communication with the vapor space of the container at all times.

5-1.2.13 All LP-Gas containers shall be examined before refilling for the following defects or damage:

(a) Dents, scrapes, and gouges of the pressure vessel,

(b) Damage to the various valves and liquid level gage,

(c) Debris in the relief valve,

(d) Damage to or loss of relief valve cap,

(e) Indications of leakage at valves or threaded connections,

(f) Deterioration damage or loss of flexible seals in the filling or servicing connections.

Where examination reveals physical damage such as dents, scrapes, or gouges [item (a)] that materially weaken the structure of the LP-Gas container, rendering it unsafe for use, it shall be removed from service.

Where examination reveals damages listed above [items (b) through (f)] other than physical damage to the container, appropriate repairs shall be made before the container is refilled.

5-1.2.14 Smoking shall be prohibited in the container refilling area for either portable or permanently mounted containers and in the exchange area when exchanging LP-Gas containers.

5-1.2.15 The service valve of the fuel container shall be closed whenever vehicles are parked overnight or stored for protracted periods of time indoors.

5-2 Dual Fuel.

5-2.1 When operating a dual-fuel truck on LPG, the gasoline level in the liquid fuel tank shall be checked daily. The truck shall not be operated unless the gasoline fuel tank is at least $\frac{1}{4}$ full.¹

¹The purpose in requiring the maintenance of at least $\frac{1}{4}$ -full tank of gasoline is to provide a sufficient amount of liquid fuel to maintain a vapor saturation in the tank above the normally explosive level. The amount of fuel in the tank may be determined using the normal fuel gage provided on the vehicle.

5-2.2 When operating a dual-fuel truck on LPG fuel, the provisions of 5-1.2 shall be followed.

5-2.3 When operating a dual-fuel truck on liquid fuel, the provisions of 5-1.1 shall be followed.

5-3 Changing and Charging Storage Batteries.

5-3.1 This section shall apply to batteries used on electric trucks. The two types of batteries in common use are (a) lead and (b) nickel-iron. They contain corrosive chemical solutions, either acid or alkali, and therefore present a chemical hazard. On charge, they give off hydrogen and oxygen which, in certain concentrations, are explosive.

5-3.2 Battery charging installations shall be located in areas designated for that purpose; such areas shall be kept free of extraneous combustible materials. Facilities shall be provided for: flushing spilled electrolyte; fire protection; protecting charging apparatus from damage by trucks; and adequate ventilation for dispersal of fumes from gassing batteries. Where on-board chargers are used, charging shall be accomplished at locations designated for that purpose, taking into account the electrical requirements of the charger and facilities for fire protection.

Exception: Flushing facilities are not required if charging is accomplished without removing battery from the vehicle.

5-3.3 When handling acid concentrates greater than 50 percent acid (above 1.400 specific gravity), an eye wash fountain shall be provided.

5-3.4 A conveyor, overhead hoist, or equivalent material handling equipment shall be provided for handling batteries.

5-3.5 Chain hoists shall be equipped with load-chain containers. When hand hoist is used, uncovered batteries shall be covered with a sheet of plywood or other nonconducting material to prevent the hand chain from shorting on cell connectors or terminals. A properly insulated spreader bar shall be used with any overhead hoist.

5-3.6 Reinstalled batteries shall be positioned properly and secured in the truck.

5-3.7 A carboy tilter or siphon shall be provided when acid in carboys is used. When diluting concentrated sulfuric acid to make up electrolyte, ALWAYS add the acid to the water and not the water to the acid. Battery maintenance personnel shall wear protective clothing such as eye protection, long sleeves, and gloves.

Exception: Removal and replacement of batteries does not require the use of protective clothing.

5-3.8 Electrical installations shall conform to NFPA 70, *National Electrical Code*, and any local ordinances.

5-3.9 Trained and authorized personnel shall change or charge batteries.

5-3.10 Trucks shall be properly positioned and brake applied before attempting to change or charge batteries.

5-3.11 When charging batteries, the vent caps shall be kept in place to avoid electrolyte spray. Care shall be taken to assure that vent caps are functioning. The battery (or compartment) cover(s) shall be open to dissipate heat and gas.

5-3.12 Smoking shall be prohibited in the charging area.

5-3.13 Precautions shall be taken to prevent open flames, sparks, or electric arcs in battery charging areas.

5-3.14 Tools and other metallic objects shall be kept away from the top of uncovered batteries.

5-4 Use of Trucks in Classified Areas.

5-4.1 Industrial trucks shall not be used in classified areas except as specified in Chapter 1 of this standard.

5-4.2 Markings of Types DS, DY, ES, EE, EX, GS, LPS, GS/LPS Industrial Trucks and Their Areas of Use.

5-4.2.1 The use of proper equipment in classified areas is essential for the safety and protection of employees and property. Approved trucks, listed by a testing laboratory for use in such areas, shall be clearly identified. To facilitate identification both by operators and supervisory personnel, a uniform system of marking has been developed as described herein.

5-4.2.2 Durable markers indicating the designation of the type of truck for use in classified areas shall be applied to each side of the vehicle in a visible but protected location. These markers shall be distinctive in shape as indicated in Figure 5-4.2.2.

5-4.2.3 Entrances to classified areas where industrial trucks are intended to be used shall be posted with durable markers as shown in Figure 5-4.2.3.

5-5 Safe Operating Rules. Powered industrial truck operation shall be in accordance with ANSI B56.1, *Safety Standard for Powered Industrial Trucks, Low Lift and High Lift Trucks*.


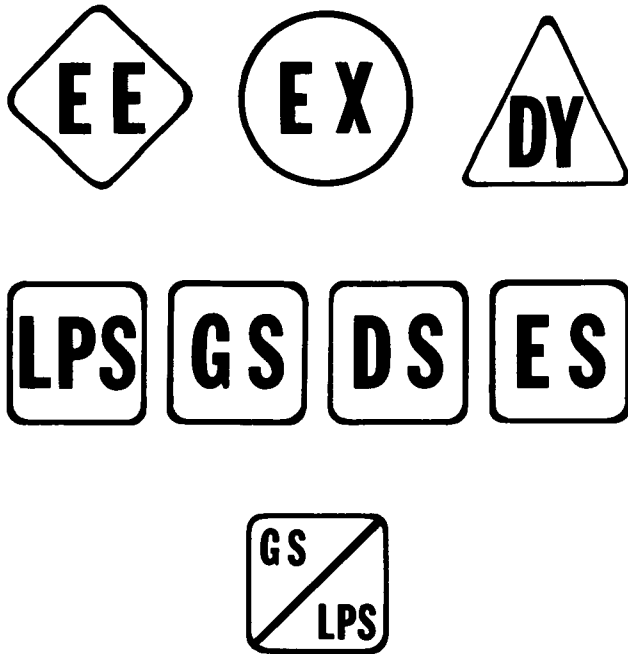


Figure 5-4.2.2. Markers to identify type of industrial truck. The markers for LPS, GS, DS, ES, and GS/LPS are 4 in. (102 mm) square. The width of the others is 5 in. (127 mm). The signs shall have black borders and lettering on a yellow background.

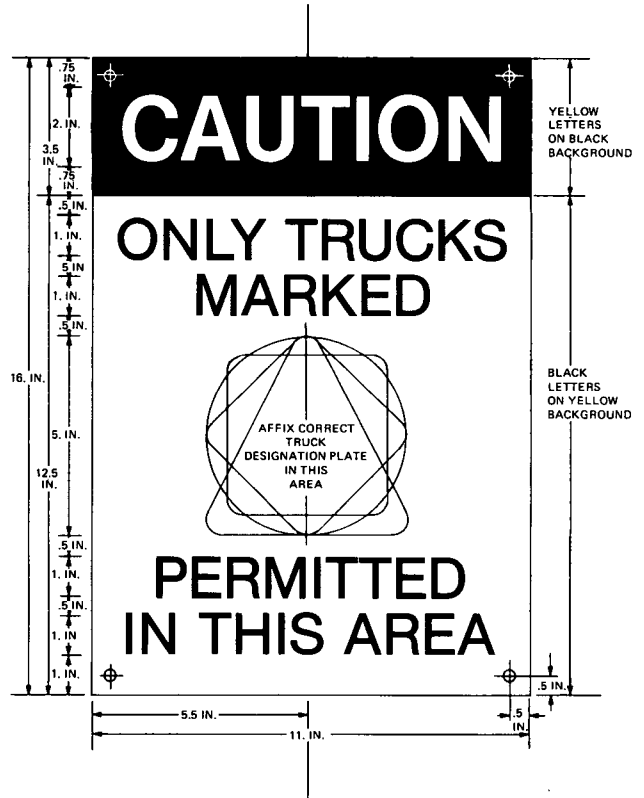

For SI Units: 1 in. = 25.4 mm.

Figure 5-4.2.3. Building signs for posting at entrance to hazardous areas. The minimum width of the sign is 11 in. (279 mm); the minimum height of the sign is 16 in. (406 mm). The sign shall have the word "Caution" in yellow letters on a black background. The body of the sign shall have black letters on a yellow background. A marker(s) identical to the one(s) used on the side of the truck shall be installed on the sign as indicated (see Fig. 5-4.2.2).

Chapter 6 Referenced Publications

6-1 The following documents or portions thereof are referenced within this document and shall be considered part of the requirements of this document. The edition indicated for each reference shall be the current edition as of the date of the NFPA issuance of this document. These references shall be listed separately to facilitate updating to the latest edition by the user.

6-1.1 NFPA Publications. National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

NFPA 30-1987, *Flammable and Combustible Liquids Code*

NFPA 58-1986, *Standard for the Storage and Handling of Liquefied Petroleum Gases*

NFPA 70-1987, *National Electrical Code*.

6-2 Other Publications.

6-2.1 The following publications may be obtained from Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062, or from the American National Standards Institute, Inc., 1430 Broadway, New York, NY 10018.

ANSI/UL 558, *Safety Standard for Internal-Combustion-Engine-Powered Industrial Trucks*, 1984

ANSI/UL 583, *Safety Standard for Electric-Battery-Powered Industrial Trucks*, 1984

ANSI/ASME B56.1-1983, *Safety Standard for Powered Industrial Trucks, Low Lift and High Lift Trucks*.

Appendix A

This Appendix is not a part of the requirements of this NFPA document, but is included for information purposes only.

The following notes, bearing the same number as the text of this standard, contain useful explanatory material and references to standards.

A-1-3 Specific standards covering the types of industrial trucks detailed in Section 1-3 have been published by Underwriters Laboratories Inc., and are identified as *Standard for Internal-Combustion-Engine-Powered Industrial Trucks*, ANSI/UL 558 and *Standard for Electric-Battery-Powered Industrial Trucks*, ANSI/UL 583. UL 558 covers Types D, DS, DY, G, GS, LP, LPS, G/LP, and GS/LPS; UL 583 covers Types E, EE, ES, and EX.

Underwriters Laboratories Inc.'s examination of powered industrial trucks relates to fire hazards only for Types D, DS, DY, G, GS, LP, LPS, G/LP, and GS/LPS internal-combustion-engine-powered industrial trucks; to fire and electrical shock hazard only for Types E, ES, and EE battery-powered industrial trucks; and to the fire, electric shock, and explosion hazard for Type EX trucks, suitable either for use in Class I, Group D, or Class II, Group G hazardous locations. Trucks that have been examined and classified as meeting the respective Under-

writers Laboratories standards for the particular area of use are listed in their *Automotive Equipment Directory*, except for Type EX trucks, which are listed in their *Hazardous Location Equipment Directory*.

Specific approval standards emphasizing fire protection regarding design and equipment arrangement covering the types of industrial trucks detailed in Section 1-3 have been published by the Factory Mutual Research Corporation, PO Box 9102, 1151 Boston-Providence Highway, Norwood, MA 02062, and are identified as:

Approval Standard for Gasoline or Diesel Engine Powered Industrial Trucks, Types G, GS, D, or DS, Class Nos. 7811 and 7813; *Approval Standard for Electric Battery Powered Industrial Trucks*, Types E, ES and EE, Class No. 7820; and *Approval Standard for LP-Gas Engine Powered Industrial Trucks*, Types LP and LPS, Class No. 7812; *Approval Standard for Gasoline/LP-Gas Engine Powered Dual Fuel, Industrial Trucks*, Types G/LP, and GS/LPS, Class No. 7816.

Approval standards for types DY and EX designated trucks are not in published form; however, information is available from Factory Mutual Research Corporation as to their requirements for these types.

Trucks that have been examined and classified as meeting the respective Factory Mutual standards for a particular area of use are listed in their Approval Guide.

A-1-7.1 The following are some examples of Class I, Group A, B, and C chemicals:

acetaldehyde	ethylene oxide
acetylene	ethylenimine
acrolein (inhibited)	hydrogen
allyl alcohol	hydrogen cyanide
arsine	hydrogen sulfide
butadiene	manufactured gases containing more than 30% hydrogen (by volume)
n-butylaldehyde	morpholine
carbon monoxide	2-nitropropane
crotonaldehyde	propylene oxide
cyclopropane	propyl nitrate
diethyl ether	tetrahydrofuran
diethylamine	unsymmetrical dimethyl hydrazine (UDMH 1, 1-dimethyl hydrazine)
epichlorohydrin	
ethyl mercaptan	
ethyl sulfide	
ethylene	

A-1-7.2.1 The following are some examples of Class I, Group D chemicals:

acetic acid (glacial)	ethanol (ethyl alcohol)
acetone	ethyl acetate
acrylonitrile	ethyl acrylate
ammonia	ethylene diamine (anhydrous)
benzene	ethylene dichloride
butane	ethylene glycol monomethyl ether
1-butanol	gasoline
2-butanol (secondary butyl alcohol)	heptanes
n-butyl acetate	hexanes
isobutyl acetate	isoprene
sec-butyl alcohol	isopropyl ether
di-isobutylene	mesityl oxide
ethane	

methane (natural gas)	pentanes
methanol (methyl alcohol)	1-pentanol (amyl alcohol)
3-methyl-1-butanol (isoamyl alcohol)	propane
methyl ethyl ketone	1-propanol (propyl alcohol)
methyl isobutyl ketone	2-propanol (isopropyl alcohol)
2-methyl-1-propanol (isobutyl alcohol)	propylene
2-methyl-2-propanol (tertiary butyl alcohol)	styrene
petroleum naphtha	toluene
pyridine	vinyl acetate
octanes	vinyl chloride
	xylenes

A-3-1 Section 3-1 provides that acceptance of an industrial truck that has been converted:

- (a) from the use of gasoline as a fuel to liquefied petroleum gas as a fuel,
- (b) from the use of either gasoline or liquefied petroleum gas as a fuel to dual-fuel,
- (c) from the use of liquefied petroleum gas or dual-fuel to gasoline as a fuel,

(d) from the use of dual-fuel to liquefied petroleum gas as a fuel,

rests entirely with the inspection authority having jurisdiction. The responsibility of determining whether or not a truck has been properly converted is placed with the authority having jurisdiction because it is impractical to ship each converted truck back to the testing laboratory to be re-examined or retested, and it is also impractical for the laboratory to send a representative into the field to examine or test every converted truck.

It is recognized that the various authorities having jurisdiction may not be expert in determining what constitutes a proper conversion. Installation directions furnished with conversion equipment, "Listed by Report," specify in detail how the conversion is to be made so that it will be in accordance with NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*. These detailed instructions supply the authority having jurisdiction with all the necessary information to determine whether or not a truck has been properly converted.

Index

© 1987 National Fire Protection Association, All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document which it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

- A-**
- Areas of use** 1-7, 5-4, see also **Locations**
 Containing combustible dusts 1-7.4 thru 1-7.6
 Containing flammable liquids 1-7.1 thru 1-7.3, A-1-7.1, A-1-7.2.1
 Containing ignitable fibers 1-7.7, 1-7.8
 Not otherwise classified 1-7.9
 Signs at entrance to 5-4.2.3
- B-**
- Batteries, storage, changing and charging** 5-3
- C-**
- Chemicals, Class I, examples of** A-1-7.1, A-1-7.2.1
Containers, LP-Gas 5-1.2
Conversion kits 3-2.2, 3-2.3
Converted industrial trucks 1-7.13, Chap. 3, A-3-1
- D-**
- Diesel fuels** see **Fuels, Liquid**
Dual-fuel trucks Chap. 2, 5-2
- F-**
- Fuels**
 Handling and storage 5-1
 Liquid 5-1.1
- G-**
- Gasoline** see **Fuels, Liquid**
- H-**
- Hazards**
 Classification 1-4, 1-5
 Trucks for use in specific hazard areas 1-6, 1-7
- L-**
- Location, trucks for use in** 1-7, see also **Areas**
 Class I, Groups A, B, and C, Division I 1-7.1, A-1-7.1, A-1-7.2.1
 Class I, Group D, Division 1 1-7.2
 Class I, Group D, Division 2 1-7.3
 Class II, Groups E and F, Division 1 1-7.4
 Class II, Group G, Division 1 1-7.5
 Class II, Group G, Division 2 1-7.6
 Class III, Division 1 1-7.7
 Class III, Division 2 1-7.8
LP-Gas 5-1.2
- M-**
- Maintenance** Chap. 4
Markings 5-4.2
- O-**
- Operating rules** see **Rules, Safe operating**
- P-**
- Piers** 1-7.10
Properties, general industrial or commercial 1-7.12
- R-**
- Repairs** 4-2.1 thru 4-3
Rules, safe operating 5-5
- S-**
- Safe operating rules** see **Rules, Safe operating**
Scope of the standard 1-1
Storage batteries see **Batteries, Storage**
Storage, general, inside and outside 1-7.11
- T-**
- Trucks** see specific type such as **Converted industrial trucks**
Type designation
 Definition 1-3, A-1-3
- W-**
- Wharves** 1-7.10

SUBMITTING PROPOSALS ON NFPA TECHNICAL COMMITTEE DOCUMENTS

**Contact NFPA Standards Administration for final date for receipt of proposals
on a specific document.**

INSTRUCTIONS

**Please use the forms which follow for submitting proposed amendments.
Use a separate form for each proposal.**

1. For each document on which you are proposing amendment indicate:
 - (a) The number and title of the document
 - (b) The specific section or paragraph.
2. Check the box indicating whether or not this proposal recommends new text, revised text, or to delete text.
3. In the space identified as "Proposal" include the wording you propose as new or revised text, or indicate if you wish to delete text.
4. In the space titled "Statement of Problem and Substantiation for Proposal" state the problem which will be resolved by your recommendation and give the specific reason for your proposal including copies of tests, research papers, fire experience, etc. If a statement is more than 200 words in length, the technical committee is authorized to abstract it for the Technical Committee Report.
5. Check the box indicating whether or not this proposal is original material, and if it is not, indicate source.
6. If supplementary material (photographs, diagrams, reports, etc.) is included, you may be required to submit sufficient copies for all members and alternates of the technical committee.

NOTE: The NFPA Regulations Governing Committee Projects in Paragraph 10-10 state: Each proposal shall be submitted to the Council Secretary and shall include:

- (a) identification of the submitter and his affiliation (Committee, organization, company) where appropriate, and
- (b) identification of the document, paragraph of the document to which the proposal is directed, and
- (c) a statement of the problem and substantiation for the proposal, and
- (d) proposed text of proposal, including the wording to be added, revised (and how revised), or deleted.

FORM FOR PROPOSALS ON NFPA TECHNICAL COMMITTEE DOCUMENTS

Mail to: Secretary, Standards Council

National Fire Protection Association, Batterymarch Park, Quincy, Massachusetts 02269

Date 5/18/85 Name John B. Smith Tel. No. 617-555-1212

Address 9 Seattle St., Seattle, WA 02255

Representing (Please indicate organization, company or self) Fire Marshals Assn. of North America

1. a) Document Title: Protective Signaling Systems NFPA No. & Year NFPA 72D

b) Section/Paragraph: 2-7.1 (Exception)

2. Proposal recommends: (Check one) ☐ new text
☐ revised text
☒ deleted text.

3. Proposal (include proposed new or revised wording, or identification of wording to be deleted):

Delete exception.


4. Statement of Problem and Substantiation for Proposal:

A properly installed and maintained system should be free of ground faults. The occurrence of one or more ground faults should be required to cause a "trouble" signal because it indicates a condition that could contribute to future malfunction of the system. Ground fault protection has been widely available on these systems for years and its cost is negligible. Requiring it on all systems will promote better installations, maintenance and reliability.

5. ☒ This Proposal is original material.
☐ This Proposal is not original material; its source (if known) is as follows: _____

(Note: Original material is considered to be the submitter's own idea based on or as a result of his own experience, thought, or research and, to the best of his knowledge, is not copied from another source.)

I agree to give NFPA all and full rights, including rights of copyright, in this Proposal and I understand that I acquire no rights in any publication of NFPA in which this Proposal in this or another similar or analogous form is used.

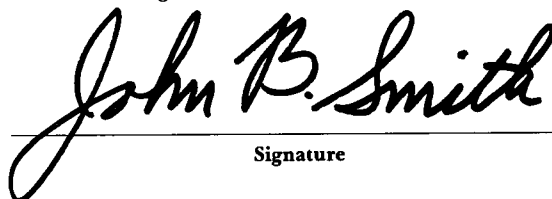
Signature

PLEASE USE SEPARATE FORM FOR EACH PROPOSAL