

NFPA 8501

Single Burner Boiler Operation

1992 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA Headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable Federal, State and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action which is not in compliance with applicable laws and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision — This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference — Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders or similar instruments. Any deletions, additions and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription — **A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and, (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rulemaking process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rulemaking powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rulemaking powers may apply for and may receive a special royalty when the public interest will be served thereby.

3. Scope of License Grant — The terms and conditions set forth above do not extend to the index to this document.

(For further explanation, see the Policy Concerning the Adoption, Printing and Publication of NFPA Documents which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accepts any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

**CHARLES S. MORGAN LIBRARY
NATIONAL FIRE PROTECTION ASSOCIATION
1 BATTERY MARCH PARK
QUINCY, MA 02269-9101**

8501-1

Copyright © 1992 NFPA, All Rights Reserved

NFPA 8501

Standard for

Single Burner Boiler Operation

1992 Edition

This edition of NFPA 8501, *Standard for Single Burner Boiler Operation*, was prepared by the Technical Committee on Boiler Combustion System Hazards and acted on by the National Fire Protection Association, Inc. at its Annual Meeting held May 18-21, 1992 in New Orleans, LA. It was issued by the Standards Council on July 17, 1992, with an effective date of August 14, 1992, and supersedes all previous editions.

The 1992 edition of this document has been approved by the American National Standards Institute.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

Origin and Development of NFPA 8501

This standard was originally adopted at the 1964 Annual Meeting as NFPA 85A and covered natural gas-fired units. At the 1965 Annual Meeting, Tentative Standard NFPA 85C-T — 1964, covering fuel oil-fired units, was combined with NFPA 85A and the combined standard issued as NFPA 85. Revisions were adopted in 1967, 1972, and 1973.

In 1982, the committee suggested the document be renumbered to 85A to distinguish it from the remainder of the Boiler-Furnace standards, which are referred to as the NFPA 85 series.

Major revisions in 1982 included changes to the scope of the standard so that it applies to boilers with fuel input greater than 12,500,000 Btuh (3663 kW) rather than 10,000 lb of steam per hour.

In 1987, NFPA 85A was completely revised. Various technical changes were incorporated, and other revisions were made to conform with the NFPA *Manual of Style*.

This latest edition is a partial revision and includes a variety of changes. Foremost is the renumbering and retitling of the document to NFPA 8501, *Standard for Single Burner Boiler Operation*. This is consistent with an initiative by the NFPA Boiler project to remove the letter designations and use shorter document titles.

Technical Committee on Boiler Combustion System Hazards

James K. Lafontaine, *Chairman*
Pennsylvania Electric, PA

Courtney D. Alvey, Lutherville, MD
William H. Axtman, Manassas, VA
Herbert L. Berman, Caltex Services Corp., TX
Rep. American Petroleum Institute
James R. Bostick, Bailey Controls Co., OH
Paul L. Cioffi, Babcock & Wilcox, OH
William E. Cunningham, United Engineers & Constructors, MA
Dale E. Dressel, Monsanto Co., MO
Shelton Ehrlich, Electric Power Research Institute, CA
Robert S. Elek, Kemper Group, OH
Rep. The Alliance of American Insurers
Humphrey Fedorak, E. I. du Pont de Nemours & Co., DE
Ronald E. Fringeli, M&M Protection Consultants, OH
Thomas B. Hamilton, Hamilton Consulting Services, NC
Warren G. Hudson, Union Carbide Corp., WV
Masaaki Kinoshita, Mitsubishi Heavy Industries, Ltd. Japan
Albert L. Lake, Int'l Union of Operating Engineers, DC

Kenneth N. Lawrence, Honeywell Inc., PA
Rep. Nat'l Electrical Manufacturers Assn.
Donald J. L. Lin, Qilin Inc., TX
Robert M. Lundberg, Los Altos, CA
Peter B. Matthews, Hartford Steam Boiler Insp & Ins Co., CT
Russell N. Mosher, American Boiler Manufacturers Assn., VA
Jerry J. Moskal, Combustion Engineering Inc., CT
Michael C. Polagye, Factory Mutual Research Corp., MA
Robert P. Richmond, Baton Rouge, LA
James L. Sherman, Baltimore Gas & Electric Co., MD
Robert F. Tomczak, Tampa Electric Co., FL
Rep. Electric Light Power Group/Edison Electric Institute
Enno Toomsalu, Underwriters Laboratories Inc., IL
James O. Toutz, Forney Engineering, TX
Peter J. Gore Willse, Industrial Risk Insurers, CT
Henry K. Wong, Foster Wheeler Energy Corp., NJ

Alternates

John C. deRuyter, E. I. du Pont de Nemours & Co., DE
(Alternate to H. Fedorak)
John Jaresko, Industrial Risk Insurers, IL
(Alternate to P. J. G. Willse)
Dennis P. Jenkins, Kemper National Insurance Cos., NC
(Alternate to R. S. Elek)
Paul Karadi, Combustion Engineering Inc., CT
(Alternate to J. J. Moskal)

Richard F. Murphy, Exxon Research & Engr Co., NJ
(Alternate to H. L. Berman)
Satoshi Nonaka, Mitsubishi Heavy-America, CT
(Alternate to M. Kinoshita)
S. Sam Pagadala, M&M Protection Consultants, IL
(Alternate to R. E. Fringeli)
J. C. Waung, Babcock & Wilcox Co., OH
(Alternate to P. L. Cioffi)

Subcommittee on Single Burner Boilers

Humphrey Fedorak, *Chairman*
E. I. du Pont de Nemours & Co., DE

Dale E. Dressel, *Vice Chairman*
Monsanto Company, MO

Courtney D. Alvey, Lutherville, MD
William H. Axtman, Manassas, VA
Ian M. Clark, ABB Combustion Engineering, Inc., CT
Thomas C. Clayton, Black & Veatch, MO
John M. DeLacy, The Coen Co., CA
Robert J. Gross, Babcock & Wilcox, OH

James K. Lafontaine, Pennsylvania Electric, PA
Kenneth N. Lawrence, Honeywell, Inc., PA
Rep. Nat'l Electrical Manufacturers Assn.
Enno Toomsalu, Underwriters Laboratories Inc., IL
James C. Williams, American Risk Management Corp., GA
Peter J. Gore Willse, Industrial Risk Insurers, CT

Nonvoting

Russell N. Mosher, American Boiler Manufacturers Assn., VA

Casey C. Grant, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Contents

Chapter 1 Introduction	8501- 5
1-1 Scope	8501- 5
1-2 Purpose	8501- 5
Chapter 2 General	8501- 6
2-1 Furnace Explosions	8501- 6
2-2 Manufacture, Design, and Engineering	8501- 6
2-3 Installation	8501- 6
2-4 Coordination of Design, Construction, and Operation	8501- 7
2-5 Maintenance Organization	8501- 7
2-6 Basic Operating Objectives	8501- 7
2-7 Gas and Oil Firing — Special Problems	8501- 7
Chapter 3 Definitions	8501- 7
Chapter 4 Equipment Requirements	8501-10
4-1 Fuel Supply (Oil)	8501-10
4-2 Fuel Supply (Gas)	8501-11
4-3 Alternate Fuel Firing	8501-11
4-4 Fuel Burning Equipment	8501-11
4-5 Burner Management System, Logic	8501-12
4-6 Combustion Control System	8501-13
4-7 Interlock System	8501-13
4-8 Flame Safety Shutdown System	8501-13
Chapter 5 Starting a Cold Boiler	8501-13
5-1 General	8501-13
5-2 Gas-Fired Boilers	8501-13
5-3 Oil-Fired Burners	8501-13
Chapter 6 Operating Systems	8501-14
6-1 General	8501-14
6-2 Automatic (Recycling) Systems for Watertube Boilers	8501-14
6-3 Automatic (Nonrecycling) Systems for Watertube Boilers	8501-16
6-4 Automatic (Recycling) Systems for Firetube Boilers	8501-16
6-5 Automatic (Nonrecycling) Systems for Firetube Boilers	8501-17
6-6 Supervised Manual Systems for Oil-Fired Watertube Boilers	8501-17
6-7 Supervised Manual Systems for Gas-Fired Watertube Boilers	8501-18
6-8 Soot Blowing	8501-19
Chapter 7 Simultaneous Firing of Oil and Gas Fuels	8501-19
7-1 General	8501-19
7-2 Continuous Firing	8501-19
7-3 Light-Off Cycles	8501-20
7-4 Normal Shutdown Procedure	8501-20
Chapter 8 Simultaneous Firing of Oil and Gas for Fuel Transfer Only	8501-20
Chapter 9 Dual Oil Atomizers in a Single Burner	8501-22
Chapter 10 Inspection and Maintenance	8501-23
Chapter 11 Referenced Publications	8501-23

Appendix A	8501-23
Appendix B Referenced Publications	8501-31
Index	8501-32

NFPA 8501**Standard for****Single Burner Boiler Operation****1992 Edition**

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates explanatory material on that paragraph in Appendix A.

Information on referenced publications can be found in Chapter 11 and Appendix B.

Foreword

Technological advances in recent years, and in particular the pervasiveness of microprocessor-based hardware, make it even more important that only highly qualified individuals be employed in the translation of these guidelines into operating systems. Each type of hardware has its own unique features and operational modes. It is vital that the designer of the safety system be completely familiar with the features and foibles of the specific hardware, as well as possess a thorough understanding of these standards and their intent.

It is not possible for these standards to encompass specific hardware applications, nor should these be considered a "cookbook" for the design of a safety system.

When applying any type of equipment to a safety system, the designer must carefully consider all of the possible failure modes and the effect that each might have on the integrity of the system and the safety of the unit and personnel. In particular, no single point failure should result in an unsafe or uncontrollable condition or a masked failure of a microprocessor-based system that could result in the operator unwittingly taking action that could lead to an unsafe condition.

This document is to be used for the design, installation, operation, and maintenance of single burner firetube and watertube boiler-furnaces and their burner management and combustion control systems. The standard is organized as follows:

(a) Introduction and common sections that apply to all fired fuels covered in this standard (Chapters 1 through 4).

(b) Detailed sections that are specific to the particular operation described. Chapter 5 applies to starting up a cold boiler. Chapter 6 applies to operating systems including automatic recycling and automatic nonrecycling systems for both watertube and firetube boilers and supervised manual systems for oil- or gas-fired watertube boilers. Chapter 7 applies to simultaneous firing of fuels. Chapter 8 applies to fuel transferring. Chapter 9 applies to dual atomizers in a single burner. Chapter 10 applies to inspection and maintenance.

When using this standard, the common sections should be used in conjunction with the sections covering the specific operation described. Appendix A contains useful information but is not mandatory.

Chapter 1 Introduction**1-1 Scope.**

1-1.1 This standard applies to boilers with a fuel input rating of 12,500,000 Btu/hr (3663 kW) or greater. This standard applies only to boiler-furnaces using single burners firing:

- (a) Natural gas only as defined in Chapter 3.
- (b) Other gas with a Btu value and characteristics similar to natural gas.
- (c) Fuel oil only of No. 2, 4, 5 or 6 grade.
- (d) Simultaneous firing of gas and oil for fuel transfer.
- (e) Simultaneous firing of gas and oil continuously.

1-1.2 The standard is not retroactive. This standard is applicable to new installations and to major alterations or extensions of existing equipment for the preparation and burning of fuel contracted for use subsequent to June 15, 1992.

1-1.3 Furnaces such as those of process heaters used in chemical and petroleum manufacture, wherein steam generation is incidental to the operation of a processing system, are not covered by this standard.

1-1.4 Since this standard is based on the present state of the art, its application to existing installations is not mandatory. Nevertheless, operating companies are encouraged to adopt those features of this standard that are considered applicable and reasonable for existing installations.

1-1.5 Revisions to this document reflect the current state of knowledge and do not imply that previous editions were inadequate.

1-2 Purpose.

1-2.1 The purpose of this standard is to establish minimum standards for the design, installation, operation, and maintenance of single burner boiler-furnaces, their fuel-burning systems, and related systems, to contribute to operating safety, and, in particular, to prevent furnace explosions.

1-2.2 No standard can be promulgated that will guarantee the elimination of boiler-furnace explosions. Technology in this area is under constant development, reflected in part by revisions to this standard. The user of this standard must recognize the complexity of fuel firing as to the type of equipment and the characteristics of the fuel. Therefore, the designer is cautioned that the standard is not a design handbook and does not do away with the need for competent engineering judgment. It is intended that a designer capable of applying more complete and rigorous analysis to special or unusual problems shall have latitude in the development of such designs. In such cases, the designer is responsible for the validity of the approach.

1-2.3 Emphasis is placed on the importance of operation and maintenance procedures, combustion control equipment, safety interlocks, alarms, trips, and other related controls that are essential to safe boiler operation.

1-2.4 The effect of gas cleanup systems located downstream of the post-combustion gas passes of the boiler-furnace is known to be significant. Coordination of the operating procedures and designs of the boiler-furnace and air quality system's air/flue gas path is required. Such coordination shall include requirements for ensuring a continuous flow path from the forced draft fan inlet through the stack. This standard offers only the general requirements of these systems because of the many variations of the designs.

Chapter 2 General

2-1 Furnace Explosions.

2-1.1 The basic cause of furnace explosions is the ignition of an accumulated combustible mixture within the confined space of the furnace or the associated boiler passes, ducts, and fans that convey the gases of combustion to the stack.

2-1.2 A dangerous combustible mixture within the boiler-furnace enclosure consists of the accumulation of an excessive quantity of combustibles mixed with air in proportions that will result in rapid or uncontrolled combustion when an ignition source is supplied. A furnace explosion may result from ignition of this accumulation if the quantity of combustible mixture and the proportion of air to fuel are such that an explosive force is created within the boiler-furnace enclosure. The magnitude and intensity of the explosion will depend on both the relative quantity of combustibles that has accumulated and the proportion of air that is mixed therewith at the moment of ignition. Explosions, including "furnace puffs," are the result of improper procedures by operating personnel, improper design of equipment or control system, or equipment or control system malfunction.

2-1.3 Numerous situations can arise in connection with the operation of a boiler-furnace that will produce explosive conditions; the most common experiences are:

- (a) An interruption of the fuel or air supply or ignition energy to the burners, sufficient to result in momentary loss of flames, followed by restoration and delayed reignition of an accumulation.
- (b) Fuel leakage into an idle furnace and the ignition of the accumulation by a spark or other source of ignition.
- (c) Repeated unsuccessful attempts to light off without appropriate purging resulting in the accumulation of an explosive mixture.
- (d) The accumulation of an explosive mixture of fuel and air as a result of a complete furnace flameout and the ignition of the accumulation by a spark or other ignition source, such as that from attempting to light burner.

2-1.4 The conditions favorable to a boiler-furnace explosion described in 2-1.3 are typical examples, and an examination of numerous reports of boiler-furnace explosions suggests that the occurrence of small explosions, furnace puffs, or near misses has been far more frequent than is usually recognized. It is believed that improved instrumen-

tation, safety interlocks and protective devices, proper operating sequences, and a clearer understanding of the problem by both designers and operators can greatly reduce the risks and actual incidence of furnace explosions.

2-1.5 In a boiler-furnace, upset conditions or control malfunction may lead to an air/fuel mixture that may result in a flameout followed by reignition after a combustible air/fuel ratio has been reestablished. Dead pockets may exist in the boiler-furnace enclosure, or other parts of the unit, where combustible mixtures can accumulate under upset furnace conditions. These accumulations may ignite with explosive force in the presence of an ignition source.

2-2 Manufacture, Design, and Engineering.

2-2.1 The purchaser or the purchaser's agent shall, in cooperation with the manufacturer, assure that the unit is not deficient in apparatus that is required for proper operation, so far as practical, with respect to pressure parts, fuel burning equipment, air and fuel metering, and safe lighting and maintenance of stable flame.

2-2.2 All fuel systems shall include provisions to prevent foreign substances interfering with the fuel supply to the burner.

2-2.3 An evaluation shall be made to determine the optimum integration of manual and automatic safety features considering the advantages and disadvantages of each trip function.

NOTE: The maximum number of automatic trip features does not necessarily provide for maximum overall safety. Some trip actions result in additional operations that increase exposure to hazards.

2-2.4 This standard requires a minimum degree of automation. The trend toward more complex plants or increased automation requires added provisions for:

- (a) Information about significant operating events permitting the operator to make a rapid evaluation of the operating situation. Usable displays of variables shall be provided that will allow the operator to avoid unsafe conditions.
- (b) In-service maintenance and checking of system functions without impairing the reliability of the overall control system.
- (c) An environment conducive to proper decisions and actions.

2-2.5 The burner front piping and equipment shall be designed and constructed to prevent the formation of hazardous concentrations of combustible gases that may exist under normal operating conditions.

2-3 Installation.

2-3.1 The boiler shall not be released for operation before the installation and checkout of the required safeguards and instrumentation system.

2-3.2 The constructor responsible for the erection and installation of the equipment shall see that all pertinent apparatus is properly installed and connected.

2-3.3 The purchaser, the engineering consultant, the equipment manufacturer, and the operating company shall avoid boiler operation until such safeguards have been tested to operate properly as a system. In some instances it may be necessary to install temporary interlocks and instrumentation to meet these requirements. Any such temporary system shall be reviewed by the purchaser, the engineering consultant, the equipment manufacturer, and the operating company, and agreement shall be reached on its suitability in advance of start-up.

2-3.4 The safety interlock system and protective devices shall be jointly tested by the organization with the system design responsibility and those who operate and maintain such systems and devices during the normal operating life of the plant. These tests and checks shall be accomplished before initial operation.

2-4 Coordination of Design, Construction, and Operation.

2-4.1 Statistics indicate that human error is a contributing factor in the majority of furnace explosions. It is important to consider whether the error was a result of:

- (a) Lack of understanding of, or failure to use, proper operating procedures, safeguards, and equipment.
- (b) Unfavorable operating characteristics of the equipment or its control.
- (c) Lack of functional coordination of the various components of the steam generating system and its controls.

2-4.2 Furnace explosions have occurred as a result of unfavorable functional design. Frequently the investigation has revealed human error and has completely overlooked the chain of causes that triggered the operating error. Therefore, the design, installation, and functional objectives of the overall system of components and their controls shall be integrated. Consideration shall be given to the ergonomics that will exist during the operating life of the system.

2-4.3 In the planning and engineering phases of plant construction, design shall be coordinated with operating personnel.

2-4.4 The proper integration of the various components consisting of boiler, burner, fuel and air supply equipment, controls, interlocks and safety devices, operator and maintenance functions, and communication and training shall be the responsibility of the operating company and shall be accomplished by:

- (a) Providing design and operating personnel who possess a high degree of competence in this field and who are required to bring about these objectives.
- (b) Periodic analysis to compare the plant to evolving technology so that improvements can be made to make the plant safer and more reliable.
- (c) Maintaining documentation of plant equipment, system, and maintenance.

2-5 Maintenance Organization. A program shall be provided for maintenance of equipment at intervals consistent with type of equipment, service requirements, and the manufacturer's recommendations. (See Chapter 10.)

2-6 Basic Operating Objectives.

2-6.1 Basic operating objectives shall include the following:

- (a) Establish operating procedures that will result in the minimum number of manual operations.
- (b) Standardize all operating procedures. The use of interlocks is essential to minimize improper operating sequences and to stop sequences when conditions are not proper for continuation. It is particularly important that purge and start-up procedures with necessary interlocks be established and rigidly enforced. Chapters 5 and 6 describe operating sequences that have proven effective in boiler-furnace operation.

2-6.2 Written operating procedures and detailed checklists for operator guidance shall be provided for achieving these basic operating objectives. All manual and automatic functions shall be described.

2-7* Gas and Oil Firing — Special Problems. Common hazards are involved in the combustion of solid, liquid, or gaseous fuels. Each of these fuels has special hazards related to its physical characteristics. Refer to A-2-7 for further information.

Chapter 3 Definitions

Air Change. A quantity of air, provided through the burner, equal to the volume of furnace and boiler gas passes.

Air/Fuel Ratio.

Air-Rich. A ratio of air to fuel supplied to a furnace that provides more air than that required for an optimum air/fuel ratio.

Excess Air. Air supplied for combustion in excess of theoretical air.

NOTE: This is not "Air-Rich" as previously defined.

Fuel-Rich. A ratio of air to fuel supplied to a furnace that provides less air than that required for an optimum air/fuel ratio.

Theoretical Air (Stoichiometric Air). The chemically correct amount of air required for complete combustion of a given quantity of a specific fuel.

Alarm. An audible or visible signal indicating an off-standard or abnormal condition.

Annunciator. A device indicating an off-standard or abnormal condition by both visual and audible signals.

Approved. Acceptable to the "authority having jurisdiction."

NOTE: The National Fire Protection Association does not approve, inspect or certify any installations, procedures, equipment, or materials nor does it approve or evaluate

testing laboratories. In determining the acceptability of installations or procedures, equipment or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations which is in a position to determine compliance with appropriate standards for the current production of listed items.

Atomizer. That device in an oil burner that emits liquid fuel in a finely divided state.

Atomizer, Mechanical. That device in an oil burner that emits liquid fuel in a finely divided state without using an atomizing medium.

Atomizing Medium. A supplementary fluid, such as steam or air, that assists in breaking down oil into a finely divided state.

Authority Having Jurisdiction. The "authority having jurisdiction" is the organization, office or individual responsible for "approving" equipment, an installation or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner since jurisdictions and "approval" agencies vary as do their responsibilities. Where public safety is primary, the "authority having jurisdiction" may be a federal, state, local or other regional department or individual such as a fire chief, fire marshal, chief of a fire prevention bureau, labor department, health department, building official, electrical inspector, or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the "authority having jurisdiction." In many circumstances the property owner or his designated agent assumes the role of the "authority having jurisdiction"; at government installations, the commanding officer or departmental official may be the "authority having jurisdiction."

Boiler. A closed vessel in which water is heated, steam is generated, steam is superheated, or any combination thereof, by the application of heat from combustible fuels in a self-contained or attached furnace.

Boiler Control System. The group of control systems that regulates the boiler process including the combustion control system but not the burner management system.

Boiler-Furnace Enclosure. The physical boundary for all boiler pressure parts and the combustion process.

Burner. A device or group of devices for the introduction of fuel and air into a furnace at the required velocities, turbulence, and concentration to maintain ignition and combustion of fuel within the furnace.

Burner Control Systems.

Automatic (Recycling). A system by which a furnace is purged and a burner is started, ignited, and stopped automatically and that recycles on a preset pressure range.

Automatic (Nonrecycling). A system by which a furnace is purged and a burner is started, ignited, and stopped automatically but does not recycle automatically.

Manual. A system by which a furnace is purged and a burner is started, ignited, and stopped manually.

Supervised Manual. A system by which a furnace is purged and a burner is started, ignited, and stopped manually, with interlocks to ensure that the operation follows established proper procedures.

Burner Management System. The control system dedicated to boiler-furnace safety, operator assistance in the starting and stopping of fuel preparation and burning equipment, and preventing misoperation of and damage to fuel preparation and burning equipment.

Types of systems used in this document include:

Automatic (Recycling). A system by which a furnace is purged and a burner is started, ignited, and stopped automatically and recycles on a preset pressure range.

Automatic (Nonrecycling). A system by which a furnace is purged and a burner is started, ignited, and stopped automatically but does not recycle automatically.

Manual. A system by which a furnace is purged and a burner is started, ignited, and stopped manually.

Supervised Manual. A system by which a furnace is purged and a burner is started, ignited, and stopped manually, with interlocks to ensure that the operation follows established proper procedures.

Combustion Control System. The control system that regulates the furnace fuel and air inputs to maintain air/fuel ratio within the limits required for continuous combustion and stable flame throughout the operating range of the boiler in accordance with demand. This control system includes the furnace draft control where applicable.

Drip Leg. A chamber of ample volume, with suitable cleanout and drain connections, into which gas is discharged so that liquids and solids are trapped.

Excessive Steam Pressure Switch. A pressure-actuated device arranged to effect a safety shutdown of the burner when the steam pressure exceeds a preset pressure.

Excessive Water Temperature Switch. A temperature-actuated device arranged to effect a safety shutdown of the burner when the water temperature exceeds a preset temperature.

Flame. The visible or other physical evidence of the chemical process of rapidly converting fuel and air into products of combustion.

Flame Detector. A device that senses the presence or absence of flame and provides a usable signal.

Fuel Oil. Numbers 2, 4, 5, and 6 fuel oils as defined in ASTM D396, *Standard Specifications for Fuel Oils*.

Fuel Trip. The automatic shutoff of a specific fuel as the result of an interlock or operator action.

Furnace. An enclosure designed for the combustion of fuel.

Furnace Purge. (See definition of Purge.)

Gas. (See definitions of LP-Gas and Natural Gas.)

High Gas Pressure Switch. A pressure-actuated device arranged to effect a safety shutdown or prevent starting when the gas pressure exceeds the preset value.

High Oil Temperature Switch. A temperature-actuated device that initiates a signal when oil temperature rises above the limits required to maintain the viscosity range recommended by the burner manufacturer.

High Steam Pressure Switch. A pressure-actuated device arranged to effect a normal burner shutdown when the steam pressure exceeds a preset pressure.

High Water Temperature Switch. A temperature-actuated device arranged to effect a normal burner shutdown when the water temperature exceeds a preset temperature.

Igniter. A device that provides proven ignition energy to immediately light-off the main burner.

Class 1 (Continuous Igniter). An igniter applied to ignite the fuel input through the burner and to support ignition under any burner light-off or operating conditions. Its location and capacity are such that it will provide sufficient ignition energy, generally in excess of 10 percent of fuel load burner input, at its associated burner to raise any credible combination of burner inputs of both fuel and air above the minimum ignition temperature.

Class 2 (Intermittent Igniter). An igniter applied to ignite the fuel input through the burner under prescribed light-off conditions. It is also used to support ignition under low load or certain adverse operating conditions. The range of capacity of such igniters is generally 4 percent to 10 percent of full load burner fuel input. It shall not be used to ignite main fuel under uncontrolled or abnormal conditions. The burner shall be operated under controlled conditions to limit the potential for abnormal operation, as well as to limit the charge of fuel to the furnace in the event that ignition does not occur during light-off. Class 2 igniters may be operated as Class 3 igniters.

Class 3 (Interrupted Igniter). An igniter applied particularly to gas and oil burners to ignite the fuel input to the burner under prescribed light-off conditions. The capacity of such igniters generally does not exceed 4 percent of the full load burner fuel input. As a part of the burner light-off procedure, the igniter is turned off when the time trial-for-ignition of the main burner has expired. This is to ensure that the main flame is self-supporting, is stable, and is not dependent upon ignition support from the igniter. The use of such igniters to support ignition or to extend the burner control range shall be prohibited.

Class 3 Special (Direct Electric Igniter). A special Class 3 high energy electrical igniter capable of directly igniting the main burner fuel. This type igniter shall not be used unless supervision of the individual burner flame is provided.

Inerting. The dilution of the oxygen content of an air/fuel mixture to a point where it is no longer explosive through the addition of an inert gas or vapor.

Interlock. A device or group of devices arranged to sense a limit or off-limit condition or improper sequence of events and to shut down the offending or related piece of equipment or to prevent proceeding in an improper sequence in order to avoid a hazardous condition.

Labeled. Equipment or materials to which has been attached a label, symbol or other identifying mark of an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

Light-Off. The establishment of the combustion of fuel entering the furnace.

Light-Off Time Limit Timer. A device used on supervised manual systems that limits the allowable time between completion of purge and light-off. This time shall be no more than five minutes.

Listed. Equipment or materials included in a list published by an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

NOTE: The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The "authority having jurisdiction" should utilize the system employed by the listing organization to identify a listed product.

Logic System. The decision making and translation elements of the burner management system.

(a) *Hard Wired Systems.* Individual devices and interconnecting wiring.

(b) *Microprocessor Based Systems.*

1. Computer hardware, power supplies, I/O devices, and interconnections between these.

2. Operating systems and logic software.

Low Fire. The minimum fire rate resulting in stable combustion.

Low Gas Pressure Switch. A pressure-actuated device arranged to effect a safety shutdown or prevent starting when the gas pressure falls below the preset value.

Low Oil Pressure Switch. A pressure-actuated device arranged to effect a safety shutdown or prevent starting when the oil pressure falls below the preset value.

Low Oil Temperature Switch. A temperature-actuated device that initiates a signal when the oil temperature falls below the limits required to maintain the viscosity range recommended by the burner manufacturer.

Low Water Cutout. A device arranged to effect a shutdown of the burner when water level in the boiler falls to a predetermined low level.

Auxiliary Low Water Cutout. A device that is arranged to effect a safety shutdown (requires manual reset, see: Shutdown, Safety) of the burner when the water level in the boiler falls to a predetermined low level.

LP-Gas. A material composed predominantly of any of the following hydrocarbons, or mixtures of them: propane, propylene, n-butane, isobutane, and butylenes.

Main Burner Establishing Period. (See definition of Trial-for-Ignition Period.)

Modulate. To gradually vary the fuel and air flows to the burner in accordance with load demand.

Monitor. To sense and indicate a condition without initiating automatic corrective action.

Natural Gas. A gaseous fuel occurring in nature consisting mostly of a mixture of organic compounds (normally methane, ethane, propane, and butane). The Btu value of natural gases varies between about 700 and 1,500 Btu per cu ft (26.1 and 55.9 MJ/m³), the majority averaging 1,000 Btu per cu ft (37.3 MJ/m³).

Normal Fuel Supply Pressure. The pressure at the fuel service connection for which the fuel burning system has been designed.

Oil. (See definition of Fuel Oil.)

Operating Range. The region between the maximum fuel input and minimum fuel input in which the burner flame can be maintained, continuous and stable.

Outlet Draft. The flue gas pressure at the outlet of the last convection pass of the boiler.

Post Purge. A purge performed after a burner is shut down.

Prove. To establish by measurement or test the existence of a specified condition such as flame, level, flow, pressure, or position.

Purge. A flow of air through the furnace, boiler gas passages, and associated flues and ducts that will effectively remove any gaseous combustibles and replace them with air. Purging may also be accomplished by an inert medium.

Recycle. A start-up initiated by steam pressure or water temperature following a normal shutdown.

Repeatability. The ability of a device to maintain a constant set point characteristic.

Restart. A manually initiated start-up.

Safety Shutdown Trip Relay. An electromechanical relay utilized to trip all required equipment simultaneously.

Safety Shutoff Valve (Safety Trip Valve). A fast closing valve that automatically and completely shuts off the fuel supply to main burner(s) or igniter(s) in response to a normal or a safety shutdown signal.

Semiautomatic. The terms "automatic (nonrecycling)" and "supervised manual" are used in this standard to describe the functions conventionally attributed to "semiautomatic."

Service Connection. A point at which fuel, atomizing medium, or power is connected to the boiler, firing equipment, or controlled devices.

Set Point. A predetermined value to which an instrument is adjusted and at which it shall perform its intended function.

Shall. Indicates a mandatory requirement.

Should. Indicates a recommendation or that which is advised but not required.

Shutdown.

Normal. Stopping burner operation by shutting off all fuel and ignition energy to the furnace.

Safety. Stopping burner operation by shutting off all fuel and ignition energy to the furnace by means of a safety interlock or interlocks and requiring a manual restart.

Soot Blower. A mechanical device for introducing steam or air to clean heat-absorbing surfaces.

Supervise. To sense and indicate a condition requiring attention and automatically initiate corrective action.

Trial-for-Ignition Period (Igniter). That interval of time during light-off in which a safety control circuit permits the igniter fuel safety shutoff valve(s) to be opened before the flame detection system is required to supervise the igniter flame.

Trial-for-Ignition Period (Main Burner). That interval of time during light-off in which a safety control circuit permits the main burner fuel safety shutoff valve(s) to be opened before the flame detection system is required to supervise the main burner flame only.

Chapter 4 Equipment Requirements

4-1 Fuel Supply (Oil).

4-1.1 Fuel shall be properly stored, prepared, and delivered to the oil service connection under anticipated operating conditions in accordance with the applicable portions

of NFPA 31, *Standard for the Installation of Oil Burning Equipment*.

4-1.2 Operation of the burner shall not be attempted until a satisfactory fuel supply is assured.

4-1.3 Fuel shall be continuously delivered to the combustion chamber in a finely atomized form that can be readily ignited and consumed.

4-1.4 All equipment associated with pumping, heating, and straining the fuel from storage to the service connection shall be properly designed, sized, and interconnected so as to provide a suitable fuel supply over a full range of conditions. Relief valves shall be installed after the pump to prevent overpressure in the system.

4-1.5 Fuel being burned shall be delivered to the burner at proper temperature and pressure.

NOTE: Excessively heated oil may create vapor-lock, which can prevent continuous operation. Cold oil may prevent satisfactory atomization.

4-1.6 Where the fuel must be heated, care shall be taken to ensure that the interlocks and instruments reflect correct values of the variable being measured, particularly in dead-end lines where heavy oil will tend to solidify.

4-1.7 The operation of a burner system that has the capability to burn heated and unheated oils shall include a procedure to ensure that the proper type of oil, compatible with the selected mode of operation, is being supplied to the burner. Precautions shall include the intended routing of recirculated oil.

4-1.8* Two safety shutoff valves in series, each with proof of closure, shall be provided in the oil line to the main burner.

CAUTION: Means shall be provided to prevent or relieve excess pressure between these valves.

4-1.9 Oil piping materials and system design shall be in accordance with NFPA 31, *Standard for the Installation of Oil Burning Equipment*.

4-2* Fuel Supply (Gas).

4-2.1 The gas supply at the gas service connection shall be controlled at the pressure for which the fuel burning system has been designed.

4-2.2 Gas piping shall be of ample size to maintain the desired constant pressure for the maximum burner flow.

4-2.3* Two safety shutoff valves in series, each with proof of closure, shall be provided in the gas line to the main burner. An automatic vent valve shall be provided between the two valves.

4-2.4 Foreign matter such as welding beads, chips, scale, dust, and debris shall be removed from the gas piping.

4-2.5 A drip leg shall be provided in the gas piping (*see A-4-2.3 and A-4-4.1*).

4-2.6 Gas piping materials and system design shall be in accordance with NFPA 54, *National Fuel Gas Code*.

4-2.7 The discharge from atmospheric vents shall be located so that there is no possibility of the discharged gas being drawn into the air intake, ventilating system, or windows of the boiler room or adjacent buildings and shall be extended sufficiently above the boiler and adjacent structures so that gaseous discharge does not present a fire hazard. There shall be no cross connection between venting systems of different boilers.

4-3 Alternate Fuel Firing.

4-3.1 Manual Fuel Selection. Where oil and gas are to be burned alternately, a manually positioned fuel selector switch shall be provided to permit operation of the necessary interlocks, fuel safety shutoff valves, and controls for the fuel to be fired.

4-3.2 Automatic Fuel Selection. Where oil and gas are to be burned alternately, an automatic change from one fuel to the other shall be accomplished only after a shutdown. Provision for manual changeover of the system shall be provided in accordance with 4-3.1 and Chapter 8. For simultaneous firing of oil and gas fuels, see Chapter 7.

4-4 Fuel Burning Equipment.

4-4.1* Ignition.

4-4.1.1 The main burner shall be equipped with a permanently installed igniter. If an intermittent igniter (Class 2) is used and is not operated as an interrupted igniter, the main burner flame shall be proven independently of the igniter.

4-4.1.2 The igniter flame or arc shall impinge on the main burner air/fuel mixture and supply sufficient ignition energy to provide immediate ignition of all fuel discharge from the main burner under light-off conditions.

4-4.1.3* Two safety shutoff valves in series shall be provided in the line to the gas igniter. An automatic vent valve shall be provided between the two valves for gas igniters. One safety shutoff valve shall be provided in the line to the oil igniter.

4-4.1.4 The igniter shall be designed for periodic removal, cleaning, and maintenance.

4-4.2 Main Burner.

4-4.2.1 The main burner shall direct the fuel and air into the furnace so as to provide a stable flame and efficient combustion over its entire operating range.

4-4.2.2 The burner shall be provided with at least one convenient observation port of a size to permit visual inspection of the igniter and main burner flames.

4-4.2.3 The limits of stable flame for the burner shall be determined by test. These tests shall be performed without the igniter in service and shall include the intended range and grade of fuel(s).

The tests shall verify that transients generated in the fuel and air systems do not adversely affect burner operation. Such transients are generated by burner control valves, dampers, and other equipment that operate at speeds faster than the speed of response of other components in the system.

4-4.2.4 Each manual adjustment feature on the burner shall be provided with means for securing it in its intended position.

4-4.2.5 The atomizing equipment for oil burners shall be designed for periodic removal, cleaning, and maintenance.

4-4.2.6 Any procedure for clearing the atomizer and piping into the furnace prior to shutdown shall be accomplished while the fan is operating and the igniter is reestablished or the main flame is continuously proven during this operation.

4-4.2.7 Clearing of the oil passages of the atomizer into the furnace immediately after a shutdown shall be prohibited.

4-4.3 Atomizing Medium for Oil Burners.

4-4.3.1 Where the fuel is to be atomized with the assistance of another medium, this atomizing medium shall be supplied free of contaminants that could cause an interruption of service.

4-4.3.2 The atomizing medium shall be provided at the pressures required for proper operation.

4-4.3.3 Provisions shall be made to ensure that fuel cannot enter the atomizing medium line during or after operation.

4-4.4 Combustion Air Supply.

4-4.4.1 The combustion air supply equipment shall be capable of supplying combustion air for the optimum air/fuel ratio over the entire operating range of the burner.

4-4.4.2 Provision shall be made for periodic cleaning of the combustion air supply equipment.

4-4.5 Furnace.

4-4.5.1 The furnace shall be designed to promote main burner stability while minimizing zones that cannot be purged.

4-4.5.2 At least one observation port in addition to the requirements of 4-4.2.2 shall be provided to permit observation of the burner flame and furnace.

4-4.6 Combustion Products Removal.

4-4.6.1 The outlet draft equipment shall be capable of removing combustion products without adversely affecting stable flame conditions.

CAUTION: Tall stacks can produce furnace draft conditions adversely affecting flame stability and may require special draft control provisions.

4-4.6.2 Where two or more boilers are connected to a common stack, each connection shall be equipped with a damper system. All boiler outlet dampers shall be equipped with accessible operating and locking devices. This equipment shall be compatible with the combustion control system of the boiler. Interlocks shall be provided to prevent firing against a closed damper. Provision shall be made to prevent rendering the interlock nonfunctional if the linkage becomes disconnected. This can be accomplished by any of the following:

- (a) Placing the interlock on the driven member,
- (b) Utilizing a furnace pressure switch, or
- (c) Other appropriate means.

Exception: Dampers are not required on the outlet of boilers of a type in which maintenance operations are performed from outside of the boiler.

4-5 Burner Management System, Logic. The intent of this section is to provide guidance in the use of logic systems in burner management.

4-5.1 General Requirements. A logic system provides outputs in a particular sequence in response to external inputs and internal logic. The logic system for burner management shall be specifically designed so that a single failure in that system shall not prevent an appropriate shutdown.

4-5.2 Specific Requirements. As a minimum, the following shall be included in the design to ensure that a logic system for burner management meets the intent of these standards.

NOTE: Some items are not applicable to specific types of logic systems, e.g., relay.

4-5.2.1 Failure Effects. The logic system designer shall recognize the failure modes of components when considering the design application of the system. As a minimum the following failure effects shall be evaluated and addressed:

- (a) Interruptions, excursions, dips, recoveries, transients, and partial losses of power.
- (b) Memory corruption and losses.
- (c) Information transfer corruption and losses.
- (d) Inputs and outputs "fail-on," "fail-off."
- (e) Signals unreadable or not being read.
- (f) Addressing errors.
- (g) Processor faults.

4-5.2.2 Design.

- (a) Diagnostics shall be included in the design to monitor processor logic functionality.
- (b) Logic system failure shall not preclude proper operator intervention.
- (c) Logic shall be protected from unauthorized changes.
- (d) Logic shall not be changed when the associated equipment is in operation.

(e) System response time (throughput) shall be sufficiently short to prevent negative effects on the application.

(f) Noise immunity shall be adequate to prevent false operation.

(g) A single component failure within the logic system shall not prevent a mandatory safety shutdown trip.

(h) The operator shall be provided with (a) dedicated manual switch(es) that shall independently and directly actuate the safety shutdown trip relay.

4-5.2.3 Requirement for Independence. The logic system performing the safety functions for burner management and boiler control systems shall not be combined with any other logic or control system. These burner management safety functions shall include, but not be limited to, proper purge interlocks and timing, mandatory safety shutdowns, trial timing for ignition, and flame monitoring.

4-6 Combustion Control System.

4-6.1 The combustion control system shall maintain air/fuel mixtures at preestablished ratios throughout the operating range of the burner and during changes in firing rate.

4-6.2 The system shall provide limits on fuel and air to prevent reducing furnace input below the point of stable burner operation. The minimum and maximum points of stable burner operation shall be defined by the burner manufacturer and verified by operational tests.

4-7 Interlock System.

4-7.1 The system shall be equipped with a method of determining the operating state of each interlock without disassembling any of the interlock devices.

4-7.2 Each interlock shall be provided with a method of establishing the set point. The set point shall be repeatable within prescribed limits.

4-7.3 Interlock devices shall be designed for anticipated environmental conditions, such as temperature, humidity, vibration, and corrosive agents.

4-7.4 The interlocks on the low water cutouts may be bypassed for blowdown purposes only. This bypass shall be of a type that is temporarily held during blowdown.

4-7.5 Interlocks shall not be manually bypassed at any time during normal operation.

Exception: See 4-7.4 and Chapter 5.

4-7.6 Each safety control ac circuit shall be two wire, one side grounded, preferably not exceeding nominal 120 volts, and shall be protected with a suitable fuse or circuit breaker in the hot side only.

4-7.7 Safety control dc circuits shall be arranged as called for in 4-7.6 where grounding is possible. Where grounding is not possible and the circuit voltage exceeds 50 volts, the circuit shall have switching contacts in one side of the line and ground-fault circuit-interrupters provided.

4-8 Flame Safety Shutdown System.

4-8.1 The time interval between loss of flame and stopping the fuel flow to the burner shall be not more than four seconds.

4-8.2 Permanent means shall be provided for making periodic tightness tests of the main burner gas safety shut-off valves.

Chapter 5 Starting a Cold Boiler

5-1 General.

5-1.1 Starting of a cold boiler shall be accomplished in conformance with the manufacturer's recommendations. In no case shall a boiler that has been taken out of service for maintenance, repair, or extended shutdown be started from a cold condition without a qualified operator present.

5-1.2 Applicable start-up procedures for the burner control system provided shall be followed. Firing rate shall be limited in accordance with the boiler manufacturer's instructions.

5-2 Gas-Fired Boilers. The procedures of Chapter 6 shall be followed for starting a cold gas-fired boiler.

5-3 Oil-Fired Burners. When steam is not available for heating oil, or as an atomizing medium, or for driving auxiliary equipment, one of the starting methods described in 5-3.1, 5-3.2 or 5-3.3 shall be used.

5-3.1 Auxiliary Air Atomizing of Oil.

5-3.1.1 Equipment Required.

(a) Forced draft (FD) fan.

(b) Approved auxiliary oil heater for start-up fuel flow with a capacity not less than that required for minimum fire with stable flame.

(c) Compressed air supply.

(d) Check valves in steam and air lines to the atomizer.

5-3.1.2 Facility Required.

(a) An atomizing air supply (*see A-4-1.8*).

5-3.1.3 Starting Procedure.

(a) Circulate and heat oil, using auxiliary heater and recirculating system, to satisfy all interlocks, where included.

(b) Follow normal start-up procedure described in Chapter 6 using air as the atomizing medium.

(c) Set combustion control at light-off firing rate.

(d) When steam pressure is raised to a point where it is adequate for heating and atomizing the oil, shut down in accordance with the normal shutdown procedure described in Chapter 6.

(e) Close atomizing air supply and open atomizing steam supply, making certain that dry steam is available.

(f) Change over from auxiliary oil heater to steam oil heater.

(g) Follow normal start-up procedure.

5-3.2 Auxiliary Mechanical Atomizing of Heavy Oil.

5-3.2.1 Equipment Required.

(a) FD fan.

(b) Approved auxiliary oil heater for start-up fuel flow with a capacity not less than that required for minimum fire with stable flame.

(c) Mechanical atomizer.

(d) Means to bypass atomizing medium interlocks. The fact that these are bypassed shall be made evident to the operator with adequate warning devices.

5-3.2.2 Starting Procedure.

(a) Circulate and heat oil using auxiliary heater and recirculating systems to satisfy oil interlocks, where included.

(b) Bypass atomizing medium interlocks [See 5-3.2.1(d).]

(c) Insert mechanical atomizer.

(d) Follow normal start-up procedure described in Chapter 6.

(e) Set combustion control at light-off firing rate.

(f) When steam pressure is raised to a point where it is adequate for heating and atomizing the oil, shut down in accordance with the normal shutdown procedure described in Chapter 6.

(g) Remove mechanical atomizer.

(h) Insert steam atomizer.

(i) Make atomizing medium interlocks operable.

(j) Change over from auxiliary oil heater to steam oil heater.

(k) Follow normal start-up procedure.

5-3.3 Auxiliary Mechanical Atomizing of Light (Unheated) Oil.

5-3.3.1 Equipment Required.

(a) FD fan.

(b) Mechanical atomizer.

(c) Check valves in the heavy and light oil lines.

(d) Means to bypass oil and atomizing medium interlocks. The fact that these are bypassed shall be made evident to the operator with adequate warning devices.

5-3.3.2 Facility Required.

(a) A light oil supply.

5-3.3.3 Starting Procedure.

(a) Shut off heavy oil to system.

(b) Insert mechanical atomizer.

(c) Bypass oil and atomizing medium interlocks.

(d) Open light oil supply into the system.

(e) Follow normal start-up procedure described in Chapter 6.

(f) Set combustion control at light-off rate.

(g) When steam pressure is raised to a point where it is adequate for heating and atomizing the heavy oil, shut down in accordance with normal shutdown procedure described in Chapter 6.

(h) Shut off light oil supply to the system.

(i) Remove mechanical atomizer.

(j) Insert steam atomizer.

(k) Make oil and atomizing medium interlocks operable by removing bypasses.

(l) Open heavy oil supply to the system.

(m) Follow normal start-up procedure.

Chapter 6 Operating Systems

6-1* General. Chapter 6 and Figures A-4-1.8, A-4-2.3, and A-4-4.1 illustrate typical arrangements of operating systems for automatic (recycling), automatic (nonrecycling), and supervised manual systems to meet the intent of this standard. Manual systems (while not recommended) are discussed in Appendix A. Different arrangements are permissible if they provide equivalent protection and meet the intent of this standard.

6-2 Automatic (Recycling) Systems for Watertube Boilers.

6-2.1 An automatic (recycling) unit shall not be started from a cold condition unless a qualified operator is present. In this section, it is assumed that the unit is hot and that steam pressure and operating water level have been established.

6-2.2 It is further assumed that the fuel to be fired has been manually selected. The alternate fuel system shall be placed in a nonfiring condition, and the manual burner valve(s) shall be closed.

6-2.3 An igniter as specified in 4-4.1.1 shall be provided.

6-2.4 An automatic (recycling) unit shall recycle on a pre-set pressure and perform four major functions:

- (a) Pre-firing cycle.
- (b) Light-off cycle.
- (c) Modulation, where provided.
- (d) Shutdown cycle.

6-2.4.1 The pre-firing cycle shall accomplish the following in the order listed:

- | (a) Prove the main fuel safety shutoff valves closed.
- (b) Prove no flame present at the burner.
- (c) Start fan.
- (d) Satisfy fan interlock.

(e) Where atomizing medium is used and if not already on, admit medium to main burner.

(f) Where atomizing medium is used, satisfy atomizing medium interlocks.

(g) Satisfy appropriate fuel interlocks.

NOTE: The order of items (e), (f), and (g) in the sequence is optional.

(h) Prove purge airflow by satisfying: (1) air pressure and "open damper" interlocks for all dampers in the flow path or (2) airflow interlock. Purge airflow shall reach no less than 70 percent of the airflow required at maximum continuous capacity of the unit.

(i) The purge shall be sufficient for at least eight air changes. Airflow during the time to open the damper and return it to light-off position may be included in computing the time for eight air changes.

(j) Set controls to light-off position.

(k) Prove dampers and fuel control valve in light-off position.

6-2.4.2 The light-off cycle for a burner with an interrupted igniter shall accomplish the following in the order listed:

(a) Energize igniter.

(b) Prove igniter flame within 10 seconds (for direct electric igniter, proof of igniter operation is not required).

1. If proven, admit fuel to main burner. For an oil burner other than return flow type, simultaneously shut off oil recirculating flow.

2. If not proven, establish safety shutdown.

(c) After a maximum of 10 seconds for gas and Nos. 2 and 4 oils or 15 seconds for Nos. 5 and 6 oils, shut off igniter. For gas igniters vent the gas piping between igniter safety shutoff valves to atmosphere.

(d) Prove main flame.

1. If proven, release to modulating control where provided.

2. If not proven, establish safety shutdown.

6-2.4.3 The light-off cycle for a burner with an intermittent igniter shall accomplish the following in the order listed:

(a) Energize igniter.

(b) Prove igniter flame within 10 seconds.

1. If proven, admit fuel to main burner. For an oil burner other than return flow type, simultaneously shut off recirculating flow.

2. If not proven, establish safety shutdown.

(c) After a maximum of 10 seconds for gas and Nos. 2 and 4 oils or 15 seconds for Nos. 5 and 6 oils, prove the main flame.

1. If proven, release to combustion control for modulation where provided.

2. If not proven, establish safety shutdown.

6-2.4.4 Modulation, where provided, shall be accomplished by a combustion control system.

6-2.4.5 The normal shutdown cycle shall accomplish the following in the order listed:

(a) Shut off fuel supply to main burner.

(b) Interrupt spark and shut off fuel supply to igniter, if in operation.

(c) For oil:

1. Where used, open recirculating valve.

2. Shut off atomizing medium, if desired.

(d) For gas, vent piping between safety shutoff valves to atmosphere.

(e) Perform a post purge of the boiler furnace enclosure.

(f) Shut down fan, if desired.

6-2.4.6 For automatic (recycling) boilers, the high steam pressure, high water temperature, or low water level (not determined by the auxiliary low water cutout) shall accomplish a normal shutdown, and the burner shall be allowed to recycle when steam pressure, water temperature, or water level has dropped to within the preset operating range.

6-2.4.7 The safety shutdown cycle shall accomplish the following in the order listed and activate an alarm:

(a) Shut off fuel supply to main burner.

(b) Shut off fuel supply and interrupt spark to the igniter if in operation.

(c) For oil:

1. Where used, open recirculating valve.

2. Where used, shut off atomizing medium, if desired.

(d) For gas:

1. Vent gas piping between safety shutoff valves to atmosphere.

(e) Where used, the inerting system shall be simultaneously energized with 6-2.4.7(a) above.

(f) After post purge, shut down fan, if desired.

(g) Require manual reset.

6-2.4.8* Any of the following conditions shall accomplish a safety shutdown, and the burner shall not be allowed to recycle until a qualified operator determines the cause of the shutdown and takes the necessary corrective action to assure that safe operating conditions prevail before restarting:

(a) For oil:

1. Low fuel pressure.

2. Low temperature of heated oils.

3. Loss of combustion air supply.

4. Loss of or failure to establish flame.

5. Loss of control system actuating energy.

6. Power failure.

7. Low water level as determined by the auxiliary low water cutoff.

8. Loss of atomizing medium, where used, as interlocked by flow or two pressure switches, one located at the service connection and the other at the burner, either one of which shall initiate a safety shutdown on low pressure.

9. Excessive steam pressure or water temperature.

(b) For gas:

1. High gas pressure.
2. Low gas pressure.
3. Loss of combustion air supply.
4. Loss of or failure to establish flame.
5. Loss of control system actuating energy.
6. Power failure.

7. Low water level as determined by the auxiliary low water cutoff.

8. Excessive steam pressure or water temperature.

CAUTION: Excessive recycling to achieve a burner light-off can lead to accumulation of a hazardous amount of fuel in the furnace and shall be avoided.

6-3 Automatic (Nonrecycling) Systems for Watertube Boilers.

6-3.1 The provisions of 6-2.1, 6-2.2, 6-2.3, and 6-2.4 shall apply except for 6-2.4.6 (*see 6-3.1.1*).

6-3.1.1 When high steam pressure or high water temperature establishes a normal shutdown, the burner shall not be allowed to recycle. A qualified operator shall initiate the restart.

6-4 Automatic (Recycling) Systems for Firetube Boilers.

6-4.1 In this section, it is assumed that the equipment is in accordance with Chapter 4, the boiler has been placed in service in accordance with Chapter 5, and the operating water level has been established.

6-4.2 An automatic (recycling) unit shall recycle on a preset pressure or temperature and perform four major functions:

- (a) Pre-firing cycle.
- (b) Light-off cycle.
- (c) Modulation, where provided.
- (d) Shutdown cycle.

6-4.2.1 The pre-firing cycle shall accomplish the following in the order listed:

- (a) Prove the fuel safety shutoff valves closed.
- (b) Prove no flame present at burner.
- (c) Start fan.
- (d) Satisfy fan interlock.

(e) Where atomizing medium is used and if not already on, admit medium to main burner.

(f) Where atomizing medium is used, satisfy atomizing medium interlocks.

(g) Satisfy appropriate fuel interlocks.

NOTE: The order of items (c), (f), and (g) in the sequence is optional.

(h) Prove purge airflow by satisfying:

1. Air pressure and "open damper" interlocks for all dampers in the flow path, or
2. Airflow interlock.

(i) The purge of the furnace and boiler gas passes shall be sufficient for at least four air changes. During the purge, the air damper shall be driven to the full open position. Airflow during the time to open the damper and return it to light-off position may be included in computing the time for four air changes.

(j) Prove control system in light-off position.

6-4.2.2 The light-off cycle shall accomplish the following in the order listed:

(a) Energize interrupted igniter.

(b) Prove igniter flame within 10 seconds (for direct electric igniter, proof of igniter operation is not required).

1. If proven, admit fuel to main burner.
2. If not proven, establish safety shutdown.

(c) After a maximum of 10 seconds for gas and Nos. 2 and 4 oils, or 15 seconds for Nos. 5 and 6 oils, shut off igniter. For gas igniters, vent the gas piping between igniter safety shutoff valves to atmosphere.

(d) Prove main flame.

1. If proven, release to modulating control where provided.

2. If not proven, establish safety shutdown.

6-4.2.3 Modulation, where provided, shall be accomplished by a combustion control system.

6-4.2.4 High steam pressure, high water temperature, or low water (not determined by the auxiliary low water cutoff) shall accomplish a normal shutdown, and the burner shall be allowed to recycle when steam pressure, water temperature, or water level has returned to within the preset operating range.

6-4.2.5 The normal shutdown cycle shall accomplish the following in the order listed:

(a) Shut off fuel supply to main burner.

(b) For oil:

1. Where used, open recirculating valve.
2. Where used, shut off atomizing medium, if desired.

(c) For gas:

1. Vent gas piping between safety shutoff valves to atmosphere.

(d) After post purge, shut down fan, if desired.

6-4.2.6 The safety shutdown cycle shall accomplish the following in the order listed:

- (a) Shut off fuel supply to main burner.
- (b) Shut off fuel supply and interrupt spark to the igniter if in operation.
- (c) For oil:
 - 1. Where used, open recirculating valve.
 - 2. Where used, shut off atomizing medium, if desired.
- (d) For gas:
 - 1. Vent gas piping between safety shutoff valves to atmosphere.
- (e) Where used, energize inerting system simultaneously with 6-4.2.6(a).
- (f) After post purge, shut down fan, if desired.
- (g) Require manual reset.

6-4.2.7 Any of the following conditions shall accomplish a safety shutdown, and the burner shall not be allowed to recycle until a qualified operator determines the cause of the shutdown and takes the necessary corrective action to assure that safe operating conditions prevail before restarting:

- (a) For oil:
 - 1. Low oil pressure.
 - 2. Low temperature of heated oils.
 - 3. Loss of combustion air supply.
 - 4. Loss of or failure to establish flame.
 - 5. Loss of control system actuating energy.
 - 6. Low water level as determined by the auxiliary low water cutout.
 - 7. Loss of atomizing medium where used.
 - 8. Excessive steam pressure or water temperature.
 - 9. Power failure.
- (b) For gas:
 - 1. High gas pressure.
 - 2. Low gas pressure.
 - 3. Loss of combustion air supply.
 - 4. Loss of or failure to establish flame.
 - 5. Loss of control system actuating energy.
 - 6. Low water level as determined by the auxiliary low water cutout.
 - 7. Excessive steam pressure or water temperature.
 - 8. Power failure.

CAUTION: Excessive recycling to achieve a burner light-off can lead to accumulation of a hazardous amount of fuel in the furnace and shall be avoided.

6-5 Automatic (Nonrecycling) Systems for Firetube Boilers.

6-5.1 The provisions of 6-4.1 and 6-4.2 shall apply, except for 6-4.2.4 (*see 6-5.1.1*).

6-5.1.1 When a high steam pressure or high water temperature operating control establishes a normal shutdown, the burner shall not be allowed to recycle. A qualified operator shall initiate the restart.

6-6 Supervised Manual Systems for Oil-Fired Watertube Boilers.

6-6.1 The following steps shall be taken by the operator when starting a supervised manual unit, and the indicated interlocks shall be satisfied at each step. It is assumed that fuel pressure and temperature, atomizing medium, control system energy, power, and water level have been established. When interlocks have been satisfied, this fact shall be indicated to the operator.

6-6.2 Select the fuel to be fired. The alternate fuel system shall be placed in a nonfiring condition, and the manual burner valve(s) shall be closed.

6-6.3 An igniter as specified in 4-4.1.1 shall be provided.

6-6.4 Pre-firing Cycle (in order listed).

Operator Functions	Interlock Functions
1. Check manual fuel shutoff valve(s) closed.	1. Manual fuel shutoff valve(s) closed.
2. Start fan.	2. Fan on.
3. Where used, open atomizing medium valve.	3. Atomizing medium supply available.
4. Open damper(s) to purge position.	4. (1) Air pressure and open damper(s), or (2) Airflow. See 6-2.4.1(h) and (i).
5. Start purge timer.	5. Purge complete.
6. Place damper and fuel control valve in light-off position.	6. Damper and fuel control valve in light-off position. If light-off airflow is less than purge airflow rate, start light-off time limit timer.
7. None.	7. Spark and igniter and main safety shutoff valves ready for operation.

6-6.5 Light-Off Cycle.

Operator Functions	Interlock Functions
1. Energize igniter.	1. Prove igniter flame within 10 seconds. (For direct electric ignition, proof of igniter operation is not required.)
2. Open fuel safety shutoff valve to main burner.	2. None.

- | | |
|---|---|
| 3. Close recirculating valve, where used. | 3. None. |
| 4. Open manual fuel shutoff valve. | 4. Prove main flame within 10 seconds for Nos. 2 and 4 oils or 15 seconds for Nos. 5 and 6 oils. Close igniter safety shutoff valve(s). For gas igniter, vent gas piping between safety shutoff valves. |
| 5. Bring unit to present operating pressure at an acceptable rate, maintaining an optimum air/fuel ratio. | 5. None. |
| 6. On reaching preset pressure range, change to automatic combustion control. | 6. None. |

6-6.6 Normal Shutdown Cycle.

- | Operator Functions | Interlock Functions |
|---|--|
| 1. Shut off fuel supply to the main burner. | 1. Fuel safety shutoff valve(s) to main burner closed. |
| 2. Open fuel recirculating valve, where used. | 2. None. |
| 3. Where used, shut off atomizing medium. | 3. None. |
| 4. Remove fuel atomizer. | 4. None. |
| 5. After post purge, shut down fan, if desired. | 5. None. |

6-6.7 Safety Shutdown Cycle.

- | Operator Functions | Interlock Functions |
|---|---|
| 1. None. | 1. Shut off fuel supply to the main burner and shut off fuel supply and interrupt spark to the igniter if in operation. |
| 2. None. | 2. With gas igniter, vent gas piping between safety shutoff valves to atmosphere. |
| 3. After post purge, shut down fan, if desired. | 3. None. |

6-6.8 Any of the following conditions shall accomplish a safety shutdown.

- (a) Low pressure in the fuel supply at the service connection.
- (b) Loss of combustion air supply.
- (c) Loss of or failure to establish flame.
- (d) Loss of control system actuating energy.

- (e) Power failure.
- (f) Low water level as determined by the auxiliary low water cutout.
- (g) Loss of atomizing medium.
- (h) Excessive steam pressure or water temperature.

CAUTION: Excessive recycling to achieve a burner light-off can lead to accumulation of a hazardous amount of fuel in the furnace and shall be avoided.

6-6.9 The following conditions, where oil heating is provided, shall sound alarms:

- (a) Low oil temperature.
- (b) High oil temperature.

6-7 Supervised Manual Systems for Gas-Fired Watertube Boilers.

6-7.1 The following steps shall be taken by the operator when starting a supervised manual unit, and the indicated interlocks shall be satisfied at each step. It is assumed that control system energy, power, and water level have been established. When interlocks have been satisfied, this fact shall be indicated to the operator.

6-7.2 Select the fuel to be fired. The alternate fuel system shall be placed in a nonfiring condition, and the manual burner valve(s) shall be closed.

6-7.3 An igniter as specified in 4-4.1.1 shall be provided.

6-7.4 Pre-firing Cycle.

- | Operator Functions | Interlock Functions |
|--|---|
| 1. Check gas safety shutoff valves closed. | 1. Gas safety shutoff valves closed. |
| 2. Start fan. | 2. Fan motor on. |
| 3. Open damper(s) to purge position. | 3. (1) Air pressure and open dampers(s), or (2) Airflow. See 6-2.4.1(h) and (i). |
| 4. Start purge timer. | 4. Purge complete. |
| 5. Place damper and gas control valve in light-off position. | 5. Damper and fuel control valve in light-off position. If light-off airflow is less than purge airflow rate, start light-off time limit timer. |

6-7.5 Light-Off Cycle.

- | Operator Functions | Interlock Functions |
|---|---|
| 1. Energize igniter. | 1. Prove igniter flame within 10 seconds. (For direct electric ignition, proof of igniter operation is not required.) |
| 2. Open gas safety shutoff valves to main burner. | 2. Prove main flame within 10 seconds. |

- | | |
|--|----------|
| 3. Bring unit to preset operating pressure at an acceptable rate, maintaining an optimum air/fuel ratio. | 3. None. |
| 4. On reaching preset range, change to automatic combustion control. | 4. None. |

6-7.6 Normal Shutdown Cycle.

- | Operator Functions | Interlock Functions |
|---|---|
| 1. Shut off gas supply to the main burner and to the igniter, if in operation, and interrupt spark. | 1. Vent gas piping between safety shutoff valves to atmosphere. |
| 2. After post purge, shut down fan, if desired. | 2. None. |

6-7.7. Safety Shutdown Cycle

- | Operator Functions | Interlock Functions |
|--------------------|---|
| 1. None. | 1. Shut off gas supply to the main burner, shut off fuel supply, and interrupt spark to the igniter if in operation. Where used, simultaneously energize inerting system. |
| 2. None. | 2. Vent gas piping between safety shutoff valves to atmosphere. |

6-7.8 Any of the following conditions shall accomplish a safety shutdown:

- (a) High gas pressure.
- (b) Low gas pressure.
- (c) Loss of combustion air supply.
- (d) Loss of or failure to establish flame.
- (e) Loss of control systems actuating energy.
- (f) Power failure.
- (g) Low water level as determined by the auxiliary low water cutout.
- (h) Excessive steam pressure or water temperature.

CAUTION: Excessive recycling to achieve a burner light-off can lead to accumulation of a hazardous amount of fuel in the furnace and shall be avoided.

6-8 Soot Blowing.

6-8.1 Soot blowing is necessary to maintain high thermal efficiency in oil-fired boilers. However, if this operation is not performed with optimum air/fuel ratio, explosions may occur from the formation and ignition of air-soot dust clouds within the boiler.

6-8.1.1 Soot blowers shall be operated only while burners are firing at rates sufficiently high to avoid extinguishing the burner flame.

6-8.1.2 Boilers equipped with automatic soot-blowing equipment shall have their controls interlocked to prevent operation when the burner is shut down or in the pre-firing or light-off cycles.

Chapter 7 Simultaneous Firing of Oil and Gas Fuels

7-1 General. When it is necessary or desirable to fire both oil and gas simultaneously in a single burner boiler on a continuous basis, the following equipment and procedure shall be used to avoid a hazardous furnace condition.

7-1.1 Hazards related to gas firing alone and oil firing alone are included in Section 2-7 and A-2-7. In addition, the simultaneous firing of gas and oil increases the potential for:

- (a) A fuel-rich condition.
- (b) Abrupt change in air/fuel ratio.
- (c) Over-firing of a boiler.

7-2 Continuous Firing. The following equipment shall be provided for continuous firing of both oil and gas:

(a) A burner capable of burning either oil or gas fuel individually or both fuels simultaneously.

(b) A combustion control system capable of performing the following functions:

1. Proportion total fuel input, each fuel individually or in any combination, to total airflow in order to obtain a proper air/fuel ratio. A control system designed to accommodate a fixed amount of secondary fuel without metering and totaling all fuels shall be acceptable provided it maintains proper air/fuel ratios throughout the entire operating range of the burner.

2. Limit total fuel input to the maximum capacity of the boiler-furnace.

3. Control a minimum airflow rate.

4. Control minimum input rates of each fuel.

5. Provide a stable return to proper air/fuel ratio after the trip of either one of the two fuels.

(c) A safety interlock system with the following capabilities:

1. Meets the requirements of Section 4-7 for each fuel being fired.

2. Provides, on an interlock action peculiar to only one of the fuels being fired, that this particular fuel shall automatically shut down, with operation continuing on the unaffected fuel in a stable manner.

NOTE: Shutdown of both fuels is acceptable.

3. Provides that both the first and second fuels be introduced with their flow control valves in light-off positions.

4. Provides for the introduction of the second fuel without requiring a boiler prepurge.
5. Requires a manual reset following any interlock shutdown.
6. Prohibits the simultaneous light-off of both fuels.
7. Provides detector(s) to supervise any of the following conditions:
 - (i) Igniter flame.
 - (ii) Gas firing.
 - (iii) Oil firing.
 - (iv) Combined gas and oil firing.

7-3 Light-Off Cycles.

7-3.1 Pre-firing and light-off cycles for the initial fuel to be fired shall be in accordance with Section 6-6 for oil and Section 6-7 for gas.

7-3.2 When oil is introduced as the second fuel the procedure shall be as follows:

- (a) Establish oil fuel system to satisfy interlocks.
- (b) Install oil atomizer.
- (c) Open atomizing medium shutoff valve.
- (d) Place oil control valve in light-off position.
- (e) Open oil safety shutoff valve and establish oil flow through the burner.
- (f) Verify stable flame and proper air/fuel ratio.
- (g) Place the combustion control system into the desired mode for controlling input rate of each fuel.

7-3.3 When gas is introduced as the second fuel the procedure shall be as follows:

- (a) Establish gas fuel system to satisfy interlocks.
- (b) Place gas control valve in light-off position.
- (c) Open safety shutoff valves, close vent valve, and establish gas flow through the burner.
- (d) Verify stable flame and proper air/fuel ratio.
- (e) Place the combustion control system into the desired mode for controlling input rate of each fuel.

7-4 Normal Shutdown Procedure.

7-4.1 The normal shutdown procedure for oil while continuing to fire gas shall be as follows:

- (a) Reduce oil flow to light-off rate.
- (b) Shut off oil supply to burner and open oil recirculating valve, where used.
- (c) Verify stable flame and adjust air/fuel ratio in preparation for purging oil atomizer.
- (d) Purge oil passages of oil atomizer.
- (e) Shut off atomizing medium if required.
- (f) Remove oil atomizer from burner if required.
- (g) Verify stable flame and proper air/fuel ratio of the gas fire.

7-4.2 The normal shutdown procedure for gas while continuing to fire oil shall be as follows:

- (a) Reduce gas flow to light-off rate.
- (b) Shut off gas supply to the burner.
- (c) Verify stable flame and proper air/fuel ratio of the oil fire.

7-4.3 Safety Shutdowns.

7-4.3.1 Any of the following operating conditions shall accomplish a safety shutdown of the oil supply to the burner (fuel trip):

- (a) Low oil pressure.
- (b) Low temperature of heated oils.
- (c) Loss of atomizing medium.

7-4.3.2 Either of the following conditions shall accomplish a safety shutdown of the gas supply to the burner (fuel trip):

- (a) High gas pressure.
- (b) Low gas pressure.

7-4.3.3 Any of the following conditions shall accomplish a complete safety shutdown of the boiler:

- (a) Loss of combustion air supply.
- (b) Loss of or failure to establish flame.
- (c) Loss of control system actuating energy.
- (d) Power failure.
- (e) Excess steam pressure or water temperature.
- (f) Low water level.
- (g) The occurrence of either the oil or the gas fuel trip when only that fuel is being fired.

7-4.3.4 Where oil heating is provided the following conditions shall be alarmed:

- (a) Low oil temperature.
- (b) High oil temperature.

Chapter 8 Simultaneous Firing of Oil and Gas for Fuel Transfer Only

8-1 When it is necessary or desirable to transfer from one fuel to another without stopping the flow of fuel to the furnace, the changeover shall be accomplished in a manner to prevent a fuel-rich condition. The following equipment and procedures shall be used to avoid a hazardous furnace condition.

8-2 When a transfer combustion control system is designed for simultaneous firing of oil and gas fuels on a continuous basis, Chapter 7 shall apply.

8-3 When a combustion control system is designed for firing only one fuel at a time and no capability of biasing the airflow upward is provided, the following equipment and procedures shall be used.

8-3.1 Equipment required.

(a) A burner capable of firing the two fuels simultaneously during the transfer period.

(b) A fuel transfer system that includes the following:

1. A gas-firing mode in which oil cannot be fired.
2. An oil-firing mode in which gas cannot be fired.
3. A gas/oil-firing mode that permits simultaneous firing of both fuels, provided all interlocks for both fuels are satisfied, including light-off position for both fuel valves.

4. A control device, transfer timer, and an alarm for 8-3.1(b)3, above, to limit continuous operation in this mode.

(c) A safety interlock system with the following capabilities:

1. Meets the requirements of Section 4-7 for each fuel being fired.
2. Provides, on an interlock action peculiar to only one of the fuels being fired, that this particular fuel shall automatically shut down, with operation continuing on the unaffected fuel in a stable manner.

NOTE: Shutdown of both fuels is acceptable.

3. Provides that both the first and second fuels be introduced with their flow control valves in light-off positions.

4. Provides an interlock action that will trip either fuel should its respective flow control valve leave a predetermined low rate during fuel transfer.

5. Provides for the introduction of the second fuel without requiring a boiler purge.

6. Requires a manual reset following any interlock shutdown.

7. Prohibits the simultaneous light-off of both fuels.

8. Provides detector(s) to supervise any of the following conditions:

- (i) Igniter flame.
- (ii) Gas firing.
- (iii) Oil firing.
- (iv) Combined gas and oil firing.

(d) Manual shutoff valves at the burner, downstream of the safety shutoff valves in each fuel line.

(e) A pressure gage in each fuel line downstream of the manual shutoff valve.

8-3.2 Procedure required for changing from gas to oil:

(a) Where a Class I or II igniter is available, place it in service.

(b) Check that the manual oil valve at the burner is closed.

(c) Establish oil fuel system to satisfy interlocks.

(d) Install oil atomizer.

(e) Open atomizing medium shutoff valve.

(f) Place combustion control system in manual position.

(g) Reduce gas firing rate to light-off flow.

(h) Place oil control valve in the normal light-off position.

(i) Place fuel transfer switching system into oil/gas position. If the oil safety interlocks are satisfied, the oil safety shutoff valve will open. Fuel oil pressure now will be upstream of manual oil valve at the burner.

(j) Observe the gas pressure downstream from the manual gas shutoff valve and slowly close valve until the gas pressure starts to drop. At this point the gas flow rate is controlled by the manual valve instead of by the normal control valve.

(k) Simultaneously and slowly close the manual gas valve while opening the manual oil valve to light the oil flame from the gas flame. Continue to increase oil firing rate while cutting back on gas firing rate to keep a constant heat input of the combined fuels to the burner until the manual gas valve is closed and manual oil valve is fully open. Care must be taken to maintain an adequate amount of excess air at all times by continuously observing the burner flame, or by observing the air/fuel ratio or oxygen indicator, if provided. During this period, airflow is maintained at a constant rate, with only the manual fuel valves operated.

(l) Place the fuel transfer system in the oil position.

(m) Return the combustion control system and burner firing rate to automatic operation.

8-3.3 Procedure required for changing from oil to gas:

(a) Where a Class I or II igniter is available, place it in service.

(b) Check that the manual gas valve at the burner is closed.

(c) Establish gas fuel system to satisfy interlocks.

(d) Place combustion control system in manual position.

(e) Reduce oil firing rate to light-off flow.

(f) Place gas control valve in the normal light-off position.

(g) Place fuel transfer switching system in the gas/oil position. If the gas safety interlocks are satisfied, the gas safety shutoff valves will open. Gas pressure now will be upstream of manual gas valve at the burner.

(h) Observe the oil pressure downstream from the manual oil shutoff valve and slowly close valve until the oil pressure starts to drop. At this point the oil flow is controlled by the manual valve instead of by the normal control valve.

(i) Simultaneously and slowly close the manual oil valve while opening the manual gas valve to light the gas flame from the oil flame. Continue to increase gas firing rate while cutting back on oil firing rate to keep a constant heat input of the combined fuel to the burner until the oil valve is closed and manual gas valve is fully open. Care must be taken to maintain an adequate amount of excess air at all times by continuously observing the burner flame, or by observing the air/fuel ratio or oxygen indicator, if provided. During this period, airflow is being maintained at a constant rate, with only the manual fuel valves operated.

(j) Place the fuel transfer system in the gas position. The oil safety shutoff valve will now close.

(k) Return the combustion control system and burner firing rate to automatic operation.

(l) Shut off atomizing medium, if required.

(m) Remove oil atomizer from burner, if required.

8-4 When a combustion control system is designed for firing only one fuel at a time and the capabilities have been provided enabling the airflow to be automatically biased up a preset amount when either fuel is fired at a predetermined low rate, the following equipment and procedures shall be used.

8-4.1 Equipment required.

(a) A burner capable of firing the two fuels simultaneously during the transfer period.

(b) A fuel transfer system that includes the following:

1. A gas-firing mode in which oil cannot be fired (except during fuel transfer).

2. An oil-firing mode in which gas cannot be fired (except during fuel transfer).

3. A momentary contact push button enabling fuel transfer.

(c) A safety interlock system with the following capabilities:

1. Meets the requirements of Section 4-7 for each fuel being fired.

2. Provides, on an interlock action peculiar to only one of the fuels being fired, that this particular fuel shall automatically shut down, with operation continuing on the unaffected fuel in a stable manner.

NOTE: Shutdown of both fuels is acceptable.

3. Provides that both the first and second fuels be introduced with their flow control valves in light-off positions.

4. Provides an interlock action that will trip either fuel should its respective flow control valve leave the predetermined low rate described in Section 8-4 during fuel transfer.

5. Provides for the introduction of the second fuel without requiring a boiler purge.

6. Requires a manual reset following any interlock shutdown.

7. Prohibits the simultaneous light-off of both fuels.

8. Provides detector(s) to supervise any of the following conditions:

(i) Igniter flame.

(ii) Gas firing.

(iii) Oil firing.

(iv) Combined gas and oil firing.

9. Provides a momentary contact fuel transfer push button [see 8-4.1(b)3] to simultaneously bias the airflow by a preset value and opens the safety shutoff valve(s) of the fuel being introduced.

8-4.2 Procedure required for changing from gas to oil:

(a) Establish oil fuel system to satisfy interlocks.

(b) Install oil atomizer.

(c) Open atomizing medium shutoff valve.

(d) Place combustion control system in manual position.

(e) Reduce gas firing rate to light-off flow.

(f) Place oil control valve in the normal light-off position.

(g) Depress fuel transfer push button.

(h) Observe that oil firing has commenced.

(i) Move fuel selector switch to the oil firing position.

(j) Release fuel transfer push button, which automatically trips the gas safety shutoff valves.

(k) Return the combustion control system and burner firing rate to automatic operation.

8-4.3 Procedure required for changing from oil to gas:

(a) Establish gas fuel system to satisfy interlocks.

(b) Place combustion control system in manual position.

(c) Reduce oil firing rate to light-off flow.

(d) Place gas control valve in the normal light-off position.

(e) Depress fuel transfer push button.

(f) Observe that gas firing has commenced.

(g) Move fuel selector switch to the gas firing position.

(h) Release fuel transfer push button, which automatically trips the oil safety shutoff valves.

(i) Return the combustion control system and burner firing rate to automatic operation.

(j) Close atomizing medium shutoff valve, if required.

(k) Remove oil atomizer, if required.

Chapter 9 Dual Oil Atomizers in a Single Burner

9-1 When a burner is equipped with main and auxiliary oil atomizers for the purpose of changing atomizers for maintenance without affecting the boiler load, the changeover of atomizers shall be carried out under stable firing conditions by a qualified operator.

CAUTION: Care shall be taken to prevent a fuel-rich condition during the changeover period.

9-2 The following procedure for changing atomizers shall be followed:

(a) Where an intermittent igniter is available, place it in service.

(b) Install auxiliary atomizer.

(c) Slowly open atomizing medium valve to auxiliary atomizer until pressure reaches that required for light-off.

(d) Slowly close manual fuel valve on main atomizer until it is in control of oil flow.

(e) Slowly open the manual valve admitting oil to the auxiliary atomizer until it ignites.

(f) Divert the atomizing medium and oil flow from the main atomizer to the auxiliary atomizer until the main atomizer is out of service.

(g) To place a main atomizer back into service and to remove auxiliary atomizer, repeat the procedure outlined in Section 9-2(a) through (f) substituting the main atomizer for the auxiliary atomizer.

Chapter 10* Inspection and Maintenance

10-1 Since the effective operation of all safety and control devices depends upon their ability to respond quickly to their activating impulses, it is important that they be in proper operating condition at all times. Systematic and thorough inspection and maintenance are required.

10-2 An inspection and maintenance schedule shall be established and performed on a periodic basis.

10-2.1 Operability and set points on all devices, where applicable, shall be verified by periodic testing, and the results shall be recorded in the log book.

10-2.2 Any defects found shall be corrected immediately.

10-2.3 During initial operation, more frequent inspection, adjustment, and cleaning are required.

10-3 It is essential that individuals making inspections and tests be thoroughly familiar with all operating procedures and equipment functions and be capable of rendering sound judgement as to when equipment is in reliable operating condition.

Chapter 11 Referenced Publications

11-1 The following documents or portions thereof are referenced within this standard and shall be considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

11-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 31, *Standard for the Installation of Oil Burning Equipment*, 1992 edition

NFPA 54, *National Fuel Gas Code*, 1992 edition

11-1.2 Other Publication.

11-1.2.1 ASTM Publication. American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.

ASTM D396-90, *Standard Specifications for Fuel Oils*

Appendix A

This Appendix is not a part of the requirements of this NFPA document, but is included for information purposes only.

A-2-7 Gas and Oil Firing — Special Problems.

A. Hazards Peculiar to Gas Firing. Characteristics of gas and gas-firing that require special consideration are as follows:

(a) Gas is colorless; therefore, a leak usually cannot be visually detected. Also, reliance cannot be placed on detection of a gas leak by the presence of odor.

(b) Potentially hazardous conditions are most likely to occur within buildings, particularly where the gas piping is routed through confined areas. In the latter instance, adequate ventilation should be provided. Outdoor boilers tend to minimize confined area problems.

(c) The nature of gas fuel makes it possible to experience severe departures from safe air-fuel ratios without any visible evidence at the burners, furnace, or stack and to cascade into a progressively worse condition. Thus, combustion control systems that respond to reduced boiler steam pressure or steam flow with an impulse for more fuel, unless protected or interlocked to prevent a fuel-rich mixture, should be considered potentially hazardous. The same applies to manual firing without the above-mentioned interlocks or alarms. (See Section 4-6 for requirements to avoid such hazards.)

(d) Particularly with respect to natural gas systems, the gas may be either "wet" or "dry." A wet gas usually implies the presence of distillate, which may be characteristic of a particular source. In the case of such a wet gas, the carry-over of distillate into the burners could result in a momentary flameout and possible reignition. Reignition could result in a furnace explosion. Therefore, special precautions should be taken with wet gas supply systems. (For details, see NFPA 54, *National Fuel Gas Code*.)

(e) Widely different characteristics of gas from either a single source or multiple sources may result in a significant change in Btu (kJ) input rate to the burner(s) without an equivalent change in airflow.

(f) Discharges from relief valves or any other form of atmospheric vents can become hazardous unless special precautions are taken. (See A-4-4.1.3 and A-6-2.4.8.)

(g) Maintenance and repair of gas piping can be hazardous unless proper methods are used for purging and recharging the line, respectively, before and after making the repairs. (See NFPA 54, *National Fuel Gas Code*.)

B. Hazards Peculiar to Oil Firing.

1. Characteristics of fuel oil and fuel oil firing that require special considerations include:

(a) Fuel oils have high volumetric heats of combustion; therefore, even small leaks can create potential fire hazards.

(b) When firing oils that require preheating, the viscosity of oil flowing to the burners should be held within limits to maintain proper atomization.

(c) Water or sludge in fuel oil storage tanks or improperly located suction takeoffs from the storage tank may result in hazardous interruptions or pulsations of the fuel supply to the burners. A flameout, either immediately or at a later time, may result because of plugged strainers or burner tips.

(d) Widely different characteristics of fuel oil, from either a single source or multiple sources, may result in a significant change in Btu (kJ) input rate to the burner(s) without an equivalent change in airflow or without an appropriate change in fuel oil temperature to restore the flowing viscosity to the proper value. Different shipments of fuel oil with dissimilar characteristics can cause a precipitation of sludge that can lead to hazards as described in A-2-7B1(c).

(e) On installations designed to fire both heated and unheated fuel oils, consideration should be given to the design of the burner control system to ensure proper interlocks are activated for the selected fuel oil. Similar consideration should be given to the fuel oil piping supply to the burner as well as oil recirculating piping to the fuel storage tanks, depending on the arrangement of the equipment provided.

(f) There is the ever-present hazard of inserting an oil gun in the burner assembly without a tip, new gaskets, or sprayer plate. This can result in an unsafe operating condition.

(g) Proper pumping and atomization of fuel oils are dependent upon control of viscosity. Changes in viscosity in relation to temperature vary for different oils and blends of oils. Very close attention to the design and operation of viscosity control systems shall be followed for each fuel when the source or properties are variable.

(h) Clean distillate fuels have low conductivities and will generate static electrical charges in the fuel stream that may be dangerous unless flowing velocities are limited. (See NFPA 77, *Recommended Practice on Static Electricity*, and API-RP 2003, *Protection Against Ignitions Arising Out of Static Lighting and Stray Currents*.)

(i) The incompressibility of fuel oil can create very rapid transients in oil flow through an operating burner upon:

1. Rapid operation of oil supply valve.
2. Rapid operation of burner shutoff valves.
3. Rapid operation of regulating valve in the return oil line from the burner header (on systems using this type of control).

2. The term fuel oil refers to liquid fuels with widely differing characteristics. A fuel oil burning system is designed for a specific range of oil characteristics. Attempting to burn an oil whose characteristics differ widely from those for which the system was designed can cause serious operating difficulties and potential safety hazards. Hence, care must be exercised to ensure that oils received at a plant are within the specific ranges of the fuel handling and burning equipment.

3. The more important characteristics of fuel oils are defined in ASTM D396, *Standard Specifications for Fuel Oils*. Thus it is relatively simple to identify oils that require spe-

cial provisions for storing, heating, pumping, atomizing, etc. Generally speaking, grades 1, 2, and 4 have lower viscosities and less water and sediment than grades 5 or 6; hence they require fewer special provisions to ensure proper handling and burning. However, most power boiler fuel oil systems are designed for the heavier grades 5 and 6; hence such systems include provisions for preheating these usually viscous fuels. Furthermore, more care is required in design and operation of fuel oil systems supplied with grade 6 oil than with the other ASTM grades, to avoid flameouts attributed to interruptions or pulsation of the fuel supply, or plugging of strainers, or burner tips.

4. All of the following characteristics may have a bearing on the problem of properly and safely burning fuel oils:

(a) Fuel oil is a complex mixture of hydrocarbons of differing molecular weights and boiling and freezing points. When fuel oil is subjected to sufficiently high temperature it will partially decompose or vaporize, thus creating new liquid, gaseous, and solid fuels with unpredictable properties.

(b) Fuel oil is introduced into the furnace as an extremely fine mist to intimately mix with the combustion air in order to burn quickly and completely. In power boilers this is accomplished by spraying through small orifices with high pressure drops (mechanical atomization) or by using steam or air to break up small oil streams. Viscosity and volatility are characteristics of the oil that indicate ease of atomization.

(c) Flash point is an indicator of volatility and, thus, of potential for flammable vapors. It is a function of pressure and fuel composition.

(d) Some fuel oils contain constituents that, when overheated, may decompose, forming solids, or may solidify when exposed to low ambient temperature. The presence of such solids in the fuel may cause interruptions.

1. When storing, handling, or burning fuel oils that may have flash points below 100°F (38°C) (Class I liquids as defined in NFPA 30, *Flammable and Combustible Liquids Code*) or that may be heated above their flash point, consideration should be given to electrical installations in areas where flammable vapors or gases may be present in the atmosphere. Typical locations are burner areas, fuel handling equipment areas, fuel storage areas, pits, sumps, and low spots where fuel leakage or vapors may accumulate. Article 500 of NFPA 70, *National Electrical Code*®, provides for classifying such areas and defines requirements for electrical installations in the areas so classified.

(e) Purging the burner atomizer before removal will minimize the probability for hazardous concentrations of flammable vapors at the burner front during maintenance operations. With such provisions, the burner front is not normally classified more restrictively than Class I, Division 2.

(f) The operating company is responsible for classifying areas where fuel is stored, handled, or burned and for revising the classification if conditions are changed. Installations should conform to NFPA 30, *Flammable and Combustible Liquids Code*; NFPA 31, *Standard for the Installation of Oil Burning Equipment*; and NFPA 70, *National Electrical Code*. Guidance can be obtained from API-RP 500, *Recommended Practice for Classification of Areas for Electrical Installations in Petroleum Refineries*.

C. Low NO_x Operation — Special Problems.

1. Air pollution control regulations require that new installations meet NO_x emission limits lower than emissions now obtained from many of the presently installed firing systems and furnace designs using past operating procedures. In addition, air quality regulations in some local areas require a reduction of NO_x emissions from existing boilers.

2. In order to achieve these reductions, one or more of the following methods are used.

(a) Low excess air firing, i.e., less than the "normal" 10 percent to 25 percent excess air.

(b) Multistage air admission involving the introduction of combustion air in two or more stages partly at the fuel nozzle (may be less than stoichiometric air) and partly by independent admission through (1) special furnace ports, and (2) a second stage of air admission within the same burner housing.

(c) Flue gas recirculation into all or a portion of the secondary air.

(d) Reduced secondary air temperature.

(e) Fuel staging.

(f) On new units, the equipment manufacturers may also introduce new burner and furnace designs.

3. The effect of all of these methods is generally to produce lower flame temperatures and longer, less turbulent flames, which result in lower NO_x.

D. Hazards of Low NO_x Firing Methods.

1. These methods may have important implications with regard to furnace safety, particularly for existing units, and may introduce unacceptable risks if proper precautions are not taken.

(a) Fuel firing systems designed to reduce NO_x emissions tend to reduce the margins formerly available to prevent or minimize accumulations of unburned fuel in the furnace during combustion upsets or flameouts. Thus, it is important to trip fuel on loss of flame.

(b) These methods may narrow the limits of stable flames produced by the burner system. The tests specified in 4-4.2.3 should be repeated on existing units when any of these methods are employed.

(c) When flue gas recirculation is used, equipment should be provided to assure proper mixing and uniform distribution of recirculated gas and the combustion air. When flue gas recirculation is introduced into the total combustion air stream, equipment should be provided to monitor either the ratio of flue gas to air or the oxygen content of the mixture. When flue gas recirculation is introduced so that only air and not the mixture is introduced at the burner, proper provisions should be made to ensure the prescribed distribution of air and the recirculating flue gas/air mixture.

(d) All of the methods tend to increase the possibility of an unstable flame and unburned combustibles throughout the unit and ducts; therefore, recommendations of the boiler, burner, and instrument manufacturers should be followed, or tests to verify operating margins should be conducted.

2. Any change in flame characteristics to reduce NO_x emissions may require changing either or both the type and location of flame detectors on existing units.

A-4-1.8 See Figure A-4-1.8.

A-4-2 For additional information, see NFPA 54, *National Fuel Gas Code*, and NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*.

A-4-2.3 Main Burner Gas Supply. Most natural gas supplied to boilers typically is lighter than air and presents no special problems in atmosphere over and above those addressed in this standard. Because of developing energy cost considerations, many boilers are using a gas or a mixture of gases with heavier-than-air characteristics. These heavier-than-air gases, such as propane/air mixtures, refinery gases, etc., require special consideration in storing, handling, and venting to prevent accumulations in depressions or in confined areas.

An alternative to the automatic venting of heavier-than-air gases is to eliminate the vent valve from between the two main gas safety shutoff valves.

A-4-4.1 See Figure A-4-4.1.

A-4-4.1.3 Heavier-than-Air Gases. Gas-Fired Igniters. Many oil-fired boilers are equipped with propane or other liquefied petroleum gas (LPG) fired igniters. Special precautions are required in locating the vent pipe from the automatic bleed valve so that heavier-than-air, vented gases do not accumulate in depressions or in confined areas. An alternative to the automatic venting of heavier-than-air gases is to eliminate the igniter vent valve from between the two igniter safety shutoff valves.

A-6-1 Manual Systems for Watertube Boilers. The manual systems are not recommended; however, it is recognized that with adequate and uninterrupted supplies of fuel and air, certain operating functions can be performed by a qualified operator as well as by control devices.

A. Controls and Interlocks.

1. Interrupted or intermittent igniter.


2. Safety shutoff valves, as follows:

(a) *Gas Firing.* Two automatic safety shutoff valves, spring-closing, in gas line to the main burner, with intermediate spring opening automatic vent valve.

(b) *Oil Firing.* Two automatic spring-closing safety shutoff valves in oil line to burner.

CAUTION: Means shall be provided to prevent or relieve excess pressure between these valves.

(c) *Gas-Fired Igniter.* Two spring-closing automatic safety shutoff valves in the gas line to the igniter, with intermediate, spring-opening automatic vent valve.

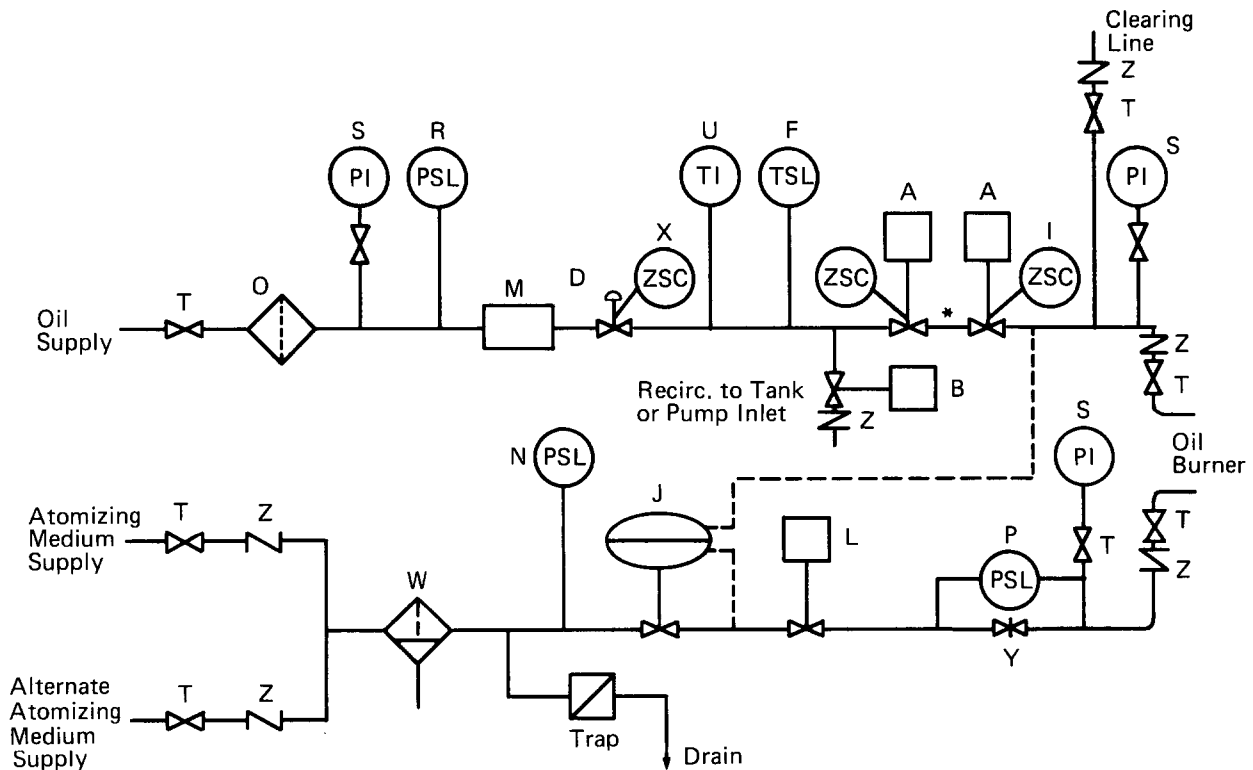


- A Safety shutoff valve, spring closing (NC)
- B Oil recirculation valve atomizing (NO) (optional for unheated oil)
- D Oil flow control valve
- F Low oil temperature switch (not applicable for unheated oil)
- I Closed position interlock on safety shutoff valve
- J Atomizing medium differential control valve
- L Automatic atomizing medium shutoff valve
- M Oil meter (optional)
- N Low atomizing medium pressure switch
- O Oil strainer
- P Atomizing medium flow interlock differential switch, or pressure interlock switch
- R Low pressure switch
- S Pressure gage
- T Manual shutoff valve
- U Oil temperature gage (optional for unheated oil)
- W Atomizing medium strainer
- X Low fire start switch
- Y Atomizing medium flow orifice
- Z Check valve

Safety Shutdown Interlocks (not shown)

- Flame detector(s)
- Excessive steam pressure interlock
- Auxiliary low water cut-off (one required)
- Combustion air supply interlock

*Caution: Means shall be provided to prevent or relieve excess pressure between these valves

Figure A-4-1.8 Typical fuel and atomizing medium supply systems and safety controls for oil burner.

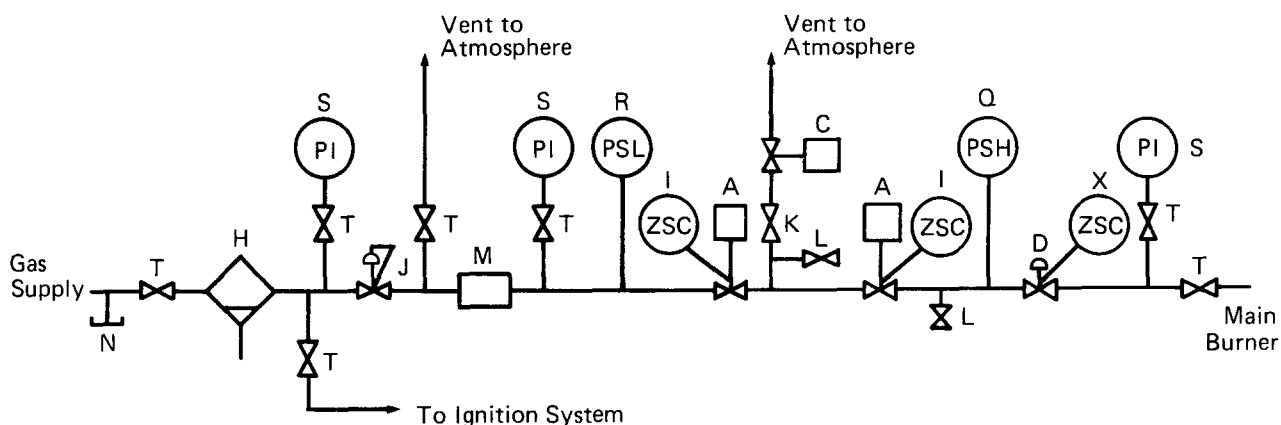


- A Safety shutoff valve, spring closing (NC)
- C Vent valve, spring opening (NO)
- D Gas flow control valve
- H Gas strainer
- I Closed position interlock on valves safety shutoff
- J Constant gas pressure regulator valve
- K Vent line manual shutoff valve for leakage testing (locked or sealed open)
- L Leakage test connection
- M Gas meter (optional)
- N Drip leg
- Q High gas pressure switch
- R Low gas pressure switch
- S Pressure gauge
- T Manual shutoff valve
- X Low fire start switch

Safety Shutdown Interlocks (not shown)


- Flame detector(s)
- Excessive steam pressure interlock (excessive water temperature and pressure interlock for hot water boilers)
- Auxiliary low water cut-off (one required)
- Combustion air supply interlock

Note: NC = normally closed, deenergized
NO = normally open, deenergized

Figure A-4-2.3 Typical fuel supply systems and safety controls for gas burner.

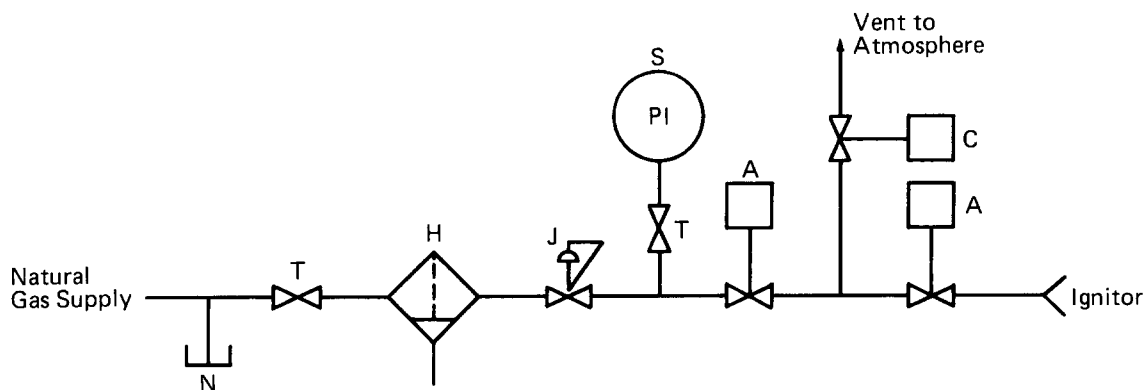

- A Safety shutoff valve, spring closing (NC)
- C Vent valve, spring opening (NO)(optional)
- H Gas strainer
- J Constant gas pressure regulator
- N Drip leg
- S Pressure gage
- T Manual shutoff valve

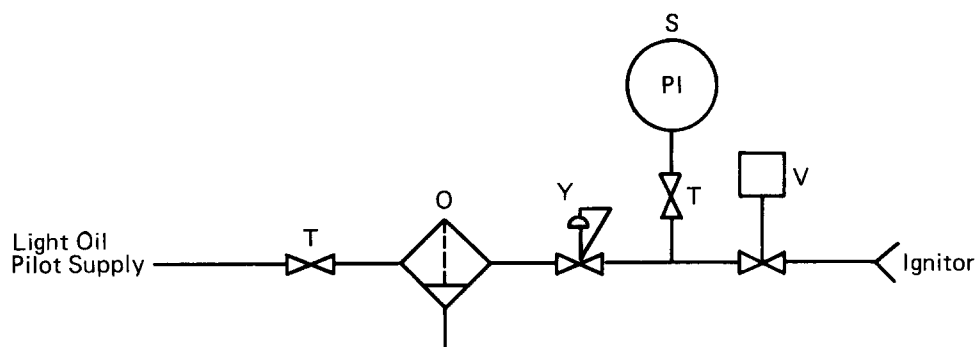

- O Ignitor oil strainer
- S Pressure gage
- T Manual shutoff valve
- V Pilot oil safety shutoff valve, spring closing (NC)
- Y Pilot oil pressure regulator (optional)

NC = normally closed, deenergized

NO = normally open, deenergized

Figure A-4-4.1 Typical ignition systems for gas/oil-fired burner.

3. Manual shutoff valve(s) in the fuel line(s) adjacent to the burner. For gas firing this shutoff valve should be proved closed before the spark to the igniter can be energized and the igniter and main gas safety shutoff valves can be opened.

4. Changes in firing rate are made by the simultaneous adjustment of fuel and air supplies at a preestablished optimum air/fuel ratio by the manipulation of a single control device.

5. Limits on fuel and air to prevent reducing furnace input below the point of stable burner operation are provided. The minimum and maximum points of stable burner operation are defined by the burner manufacturer and verified by operating investigation.

6. Safety shutdown interlocks include the following:

- (a) Low oil pressure.
- (b) High gas pressure.
- (c) Low gas pressure.
- (d) Loss of combustion air supply.

CAUTION: Excessive recycling to achieve a burner light-off can lead to accumulation of a hazardous amount of fuel in the furnace and should be avoided.

7. Where oil heating is provided the following conditions sound an alarm:

- (a) Low oil temperature.
- (b) High oil temperature.

A-6-2.4.8 Supplemental Recommendations and Precautions.

A. Excessive recycling to achieve a burner light-off can lead to accumulation of a hazardous amount of fuel in the furnace and should be avoided.

B. Recovering from a Fuel-Rich Furnace Condition. If an air deficiency should develop while flame is maintained at the burners, reduce the fuel until the normal air/fuel ratio has been restored. If fuel flow cannot be reduced, slowly increase air flow until normal air/fuel ratio has been restored.

C. It should be recognized that fuels available today contain unexpected constituents. Therefore, engineering systems and material designs must take into consideration these potential variables.

A-10 Inspection and Maintenance.

A. Maintenance, Inspection, Training, and Safety.

1. The objective of a maintenance program is to identify and correct conditions relating to the safety, continued reliable operation, and efficient performance of equip-

ment. A program should be provided for maintenance of equipment at intervals consistent with the type of equipment, service requirements, and manufacturer's recommendations.

2. As a minimum, the maintenance program should include the following:

(a) In-service inspections to identify conditions requiring corrective action or further study.

(b) Detailed, knowledgeable planning to allow use of qualified personnel, procedures, and equipment for an efficient safe repair or modification.

(c) Use of comprehensive equipment history that records conditions found, maintenance work done, changes made, and date of each.

(d) Written comprehensive maintenance procedures incorporating manufacturer's instructions to define tasks and skills required. Any special techniques, such as non-destructive testing or those tasks requiring special tools, should be defined. Special environmental factors should be covered, such as temperature limitations, dusts, contaminated or oxygen-deficient atmosphere, and limited access or confined space requirements.

(e) Shutdown maintenance inspections, comprehensive in scope, to cover all problem areas.

(f) Adequate spare parts available meeting manufacturer's specifications to provide reliable service without necessitating makeshift repairs.

3. In-service inspection of equipment should be established and followed.

4. Operation, set points, and adjustments should be verified by periodic testing and the results documented.

5. Defects should be reported and corrected and repairs documented.

6. System configuration, including logic, set points, and sensing hardware, should not be changed without the effect being evaluated and approved.

7. Inspections, adjustments, and repairs should be performed by trained personnel using tools and instruments suitable for the work. Maintenance and repairs should be performed in accordance with the manufacturer's recommendations and applicable standards and codes.

8. It is not practical to preestablish a single schedule for all installations. Therefore, the following typical schedule is a guide only, subject to adjustment according to specific plant operation and equipment involved. (*See 10-2.1 and 10-2.2.*)

- (a) Daily.
 - (i) Flame failure detection system
 - (ii) Low water level cutoffs and associated alarms
- (b) Weekly.
 - (i) Igniter and burner operation
- (c) Monthly.
 - (i) Fan and airflow interlocks

- (ii) Fuel safety shutoff valves for leakage
- (iii) Low fire start interlock
- (iv) High steam pressure interlock
- (v) For oil:
 - 1. fuel pressure and temperature interlocks
- (vi) For gas:
 - 1. Gas strainer and drip leg
 - 2. High and low fuel pressure interlocks
- (d) Semiannually or Annually as Required.
 - (i) Igniter and burner components
 - (ii) Combustion air supply system
 - (iii) Flame failure system components
 - (iv) Piping, wiring, and connections of all interlocks and shutoff valves
 - (v) Combustion control system
 - (vi) Calibration of indicating and recording instruments
- (e) As Required for Oil Firing.
 - (i) Atomizers
 - (ii) Strainers

B. Training.

1. Operator Training.

(a) A formal training program should be established to prepare personnel to safely and effectively operate equipment. This program can consist of review of operating manuals, videotapes, programmed instruction, testing and field training, among others. The training program should be consistent with the type of equipment and hazards involved.

(b) Operating procedures should be established that cover normal and emergency conditions. Start-up and shutdown procedures, normal operating conditions, and lockout procedures should be covered in detail.

(c) Operating procedures should be directly related to the equipment involved and consistent with safety requirements and manufacturer's recommendations.

(d) Procedures should be periodically reviewed to keep them current with changes in equipment and personnel.

2. Maintenance Training.

(a) A formal maintenance training program should be established to prepare personnel to safely and effectively perform any required maintenance tasks. This program can consist of review of maintenance manuals, videotapes, programmed instruction, testing, field training, and equipment manufacturer training among others. The training program should be specific to the equipment involved and to potential hazards.

(b) Maintenance procedures should be established to cover routine and special techniques. Any potential envi-

ronmental factors such as temperature, dust, contaminated or oxygen-deficient atmosphere, internal pressure, and limited access or confined space requirements should be included.

(c) Procedures should be consistent with safety requirements and manufacturer's recommendations.

(d) Procedures should be periodically reviewed to keep them current with changes in equipment and personnel.

C. Housekeeping.

1. Good housekeeping is essential for safe operation and prevention of fires or explosions; therefore, provision should be made for periodic cleaning of horizontal ledges or surfaces of buildings and equipment to prevent the accumulation of appreciable dust deposits.

2. Creation of dust clouds should be minimized during cleaning. Compressed air should not be used to dislodge soot or dust accumulations; water washing or vacuum cleaning methods are preferred.

D. Safety.

1. General Safety Precautions. Protective clothing, including but not limited to hard hats and safety glasses, should be used by personnel during maintenance operations.

2. Special Safety Precautions.

(a) Welding and flame cutting. (*See also NFPA 51, Oxygen-Fuel Gas Systems for Welding, Cutting and Allied Procedures, and NFPA 51B, Fire Prevention in Use of Cutting and Welding Processes.*)

(i) Fire-resistant blankets or other approved methods should be used in such a manner as to confine weld spatter or cutting sparks.

(ii) A careful inspection of all areas near where welding or cutting has been done, including the floors above and below, should be made when the job is finished or interrupted and such areas patrolled for a period long enough to make certain that no smoldering fires have developed.

(b) Where flammable dusts or dust clouds are present, sparking electrical tools must not be used. All lamps must be suitable for Class II, Division 1 locations as defined in NFPA 70, *National Electrical Code*.

(c) Either ground fault protected or specially approved low voltage (6 or 12 volt) extension cords and lighting should be used for all confined spaces and where moisture may be a hazard.

(d) Explosion-operated tools and forming techniques should not be used where flammable dust or dust clouds are present. When these operations become necessary, all equipment, floors, and walls should be cleaned and all dust accumulation removed by an approved method. A careful check should be made to be sure that no cartridges or charges are left in the work area.