



UL 60079-26

STANDARD FOR SAFETY

Explosive Atmospheres – Part 26:
Equipment with Equipment Protection
Level (EPL) Ga

[ULNORM.COM](https://www.ulnorm.com) : Click to view the full PDF of UL 60079-26 2022

[ULNORM.COM](https://www.ulnorm.com) : Click to view the full PDF of UL 60079-26 2022

UL Standard for Safety for Explosive Atmospheres – Part 26: Equipment with Equipment Protection Level (EPL) Ga, UL 60079-26

Third Edition, Dated April 21, 2017

Summary of Topics

This revision of ANSI/UL 60079-26 dated August 16, 2022 is being issued to update the title page to reflect the most recent designation as a Reaffirmed American National Standard (ANS). No technical changes have been made.

Please note that the national difference document incorporates all of the US national differences for UL 60079-26. UL 60079-26 is based on IEC 60079-26, Edition 3, published October, 2014.

Text that has been changed in any manner or impacted by UL's electronic publishing system is marked with a vertical line in the margin.

The requirements are substantially in accordance with Proposal(s) on this subject dated June 24, 2022.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

UL provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

Users of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgment (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 60079-26 2022

APRIL 21, 2017
(Title Page Reprinted: August 16, 2022)



ANSI/UL 60079-26-2017 (R2022)

1

UL 60079-26

**Standard for Explosive Atmospheres – Part 26: Equipment with Equipment
Protection Level (EPL) Ga**

Third Edition

April 21, 2017

This ANSI/UL Standard for Safety consists of the Third Edition including revisions through August 16, 2022.

The most recent designation of ANSI/UL 60079-26 as a Reaffirmed American National Standard (ANS) occurred on August 16, 2022. ANSI approval for a standard does not include the Cover Page, Transmittal Pages, Title Page, or Preface. The National Difference Page and IEC Foreword are also excluded from the ANSI approval of IEC-based standards.

Comments or proposals for revisions on any part of the Standard may be submitted to UL at any time. Proposals should be submitted via a Proposal Request in UL's On-Line Collaborative Standards Development System (CSDS) at <https://csds.ul.com>.

UL's Standards for Safety are copyrighted by UL. Neither a printed nor electronic copy of a Standard should be altered in any way. All of UL's Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

COPYRIGHT © 2022 UNDERWRITERS LABORATORIES INC.

No Text on This Page

[ULNORM.COM](https://www.ulnorm.com) : Click to view the full PDF of UL 60079-26 2022

CONTENTS

Preface (UL)	5
National Differences	9
FOREWORD	11
1 Scope	15
1DV Modification of Clause 1 to replace with the following:	15
2 Normative references	15
2DV Modification of Clause 2 references to replace with the following:	15
3 Terms and definitions.....	16
4 Requirements for design and construction.....	16
4.1 Protection measures against ignition hazards of the electrical circuits.....	16
4.2 Equipment with moving parts.....	23
4.3 Process connection	24
5 Type tests.....	24
5.1 Standardized types of protection.....	24
5.1DV Modification to delete Clause 5.1. It does not apply.....	24
5.2 Separation elements.....	24
5.3 Temperature evaluation.....	25
6 Marking	25
6.1 General	25
6.1DV Modification of Clause 6.1 to replace with the following:	25
6.2 Examples of marking	25
6.2DV Modification of Clause 6.2 to replace with the following:	25
7 Instructions.....	26
7.1 Separation elements:.....	26
7.1DV Modification of Clause 7.1 to replace with the following:	26
7.2 Process connection:	26
7.3 EPL allocation	26

Bibliography

ULNORM.COM : Click to view the full PDF of UL 60079-26 2022

No Text on This Page

[ULNORM.COM](https://www.ulnorm.com) : Click to view the full PDF of UL 60079-26 2022

Preface (UL)

This UL Standard is based on IEC Publication 60079-26: third edition Explosive Atmospheres – Part 26: Equipment with Equipment Protection Level (EPL) Ga, as revised by corrigendum 60079-26. IEC publication 60079-26 is copyrighted by the IEC.

Efforts have been made to synchronize the UL edition number with that of the corresponding IEC standard with which this standard is harmonized. As a result, one or more UL edition numbers have been skipped to match that of the IEC edition number.

These materials are subject to copyright claims of IEC and UL. No part of this publication may be reproduced in any form, including an electronic retrieval system, without the prior written permission of UL. All requests pertaining to the Explosive Atmospheres – Part 26: Equipment with Equipment Protection Level (EPL) Ga, UL 60079-26 Standard should be submitted to UL.

Note – Although the intended primary application of this Standard is stated in its Scope, it is important to note that it remains the responsibility of the users of the Standard to judge its suitability for their particular purpose.

The following people served as members of STP 60079 and participated in the review of this standard:

<u>NAME</u>	<u>COMPANY</u>
*B. Zimmermann, Chair	R Stahl Inc.
*T. Adam	FM Approvals LLC
R. Allen	Honeywell International Inc.
F. AISahan	Saudi Aramco
J. Anderson	Thermon Mfg Co.
D. Ankele	UL LLC
Mike Barret	Nemko
P. Becker	nVent
S. Blais	Emerson/Appleton Group
K. Boegli	KBB Consulting
R. Brownlee	Pepperl + Fuchs Inc.
D. Burns	Shell P&T – Innovation / R&D
*J. Chambers	UL LLC
R. Chalmers	Industrial Scientific Corp.
*C. Coache	National Fire Protection Association
*M. Cole	Hubbell Canada LP
M. Coppler	LabTest Certification Inc.
*R. Deadman	UL LLC
*K. Dhillon	LabTest Certification Inc.
D. Mario	Beach Energy
T. Dubaniewicz	NIOSH
G. Edwards	Det-Tronics
M. Egloff	Montana Tech, University of Montana
M. Ehrmann	R Stahl Inc
D. El Tawy	Siemens Energy
A. Engler	Det Norske Veritas DNV
M. Phillip	National Oilwell Varco
W. Fiske	Intertek
Z. Fosse	DEKRA Certification Inc

<u>NAME</u>	<u>COMPANY</u>
G. Gurinder	Gurinder Garcha Consulting
D. Grady	Talema Group
J. Hickle	Caterpillar Inc.
Bryce Hollenbeck	Hotstart Inc
R. Holub	DuPont
E. Hong	Solar Turbines Inc.
*B. Johnson	Thermon Mfg. Co.
R. Johnson	Source IEC
B. Keane	INNIO Waukesha Gas Engines
*P. Kelly	UL LLC
S. Kiddle	ABB Inc
*M. Kornitsky	FM Approvals LLC
S. Lambaz	Littelfuse Inc.
W. Lawrence	FM Approvals LLC
E. Leubner	Eaton's Crouse-Hinds Business
W. Lockhart	GE Gas Power
W. Lowers	WCL Corp.
*N. Ludlam	FM Approvals Ltd.
M. Marrington	Index
R. Martin	USCG
E. Massey	L E Massey
T. Michalski	Killark Electric Mfg. Co.
B. Miller	Mettler-Toledo LLC
*J. Miller	MSA Innovation LLC
N. Minquez	Proyelco
*O. Murphy	Honeywell International Inc.
D. Nedorostek	Bureau of Safety & Environmental Enforcement (BSEE)
A. Page	Bud Page Consulting Inc.
R. Parks	National Instruments Corp.
Igor Rakonjac	Eurofins North America (MET Labs)
L. Ricks	ExVeritas North America LLC
P. Rigling	MTL – Eaton Electric Ltd.
*K. Robinson	Occupational Safety and Health Adm.
J. Ruggieri	General Machine Corp.
*J. Scheller	ABB Motor and Mechanical Inc.
P. Schimmoeller	CSA Group
*T. Schnaare	Rosemount Inc.
R. Seitz	ARTECH Engineering
S. Sharma	Lindsay Corp.
J. Silliman	3M
K. Singh	Ex Safet Services and Solutions
G. Sitnik	QPS America Inc.
J. Smith	SGS
G. Steinman	ABB Installation Products Inc.
*R. Teather	Det Norske Veritas Certification Inc.
L. Vlaga	General Monitors

NAME

D. Wechsler

N. Wienhold

R. Wigg

*K. Wolf

T. Woods

F. Young

R. Zalosh

COMPANY

American Chemistry Council

Rosemount Inc.

E-x Solutions International Pty Ltd.

Intertek

Bently Nevada

Pinnacle Forensics

Firexplo

* Non-voting member

ULNORM.COM : Click to view the full PDF of UL 60079-26 2022

No Text on This Page

[ULNORM.COM](https://www.ulnorm.com) : Click to view the full PDF of UL 60079-26 2022

National Differences

National Differences from the text of International Electrotechnical Commission (IEC) Publication 60079-26, Explosive atmospheres – Part 26: Equipment with Equipment Protection Level (EPL) Ga, copyright 2014, are indicated by notations (differences) and are presented within the body of the UL printed standard in bold text with legislative mark-ups (strike-out and underline).

There are five types of National Differences as noted below. The difference type is noted on the first line of the National Difference in the standard. The standard may not include all types of these National Differences.

D1 – These are National Differences which are based on **basic safety principles and requirements**, elimination of which would compromise safety for consumers and users of products.

D2 – These are National Differences from IEC requirements based on existing **safety practices**. These requirements reflect national safety practices, where empirical substantiation (for the IEC or national requirement) is not available or the text has not been included in the IEC standard.

DC – These are National Differences based on the **component standards** and will not be deleted until a particular component standard is harmonized with the IEC component standard.

DE – These are National Differences based on **editorial comments or corrections**.

DR – These are National Differences based on the **national regulatory requirements**.

Each national difference contains a description of what the national difference entails. Typically one of the following words is used to explain how the text of the national difference is to be applied to the base IEC text:

Addition / Add - An addition entails adding a complete new numbered clause, subclause, table, figure, or annex. Addition is not meant to include adding select words to the base IEC text.

Deletion / Delete - A deletion entails complete deletion of an entire numbered clause, subclause, table, figure, or annex without any replacement text.

Modification / Modify - A modification is an altering of the existing base IEC text such as the addition, replacement or deletion of certain words or the replacement of an entire clause, subclause, table, figure, or annex of the base IEC text.

No Text on This Page

[ULNORM.COM](https://www.ulnorm.com) : Click to view the full PDF of UL 60079-26 2022

FOREWORD

INTERNATIONAL ELECTROTECHNICAL COMMISSION

EXPLOSIVE ATMOSPHERES – Part 26: Equipment with Equipment Protection Level (EPL) Ga

1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.

2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.

3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.

4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.

5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.

6) All users should ensure that they have the latest edition of this publication.

7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.

8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.

9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 60079-26 has been prepared by IEC technical committee 31: Equipment for explosive atmospheres.

This third edition cancels and replaces the second edition published in 2006 and constitutes a technical revision.

This edition includes the following significant changes with respect to the previous edition:

Changes	Clause	Type		
		Minor and editorial changes	Extension	Major technical changes
Notes deleted	1	X		
Reference to associated apparatus deleted	1	X		
Additional normative references included	3	X		
Requirements against mechanical and electrostatic ignition hazards deleted (now covered in IEC 60079-0)	4.1	X		
Requirement for separation element detailed regarding external influences	4.1.3.2	X		
Intrinsic safety Ex ia as single type of protection including associated apparatus deleted (now covered by EPL)	4.2.2 (ed.2)	X		
Encapsulation Ex ma as single type of protection deleted (now covered by EPL)	4.2.3 (ed.2)	X		
Conditions a) and b) linked with an "and", therefore requirement of "flameproof joint" deleted in following clause. Both requirements already covered by separation elements and standardised process connections.	4.3	X		
Process connection requires a sufficiently tight joint: IP66 added alternatively to IP67	4.3		X	
Requirement for isolated conductive components deleted (now covered in IEC 60079-0)	4.4 (ed.2)	X		
Requirements for non-conductive enclosures deleted (now covered in IEC 60079-0)	4.5 (ed.2)	X		
Test of partition walls according to 4.1.3.2 b) is specified in more detail	5.2			C1
Marking example for associated apparatus deleted	6.2 b)	X		
Note 3 with an additional example added	6.2	X		
Specification of material of partition wall required in instructions (also required in 4.1.3.2)	7	X		
Alternative risk assessment method deleted (is now generally introduced)	Annex A (ed.2)	X		

NOTE The technical changes referred to include the significance of technical changes in the revised IEC Standard, but they do not form an exhaustive list of all modifications from the previous version.

Explanation of the types of changes:

A) Definitions

1) Minor and editorial changes:

- Clarification
- Decrease of technical requirements
- Minor technical change
- Editorial corrections

These are changes which modify requirements in an editorial or a minor technical way. They include changes of the wording to clarify technical requirements without any technical change, or a reduction in level of existing requirement.

2) Extension: Addition of technical options

These are changes which add new or modify existing technical requirements, in a way that new options are given, but without increasing requirements for equipment that was fully compliant with the previous standard. Therefore, these will not have to be considered for products in conformity with the preceding edition.

3) Major technical changes:

- addition of technical requirements
- increase of technical requirements

These are changes to technical requirements (addition, increase of the level or removal) made in a way that a product in conformity with the preceding edition will not always be able to fulfil the requirements given in the later edition. These changes have to be considered for products in conformity with the preceding edition. For these changes additional information is provided in Clause B below.

NOTE These changes represent current technological knowledge. However, these changes should not normally have an influence on equipment already placed on the market.

B) Information about the background of 'Major technical changes'

C1: Introduction of type tests for separation elements according to "4.1.3.2 b)"

The text of this standard is based on the following documents:

FDIS	Report on voting
31/1146/FDIS	31/1155/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts in the IEC 60079 series, published under the general title *Explosive atmospheres*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 60079-26 2022

EXPLOSIVE ATMOSPHERES – Part 26: Equipment with Equipment Protection Level (EPL) Ga

1 Scope

1DV DR Modification of Clause 1 to replace with the following:

This part of IEC 60079 standard specifies alternative requirements for construction, test and marking for electrical equipment that provides Equipment Protection Level (EPL) Ga when single standardised Types of Protection (e.g. Ex “ia”, Ex “ma”, Ex “da”) cannot be applied. This standard also applies to equipment mounted across a boundary where different Equipment Protection Levels may be required.

EXAMPLE: Equipment installed in the wall of a storage vessel containing Zone 0 (requiring EPL Ga) inside an area defined as Zone 1 (requiring EPL Gb).

This electrical equipment, within the operational parameters specified by the manufacturer, ensures a very high Level of Protection that includes rare malfunctions related to the equipment or two malfunctions occurring independently of each other.

NOTE A malfunction may result from a failure of the component parts of the electrical equipment or from anticipated externally applied influences. Two independent malfunctions which may occur more frequently and which, separately, would not create an ignition hazard but which, in combination, could create a potential ignition hazard, are regarded as occurring together to form a rare malfunction.

This standard supplements and modifies the general requirements of IEC 60079-0 UL 60079-0. Where a requirement of this standard conflicts with a requirement of IEC 60079-0 UL 60079-0, the requirement of this standard takes precedence.

Where references are made to IEC 60079 standards, the referenced requirements found in these standards shall apply as modified by any applicable U.S. National Differences.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

2DV DR Modification of Clause 2 references to replace with the following:

ANSI/IEC 60529, Degrees of protection provided by enclosure (IP Code)

IEC 60079-0, Explosive atmospheres – Part 0: Equipment – General requirements

IEC 60079-1, Explosive atmospheres – Part 1: Equipment protection by flameproof enclosures “d”

IEC 60079-11, Explosive atmospheres – Part 11: Equipment protection by intrinsic safety “i”

IEC 60695-11-10, Fire hazard testing – Part 11-10: Test flames – 50 W horizontal and vertical flame test methods

IEC 60529, Degrees of protection provided by enclosures (IP Code)

ISA 60079-0 (12.00.01), Explosive atmospheres – Part 0: Equipment – General requirements

ISA 60079-1 (12.22.01), Explosive atmospheres – Part 1: Equipment protection by flameproof enclosures "d"

ISA 60079-11 (12.02.01), Explosive atmospheres – Part 11: Equipment protection by intrinsic safety "i"

NFPA 70, National Electrical Code

UL 60079-0 Explosive atmospheres – Part 0: Equipment – General requirements

UL 60079-1 Explosive atmospheres – Part 1: Equipment protection by flameproof enclosures "d"

UL 60079-11 Explosive atmospheres – Part 11: Equipment protection by intrinsic safety "i"

UL 94 Tests for Flammability of Plastic Materials for Parts in Devices and Appliances

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 60079-0 and the following apply.

NOTE Additional definitions applicable to explosive atmospheres can be found in IEC 60050-426.

3.1

separation element

mechanical element inside the equipment, which separates different parts of the equipment with different EPLs

Note 1 to entry: A separation element consists of a mechanical partition wall, which may be combined with a flameproof joint or a natural ventilation

4 Requirements for design and construction

4.1 Protection measures against ignition hazards of the electrical circuits

4.1.1 General

4.1.1DV DR Modification of Clause 4.1.1 to replace with the following:

The equipment shall comply with the requirements of [4.1.2](#) or [4.1.3](#) in the event of a failure of one equipment means of protection, by the provision of a second independent means of protection.

NOTE 1 Types of Protection according to EPL Ga do not require a second independent means of protection, e.g. Ex "ia" (IEC 60079-11), Ex "ma" (IEC 60079-18), Ex "da" (IEC 60079-1).

Electrical connections and permanently connected cables of the equipment sited within an area requiring EPL Ga equipment shall comply with the same Level of Protection required by this standard, for example a cable suitable for EPL Gb containing non-Ex “ia” circuits additionally protected by a flameproof conduit or a cable suitable for EPL Gb provided with earth leakage protection.

NOTE 2 Detailed cable and installation requirements for Types of Protection accepted as achieving EPL Ga beyond intrinsically safe circuits are under consideration in IEC 60079-14.

NOTE 3 Because of ignition hazards which can arise from faults and/or transient circulating currents in the potential equalization system, galvanic isolation in the power and signal connections to the equipment according to 4.1.2 and 4.1.3 is commonly applied along with minimizing the effect of transient fault currents in the potential equalization network by the use of electrical protection equipment such as sensitive earth leakage monitors.

4.1.2 Application of two independent Types of Protection providing EPL Gb

4.1.2DV DR *Modification to delete Clause 4.1.2. It does not apply.*

~~Electrical equipment shall comply with the requirements of two independent Types of Protection that provide EPL Gb. If one Type of Protection fails, the other Type of Protection shall continue to function. The independent Types of Protection shall not have a common mode of failure, except as specified in this clause. Combined types of protection providing EPL Gb shall depend on different physical protection principles.~~

~~NOTE 1 An example of a common mode of failure is if an Ex “d” enclosure containing arcing components is installed inside an Ex “e” enclosure. Should the Ex “d” enclosure be compromised, it would also compromise the Ex “e” enclosure.~~

~~NOTE 2 The combination of Ex “d” and Ex “q” both depend on the avoidance of flame propagation (same physical protection principle) and may not be useful in combination. In practice, some combinations may not be useful, for example the combination of oil immersion “o” and powder filling “q”.~~

~~Where combined types of protection are used, it shall be possible for each Type of Protection to be tested individually (see 5.1).~~

~~Both Types of Protection shall be assessed using the most arduous fault condition of the other Type of Protection. When combining intrinsic safety, Type of Protection “ib”, with other Types of Protection, the second Type of Protection shall be assessed, with the most arduous fault condition applied to the intrinsically safe circuit. Thermal dissipation shall be considered in case of a fault of one Type of protection.~~

~~When using two Types of Protection, which both rely on the same parameter (for example, the creepage distance combining Ex “ib” with Ex “e”), the most stringent requirement of both Types of Protection shall be applied.~~

~~If two Types of Protection are combined which both rely on the enclosure, one of the following shall be met:~~

~~a) if two enclosures are used (one totally enclosed within the other), each enclosure shall comply with the requirements of the respective Type of Protection; or~~

~~b) if only one enclosure is used, the enclosure and the cable glands shall meet the impact test requirements of IEC 60079-0, using the Group I values.~~

~~Examples of relevant combinations of two independent Types of Protection are as follows:~~

- ~~— inductive transmitters (for example proximity switches, electrical position sensors) with intrinsic safety “ib” enclosed by encapsulation “mb”. The connections to intrinsically safe “ib” circuits can be protected by the increased safety “e”;~~
- ~~— a luminaire designed as increased safety “e” may be included in a flameproof enclosure “d”;~~
- ~~— measuring transducers with intrinsic safety “ib” and a flameproof enclosure “d”;~~
- ~~— equipment with electrical circuits of intrinsic safety “ib”, additionally protected by powder filling “q”;~~
- ~~— electromagnetic valves with encapsulation “mb”, enclosed by a flameproof enclosure “d”;~~
- ~~— increased safety “e”, with pressurized equipment “pxb”.~~

4.1.3 Application of a Type of Protection providing EPL Gb and a separation element

4.1.3.1 General

Equipment which is mounted through or forms part of the boundary wall to an area requiring EPL Ga and contains electrical circuits which do not comply with EPL Ga shall comply with at least one of the Types of Protection providing EPL Gb. Additionally, it shall contain a mechanical separation element as part of the equipment to separate the electrical circuits of the equipment from the area requiring EPL Ga.

If the Type of Protection fails, the separation element shall:

- a) prevent flame propagation through the equipment into the area requiring EPL Ga,
- b) maintain its safety characteristics,
- c) not exceed the maximum surface temperature of the specified temperature class of the equipment (see [5.3](#)).

4.1.3.2 Partition walls

4.1.3.2DV DR Modification of Clause 4.1.3.2 to replace with the following:

~~Partition walls shall be constructed of either:~~

- ~~a) corrosion-resistant metals, glass or ceramics,~~
- ~~b) other materials which can be verified to provide the same level of safety. In this case, the certificate number shall include the “X” suffix in accordance with the marking requirements of IEC 60079-0.~~

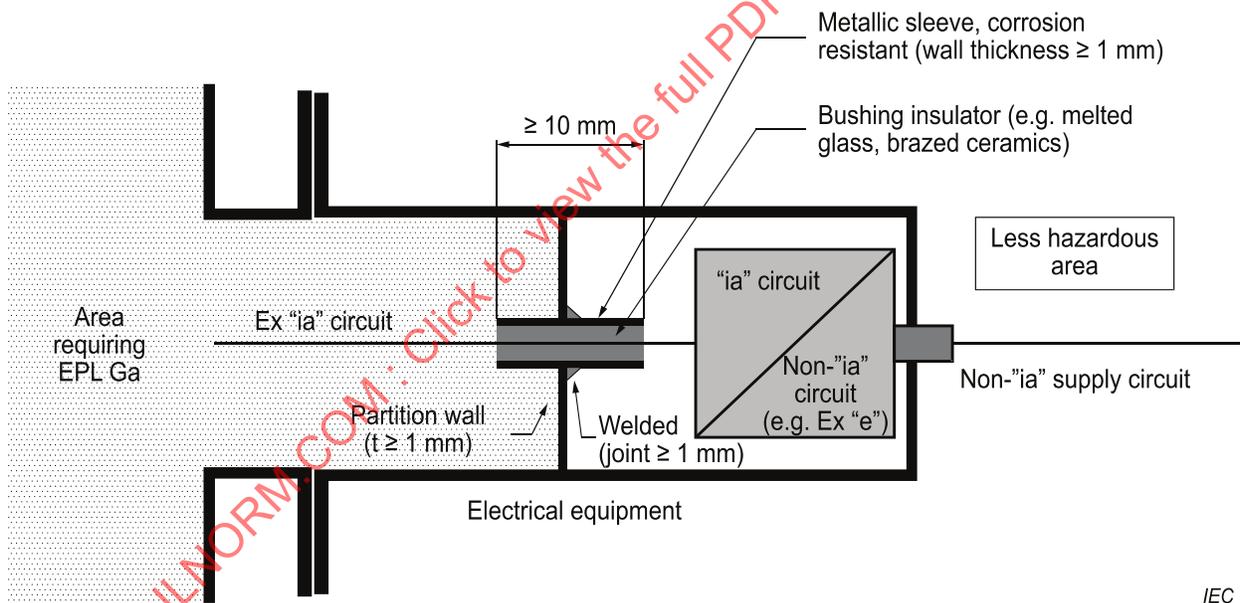
~~If the wall thickness is less than 1 mm, the certificate number shall include the “X” suffix in accordance with the marking requirements of IEC 60079-0 and the Specific Conditions of Use listed on the certificate shall indicate that the UL 60079-0 to indicate there are specific conditions of use. The specific conditions of use shall require that the material shall not be subject to environmental conditions which might adversely affect the partition wall.~~

If the partition wall is under constant vibrational stress (for example vibrating membranes), the minimum endurance limit at maximum amplitude shall be defined in the documentation (see Clause 7). Due to specified process pressure, loads or temperature, the separation element shall not impair the Type of Protection.

A wall thickness less than 1 mm is only permitted in combination with intrinsic safety "ib", or a flameproof joint or natural ventilation (see 4.1.3.3). For glass or ceramics, a minimum thickness of 1/10 of the diameter/maximum dimension but not less than 1 mm is required.

In addition to the requirements of 4.1.3.1 to 4.1.3.3, metallic partition walls with a thickness ≥ 1 mm may be provided with suitable conductor bushings (see Figure 1).

To avoid a critical concentration of explosive gas atmosphere diffusing from the area requiring EPL Ga into the enclosure containing the electrical circuits, the leakage rate through the bushing shall be low compared to the leakage rate from the enclosure into the free atmosphere. For example this could be done using a standard enclosure with an IP67 rating according to IEC 60529 ANSI/IEC 60529, a bushing with a leakage rate equivalent to a helium-leakage rate less than 10^{-2} Pa·l/s (10^{-4} mbar × l/s) at a pressure difference of 10^5 Pa (1 bar). This can be achieved, for example, by using a glass or ceramic bushing as shown in Figure 1.



su2326

Figure 1

Example of a partition wall with a conductor bushing considered as gas diffusion tight

Figure 1DV DR Modification for Figure 1 as follows:

Replace "Area requiring EPL Ga" with "Area requiring Class I, Zone 0".

4.1.3.3 Requirements depending on the thickness of the partition wall

The combinations of separation elements and additional protective measures depend on the wall thickness, t , of the partition wall as described below and shown in [Table 1](#):

i) For homogeneous partition walls with a thickness ≥ 3 mm, no additional protection measures are required.

ii) For homogeneous partition walls with a thickness of $3 \text{ mm} > t \geq 1 \text{ mm}$, one EPL Gb type of protection is required (see example a) of [Table 1](#)). A homogeneous part of the enclosure of an equipment with a EPL Gb type of protection may form the partition wall, even for types of protection which rely on the enclosure, provided the equipment does not contain an ignition capable source, for example exposed contacts (see example a) of [Table 1](#)). If the equipment contains a source of ignition in normal operation, either a flameproof joint (example b) of [Table 1](#)) or a ventilated air gap (example c) of [Table 1](#)) is also required.

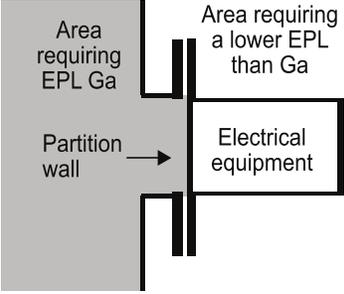
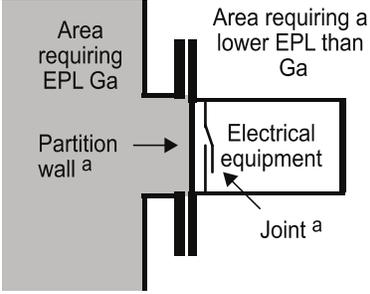
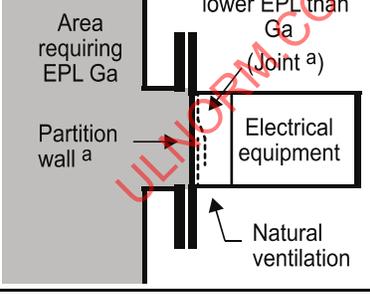
iii) Behind partition walls of $1 \text{ mm} > t \geq 0,2 \text{ mm}$, one of the following protective measures is required:

- Type of Protection intrinsic safety “ib” according to IEC 60079-11 (example a) of [Table 1](#)); or
- one EPL Gb Type of Protection in combination with a flameproof joint (example b) of [Table 1](#)); or
- one EPL Gb Type of Protection in combination with a ventilated air-gap and a flameproof joint (example c) of [Table 1](#)).

iv) For a partition wall with $t < 0,2 \text{ mm}$ (for example membranes), a flameproof joint and one EPL Gb Type of Protection are required (example b) of [Table 1](#)). If the equipment contains a source of ignition in normal operation (for example by exposed contacts), a ventilated air gap is also required (type c) of [Table 1](#)).

NOTE In the context of this clause, ‘homogeneous’ means a membrane constructed of a single piece of material without any insertions such as feed-throughs, bushings.

Table 1
Separation elements

Type of construction	Requirements depending on the thickness, t , of the partition wall i) $t \geq 3$ mm: no additional requirements		
	ii) $3 \text{ mm} > t \geq 1 \text{ mm}$	iii) $1 \text{ mm} > t \geq 0.2 \text{ mm}$ ("X" marking required)	iv) $t < 0.2 \text{ mm}$ ("X" marking required)
<p>a) Partition wall</p> 	<p>EPL Gb Type of Protection</p> <p>and</p> <p>no ignition source under normal operation (for example no exposed contacts)</p>	<p>Type of Protection intrinsic safety "ib"</p>	<p>Not permissible</p>
<p>b) Partition wall + joint</p> 	<p>EPL Gb Type of Protection</p>	<p>EPL Gb Type of Protection</p>	<p>EPL Gb Type of Protection</p> <p>and</p> <p>no ignition source under normal operation (for example no exposed contacts)</p>
<p>c) Partition wall + ventilation</p> 	<p>EPL Gb Type of Protection</p>	<p>EPL Gb Type of Protection</p> <p>and</p> <p>flameproof joint (dashed)</p>	

^a Flameproof joint and partition wall are exchangeable in sequence of order.